

GEOTECHNICAL ENGINEERING REPORT

**PROPOSED FIRE STATION # 32
19959 OAKS STREET
MONROE, WASHINGTON
SNOHOMISH COUNTY PARCEL
27070600200300**


**PREPARED FOR
SNOHOMISH COUNTY REGIONAL FIRE &
RESCUE
c/o OAC SERVICES, INC.**

**BY:
OTTO ROSENAU & ASSOCIATES, INC.
ORA JOB No. 24-0267, REPORT NO. 1**



OTTO ROSENAU & ASSOCIATES, INC.

Geotechnical Engineering, Construction Inspection & Materials Testing



OTTO ROSENAU & ASSOCIATES, INC.

Geotechnical Engineering, Construction Inspection & Materials Testing

6747 M. L. King Way South, Seattle, Washington 98118-3216 USA
Tel: (206) 725-4600 • Toll Free: (888) OTTO-4-US • Fax: (206) 723-2221
WBE W2F5913684 • WABO Registered Agency • Website: www.ottorosenau.com

April 29, 2025

Snohomish Regional Fire & Rescue
c/o OAC Services, Inc.
2200 1st Avenue S
Seattle, WA 98134

Re: **GEOTECHNICAL ENGINEERING REPORT**
PROPOSED FIRE STATION # 32
19959 OAKS STREET
MONROE, WASHINGTON
SNOHOMISH COUNTY PARCEL # 27070600200300

ORA Project Number: 24-0267

Dear Mr. Bailey (OAC Services),

We are pleased to provide this for the proposed Fire Station # 32 located at 19959 Oaks Street in Monroe, Washington. Based on our findings from the subsurface explorations and our analyses, we anticipate that the site can be satisfactorily developed, but that the presence of shallow groundwater, potentially liquefiable soils, and near-surface, highly compressible soils will require mitigation of those conditions to be performed. Based on discussions with the design team and contractors, we understand that the preferred mitigation option is to perform ground improvement at the location of the proposed fire station to stabilize the soils and allow for the use of the conventional spread foundation elements. Additional explorations were completed at the site to support this design approach.

It is our opinion that the construction of the proposed new fire station will not have any adverse impact on the adjacent properties, provided that the recommendations as presented in this report are implemented in their entirety and under the supervision of an ORA representative during construction. If you have any questions or if we may be of additional service, please contact us.

Sincerely,

Anthony Coyne, P.E.
Senior Geotechnical Engineer

Scott Hoobler, PE
Geotechnical Engineer

TABLE OF CONTENTS

1. INTRODUCTION	1
2. PROJECT DESCRIPTION.....	1
3. SCOPE OF SERVICES	2
4. SURFACE CONDITIONS	2
5. SITE CHARACTERIZATION	3
6. SUBSURFACE CONDITIONS.....	4
6.1 FILL MATERIALS.....	7
6.2 ALLUVIUM	7
6.3 OLYMPIA BEDS, SNOQUALMIE AND SKYKOMISH RIVER PROVENANCE	7
6.4 GROUNDWATER CONDITION	7
7. LABORATORY TESTING.....	8
8. DISCUSSION.....	8
9. CONCLUSIONS AND RECOMMENDATIONS.....	8
9.1 GENERAL.....	8
9.2 SEISMIC CONSIDERATIONS	9
9.2.1 Seismic Setting	9
9.2.2 Seismic Design Parameters.....	9
9.2.3 Liquefaction Hazard Evaluation	11
9.2.4 Surface Rupture Hazard Evaluation.....	13
9.2.5 Lateral Spread Hazard Evaluation	13
9.3 FOUNDATION SYSTEMS	13
9.3.1 Fire Station and Critical Ancillary Structure Foundations.....	13
9.3.2 Stormwater Detention Vault Foundation	14
9.3.3 Site Retaining Wall Foundations (less than 4-foot wall height)	15
9.4 CONCRETE SLABS-ON-GRADE.....	15
9.5 BELOW-GRADE WALLS AND RETAINING WALLS.....	16
9.6 PAVEMENT DESIGN.....	17
9.7 EARTHWORK.....	18
9.7.1 Foundation and Slab Subgrade Preparation.....	18
9.7.2 Pavement Subgrade Preparation.....	18
9.7.3 Wet Weather Grading Considerations	19
9.7.4 Structural Fill – Material, Placement and Compaction	19
9.7.5 Temporary Excavations	21
9.7.5.1 Excavations for the Proposed Fire Station.....	21
9.7.5.2 Temporary Excavations for the Proposed Stormwater Detention Vault.....	21
9.7.5.3 Temporary Excavation Construction Monitoring	22
9.7.6 Erosion and Sedimentation Control	22

9.8 DRAINAGE	23
9.8.1 Dewatering	23
9.8.2 Foundation Wall and Retaining Wall Drainage.....	23
9.8.3 Surface Drainage	23
10. REPORT LIMITATIONS	24
11. REFERENCES	24

REPORT FIGURES

- Figure 1 - Vicinity Map
- Figure 2 - Site Plan
- Figure 3 - Geologic Map
- Figure 4 – NEHRP Site Classification Map
- Figure 5 – Liquefaction Susceptibility Map

APPENDIX A – EXPLORATIONS AND LABORATORY TESTING

Boring Log Notes	A-1
Unified Soil Classification Chart.....	A-3
Boring Logs for ORA Borings B-1 through B-7	A-4
CPT Exploration Summary Report by ConeTec	A-12

APPENDIX B – LABORATORY TESTING

Grain Size Analysis	B-1
Liquid And Plastic Limit Determinations.....	B-6

APPENDIX C – RESULTS OF GEOPHYSICAL (REMI) SURVEY

Report for REMI Survey at a proposed fire station in Monroe, WA by Global Geophysics (2024)	C-1
---	-----

APPENDIX D - SEISMIC DESIGN CRITERIA

ASCE 7-16 Hazards Report	D-1
USGS Deaggregation Report	D-4

APPENDIX E - LIQUEFACTION ANALYSIS

Combined Liquefaction Analysis Results for CPT-1 and CPT-2.....	E-1
---	-----

APPENDIX F - GROUNDWATER MONITORING DATA

Groundwater Monitoring Data at B-4F-1
Groundwater Monitoring Data at B-5F-2
Groundwater Monitoring Data at B-6F-3
Groundwater Monitoring Data at B-7F-4

**GEOTECHNICAL ENGINEERING REPORT
PROPOSED FIRE STATION # 32
19959 OAKS STREET
MONROE, WASHINGTON
SNOHOMISH COUNTY PARCEL # 27070600200300**

**PREPARED FOR
SNOHOMISH COUNTY REGIONAL FIRE & RESCUE
C/O OAC SERVICES, INC.**

BY OTTO ROSENAU & ASSOCIATES, INC.

APRIL 29, 2025

1. INTRODUCTION

This report presents the results of our geotechnical engineering services for the proposed Fire Station # 32 at 19959 Oaks Street in Monroe, Washington (Snohomish County Parcel # 27070600200300). The approximate location of the site is shown in Figure 1, Vicinity Map.

2. PROJECT DESCRIPTION

Snohomish County Regional Fire & Rescue is considering constructing a new fire station at a currently undeveloped lot in Monroe, Washington. The preliminary information provided to us indicates that the fire station will be about 7,500 square feet in size and will be located on the western side of the parcel. We further understand that the fire station will be set back about 50 feet south of a potential wetland that is located close to the north property line at the west side of the site.

The associated site improvements will likely include secure firefighter parking, separate visitor parking, and maneuvering space for emergency vehicles returning to the fire station with drive-thru bays. An exterior emergency generator will also likely be included as part of the project.

Fire Station # 32 – Monroe, WA

ORA Project No.: 24-0267

April 29, 2025

Page 2 of 26

3. SCOPE OF SERVICES

ORA previously completed a preliminary site evaluation for this site and completed three borings (B-1 through B-3) using hollow-stem auger equipment to a maximum depth of 21.5 feet and two cone penetration tests (CPT-1 and CPT-2) to a maximum depth of 42 feet to evaluate the soil and groundwater conditions at the site in May 2024. Four additional explorations (B-4 through B-7) were completed using sonic drilling equipment on March 26 and 27, 2025, to depths ranging from 16.5 to 40 feet below the existing site grade. Groundwater level monitoring devices and data logging equipment were also installed at borings B-4 through B-7 to record the groundwater level and pressure data through time. The approximate locations of the completed borings, CPTs, and the ReMi geophysical investigation completed for this study are shown in Figure 2, Site Plan.

The scope of geotechnical engineering services for this study is to develop and provide the following information:

- A summary of the observed soil and groundwater conditions,
- An evaluation of the existing site conditions,
- A review of available geologic information,
- Completion of a geophysical evaluation using a geophysical survey (ReMi) to determine the measured shear-wave velocity sounding of the underlying soils,
- Evaluation of potential seismic hazards, including liquefaction, lateral spreading caused by liquefaction, and surface rupture.
- Suitable foundation systems with estimated settlements,
- Lateral earth pressures and friction coefficients,
- Recommendations for temporary cut slopes,
- Influence of groundwater on the proposed development, and
- Site preparation and earthwork.

4. SURFACE CONDITIONS

The project site is located on the east side of the City of Monroe in the Snohomish River / Skykomish River valleys. The project site consists of a single non-contiguous parcel with a combined size of approximately 2.16 acres. The larger portion of the parcel is located at the northeast corner of Woods Creek Road and Oaks Street, is approximately 2.02 acres in area, and is being considered for the location of Fire Station #32. The smaller detached portion of the parcel is located about 500 feet to the southeast, is about 0.14 acres in area, and is not being considered for development as part of this project.

The larger portion of the parcel being considered for development is roughly triangular and is located at the northeast corner of the intersection of Woods Creek Road and Oaks Street. A drainage ditch is

Fire Station # 32 – Monroe, WA

ORA Project No.: 24-0267

April 29, 2025

Page 3 of 26

located along the northeast boundary of the parcel. The drainage ditch coincides with a mapped unclassified stream as described in the City of Monroe's Stream and Wetlands 11 x 17 inventory map. The unclassified stream drains to Woods Creek, which is located to the southeast of the site. Woods Creek drains to the Skykomish River, which is located to the south of the site. An unclassified wetland is located immediately northeast of the project site. The adjacent parcels located to the northeast and east of the subject property appear to be agricultural fields. A Snohomish County PUD power switching station is located on the west side of Woods Creek Road to the west of the site. An undeveloped wooded area is located on the west side of Woods Creek Road immediately north of the site. A commercial strip mall is located on the south side of Oaks Street to the south of the subject property.

The majority of the parcel gently slopes from west to east and from south to north. The site grades along the west property line range from about Elevation 77 to 78 feet (NAVD 88) from the intersection of Woods Creek Road and Oaks Street to the northwest property corner. The roadway embankment for Woods Creek Road is approximately 5 feet in height near the northwest corner of the property and rapidly tapers downward in height from the northwest property corner. The site grades along the south property line range from about Elevation 77 feet at the southwest property corner to about Elevation 72 feet at the southeast property corner.

Gravel surfacing has been placed across much of the site to facilitate the site's historical use as a parking area for trucks and trailers and as a storage yard for construction equipment and materials. The northeast side of the property appears to have been built up with up to 4 to 5 feet of fill to create an embankment along the northeast property line.

5. SITE CHARACTERIZATION

We reviewed the "Geologic Map of the Monroe 7.5-minute Quadrangle, King and Snohomish Counties, Washington (November 2011). The near-surface soils at the site are mapped as Alluvium (Qa), which typically consists of normally consolidated, river-deposited silts, clays, sands, and gravels. Deposits of Olympia beds Snoqualmie and Skykomish provenance (Qco), appear to underlie the near-surface Alluvium. Olympia Beds, Snoqualmie and Skykomish River provenance (Qco) are nonglacial deposits that generally consist of dense cohesionless sands, gravels, cobbles, and very stiff to hard silts and clays.

The project site is mapped by the Washington Department of Natural Resources (DNR) as having Moderate to High Liquefaction Susceptibility. Please see Figure 4 titled "Liquefaction Susceptibility" for an excerpt.

Fire Station # 32 – Monroe, WA

ORA Project No.: 24-0267

April 29, 2025

Page 4 of 26

6. SUBSURFACE CONDITIONS

The subsurface soil and groundwater conditions were evaluated by completing 7 borings, 2 cone penetration tests (CPTs), and a ReMi geophysical evaluation at the site. The locations of the completed explorations are shown in the Site Plan, Figure 2.

Borings B-1, B-2, and B-3 were completed on May 21, 2024, to depths of 21.5 feet, 16.5 feet, and 16.5 feet, respectively. A pressurized, confined aquifer (artesian aquifer) was encountered during drilling at a depth of about 21 feet at boring B-1. Groundwater was observed to flow up from the boring hole onto the adjacent ground surface, and the hole was abandoned and sealed with difficulty. Borings B-2 and B-3 were drilled to a shallower depth to reduce the risk of penetrating into the artesian aquifer and the associated difficulty with sealing the hole after completion of drilling.

Borings B-4 through B-7 were completed on March 26 and 27, 2025, to a depth of 40 feet for boring B-4 and a depth of 16.5 feet for borings B-5 through B-7 using Sonic Drilling techniques on a track rig provided by Holt Services, Inc. The Sonic Drilling method utilizes a full-length pipe casing that is advanced using a high-frequency oscillating motion and rotation of the pipe casing while the boring is advanced. This allowed us to penetrate the confined aquifer at boring B-4 and to set a vibrating wire groundwater pressure monitoring device to determine the amount of groundwater pressure in the confined aquifer. 2-inch diameter standpipe piezometers were installed in borings B-5 through B-7. Groundwater pressure monitoring devices were also installed at borings B-5 through B-7 to evaluate the groundwater level fluctuations of the near-surface, unconfined aquifer. The groundwater pressure monitoring devices were connected to data logging equipment to record groundwater pressure variation through time. Plots of groundwater pressure in the confined aquifer at B-4 and plots of groundwater levels below the existing site grade are presented in Appendix G.

CPT testing was performed at two locations, CPT-1 and CPT-2 on May 28, 2024, to evaluate the soil and groundwater conditions at greater depths than could be accomplished by using conventional hollow stem auger drilling methods. Pore water dissipation testing was performed at both CPT locations. CPT-1 was completed as a Seismic CPT, which allowed shear wave velocity measurements to be collected as the CPT was advanced to assist in site characterization of the underlying soils for seismic design purposes. CPT-1 and CPT-2 were completed to depths of about 42 feet and 34.5 feet below the existing site grade, respectively, before encountering dense to very dense soils where refusal of the equipment was met and could not be advanced to greater depths. The CPT logs are presented in Appendix A.

Fire Station # 32 – Monroe, WA

ORA Project No.: 24-0267

April 29, 2025

Page 5 of 26



Photo at Boring B-1 after withdrawal of the auger and before sealing off the boring hole on May 21, 2024. Please note the artesian groundwater flowing from the unsealed boring hole onto the adjacent ground surface.

Fire Station # 32 – Monroe, WA

ORA Project No.: 24-0267

April 29, 2025

Page 6 of 26



Photo taken while drilling at Boring B-4 using Sonic Drilling technique on March 26, 2025.



Photo of CPT rig set up at the location of CPT-01 on May 28, 2024.

Fire Station # 32 – Monroe, WA

ORA Project No.: 24-0267

April 29, 2025

Page 7 of 26

In general, the soils encountered at the site can be divided into three soil units – Fill, Alluvium, and Olympia beds, Snoqualmie and Skykomish River provenance. The following is a description of the characteristics of each soil unit encountered.

6.1 FILL MATERIALS

2 to 3.5 feet of undocumented, near-surface fill was encountered below the existing ground surface at each exploration location. We anticipate that the fill is likely up to 5 feet thick at the embankment along the northeast property line. The fill materials generally consisted of loose to medium dense sands with varying amounts of silt, gravel, and cobbles. The fill materials were generally in a moist to wet condition.

6.2 ALLUVIUM

Alluvium was present below the encountered upper fill materials and appeared to extend to a depth of about 23 to 26 feet below the existing site grade. The alluvium consisted of interbedded silts, clays, sands, gravels, and some peat. The silts and clays were observed to have a soft to medium stiff consistency. The sands and gravels varied in fines content and were observed to be in a loose to dense consistency.

6.3 OLYMPIA BEDS, SNOQUALMIE AND SKYKOMISH RIVER PROVENANCE

Based on the findings from the CPTs, we interpreted that the dense to very dense sands and gravels encountered below the Alluvium at depths of 23 to 26 feet below the site grade to be Olympia Beds, Snoqualmie and Skykomish River provenance (Qco). These deposits are Pleistocene age, nonglacial deposits that generally consist of dense cohesionless sands, gravels, cobbles, and very stiff to hard silts and clays.

6.4 GROUNDWATER CONDITION

Groundwater was observed during drilling of the explorations at a depth of about 6 feet below the existing site grade in the near-surface unconfined aquifer at the site. The groundwater pressure monitoring devices and standpipe piezometers that were installed at borings B-5 through B-7 in March and April 2025 indicate that the depth to groundwater varies between 4.5 to 7 feet below the existing site grade.

A pressurized, confined aquifer (artesian aquifer) was observed to be present at a depth of about 21 feet below the existing site grade while drilling at boring B-1 in May 2024. The confined aquifer was sufficiently pressurized to allow the groundwater to reach the ground surface and flow out of the drilled hole. Boring B-4, which was completed within 25 feet of boring B-1 in March 2025, did not encounter artesian groundwater flow to the ground surface at a depth of 20 feet, but did at a depth of 25 feet, groundwater was observed to be at the ground surface with minimal flow from the boring when the casing was at a depth of 30 feet. Due to the use of a continuous steel pipe casing during sonic drilling of boring B-4, we infer that the top of the confined aquifer is likely between depths of 21 and 25 feet, or that the thickness

Fire Station # 32 – Monroe, WA

ORA Project No.: 24-0267

April 29, 2025

Page 8 of 26

of the confining silt/clay layer had become sufficiently thin during drilling at those depths to allow the pressurized water from the confined aquifer to break through the remaining silt/clay layer. A groundwater pressure monitoring device was installed at a depth of 30 feet and has shown that the groundwater pressure within the confined aquifer is equal to about a 30-foot of head of water during the month of April 2025.

Based on our observations of the monitored groundwater levels at borings B-5 through B-7 in the near-surface unconfined aquifer depth to groundwater decreases with decreasing amounts of precipitation. Similarly, we observed that the groundwater pressure at boring B-4 within the confined aquifer decreased slightly with decreasing amounts of precipitation. We anticipate that groundwater levels will fluctuate with precipitation and season and may affect the construction of the new fire station with regard to the recommended maximum depth of ground improvement and excavations for utilities and stormwater detention facilities.

7. LABORATORY TESTING

We completed grain size analyses and Atterberg Limit determinations on multiple samples and moisture content determinations on each sample collected from our borings. The result of the moisture content determinations is presented on the boring logs on pages A-4 to A-11 of Appendix A. The results of the grain size analyses and Atterberg Limit determinations are presented in Appendix B.

8. DISCUSSION

The engineering recommendations and advice presented in this report have been made in accordance with generally accepted geotechnical engineering practices in the area and are based on our understanding of the geology of the area and our experience with similar projects. Project conditions and design details often change during the design and revision process. In addition, subsurface conditions do not always match those that are anticipated. Therefore, if discrepancies are noticed, the geotechnical engineer should be contacted for review and possible revision of the recommendations presented.

9. CONCLUSIONS AND RECOMMENDATIONS

9.1 GENERAL

Based on our findings from the subsurface explorations and our analyses, we anticipate that the site can be developed as a new fire station, but the presence of potentially liquefiable soils and the compressible silt, clay and peat soils located beneath the site will require mitigation due to the risk of post-construction settlement and liquefaction-induced settlement. There is also a risk of significant lateral movement during a design-level seismic event due to liquefaction-induced lateral spread, which could affect the structure

Fire Station # 32 – Monroe, WA

ORA Project No.: 24-0267

April 29, 2025

Page 9 of 26

and the ground surface at the site. See the recommendations for the deep foundation systems in the “Foundation Systems” section of this report for specific details.

9.2 SEISMIC CONSIDERATIONS

9.2.1 Seismic Setting

The project site is in the seismically active Puget Sound region. The seismicity of the area is derived from three primary sources.

- The Cascadia Subduction Zone (CSZ) – The CSZ is in the Pacific Ocean approximately 50 miles west coast of Washington State, where a deep trough has formed as the oceanic Juan de Fuca plate is being subducted beneath the North American continental plate. Earthquakes as great as magnitude 9 are capable of being generated at the CSZ. The last earthquake along the CSZ was an estimated M9 event in 1700 CE.
- The Benioff Zone – This seismic source is located deep beneath the North American Plate, where the oceanic Juan de Fuca plate is steeply diving into the Earth’s mantle as it is being subducted. Earthquakes in the Benioff Zone are relatively frequent, with an estimated maximum magnitude of about 7. The M6.8 Nisqually earthquake in 2001 was a Benioff Zone event.
- Shallow crustal faults – There are several shallow crustal faults in the Puget Sound area, including the Seattle Fault Zone, the Tacoma Fault Zone, and the South Whidbey Fault Zone. These faults are all thrust faults, more generally called reverse faults, and are caused by compression of the crust in our region. These faults are also expected to be capable of generating an earthquake with a maximum of about magnitude 7. The most recent evidence of seismic deformation along the South Whidbey Fault zone occurred about 2,700 years ago.

9.2.2 Seismic Design Parameters

The seismic design of structures in the City of Monroe is governed by the requirements of the International Building Code (IBC). We understand that the project will be permitted under the provisions of the 2021 IBC and ASCE/SEI 7-16. These documents require that the soils underlying the site be assigned a Site Class based on the conditions that are present. A Refraction Microtremor (ReMi) survey was performed along the northeast side of the site on August 13, 2024, by Global Geophysics of Redmond, WA. The results of the ReMi geophysical survey indicate that a measured average characteristic site shear-wave velocity in the upper 100 feet of the soil profile below the ground surface, V_s100 , is 828 feet per second. Based on the measured average shear wave velocity of the underlying soils, we recommend that the site soils be categorized as Site Class D for design purposes. The completed ReMi survey provided a shear wave velocity profile that extended to a depth of 200 feet below the site. The ReMi survey report prepared by Global Geophysics is included in Appendix C. Our subsurface investigations and preliminary analyses indicate that potentially liquefiable soils underlie the site, and as a result, a Site Class F could be assigned, which would require a site response analysis to be performed in accordance with Section 21.1 of ASCE 7. However, Section 20.3.1 of ASCE/SEI 7-16 states the following:

Fire Station # 32 – Monroe, WA
ORA Project No.: 24-0267
April 29, 2025
Page 10 of 26

However, Section 20.3.1 of ASCE/SEI 7-16 states the following:

“Where any of the following conditions are satisfied, the site shall be classified as Site Class F and a site response analysis in accordance with Section 21.1 shall be performed.

- 1. Soil profile that includes soils vulnerable to potential failure or collapse under seismic loading, such as liquefiable soils, quick and highly sensitive clays, and collapsible, weakly cemented soils.*

EXCEPTION: *For structures that have fundamental periods of vibration equal to, or less than 0.5 s, site response analysis is not required to determine spectral accelerations for liquefiable soils. Rather, for the purpose of determining spectral accelerations only, a site class is permitted to be determined in accordance with Section 20.2 and the corresponding response spectrum determined from Section 11.4.*

We anticipate that the fundamental period of the proposed fire station structure will not exceed 0.5 seconds. As a result, a site response analysis may not be required for this project and the Site Class can be determined based on the criteria listed in Section 20.3 of ASCE/SEI 7-16, which permits Site Class to be determined by the V_s , or Shear Wave Velocity Profile method for the top 100 feet of the soil profile that underlies the site. Based on the results of the shear wave velocity profile from the ReMi survey (geophysical survey), the average shear wave velocity of 828 feet per second was measured in the upper 100 feet of the soil profile that underlies the site, which corresponds to Site Class D conditions based on our review. If the fundamental period of the proposed fire station structure exceeds 0.5 seconds, a site response analysis will be required, and we can provide a proposal to provide that information upon request. No additional subsurface information will be required to perform a site response analysis.

Risk-targeted Maximum Considered Earthquake (MCE_R) ground motion response accelerations for this are based on the maps in the IBC (Figures 1613.2.1(1) and 1613.2.1(2)) for 0.2-second and 1-second spectral response accelerations on a bedrock site. The values for S_S and S_1 are spectral accelerations (SRA) for a maximum considered earthquake event with a 2,475-year return period, or a 2 percent probability of exceedance in 50 years.

The seismic design values for use in the preliminary analyses in this report were obtained from the ASCE 7 Hazard Tool web tool. Please see the ASCE Hazard Tool Report on page D-1 of Appendix D. The input parameters used with this utility were the latitude and longitude for the project site (47.860741° N, 121.964541° W). The following table presents recommended values from the ASCE/SEI 7-16 “Minimum Design Loads for Buildings and Other Structures” for seismic design:

SEISMIC DESIGN PARAMETERS	
Risk Category	IV
Site Soil Class	D
PGA_M	0.544
S_s, g	1.144
S_1, g	0.402
S_{MS}, g	1.193
S_{M1}, g	N/A
S_{DS}, g	0.795
S_{D1}, g	N/A

9.2.3 Liquefaction Hazard Evaluation

The State of Washington Department of Natural Resources (DNR) has identified the project site as having a high liquefaction susceptibility. As a result, an evaluation of the potential impact of the liquefaction hazard must be performed.

Liquefaction may be defined as the sudden loss of strength of soil as the soil is subjected to rapid cyclic loading, such as during an earthquake. The mechanism that allows this to occur is that excess pore water pressures are generated between the soil particles. This excess pore water pressure reduces the frictional contact between the soil particles and reduces the shear strength of the soil. If the earthquake is of large magnitude and duration, the soil can begin to behave more like a liquid than a solid and “liquefy”. For liquefaction to occur, several conditions must typically be present, these include the following:

- Saturated soil.
- Fine to medium sand matrix containing less than about 10 percent fines (soil that can pass a No. 200 sieve).
- Very loose to medium dense soil conditions. This is usually defined as soils that have N-values of 15 or less.

Based on the findings from the explorations completed at the project site, the site appears to be underlain by alluvium that consists of potentially liquefiable, interbedded, very loose to medium dense sands and gravels and soft to medium stiff silts. Groundwater levels appear to be approximately 6 feet below the existing site grade.

We completed a liquefaction analysis using the subsurface information collected from CPT-1 and CPT-2 which was completed at the site. The liquefaction analysis was completed in general accordance with

Fire Station # 32 – Monroe, WA
ORA Project No.: 24-0267
April 29, 2025
Page 12 of 26

“Seed’s Simplified Procedure” with the suggested modifications proposed by Seed, Youd, et al. in “Liquefaction Resistance of Soils: Summary Report from the 1996 NCEER and 1998 NCEER/NSF Workshop on Evaluation of Liquefaction Resistance of Soils” (Journal of Geotechnical and Geoenvironmental Engineering – October 2001). The analyses were completed using a ground acceleration equal to 0.54 g and a 7.1 magnitude event (free field condition). The ground acceleration used in the analysis is the site-modified PGA_M from the ASCE 7 Hazard Tool report for a 2,475-year event and assuming Site Class D conditions. The magnitude of the seismic event used in the analysis was the mode value for a 2,475-year event assuming Site Class D from the USGS Unified Hazard Tool Deaggregation, which is included in Appendix D. The analyses were performed using the CLiq version 3.5.3.10 software published by GeoLogismiki.

Based on the results of our analyses, the risk of liquefaction at the project during a strong design-level seismic event is moderate to high. The results are presented in Appendix E, and a summary of the estimated liquefaction-induced settlements based on each CPT exploration is as follows:

CPT Location	Estimated Liquefaction-Induced Settlement
CPT-1	~ 1.3 inches
CPT-2	~ 2.8 inches

When liquefaction occurs at a site, it typically does not result in widespread, uniform settlement. Instead, liquefaction-induced settlement tends to occur across non-uniform areas with varying amounts of settlement being observed. Varying amounts of settlement under the foundation elements of a structure can result in differential settlement. Differential settlement of soils under a foundation tends to induce more damage than uniform settlement if the foundation system is not designed to be able to resist differential settlement.

Based on the observed subsurface soil and groundwater conditions encountered at the site and our understanding of the geologic conditions present at the site, it is our opinion that the potential for the occurrence of liquefaction at the project site is moderate to high during an IBC design level seismic event.

Based on a review of known faults on the USGS Interactive Quaternary Faults Database, we observed that the project site is located about 2.6 miles northeast of the nearest trace of the South Whidbey Fault Zone (Fault ID # 572). The South Whidbey Fault Zone is a northwest-southeast trending reverse fault and is described as a Class A fault with an estimated slip rate of between 0.2 and 1.0 mm/yr.

Fire Station # 32 – Monroe, WA

ORA Project No.: 24-0267

April 29, 2025

Page 13 of 26

Other inferred faults are described as being closer to the site in the Geologic Map of the Monroe Quadrangle, however, these faults are not well studied, and it is not clear if they have been active in the last 10,000 years. Only the mapped faults described in the USGS Interactive Quaternary Faults Database were considered in our evaluation of seismic hazards at this site.

9.2.4 Surface Rupture Hazard Evaluation

Surface rupture can occur during large seismic events on faults where the ground surface ruptures due to the movement of the fault. Given that the site is located about 2.6 miles away from the nearest known trace of the South Whidbey Fault Zone, it is our opinion that the risk of surface rupture at the project site is relatively low during the design life of the proposed fire station.

9.2.5 Lateral Spread Hazard Evaluation

Lateral spread can occur during strong seismic events when large blocks of non-liquefied surface soils and underlying liquefied soils move horizontally downslope at gently sloping locations or move towards a free face, such as along a shoreline or riverbank. A 5-foot-tall free face is present near the northeast property line, which corresponds with the location of a drainage ditch on the project site. The CPT-based CLiq liquefaction software used to perform the liquefaction analyses estimated that up to 1 to 2.5 feet of lateral spread was possible at the site during a design-level seismic event (Magnitude = 7.1, Site-Modified Peak Ground Acceleration, $PGA_M = 0.54g$) using the methodology presented by Bartlett and Youd (1995) and is based on the soil profile at our CPT-1 and CPT-2 explorations. Calculated values of lateral spread are based on regression analyses of historically observed seismically induced lateral spread events around the world under many different seismic conditions. The actual values of possible lateral spread should be considered to likely range from 50% to 200% of the calculated values.

We understand that the proposed ground improvement will strengthen the existing subsurface soils at the footprint of the proposed fire station and make them resistant to liquefaction and lateral spreading. We recommend that the zone of ground improvement extend beyond the footprint of the soil to reduce the risk of having any lateral spreading or slope failures in unimproved areas that could potentially undermine foundation elements. This is most important along the north side of the future fire station, where the free face of the open ditch is closest.

9.3 FOUNDATION SYSTEMS

9.3.1 Fire Station and Critical Ancillary Structure Foundations

We understand that a ground improvement contractor will be preparing a geotechnical design and drawings that will specify the details of the ground improvement. The ground improvement contractor will provide the allowable bearing capacity value that the new fire station's conventional spread foundation elements that bear on improved soil may be designed for. We also recommend that critical ancillary

Fire Station # 32 – Monroe, WA

ORA Project No.: 24-0267

April 29, 2025

Page 14 of 26

structures, such as emergency generators, and site retaining walls greater than 4 feet in height be supported on improved soil.

Based on discussions with the ground improvement contractor, we understand that the proposed soil improvement will stabilize the potentially liquefiable and compressible soils at the location of the fire station by mixing the existing soil in place with Portland cement to strengthen the soil and eliminate the potential for collapse due to liquefaction and the risk of post-construction settlement related to the presence of peat at that location.

We recommend that all new foundation elements be embedded at a minimum of 18 inches below the final grade for frost protection.

9.3.2 Stormwater Detention Vault Foundation

Onsite infiltration of stormwater is not feasible at the project site due to the relatively shallow depth to groundwater and the presence of relatively impermeable near-surface silt and clay soils that underlie the site. As a result, we anticipate that a stormwater detention system will be needed for the project. The configuration and location of the detention system were not known at the time of issuance of this report. Compressible silts, clays are present to depths of 6 to 9 feet across the site. Potentially liquefiable soils are present below the near-surface compressible silt and clay soils. Observed groundwater levels at depths across the site ranging from about 4.5 to 7 feet below the existing site grades during early spring 2025.

We recommend that foundations for the new stormwater detention vault not bear directly on the compressible silt and clay soils or on potentially liquefiable soils for foundation support. The use of conventional foundation elements with overexcavations and structural backfill at the foundation and slab location may be a suitable alternative, but will need to be evaluated for feasibility by ORA once the configuration of the detention vault is determined. If the stormwater detention system were to be built using conventional foundation elements and slabs that bear on a zone of structural fill, an allowable bearing capacity on the order of 750 to 1,000 psf would likely be specified and post-construction settlement due to the underlying compressible silts and clays would likely be on the order of one to two inches. Furthermore, the detention vault would still be vulnerable to liquefaction-induced settlement and lateral spreading as described in Section 9.2 of this report.

We anticipate that an overexcavation and structural backfill would likely consist of 2- to 4-inch quarry spalls that extend at least two feet in depth below the bottom of the foundation elevation would be required to provide a stable base for foundation construction. The width of the overexcavation would additionally need to extend laterally an amount equal to the overexcavation depth beyond the edges of the footings. A nonwoven geotextile fabric such as Tencate Mirafi 140N, or an approved equivalent, would need to

Fire Station # 32 – Monroe, WA

ORA Project No.: 24-0267

April 29, 2025

Page 15 of 26

fully surround the quarry spall backfill. This method would also require that the groundwater in this location be drawn down to at least 2 feet below the bottom of the excavation depth. The excavated material would likely not be suitable for reuse as structural fill around the perimeter of the stormwater vault, and imported granular backfill around the stormwater vault would be required.

A more resilient foundation alternative that would perform better during seismic events would be to provide ground improvement at this location, as is proposed for the fire station. If this method were utilized, the ground improvement contractor would provide recommendations for the allowable bearing capacity of new foundation elements that bear on improved soil.

9.3.3 Site Retaining Wall Foundations (less than 4-foot wall height)

Lightly loaded site retaining walls that have a wall height of 4 feet or less (measured from the top of the wall to the bottom of the foundation) do not require deep foundation elements or ground improvement for foundation support. The site retaining walls may be supported on a 12-inch deep overexcavation that is backfilled with a zone of imported Crushed Surfacing Top Course (CSTC). The width of the overexcavation would additionally need to extend laterally one foot beyond the edges of the footings. We recommend that an allowable bearing capacity of 1,500 psf be used for the design of retaining wall foundation elements that are supported as described above. The base of the overexcavation should be prepared per the recommendations presented in Section 9.6.1 Foundation and Slab Subgrade Preparation of this report.

Site retaining walls designed in this manner are still vulnerable to liquefaction-induced settlement and post-construction settlement due to the presence of highly compressible soils, but we understand that it is likely more cost-effective to remove and replace any poorly performing low retaining walls than to provide deep foundation support or ground improvement at those locations.

9.4 CONCRETE SLABS-ON-GRADE

We recommend that the concrete slabs on grade in the fire station be supported on a zone of ground-improved soil. We further recommend that a 6-inch-thick, free-draining, clean, crushed gravel base be provided as a capillary break. A robust vapor retarder, such as 10-mil polyethylene sheeting, shall be included beneath the slab to minimize the transmission of moisture through the concrete floor. A minimum, two-inch-thick layer of clean sand with less than 3 percent fines may be placed on top of the polyethylene sheeting to protect the sheeting and to enhance the curing of the concrete slabs. The sand must not be saturated at the time of concrete placement in order to enhance concrete curing. If slabs-on-grade are being planned for heated areas, a more robust vapor barrier should be utilized since the conditioned air in the heated areas will tend to draw moisture from the near-surface groundwater that is present beneath the site. ORA can provide recommendations for vapor barriers upon request.

Fire Station # 32 – Monroe, WA
ORA Project No.: 24-0267
April 29, 2025
Page 16 of 26

Lightly loaded concrete slabs on grade at exterior or non-critical locations around the fire station may be conventionally supported on a zone of structural fill consisting of crushed surfacing top course that is at least 6 inches in thickness.

9.5 BELOW-GRADE WALLS AND RETAINING WALLS

The below-grade foundation walls for this project must be designed as retaining walls. Lateral earth pressures for the design of permanent retaining walls and temporary shoring walls with no hydrostatic pressures or other surcharge loads may be calculated using the following equivalent fluid densities in pounds per cubic foot (pcf):

Level Back Slope Condition Active (unrestrained):

Compacted granular soils or native soils against wall 35 pcf.

Level Back Slope Condition Active (restrained):

Compacted granular soils or native soils against wall 55 pcf.

Passive:

Embedded Portions of Foundation Elements 270 pcf.

Hydrostatic Pressure on the portion of foundations below
the groundwater table (triangular pressure distribution)

62.4 pcf

No factor of safety has been applied to the active pressure values listed above. A factor of safety of about 1.5 has been applied to the passive pressure value listed above. The geotechnical engineer should be contacted to determine appropriate lateral earth pressures for situations not described above.

Seismic earth pressures were estimated using the Mononobe-Okabe pseudo-static method. We recommend that seismic earth pressures be estimated using a rectangular pressure distribution equal to $15H$, where H is the height of the retained soil behind the wall and applied to permanent retaining structures.

A total soil unit weight of 125 pounds per cubic foot should be used in the design of any permanent below-grade wall, retaining structures, or temporary shoring walls.

Passive resistance should be evaluated using an equivalent fluid pressure of 270 pounds per cubic foot (pcf) where foundation elements are cast on structural fill and backfilled on both sides with structural fill compacted to at least 95 percent of maximum dry density (MDD). This value of passive pressure includes

Fire Station # 32 – Monroe, WA
ORA Project No.: 24-0267
April 29, 2025
Page 17 of 26

a factor of safety of 1.5. An allowable coefficient of friction between footings and bearing soils of 0.35 may be used to resist lateral foundation loads. This value includes a factor of safety of about 1.5.

9.6 PAVEMENT DESIGN

We recommend that a California Bearing Ratio (CBR) of 10 and a Modulus of Subgrade Reaction (k) of 150 pounds per cubic inch (pci) be used to model the existing subgrade conditions for the design of rigid and flexible pavements. We anticipate that the traffic on new asphalt pavements around the proposed Fire Station will consist of light passenger vehicles, and heavier emergency vehicles with occasional delivery trucks.

We recommend that the driveways and aprons leading to the vehicle bays and other traffic lanes for heavy emergency vehicles utilize a Heavy-Duty pavement section. The parking areas for light vehicles can utilize a lighter Standard-Duty pavement section. The following minimum acceptable pavement sections are recommended:

- **Heavy-Duty Asphalt Concrete Pavement Areas:** 4 inches of Hot Mix Asphalt (HMA) Class ½” over 8 inches of Crushed Surfacing Base Course (CSBC).
- **Heavy-Duty Portland Concrete Cement Pavement Areas:** 10 inches of Portland Concrete Cement pavement over 6 inches of Crushed Surfacing Base Course (CSBC).
- **Standard-Duty Asphalt Concrete Pavement Areas:** 3 inches of HMA Class ½” over 6 inches of Crushed Surfacing Base Course (CSBC).

The HMA Class ½” shall meet the requirements of “Section 5-04 Hot Mix Asphalt” of the 2025 edition of the WSDOT *Standard Specifications for Road, Bridge, and Municipal Construction*. Asphalt Treated Base (ATB) may be substituted for the crushed rock and shall meet the requirements of WSDOT *Local Agency General Provisions (GSP) 4-06 Asphalt Treated Base* and WSDOT Standard Specification 9-03.6(3). HMA should be compacted to at least 91 percent of the maximum density as determined by the WSDOT FOP for AASHTO T 209 (rice density). ATB should be compacted to at least 80 percent of the maximum density as determined by the WSDOT FOP for AASHTO T 209 (rice density).

We further recommend the following precautions be taken during the placement of asphalt during adverse weather conditions:

- HMA should not be placed in the rain.
- All final lifts of HMA must be placed when the air temperature is 45 degrees and rising.
- ATB should not be placed when the air temperature is below 35 degrees.
- HMA should not be placed on frozen or ice-coated ground or subgrade.

Fire Station # 32 – Monroe, WA

ORA Project No.: 24-0267

April 29, 2025

Page 18 of 26

9.7 EARTHWORK

The recommendations presented in this report are predicated on the fulfillment of the following earthwork recommendations.

9.7.1 Foundation and Slab Subgrade Preparation

All concrete slabs, undocumented fill, organic debris, and old topsoil must be removed from all foundation element locations and future slab-on-grade areas. If construction activities are to be performed during periods of wet weather, we recommend that the exposed foundation subgrade soils be protected with 4 to 6 inches of thoroughly compacted 1-1/4 inch minus crushed rock, quarry spalls, controlled density fill (CDF), or a rat slab of structural concrete. The exposed subgrade soil conditions should be verified by a representative of ORA to ensure that the soils are adequately prepared to provide the required support. Concrete slab-on-grade areas at interior locations in the fire station should be supported on at least 12 inches of structural fill.

Overexcavations to replace unsuitable soils present at the design bottom of foundation elevation may be backfilled with structural concrete, lean concrete, or Controlled Low Strength Material (CLSM) at locations where foundation elements have an allowable bearing capacity of 1,500 psf. The most commonly used CLSM in the Puget Sound area is typically referred to as Controlled Density Fill (CDF). Granular structural fill may also be used to backfill overexcavations at these locations. The overexcavations where granular backfill is used must be extended laterally a distance equal to the depth of the overexcavation beyond the edges of all future foundation elements. All granular structural fill for overexcavations must be backfilled as described in the Earthwork section of this report.

If construction activities are to be performed during periods of wet weather, we recommend that the exposed foundation subgrade soils be protected with 4 to 6 inches of thoroughly compacted 1-1/4 inch minus crushed rock, quarry spalls, controlled density fill (CDF), or a rat slab of structural concrete.

9.7.2 Pavement Subgrade Preparation

Following the removal of the existing pavements, any underlying existing organic soils, woody debris, uncontrolled fill, and any other deleterious materials shall be removed. The exposed subgrade surface should then be thoroughly compacted to a firm and unyielding condition. A thorough proof roll of the exposed subgrade soils should then be performed using a fully loaded, single-unit dump truck to identify areas of soft subgrade soils. The proof roll shall be witnessed by an ORA geotechnical engineer or his representative. Areas of soft subgrade soil shall be removed and replaced with structural fill. The extent and depth of the overexcavations of unsuitable soils shall be determined by the ORA geotechnical engineer or his representative. All overexcavations shall be backfilled with structural fill consisting of Crushed Surfacing Base Course (CSBC).

Fire Station # 32 – Monroe, WA

ORA Project No.: 24-0267

April 29, 2025

Page 19 of 26

If the areas of unsuitable soil are extensive or deep (greater than about 18 inches), the use of one of the following measures may be considered to limit the depths of overexcavation:

- Woven geotextile fabrics,
- Geogrids, or
- Using coarser backfill such as quarry spalls at the base of overexcavations with base course crushed rock at the upper portion of the overexcavation backfill.

ORA can provide suitable recommendations to address the remediation of areas with extensive or deep unsuitable subgrade soils once the extent is determined in the field.

The near-surface soils at the site are moisture-sensitive and easily disturbed during periods of wet weather. Pavement construction activities should take place during the drier summer months if possible to minimize the risk of subgrade disturbance during periods of wet weather.

9.7.3 Wet Weather Grading Considerations

The soils at the site are moisture-sensitive, and disturbance of these soils should be assumed to be a certainty during periods of wet weather and wetter times of the year if left exposed to the weather. Mass grading activities during extended periods of wet weather, and during the wet season (October 31st through March 31st) may not be possible without incurring significant expenses related to overexcavation and replacement of loose, wet soils, and re-working of previously graded areas. We recommend that the following measures be implemented during periods of wet weather.

- Protect exposed foundation subgrade soils with 4 to 6 inches of thoroughly compacted 1-1/4 inch minus crushed rock, quarry spalls, controlled density fill (CDF), or a rat slab of structural concrete.
- The earthwork contractor should shape and compact areas being worked on to shed water and prevent the creation of low areas that would allow water to accumulate and result in degradation of underlying and/or previously prepared soils.
- Construction traffic should be limited to defined routes or quarry spall-protected haul roads to minimize widespread disturbance.
- Cover stockpiled materials that are to be used as structural fill with securely fastened plastic sheeting.
- Use approved, imported sand and gravel materials as structural fill with low fines content.

9.7.4 Structural Fill – Material, Placement and Compaction

Suitable onsite sandy soils or imported, granular aggregates may be used as structural fill. Soils consisting of clay, silt, peat, or containing deleterious matter are generally not suitable for use as structural fill. All structural fill material and any onsite sandy soils should be evaluated and approved by

Fire Station # 32 – Monroe, WA
 ORA Project No.: 24-0267
 April 29, 2025
 Page 20 of 26

ORA before use as structural fill. During periods of wet weather, it is unlikely that the onsite soils will be suitable for use as structural fill. Any imported granular aggregates should contain less than 5 percent fines during periods of wet weather.

All fill and backfill materials used as structural fill should be placed in relatively horizontal loose lifts, not exceeding 10 inches in thickness, and compacted to at least 95 percent of the maximum dry density (MDD) as determined by the modified Proctor test (ASTM D1557). If manually operated equipment such as a jumping jack compactor is used, the thickness of each loose lift should be no greater than 6 inches. Light vibratory plate compactors are not suitable for the compaction of structural fill.

Structural fill should be compacted to 95 percent of MDD should additionally be moisture-conditioned to within three (3) percent of optimum moisture. Structural fill to be compacted to 90 percent of MDD should be moisture-conditioned to within six (6) percent of optimum moisture content. Placement of frozen soils or placement of soils on frozen ground should not be attempted.

The following table summarizes our recommendations for fill material and compaction requirements for various types of aggregates.

Intended Use	Specification	Compaction Requirements
Structural fill below foundation elements	Crushed Surfacing Top Course (WSDOT 9-03.9(3)), and suitable onsite sandy gravel soils during extended periods of dry weather	Each lift must be compacted to 95 percent of MDD per ASTM D1557 test procedure.
Fill behind below-grade walls (outside of the zone of wall drainage material)	Gravel Backfill for Walls (WSDOT 9-03.12(2))	Fill placed within 5 feet of below-grade walls or retaining walls shall be compacted with manually operated compaction equipment. Fill placed at depths greater than 2 feet below finish subgrade elevation compacted to 90 percent of MDD. Fill placed at depths within 2 feet of finish subgrade elevation must be compacted to 95 percent of MDD if the area will be supporting pavements or roadway.
Fill behind below-grade walls at the zone of wall drainage material	Gravel Backfill for Drains (WSDOT 9-03.12(4))	No compaction until at least 18 inches of cover is present above the perforated drain pipe. Each subsequent 12-inch lift

Fire Station # 32 – Monroe, WA
ORA Project No.: 24-0267
April 29, 2025
Page 21 of 26

Intended Use	Specification	Compaction Requirements
		is lightly compacted using manual compaction equipment.
Capillary break Material below slabs- on-grade	Clean, 3/4-inch crushed rock	Each lift must be compacted to a firm and unyielding condition over the firm subgrade soils.

9.7.5 Temporary Excavations

9.7.5.1 EXCAVATIONS FOR THE PROPOSED FIRE STATION

We anticipate that maximum excavation depths for the proposed fire station will be on the order of 3 to 4 feet. We recommend that the inclination of temporary cut slopes be no greater than 1.5H:1V (horizontal to vertical) in the near-surface soils. However, the temporary cut slope inclinations will likely need to be flattened to 3H:1V or flatter during wetter times of the year or during extended periods of heavy precipitation when depths to groundwater will likely be on the order of 4.5 feet below the existing site grade. We recommend that water in the excavations be routed by ditches to gravel-filled, temporary sumps that will allow the water to be collected and discharged to discharge locations. We anticipate that the collected water will need to be detained to allow sedimentation to occur and to be treated, as needed, onsite in temporary storage tanks.

9.7.5.2 TEMPORARY EXCAVATIONS FOR THE PROPOSED STORMWATER DETENTION VAULT

We understand that a stormwater detention vault will likely be needed for the project. We anticipate that a detention vault would likely require excavation depths ranging from 5 to 10 feet in depth. The measured depths to groundwater have been observed to range from about 4.5 feet to 7 feet in early Spring 2025. As a result, the excavation for a stormwater detention vault would likely require a robust dewatering system. We anticipate that dewatering well points will need to be installed around the outside of the excavation by a dewatering contractor to draw down the water to a level at least 2 feet below the design base of the excavation level to provide stability of the base of the excavation. Given that a wetland is located immediately to the north of the project site there is likely a steady source of surface water to that area and groundwater dewatering volumes could easily reach 100 to 300 gallons per minute (gpm) as dewatering initially begins depending on the depth and size of the excavation, and would likely stabilize to lower levels as dewatering continues. It would be imperative that the dewatering wells do not penetrate the underlying pressurized, confined aquifer. We recommend that an experienced dewatering contractor be retained to design and maintain the dewatering system for the project. The collected water from the dewatering system will need to be stored, treated, and discharged in accordance with local and state requirements.

We anticipate that any permanent detention vault would need to be designed to resist buoyancy forces. Buoyancy forces will increase with a greater depth of embedment below the groundwater table.

Fire Station # 32 – Monroe, WA

ORA Project No.: 24-0267

April 29, 2025

Page 22 of 26

Resistance to buoyancy forces can be achieved by ensuring the self-weight of the empty detention system is greater than the buoyancy forces that are acting on it, or by providing anchors into the ground below it that provide sufficient resistance to the upward forces acting on the detention system. The upward buoyancy force exerted on an object is equal to the weight of the displaced volume of fluid. The proposed configuration of the detention is currently unknown. ORA can provide assistance in estimating buoyancy forces and other design parameters such as the design of sheet pile walls and detention vault hold-down anchors, as needed.

9.7.5.3 TEMPORARY EXCAVATION CONSTRUCTION MONITORING

An ORA representative should periodically evaluate the exposed soil conditions during construction to verify that the recommended temporary cut slope inclinations are appropriate for the conditions being encountered. In addition, the configuration for temporary cut slope inclinations may need to be modified during construction if site conditions change.

All temporary cut slopes and excavations must comply with the provisions of the Washington Administrative Code (WAC) Chapter 296-155, Part N, “Excavation, Trenching and Shoring.” The contractor performing the work has the primary responsibility for the protection of workers and adjacent improvements.

9.7.6 Erosion and Sedimentation Control

The migration of sediments from the site must be controlled in accordance with City of Monroe requirements. We recommend that the following minimum erosion control measures be employed at the site:

- Provide silt fencing around the construction area to delineate the construction limits. No construction or soil disturbance should take place outside of the construction limits.
- Stockpiled soil at the site should be kept to a minimum. Any stockpiled soils should be covered with carefully secured plastic sheeting.
- Catch basin socks should be installed in nearby catch basins located downhill from the work area that could be impacted by construction activities.
- All sediment and soil should be removed from adjacent pavements at the end of each day of construction activities.
- Periodic inspection of the adequacy and condition of the installed erosion control measures by a geotechnical engineer or an experienced representative assigned by the geotechnical engineer.

Additional erosion control measures may be required as construction progresses.

Fire Station # 32 – Monroe, WA

ORA Project No.: 24-0267

April 29, 2025

Page 23 of 26

9.8 DRAINAGE

9.8.1 Dewatering

Based on our review of the proposed development and the relatively shallow depth of groundwater encountered in our explorations (4.5 feet below the existing site grade), groundwater may be encountered during the construction of the new fire station and installation of buried utilities. The shallowest depth to groundwater will likely be during the wet season and following periods of extended precipitation. If groundwater or seepage is encountered during construction, we anticipate that dewatering could be satisfactorily completed by routing water through ditches to a low spot or sump in the excavation. We recommend that the sump depths be set to the lower groundwater level to at least 2 feet below the base of the excavation elevation. If this proves to be insufficient, a dewatering system designed by an experienced dewatering contractor may be required.

Runoff water and groundwater collected in temporary excavations should be removed as soon as possible for storage and treatment before being discharged to a location approved by the City of Monroe and in accordance with local and state requirements.

9.8.2 Foundation Wall and Retaining Wall Drainage

Good drainage is considered critical to the performance of earth-supported structures such as foundations and retaining walls. Adequate drainage must be provided behind foundation walls and retaining walls for this project. We recommend that perimeter drains be installed near the base of all foundations. Foundation drains should, at a minimum, consist of a 4-inch diameter, perforated or slotted SDR 35, or Schedule 40 PVC pipe. The foundation drains should be surrounded by at least 6 inches of drainage material such as $\frac{3}{4}$ " clean crushed rock. A 24-inch wide zone of free-draining, clean, crushed gravel should be placed at the back of all foundation walls, below-grade walls, and retaining structures to within 12 inches of the final grade. A nonwoven geotextile fabric filter fabric such as Mirafi 140N, or an approved equivalent, should fully surround the zone of free-draining gravel. In addition, an appropriate spray-applied, or roller-applied damp proofing or waterproofing membrane should be applied directly to the exterior side of all below-grade walls, the tops of footings, and along the sides to provide a continuous membrane.

9.8.3 Surface Drainage

Good surface drainage is an integral part of the performance of earth-supported structures such as foundations, retaining walls, and pavements. Therefore, construction grades and final site grades should be designed to prevent water from entering the foundations or gravel drains behind any retaining walls or from ponding on or next to pavements. Where pavement does not immediately abut structures, slopes, with an outfall of at least three (3) percent for a minimum distance of five (5) feet from exterior footings, should be provided. These slopes should be capped with relatively impervious soils to prevent infiltration of water into the foundation soils.

Fire Station # 32 – Monroe, WA
ORA Project No.: 24-0267
April 29, 2025
Page 24 of 26

10. REPORT LIMITATIONS

The recommendations presented in this report are for the exclusive use of Snohomish Regional Fire and Rescue and other members of the design team for the proposed Fire Station #32 site at 19959 Oaks Street in Monroe, Washington. The recommendations are based on completed subsurface explorations and analyses. The recommendations of this report are not transferable to any other site. If there are any revisions to the plans, or if deviations from the subsurface conditions noted in this report are encountered during construction, Otto Rosenau & Associates, Inc. (ORA) should be notified immediately to determine whether changes to the design recommendations are required.

11. REFERENCES

American Society of Civil Engineers, 2022. "Minimum Design Loads for Buildings and Other Structures, ASCE Standard ASCE/SEI 7-22", Reston, VA.

Bartlett, S. F., and Youd, T. L. (1995). "Empirical prediction of liquefaction-induced lateral spread." *Journal of Geotechnical and Geoenvironmental Engineering*, 121(4), 316–329.

Dragovich, J. D.; Anderson, M. L.; Mahan, S. A.; Koger, C. J.; Saltonstall, J. H.; MacDonald, J. H., Jr.; Wessel, G. R.; Stoker, B. A.; Bethel, J. P.; Labadie, J. E.; Cakir, Recep; Bowman, J. D.; DuFrane, S. A., 2011, Geologic map of the Monroe 7.5-minute quadrangle, King and Snohomish Counties, Washington: Washington Division of Geology and Earth Resources Open File Report 2011-1, 1 sheet, scale 1:24,000, with 24 p. text

International Code Council, 2021 "International Building Code, 2021 International Building Code® as adopted by the State Building Code Council in Chapter 51-50 WAC as published by the International Code Council excluding Chapter 1.

U.S. Department of Transportation, Federal Highway Administration, "COM624P – Laterally Loaded Pile Analysis Program for the Microcomputer, Version 2.0", June 1993, Wang Shih-Tower and Reese, Lymon C., Publication No.: FHWA-SA-91-048.

Youd, T.L., Idriss, I.M., Andrus, R.D., Arango, I., Castro, G., Christian, J.T., Dobry, R., Finn, W.D.L., Harder, L.F., Hynes, M.E., Ishihara, K., Koester, J., Liao, S., Marcuson III, W.F., Martin, G.R., Mitchell, J.K., Moriwaki, Y., Power, M.S., Robertson, P.K., Seed, R., and Stokoe, K.H., "Liquefaction Resistance of Soils: Summary Report from the 1996 NCEER and 1998 NCEER/NSF Workshop on Evaluation of Liquefaction Resistance of Soils", ASCE, *Journal of Geotechnical and Geoenvironmental Engineering*, Vol. 127, October 2001, pp 817-833


Fire Station # 32 – Monroe, WA

ORA Project No.: 24-0267

April 29, 2025

Page 25 of 26

“Washington Interactive Geologic Map” provided by the State of Washington Department of Natural Resources at <https://www.dnr.wa.gov/geology/>.

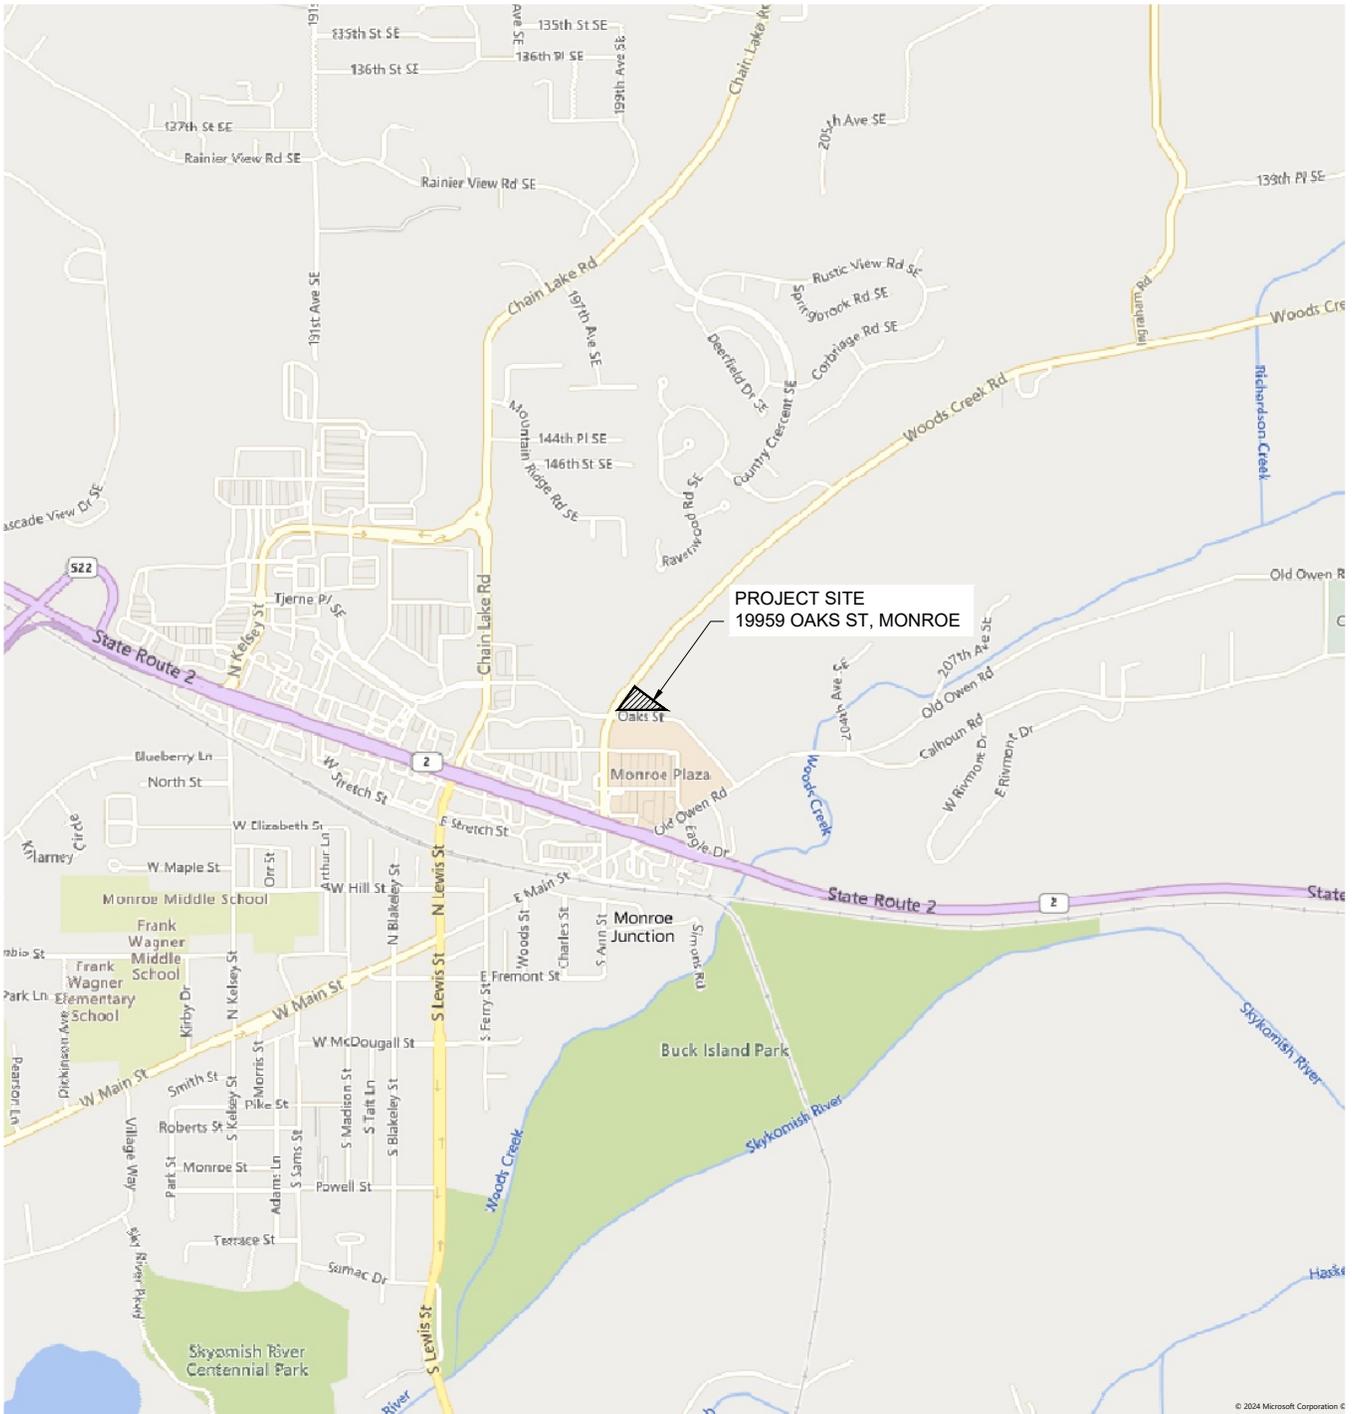


Reference: © 2024 Microsoft Corporation Tom Tom Mapping Service.



VICINITY MAP


Project Name: Proposed Fire Station # 32
Location: 19959 Oaks St, Monroe, Washington
Date: April 25, 2025



OTTO ROSENAU & ASSOCIATES, INC.

For: Snohomish Regional Fire & Rescue
ORA Project No.: 24-0267
Figure: 1

CEL A
 ROE BOUNDARY
 JUSTMENT
 603225189
 DISTRICT NO 1

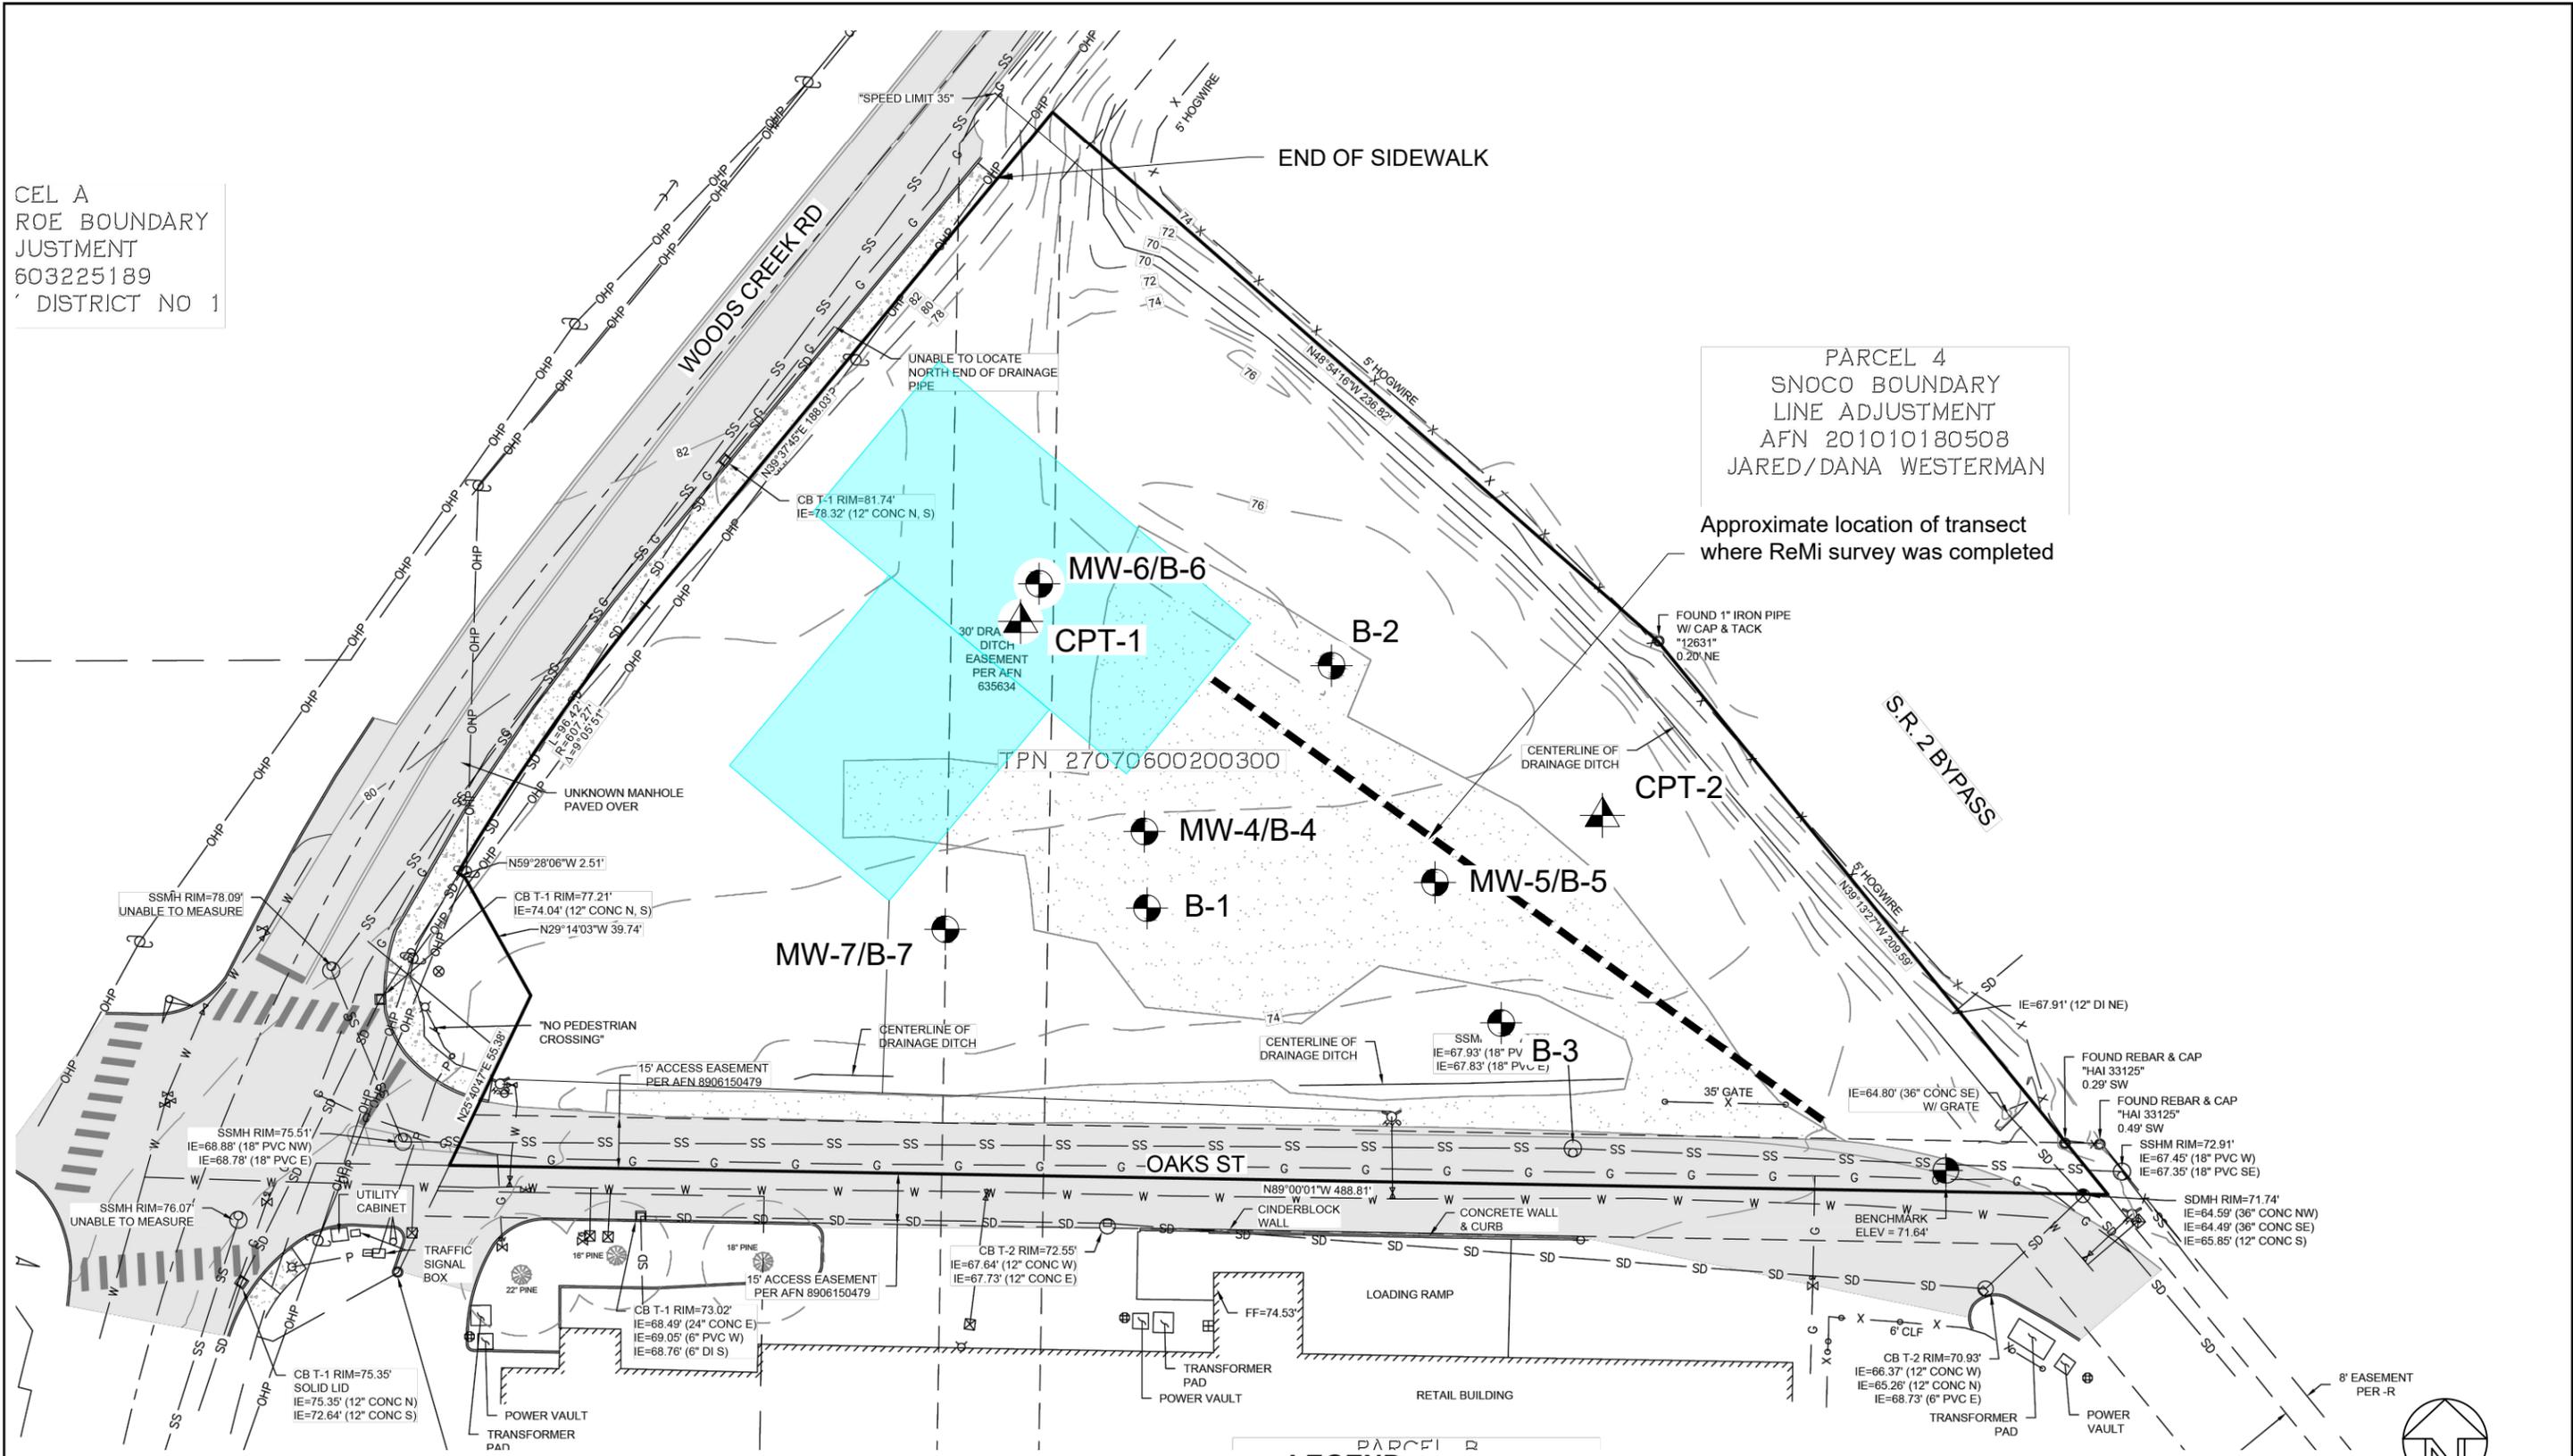

PARCEL 4
 SNOCO BOUNDARY
 LINE ADJUSTMENT
 AFN 201010180508
 JARED/DANA WESTERMAN

Approximate location of transect
 where ReMi survey was completed

LEGEND

- B-1 - Boring completed by ORA on 5/21/2024
- MW-4/B-4 - Monitoring Well/Boring completed by ORA on 3/26/2025 and 3/27/2025
- ▲ CPT-1 - Cone Penetration Test completed by ORA on 5/28/2024

Scale: 1" = 50'


PRELIMINARY SITE PLAN

Project Name: Proposed Fire Station # 32
Location: 19959 Oaks St, Monroe, Washington
Date: April 25, 2025



For: Snohomish Regional Fire & Rescue
ORA Project No.: 24-0267
Figure: 2

REFERENCE: ALTA/NSPS Land Title Survey For OAC Services, Sheet 2 of 2, prepared by Harmsen dated 05/17/2024

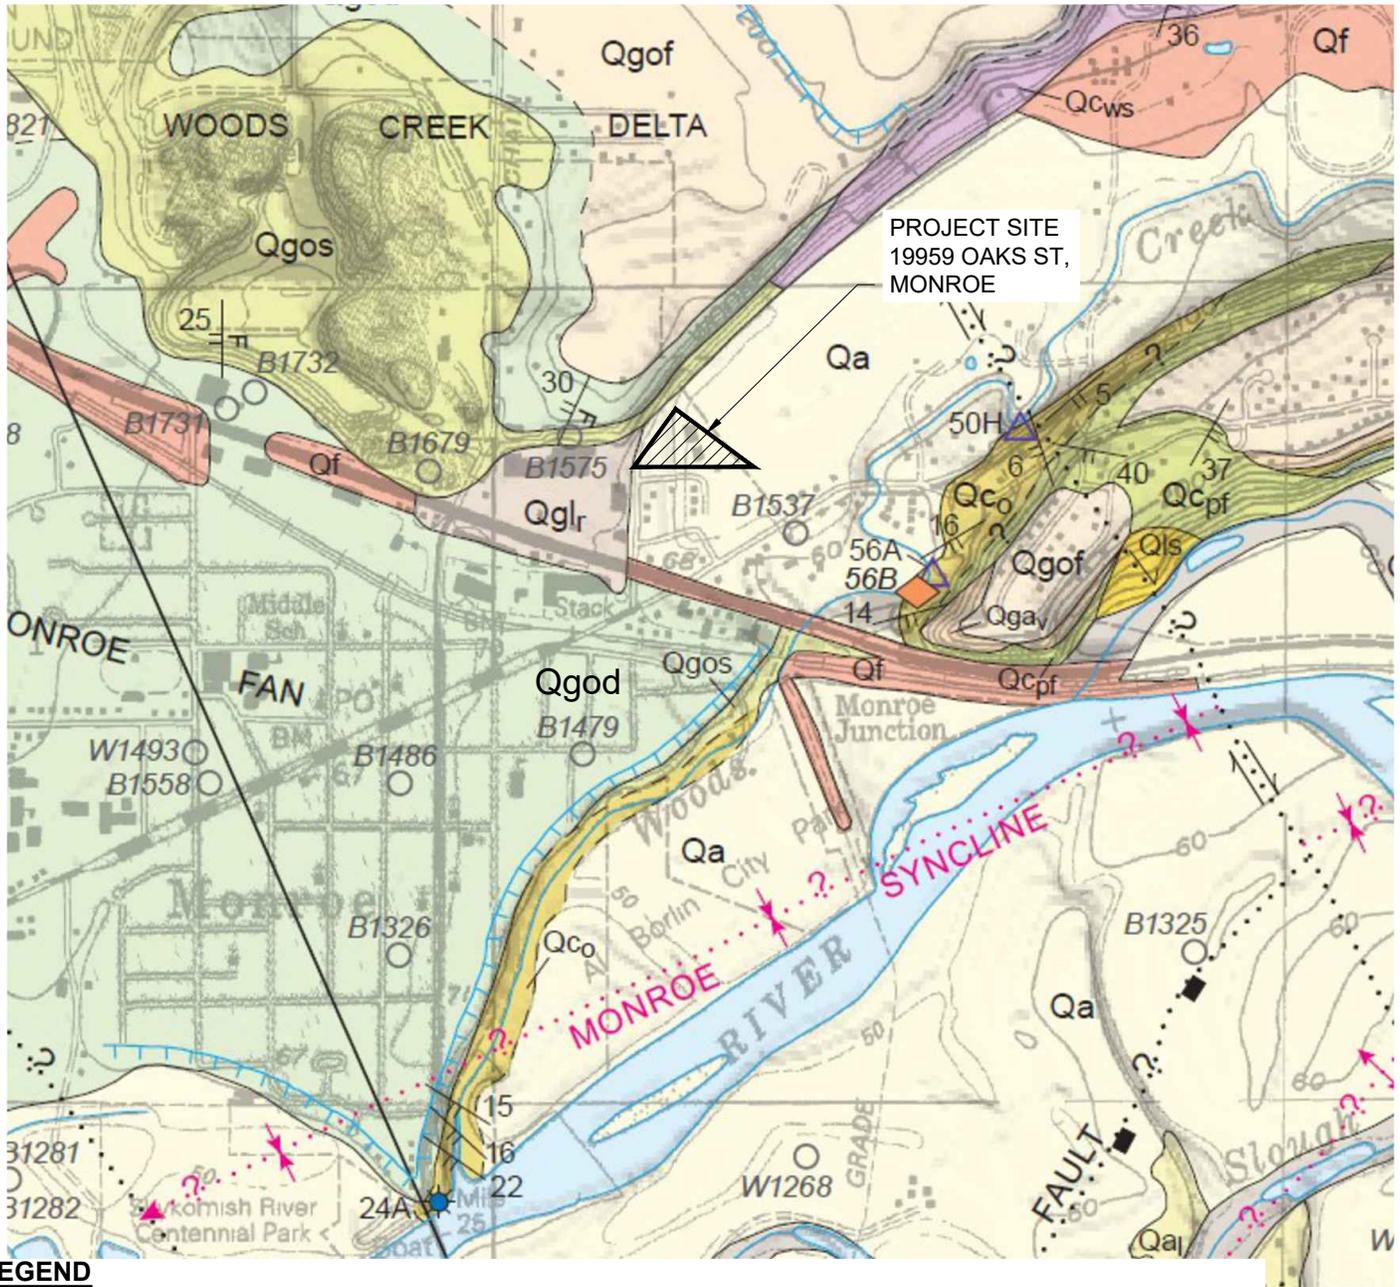

LEGEND

- Qa** - Alluvium (Nonglacial Deposit, Holocene Age)
- Qglr** - Recessional glaciolacustrine deposit (Glacial Deposit, Pleistocene Age)
- Qgod** - Deltaic outwash and kame deltas deposit (Glacial Deposit, Pleistocene Age)
- Qgos** - Outwash sand deposit (Glacial Deposit, Pleistocene Age)
- Qgof** - Fluvial outwash deposits (Glacial Deposit, Pleistocene Age)
- Qco** - Olympia beds, Snoqualmie and Skykomish provenance (Nonglacial Deposit, Pleistocene Age)


Note: The location of all features shown is approximate.

Reference: 7.5-minute quadrangle, Snohomish County, Washington: Washington Division of Geology and Earth Resources Map Series 2015-01 1:24000 scale




GEOLOGIC MAP

Project Name: Proposed Fire Station # 32
Location: 19959 Oaks St, Monroe, Washington
Date: April 25, 2025



OTTO ROSENAU & ASSOCIATES, INC.

For: Snohomish Regional Fire & Rescue
ORA Project No.: 24-0267
Figure: 3

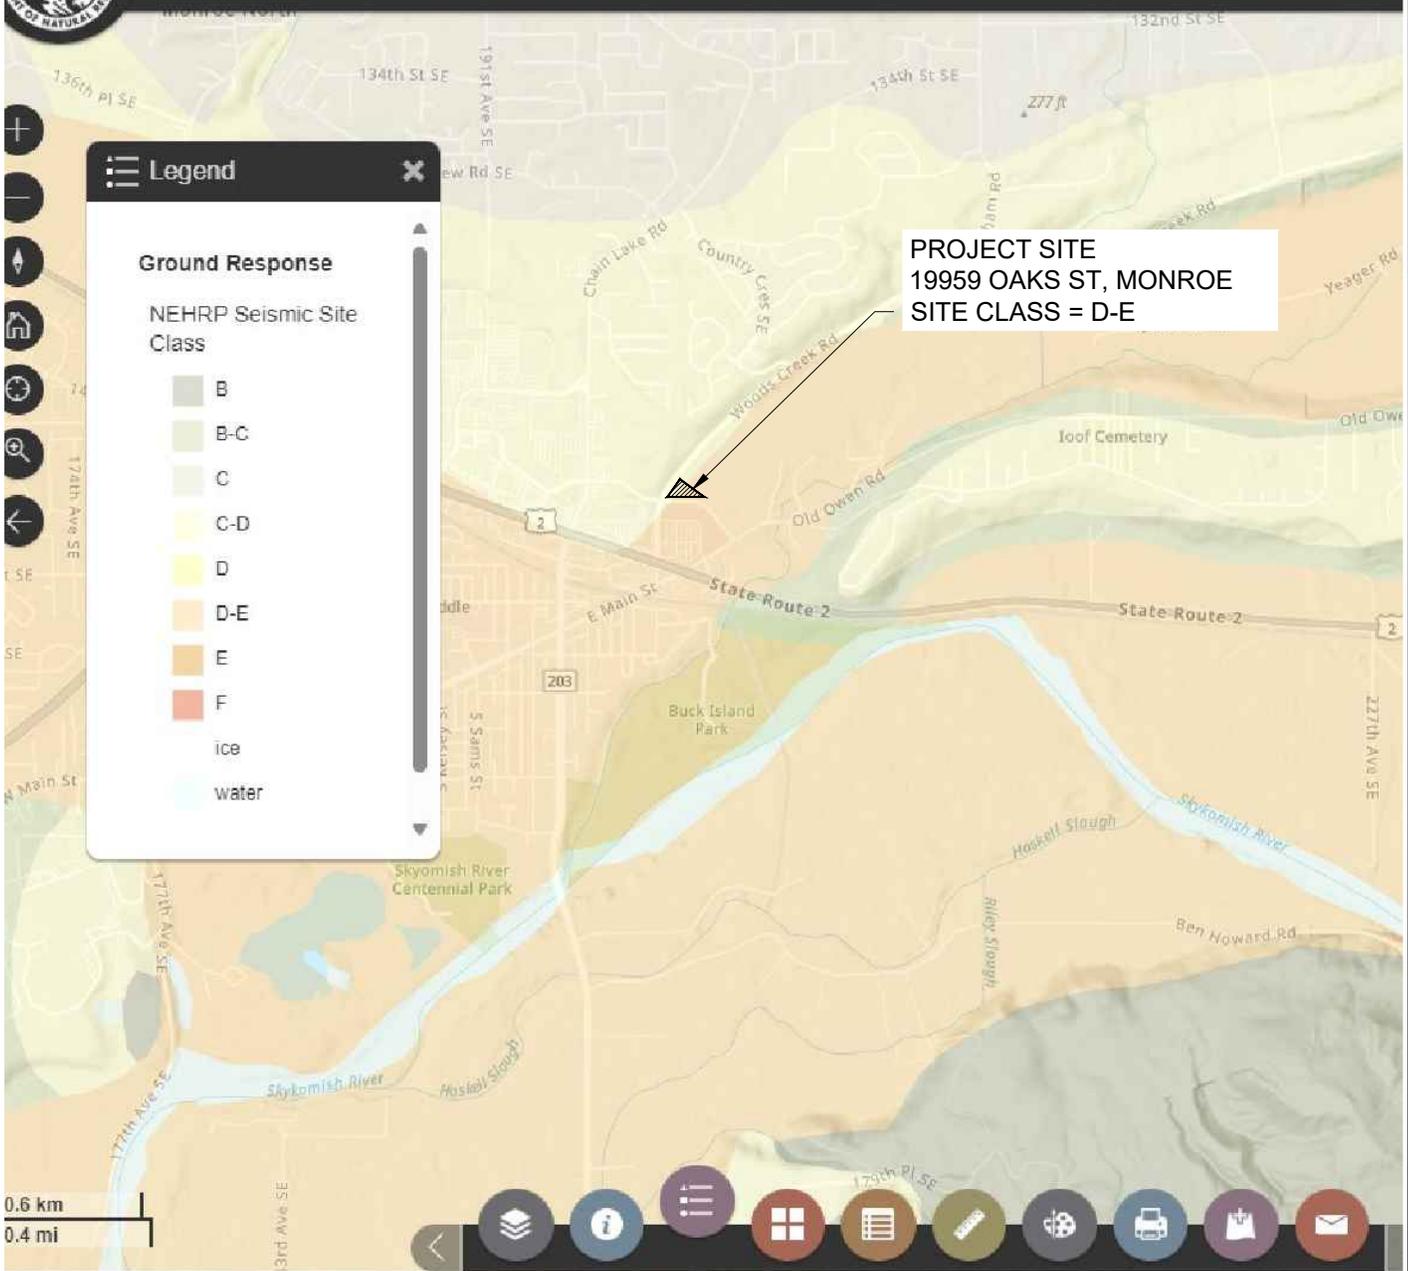

PROJECT SITE
19959 OAKS ST, MONROE
SITE CLASS = D-E

Legend

Ground Response

NEHRP Seismic Site Class

- B
- B-C
- C
- C-D
- D
- D-E
- E
- F
- ice
- water

0.6 km
0.4 mi



© 2025 Esri, NASA, NGA, USGS, FEMA | WA State Parks GIS, Esri, TomTom, Garmin, SafeGraph, GeoTechnologies, Inc, METI/NASA, USGS, Bureau of Land Management, E

Note: The location of all features shown is approximate.
Reference: Washington State Department of Natural Resources Geologic Portal at [https://geologyportal.dnr.wa.gov/Earthquakes/Ground Response/NEHRP Site Class](https://geologyportal.dnr.wa.gov/Earthquakes/Ground%20Response/NEHRP%20Site%20Class)




NEHRP SITE CLASSIFICATION

Project Name: Proposed Fire Station # 32
Location: 19959 Oaks St, Monroe, Washington
Date: April 25, 2025



For: Snohomish Regional Fire & Rescue
ORA Project No.: 24-0267
Figure: 4

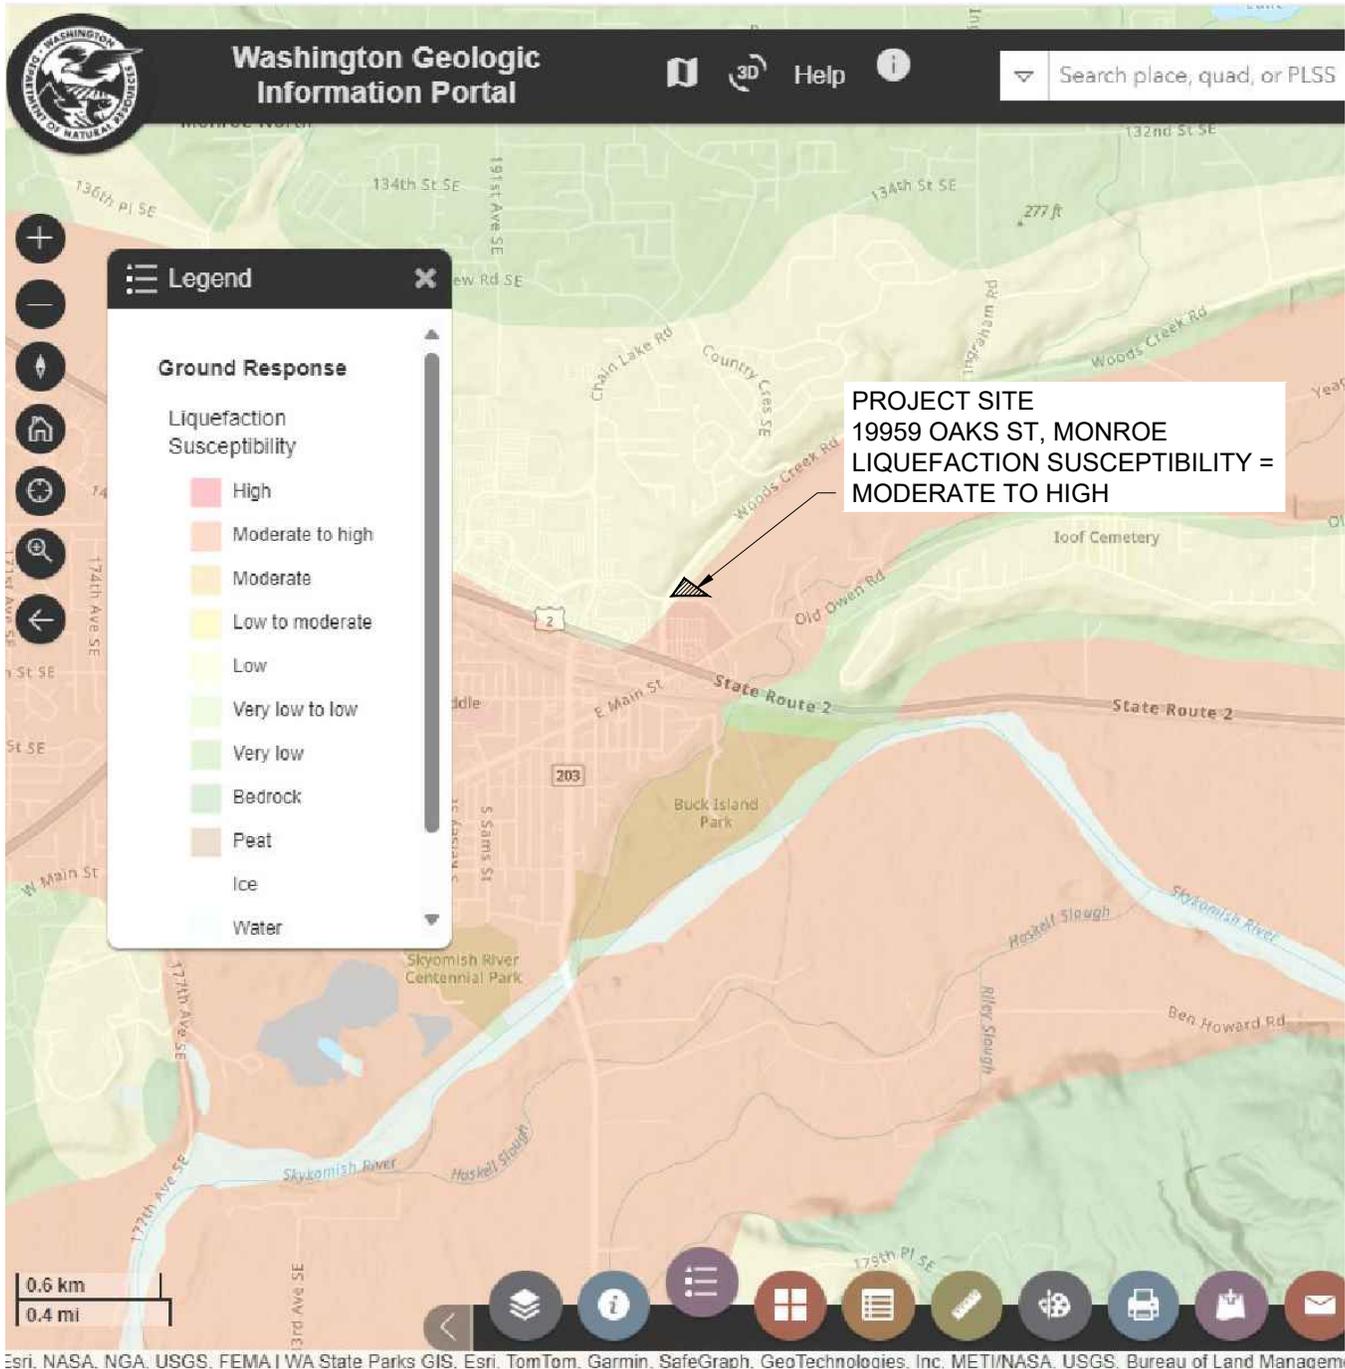

Note: The location of all features shown is approximate.

Reference: Washington State Department of Natural Resources Geologic Portal at [https://geologyportal.dnr.wa.gov/Earthquakes/Ground Response/Liquefaction Susceptibility](https://geologyportal.dnr.wa.gov/Earthquakes/Ground%20Response/Liquefaction%20Susceptibility)




LIQUEFACTION SUSCEPTIBILITY

Project Name: Proposed Fire Station # 32

Location: 19959 Oaks St, Monroe, Washington

Date: April 25, 2025



OTTO ROSENAU & ASSOCIATES, INC.

For: Snohomish Regional Fire & Rescue

ORA Project No.: 24-0267

Figure: 5

APPENDIX A

EXPLORATIONS

Boring Log Notes.....	A-1
Soil Classification Chart.....	A-3
Boring Logs for ORA Borings B-1 through B-7.....	A-4
CPT Exploration Summary Report by ConeTec.....	A-12

BORING LOG NOTES

These notes and boring logs are intended for use with this geotechnical report for the purposes and project described therein. The boring logs depict ORA's interpretation of subsurface conditions at the location of the boring on the date noted. Subsurface conditions may vary, and groundwater levels may change because of seasonal or numerous other factors. Accordingly, the boring logs should not be made a part of construction plans or be used to define construction conditions.

The approximate locations of the borings are shown on the Site Plan. The borings were located in the field by measuring from existing site features.

"Boring Size" refers the diameter and type of auger used. "HSA" denotes hollow-stem auger. "SSA" denotes solid-stem auger. "BA" denotes bucket auger.

"Sample Number and Type" refers to the sampling method and equipment used during exploration where:

- "SS" indicates split-spoon sampler with 1-3/8" inside diameter and 2" outside diameter.

"N-Values" refer to the Standard Penetration Test which records number of blows from a 140-pound hammer falling 30 inches required to advance a standard sampler eighteen inches. The blow counts required to drive the sampler through each 6-inch interval is recorded. The number of blows to drive the sampler for the last 12 inches of driving are added together and is considered to be the N-Value. The N-Value is presented in parentheses on the boring logs. The actual blow count values for each 6-inch interval is also presented. If the sample is driven less than 6 inches for a given interval, the actual distance driven is recorded.

"Moisture Content (MC)" refers to the moisture content of the soil expressed in percent by weight of dry sample as determined in the laboratory.

"Grain Size (GS)" refers to a grain size distribution analysis completed in general accordance with the ASTM D422 test procedure.

"Fines" is an estimate of the portion of a soil sample passing a No. 200 sieve as determined using the ASTM D422 test procedure.

"Atterberg Limits (AL)" refers to a determination of the liquid and plastic limits of a cohesive soil using the ASTM D 4318 test procedure.

"Dry Density (DD)" refers to an estimate of the dry density of a soil sample collected using a Shelby thin-wall sampling tube.

“Description and USCS Classification” refer to the materials encountered in the boring. The descriptions and classifications are generally based on visual examination in the field and laboratory. Where noted, laboratory tests were performed to determine the soil classification. The terms and symbols used in the boring logs are in general accordance with the Unified Soil Classification System. Laboratory tests are performed in general accordance with applicable procedures described by the American Society for Testing and Materials.

“▼” Indicates location of groundwater at the time noted.

TERMS for RELATIVE DENSITY of NON-COHESIVE SOIL

<u>Term</u>	<u>Standard Penetration Resistance “N”</u>
Very Loose	4 or less
Loose	5 to 10
Medium Dense	11 to 30
Dense	31 to 50
Very Dense	Over 50 blows/foot

TERMS for RELATIVE CONSISTENCY of COHESIVE SOIL

<u>Term</u>	<u>Unconfined Compressive Strength</u>
Very Soft	0 to 0.25 tons/square-foot (tsf)
Soft	0.25 to 0.50 tsf
Medium Stiff	0.50 to 1.00 tsf
Stiff	1.00 to 2.00 tsf
Very Stiff	2.00 to 4.00 tsf
Hard	Over 4.00 tsf

DEFINITION of MATERIAL by DIAMETER of PARTICLE

Boulder	8-inches+
Cobble	3 to 8 inches
Gravel	3 inches to 5mm
Coarse Sand	5mm to 0.6mm
Medium Sand	0.6mm to 0.2mm
Fine Sand	0.2mm to 0.074mm
Silt	0.074mm to 0.005mm
Clay	less than 0.005mm

SOIL CLASSIFICATION CHART

MAJOR DIVISIONS			SYMBOLS		TYPICAL DESCRIPTIONS
			GRAPH	LETTER	
<p>COARSE GRAINED SOILS</p> <p>MORE THAN 50% OF MATERIAL IS LARGER THAN NO. 200 SIEVE SIZE</p>	<p>GRAVEL AND GRAVELLY SOILS</p> <p>MORE THAN 50% OF COARSE FRACTION RETAINED ON NO. 4 SIEVE</p>	<p>CLEAN GRAVELS</p> <p>(LITTLE OR NO FINES)</p>		GW	WELL-GRADED GRAVELS, GRAVEL - SAND MIXTURES, LITTLE OR NO FINES
		<p>GRAVELS WITH FINES</p> <p>(MORE THAN 12% FINES)</p>		GP	POORLY-GRADED GRAVELS, GRAVEL - SAND MIXTURES, LITTLE OR NO FINES
		<p>GRAVELS WITH FINES</p> <p>(MORE THAN 12% FINES)</p>		GM	SILTY GRAVELS, GRAVEL - SAND - SILT MIXTURES
	<p>SAND AND SANDY SOILS</p> <p>MORE THAN 50% OF COARSE FRACTION PASSING ON NO. 4 SIEVE</p>	<p>CLEAN SANDS</p> <p>(LITTLE OR NO FINES)</p>		SW	WELL-GRADED SANDS, GRAVELLY SANDS, LITTLE OR NO FINES
		<p>CLEAN SANDS</p> <p>(LITTLE OR NO FINES)</p>		SP	POORLY-GRADED SANDS, GRAVELLY SAND, LITTLE OR NO FINES
		<p>SANDS WITH FINES</p> <p>(MORE THAN 12% FINES)</p>		SM	SILTY SANDS, SAND - SILT MIXTURES
<p>FINE GRAINED SOILS</p> <p>MORE THAN 50% OF MATERIAL IS SMALLER THAN NO. 200 SIEVE SIZE</p>	<p>SILTS AND CLAYS</p> <p>LIQUID LIMIT LESS THAN 50</p>		ML	INORGANIC SILTS AND VERY FINE SANDS, ROCK FLOUR, SILTY OR CLAYEY FINE SANDS OR CLAYEY SILTS WITH SLIGHT PLASTICITY	
			CL	INORGANIC CLAYS OF LOW TO MEDIUM PLASTICITY, GRAVELLY CLAYS, SANDY CLAYS, SILTY CLAYS, LEAN CLAYS	
			OL	ORGANIC SILTS AND ORGANIC SILTY CLAYS OF LOW PLASTICITY	
	<p>SILTS AND CLAYS</p> <p>LIQUID LIMIT GREATER THAN 50</p>		MH	INORGANIC SILTS, MICACEOUS OR DIATOMACEOUS FINE SAND OR SILTY SOILS	
			CH	INORGANIC CLAYS OF HIGH PLASTICITY	
			OH	ORGANIC CLAYS OF MEDIUM TO HIGH PLASTICITY, ORGANIC SILTS	
<p>HIGHLY ORGANIC SOILS</p>				PT	PEAT, HUMUS, SWAMP SOILS WITH HIGH ORGANIC CONTENTS

NOTE: FINES ARE MATERIALS PASSING THE NO. 200 SIEVE.
 COARSE GRAINED SOILS RECEIVE DUAL SYMBOLS IF THEY CONTAIN BETWEEN 5% AND 12% FINES.
 FINE GRAINED SOILS RECEIVE DUAL SYMBOLS IF THEIR LIMITS PLOT LEFT OF THE "A" LINE WITH A PLASTICITY INDEX (PI) OF 4% TO 7%.



Otto Rosenau & Associates, Inc.
 6747 Martin Luther King Jr Way South
 Seattle, WA 98118
 Telephone: (206) 725-4600

BORING NUMBER B-1

PAGE 1 OF 1

CLIENT Snohomish Regional Fire & Rescue **PROJECT NAME** Fire Station 32 Site Evaluation
PROJECT NUMBER 24-0267 **PROJECT LOCATION** 19959 Oaks St, Monroe, WA
DATE STARTED 5/21/24 **COMPLETED** 5/21/24 **GROUND ELEVATION** 75 ft NAVD 88 **HOLE SIZE** 8-inch diameter
DRILLING CONTRACTOR Geologic Drill Partners, Inc. **GROUND WATER LEVELS:**
DRILLING METHOD Track Rig Mounted Hollow Stem Auger **▽ AT TIME OF DRILLING** 10.00 ft / Elev 65.00 ft
LOGGED BY Scott Hoobler, PE **CHECKED BY** Scott Hoobler, PE **▽ AT END OF DRILLING** 0.00 ft / Elev 75.00 ft
NOTES SPT sampler, 140-pound automatic hammer, 30-inch drop **AFTER DRILLING** ---

GENERAL BH / TP / WELL - GINT STD U.S. GDT - 4/15/25 14:06 - C:\USERS\ANTHONY.COYNE\ONE\DRIVE - OTTO ROSENAU\GEO\TECH\GINT\PROJECTS\FIRE STATION 32 MONROE.GPJ

DEPTH (ft)	SAMPLE TYPE NUMBER	RECOVERY %	BLOW COUNTS (N VALUE)	TESTS	U.S.C.S.	GRAPHIC LOG	MATERIAL DESCRIPTION
0							▼
					SM		SILTY SAND, (SM) brown, moist, medium dense, some gravel, (Fill) 73.0
	SPT 1	69	3-2-4 (6)	MC = 63%	ML		SILT, (ML) dark brown, moist, medium stiff, (Alluvium)
5					ML		SILT, (ML) dark grayish brown, moist, medium stiff, (Alluvium) 69.0
	SPT 2	100	0-2-3 (5)	MC = 40%	SM		SILTY SAND, (SM) dark grayish brown, moist, loose, (Alluvium)
	SPT 3	100	2-2-3 (5)	MC = 50%	SM		SILTY SAND, (SM) dark grayish brown, moist, loose, (Alluvium) 66.5
10					SP-SM		▽ POORLY GRADED SAND WITH SILT, (SP-SM) dark grayish brown, fine to medium grained, moist, loose, some wood debris, (Alluvium)
	SPT 4	100	2-3-3 (6)	MC = 36%	SP-SM		POORLY GRADED SAND WITH SILT, (SP-SM) dark grayish brown, fine to medium grained, wet, loose, some wood debris, (Alluvium)
	SPT 5	83	2-6-9 (15)	MC = 22% Fines = 6% GS	SP-SM		POORLY GRADED SAND WITH SILT, (SP-SM) dark grayish brown, fine to medium grained, wet, medium dense, (Alluvium)
15					SP-SM		POORLY GRADED SAND WITH SILT, (SP-SM) dark grayish brown, fine to medium grained, wet, loose, (Alluvium) (Drilling mud added at D = 15' to prevent heave) 57.0
	SPT 6	100	2-2-6 (8)	MC = 25%	ML		SILT, (ML) dark grayish brown, wet, soft, (Alluvium)
20					ML		SILT, (ML) dark grayish brown, wet, soft, (Alluvium)
	SPT 7	100	0-0-2 (2)	MC = 28%	SM		SILTY SAND, (SM) dark grayish brown, moist, very loose, (Alluvium) 54.0
					SM		(Artesian groundwater encountered at about D = 21', water flowed from boring hole onto adjacent ground surface, boring abandoned and sealed) 53.5 Bottom of borehole at 21.5 feet.



Otto Rosenau & Associates, Inc.
 6747 Martin Luther King Jr Way South
 Seattle, WA 98118
 Telephone: (206) 725-4600

BORING NUMBER B-2


PAGE 1 OF 1

CLIENT Snohomish Regional Fire & Rescue **PROJECT NAME** Fire Station 32 Site Evaluation
PROJECT NUMBER 24-0267 **PROJECT LOCATION** 19959 Oaks St, Monroe, WA
DATE STARTED 5/21/24 **COMPLETED** 5/21/24 **GROUND ELEVATION** 76 ft NAVD 88 **HOLE SIZE** 8-inch diameter
DRILLING CONTRACTOR Geologic Drill Partners, Inc. **GROUND WATER LEVELS:**
DRILLING METHOD Track Rig Mounted Hollow Stem Auger **AT TIME OF DRILLING** ---
LOGGED BY Scott Hoobler, PE **CHECKED BY** Scott Hoobler, PE **▼ AT END OF DRILLING** 10.00 ft / Elev 66.00 ft
NOTES SPT sampler, 140-pound automatic hammer, 30-inch drop **▼ 0.25hrs AFTER DRILLING** 7.50 ft / Elev 68.50 ft

GENERAL BH / TP / WELL - GINT STD U.S. GDT - 4/15/25 14:06 - C:\USERS\ANTHONY.COYNE\ONE\DRIVE - OTTO ROSENAU\GEO\TECH\GINT\PROJECTS\FIRE STATION 32 MONROE.GPJ

DEPTH (ft)	SAMPLE TYPE NUMBER	RECOVERY %	BLOW COUNTS (N VALUE)	TESTS	U.S.C.S.	GRAPHIC LOG	MATERIAL DESCRIPTION
0							
	SPT 1	67	16-13-6 (19)	MC = 35%	SM		SILTY SAND, (SM) brown, moist, medium dense, some gravel, (Fill)
					SM	3.5	SILTY SAND, (SM) brown, moist, medium dense, some gravel, (Fill) 72.5
					ML		SILT, (ML) dark grayish brown, moist, medium stiff, (Alluvium)
5	SPT 2	100	5-4-3 (7)	MC = 44%	ML		SILT, (ML) dark grayish brown, moist, medium stiff, iron oxide staining, (Alluvium)
						7.0	69.0
	SPT 3	39	1-1-2 (3)	MC = 34%	SM		SILTY SAND, (SM) grayish brown, moist to wet, very loose, (Alluvium)
10	SPT 4	100	1-1-1 (2)	MC = 35%	SM		SILTY SAND, (SM) grayish brown, wet, very loose, some wood debris, (Alluvium)
						12.0	64.0
	SPT 5	100	4-8-11 (19)	MC = 40%	SP-SM		POORLY GRADED SAND WITH SILT, (SP-SM) gray, fine to medium grained, wet, medium dense, (Alluvium)
15	SPT 6	100	5-2-8 (10)	MC = 14%	SP-SM		POORLY GRADED SAND WITH SILT, (SP-SM) gray, fine to medium grained, wet, medium dense, (Alluvium)
						16.5	59.5

Bottom of borehole at 16.5 feet.



Otto Rosenau & Associates, Inc.
 6747 Martin Luther King Jr Way South
 Seattle, WA 98118
 Telephone: (206) 725-4600

BORING NUMBER B-3

PAGE 1 OF 1

CLIENT Snohomish Regional Fire & Rescue **PROJECT NAME** Fire Station 32 Site Evaluation
PROJECT NUMBER 24-0267 **PROJECT LOCATION** 19959 Oaks St, Monroe, WA
DATE STARTED 5/21/24 **COMPLETED** 5/21/24 **GROUND ELEVATION** 74 ft NAVD 88 **HOLE SIZE** 8-inch diameter
DRILLING CONTRACTOR Geologic Drill Partners, Inc. **GROUND WATER LEVELS:**
DRILLING METHOD Track Rig Mounted Hollow Stem Auger **AT TIME OF DRILLING** ---
LOGGED BY Scott Hoobler, PE **CHECKED BY** Scott Hoobler, PE **AT END OF DRILLING** 10.00 ft / Elev 64.00 ft
NOTES SPT sampler, 140-pound automatic hammer, 30-inch drop **AFTER DRILLING** ---

GENERAL BH / TP / WELL - GINT STD U.S. GDT - 4/15/25 14:06 - C:\USERS\ANTHONY.COYNE\ONE\DRIVE - OTTO ROSENAU\GEO\TECH\GINT\PROJECTS\FIRE STATION 32 MONROE.GPJ

DEPTH (ft)	SAMPLE TYPE NUMBER	RECOVERY %	BLOW COUNTS (N VALUE)	TESTS	U.S.C.S.	GRAPHIC LOG	MATERIAL DESCRIPTION
0							
					SM		SILTY SAND, (SM) brown, moist, medium dense, some gravel, (Fill) 72.0
	SPT 1	67	5-3-4 (7)	MC = 21%	ML		SILT, (ML) light grayish brown, moist, medium stiff, iron oxide staining, (Alluvium)
5	SPT 2	100	2-2-2 (4)	MC = 32%	ML		SILT, (ML) light grayish brown, moist, soft, iron oxide staining, (Alluvium) 68.0
	SPT 3	100	2-2-4 (6)	MC = 27%	SM		SILTY SAND, (SM) grayish brown, moist, very loose, trace wood debris, (Alluvium)
	SPT 4	100	5-8-7 (15)	MC = 19%	SM		SILTY SAND, (SM) grayish brown, moist, very loose, (Alluvium) 65.5
10	SPT 5	100	5-7-5 (12)	MC = 13%	SP-SM		POORLY GRADED SAND WITH SILT, (SP-SM) gray, fine to medium grained, moist, very loose to loose, (Alluvium)
	SPT 6	100	1-2-2 (4)	MC = 27%	SP-SM		POORLY GRADED SAND WITH SILT, (SP-SM) gray, fine to medium grained, wet, medium dense, (Alluvium) 60.5
15					SM		SILTY SAND, (SM) gray, wet, medium dense, (Alluvium)
					SM		SILTY SAND, (SM) gray, wet, very loose to loose, (Alluvium) 57.5

Bottom of borehole at 16.5 feet.



Otto Rosenau & Associates, Inc.
 6747 Martin Luther King Jr Way South
 Seattle, WA 98118
 Telephone: (206) 725-4600

WELL NUMBER B-4

PAGE 1 OF 2

CLIENT Snohomish Regional Fire & Rescue **PROJECT NAME** Fire Station 32 Site Evaluation
PROJECT NUMBER 24-0267 **PROJECT LOCATION** 19959 Oaks St, Monroe, WA
DATE STARTED 3/26/25 **COMPLETED** 3/26/25 **GROUND ELEVATION** 76 ft NAVD 88 **HOLE SIZE** 6-inch diameter
DRILLING CONTRACTOR Holt Services, Inc. **GROUND WATER LEVELS:**
DRILLING METHOD Terra Sonic 150 CC Track Sonic Rig - 6" Casing/4" Core **AT TIME OF DRILLING** ---
LOGGED BY Anthony Coyne, PE **CHECKED BY** Anthony Coyne, PE **AT END OF DRILLING** 0.50 ft / Elev 75.50 ft
NOTES SPT sampler, 140-pound automatic hammer, 30-inch drop **220hrs AFTER DRILLING** 0.00 ft / Elev 76.00 ft

GENERAL BH / TP / WELL - GINT STD US.GDT - 4/15/25 14:06 - C:\USERS\ANTHONY.COYNE\ONE\DRIVE - OTTO ROSENAU\GEO\TECH\GINT\PROJECTS\FIRE STATION 32 MONROE.GPJ

DEPTH (ft)	SAMPLE TYPE NUMBER	RECOVERY %	BLOW COUNTS (N VALUE)	TESTS	U.S.C.S. GRAPHIC LOG	MATERIAL DESCRIPTION	WELL DIAGRAM
0							Casing Top Elev: 0 (ft) Casing Type: VWP
0 - 2.5					GW-GM	WELL GRADED GRAVEL WITH SILT AND SAND, (GW-GM) brown, moist to wet, medium dense to dense, and cobbles, (Fill)	
2.5 - 5	GB 1			MC = 46%	MH	ELASTIC SILT, (MH) blueish gray, moist to wet, soft to medium stiff, Grab sample taken from cored material	
5 - 7.5	SPT 2	78	1-1-1 (2)	MC = 60% LL = 58 PL = 35 , AL	MH	ELASTIC SILT, (MH) blueish gray, moist to wet, soft to medium stiff, high plasticity, with wood debris	
7.5 - 10	GB 3			MC = 18%	SP-SM	(SP-SM) Grab sample taken from cored material	
10 - 17.0	SPT 4	67	2-2-2 (4)	MC = 24% Fines = 11% , GS	SP-SM	POORLY GRADED SAND WITH SILT, (SP-SM) blueish gray, fine to medium grained, wet, loose, with wood debris Grades to fine Sand with Silt from 12 ft to 13 ft Grades to fine to medium Sand with Silt from 13 ft to 14 ft Grades to fine Sand with Silt at 14 ft	
17.0 - 19.0	SPT 5	78	7-7-8 (15)	MC = 20%	SP-SM	POORLY GRADED SAND WITH SILT, (SP-SM) blueish gray, fine grained, wet, loose, with wood debris	
19.0 - 20					ML	SILT, (ML) blueish gray, wet, soft to medium stiff, low plasticity	
20 - 25	SPT 6	100	2-2-1 (3)	MC = 30% LL = 26 PL = 19 , AL	CL-ML	LEAN CLAY, SILTY, (CL-ML) blueish gray, wet, very soft to soft	



Otto Rosenau & Associates, Inc.
 6747 Martin Luther King Jr Way South
 Seattle, WA 98118
 Telephone: (206) 725-4600

WELL NUMBER B-4

PAGE 2 OF 2

CLIENT Snohomish Regional Fire & Rescue

PROJECT NAME Fire Station 32 Site Evaluation

PROJECT NUMBER 24-0267

PROJECT LOCATION 19959 Oaks St, Monroe, WA

GENERAL BH / TP / WELL - GINT STD U.S.GDT - 4/15/25 14:06 - C:\USERS\ANTHONY.COYNE\ONE\DRIVE - OTTO ROSENAU\GEO\TECH\GINT\PROJECTS\FIRE STATION 32 MONROE.GPJ

DEPTH (ft)	SAMPLE TYPE NUMBER	RECOVERY %	BLOW COUNTS (N VALUE)	TESTS	U.S.C.S.	GRAPHIC LOG	MATERIAL DESCRIPTION	WELL DIAGRAM
25	GB 7			MC = 27%	CL-ML		LEAN CLAY, SILTY, (CL-ML) blueish gray, wet, very soft to soft, Grab sample taken from cored material	
30	GB 8		MC = 50%	GP-GM		(GP-GM) Artesian groundwater pressure observed between 21.5 feet and 25 feet. Moderate artesian flow at ground surface with casing tip at 25 feet. No SPT sampling attempted for remainder of boring. Cored material was highly disturbed from 25 to 30 feet and appeared to consist of fine gravel and medium to coarse sand. (Tip of vibrating wire piezometer installed at depth of 30 feet)		
35	GB 9		MC = 29%	ML		PEAT, (PT) dark brown, moist, stiff, Grab sample taken from cored material SILT, (ML) blueish gray, moist, medium stiff to stiff, low plasticity, with peat, and wood debris, Grab sample taken from cored material		
40	GB 10		MC = 30%	ML		SILT, (ML) blueish gray, moist, medium stiff to stiff, low plasticity, some peat, Grab sample taken from cored material		

Groundwater observed at ground surface with no groundwater flow from casing with tip of casing at 40.0 feet.
 Bottom of borehole at 40.0 feet.



Otto Rosenau & Associates, Inc.
 6747 Martin Luther King Jr Way South
 Seattle, WA 98118
 Telephone: (206) 725-4600

WELL NUMBER B-5

PAGE 1 OF 1

CLIENT Snohomish Regional Fire & Rescue **PROJECT NAME** Fire Station 32 Site Evaluation
PROJECT NUMBER 24-0267 **PROJECT LOCATION** 19959 Oaks St, Monroe, WA
DATE STARTED 3/27/25 **COMPLETED** 3/27/25 **GROUND ELEVATION** 75 ft NAVD 88 **HOLE SIZE** 6-inch diameter
DRILLING CONTRACTOR Holt Services, Inc. **GROUND WATER LEVELS:**
DRILLING METHOD Terra Sonic 150 CC Track Sonic Rig - 6" Casing/4" Core **AT TIME OF DRILLING** ---
LOGGED BY Anthony Coyne, PE **CHECKED BY** Anthony Coyne, PE **AT END OF DRILLING** 6.27 ft / Elev 68.73 ft
NOTES SPT sampler, 140-pound automatic hammer, 30-inch drop **195hrs AFTER DRILLING** 6.62 ft / Elev 68.38 ft

GENERAL BH / TP / WELL - GINT STD U.S.GDT - 4/15/25 14:06 - C:\USERS\ANTHONY.COYNE\ONE\DRIVE - OTTO ROSENAU\GEO\TECH\GINT\PROJECTS\FIRE STATION 32\MONROE.GPJ

DEPTH (ft)	SAMPLE TYPE NUMBER	RECOVERY %	BLOW COUNTS (N VALUE)	TESTS	U.S.C.S.	GRAPHIC LOG	MATERIAL DESCRIPTION	WELL DIAGRAM
0								Casing Top Elev: 74.6 (ft) Casing Type: 2" PVC Pipe
2.0					GW-GM		WELL GRADED GRAVEL WITH SILT AND SAND, (GW-GM) brown, moist, medium dense to dense, (Fill)	Steel Flush Monument set in concrete WA DOE Well Tag # BQM 957 Bentonite Chips
4.0					ML		SILT, (ML) dark brown, moist, medium stiff to stiff, with sand, gravel, and organics, (Fill)	
7.5	SPT 1	89	2-2-2 (4)	MC = 36%	ML		SILT, (ML) gray, moist to wet, soft to medium stiff, trace organics, iron oxide staining	Solid pipe with 12/20 Sand Filter
9.5					SP-SM		POORLY GRADED SAND WITH SILT, (SP-SM) blueish gray, fine to medium grained, wet, loose, (increasing coarseness with depth)	
12.0	SPT 2	6	1-1-1 (2)	MC = 16%	SW-SM		WELL GRADED SAND WITH SILT, (SW-SM) blueish gray, fine to coarse grained, wet, loose	Slotted pipe with 12/20 Sand Filter
14.5					ML		SILT, (ML) gray, wet, soft to medium stiff	
16.5	SPT 3	100	6-8-5 (13)	MC = 24% Fines = 6% , GS	SP-SM		POORLY GRADED SAND WITH SILT, (SP-SM) gray, fine to medium grained, wet, medium dense	Cap
Bottom of borehole at 16.5 feet.								




Otto Rosenau & Associates, Inc.
 6747 Martin Luther King Jr Way South
 Seattle, WA 98118
 Telephone: (206) 725-4600

WELL NUMBER B-6

PAGE 1 OF 1

CLIENT Snohomish Regional Fire & Rescue **PROJECT NAME** Fire Station 32 Site Evaluation
PROJECT NUMBER 24-0267 **PROJECT LOCATION** 19959 Oaks St, Monroe, WA
DATE STARTED 3/27/25 **COMPLETED** 3/27/25 **GROUND ELEVATION** 76 ft NAVD 88 **HOLE SIZE** 6-inch diameter
DRILLING CONTRACTOR Holt Services, Inc. **GROUND WATER LEVELS:**
DRILLING METHOD Terra Sonic 150 CC Track Sonic Rig - 6" Casing/4" Core **AT TIME OF DRILLING** ---
LOGGED BY Anthony Coyne, PE **CHECKED BY** Anthony Coyne, PE **AT END OF DRILLING** 5.11 ft / Elev 70.89 ft
NOTES SPT sampler, 140-pound automatic hammer, 30-inch drop **188hrs AFTER DRILLING** 5.13 ft / Elev 70.87 ft

GENERAL BH / TP / WELL - GINT STD U.S. GDT - 4/15/25 14:06 - C:\USERS\ANTHONY.COYNE\ONE\DRIVE - OTTO ROSENAU\GEO\TECH\GINT\PROJECTS\FIRE STATION 32\MONROE.GPJ

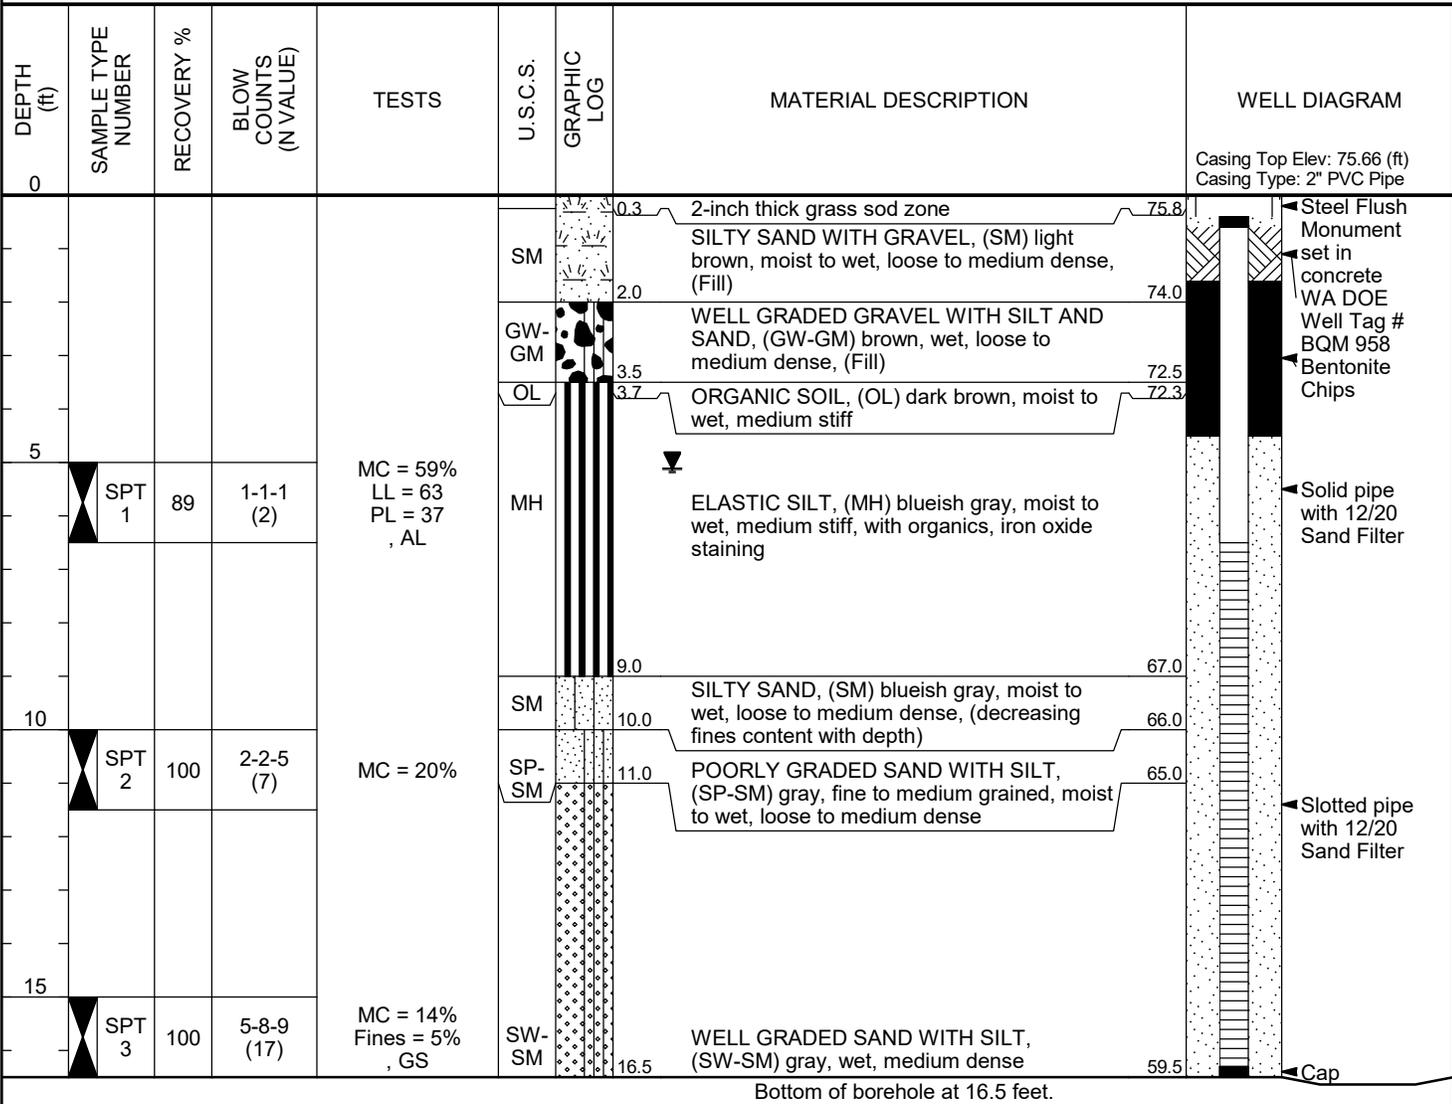



Otto Rosenau & Associates, Inc.
 6747 Martin Luther King Jr Way South
 Seattle, WA 98118
 Telephone: (206) 725-4600

WELL NUMBER B-7

PAGE 1 OF 1

CLIENT Snohomish Regional Fire & Rescue **PROJECT NAME** Fire Station 32 Site Evaluation
PROJECT NUMBER 24-0267 **PROJECT LOCATION** 19959 Oaks St, Monroe, WA
DATE STARTED 3/27/25 **COMPLETED** 3/27/25 **GROUND ELEVATION** 76 ft NAVD 88 **HOLE SIZE** 6-inch diameter
DRILLING CONTRACTOR Holt Services, Inc. **GROUND WATER LEVELS:**
DRILLING METHOD Terra Sonic 150 CC Track Sonic Rig - 6" Casing/4" Core **AT TIME OF DRILLING** ---
LOGGED BY Anthony Coyne, PE **CHECKED BY** Anthony Coyne, PE **AT END OF DRILLING** 4.82 ft / Elev 71.18 ft
NOTES SPT sampler, 140-pound automatic hammer, 30-inch drop **188hrs AFTER DRILLING** 5.19 ft / Elev 70.81 ft

GENERAL BH / TP / WELL - GINT STD U.S.GDT - 4/15/25 14:06 - C:\USERS\ANTHONY.COYNE\ONE\DRIVE - OTTO ROSENAU\GEO\TECH\GINT\PROJECTS\FIRE STATION 32\MONROE.GPJ

DEPTH (ft)	SAMPLE TYPE NUMBER	RECOVERY %	BLOW COUNTS (N VALUE)	TESTS	U.S.C.S.	GRAPHIC LOG	MATERIAL DESCRIPTION	WELL DIAGRAM
0								Casing Top Elev: 75.64 (ft) Casing Type: 2" PVC Pipe
1.0					GM		SILTY GRAVEL WITH SAND, (GM) brown, moist, (Fill)	75.0
3.5					ML		SILT, (ML) dark brown black, moist, medium stiff to stiff, with organics, (Fill)	72.5
7.0	SPT 1	100	1-2-2 (4)	MC = 31%	ML		SILT, (ML) blueish gray, moist to wet, soft to medium stiff, trace organics	69.0
12.0	SPT 2	100	2-5-9 (14)	MC = 25% Fines = 21% GS	SP-SM		POORLY GRADED SAND WITH SILT, (SP-SM) gray, fine to medium grained, wet	64.0
15.0					SW-SM		WELL GRADED SAND WITH SILT, (SW-SM) blueish gray, wet, (occasional 2- to 3-inch thick silt seams)	61.0
16.5	SPT 3	100	6-6-8 (14)	MC = 20%	ML		SILT, (ML) blueish gray, wet, non plastic	59.5

Bottom of borehole at 16.5 feet.



PRESENTATION OF SITE INVESTIGATION RESULTS

Prospective Fire Station, Monroe, WA

Prepared for:

Otto Rosenau & Associates, Inc.

ConeTec Job No: 24-59-27735

Project Start Date: 2024-05-28

Project End Date: 2024-05-28

Release Date: 2024-05-31

Report Prepared by:

ConeTec, Inc.


1237 S Director Street, Seattle, WA 98108

Tel: (253) 397-4861

ConeTecWA@conetec.com

www.conetec.com

www.conetecdataservices.com



© 2024 ConeTec Group of Companies. All Rights Reserved.

CONETEC

ABOUT THIS REPORT

The enclosed report presents the results of the site investigation program conducted by ConeTec, Inc. for Otto Rosenau & Associates, Inc..

Please note that this report, which also includes all accompanying data, are subject to the 3rd Party Disclaimer and Client Disclaimer that follow in the 'Limitations' section of this report. Please refer to the list of attached documents following the text of this report. A site map, test summaries, and test plots are all included in the body of the report.

Project	
Client	Otto Rosenau & Associates, Inc.
Project	Prospective Fire Station, Monroe, WA
ConeTec Project Number	24-59-27735
Test Types	CPTu/SCPTu
Additional Comments	None

Contents

The following listed below are included in the body of this report:

- Site Map
- Limitations and Closure
- Project Information
- Report Appendices

SITE MAP



All locations are approximate unless otherwise stated in the body of the report.

ConeTec Job Number: 24-59-27735

Client: Otto Rosenau & Associates, Inc.

Project: Prospective Fire Station, Monroe, WA

Date: 2024-05-31

LIMITATIONS

3rd Party Disclaimer

The “Report” refers to this report titled: Prospective Fire Station, Monroe, WA

The Report was prepared by ConeTec for: Otto Rosenau & Associates, Inc.

The Report is confidential and may not be distributed to or relied upon by any third parties without the express written consent of ConeTec. Any third parties gaining access to the Report do not acquire any rights as a result of such access. Any use which a third party makes of the Report, or any reliance on or decisions made based on it, are the responsibility of such third parties. ConeTec accepts no responsibility for loss, damage and/or expense, if any, suffered by any third parties as a result of decisions made, or actions taken or not taken, which are in any way based on, or related to, the Report or any portion(s) thereof.

Client Disclaimer

ConeTec was retained by: Otto Rosenau & Associates, Inc.

The “Report” refers to this report titled: Prospective Fire Station, Monroe, WA

ConeTec was retained to collect and provide the raw data (“Data”) which is included in the Report.

ConeTec has collected and reported the Data in accordance with current industry standards. No other warranty, express or implied, with respect to the Data is made by ConeTec. In order to properly understand the Data included in the Report, reference must be made to the documents accompanying and other sources referenced in the Report in their entirety. Other than the Data, the contents of the Report (including any Interpretations) should not be relied upon in any fashion without independent verification and ConeTec is in no way responsible for any loss, damage or expense resulting from the use of, and/or reliance on, such material by any party.

Closure

Thank you for the opportunity to work on this project. The equipment used as well the field procedures followed, all complied with current accepted best practice standards.

Report prepared by: MH JM

PROJECT INFORMATION

Rig		
Description	Deployment System	Test Type
C02-023 CPT Truck Rig	Twin mounted cylinders	CPTu/SCPTu

Coordinates		
Test Type	Collection Method	EPSG Number
CPTu/SCPTu	Consumer Grade GPS	4326 (WGS84 / LatLong)

Piezocones Used for this Project						
Cone Description	Cone Number	Cross Sectional Area (cm ²)	Sleeve Area (cm ²)	Tip Capacity (bar)	Sleeve Capacity (bar)	Pore Pressure Capacity (bar)
EC855:T1500F15U35	855	15	225	1500	15	35

Cone Penetration Test (CPTu)	
Depth reference	Depths are referenced to the existing ground surface at the time of each test.
Tip and sleeve data offset	0.1 Meters. This has been accounted for in the CPT data files.

Calculated Geotechnical Parameters

Additional information

The Normalized Soil Behaviour Type Chart based on Q_{tn} (SBT Q_{tn}) (Robertson, 2009) was used to classify the soil for this project. A detailed set of calculated CPTu parameters have been generated and are provided in Excel format files in the release folder. The CPTu parameter calculations are based on values of corrected tip resistance (q_t) sleeve friction (f_s) and pore pressure (u_2).

Effective stresses are calculated based on unit weights that have been assigned to the individual soil behaviour type zones and the assumed equilibrium pore pressure profile.

Soils were classified as either drained or undrained based on the Q_{tn} Normalized Soil Behaviour Type Chart (Robertson, 2009). Calculations for both drained and undrained parameters were included for materials that classified as silt mixtures (zone 4).

REPORT APPENDICES

The appendices listed below are included in the report:

- **Cone Penetration Test (CPTu) Summary and Standard CPTu Plots**
- **Advanced Cone Penetration Test Plots**
- **Soil Behavior Type (SBT) Scatter Plots**
- **Pore Pressure Dissipation Test (PPDT) Summary and PPDT Plots**
- **Seismic Cone Penetration Test (SCPTu) Tabular Results**
- **SCPTu Plots**
- **SCPTu Velocity Wave Traces**
- **Supplementary Documents and Materials**

**Cone Penetration Test (CPTu) Summary and Standard
CPTu Plots**




Job No: 24-59-27735
Client: Otto Rosenau & Associates, Inc.
Project: Prospective Fire Station, Monroe, WA
Start Date: 2024-05-28
End Date: 2024-05-28

CONE PENETRATION TEST SUMMARY

Sounding ID	File Name	Date	Cone	Cone Area (cm ²)	Assumed Phreatic Surface ¹ (ft)	Final Depth (ft)	Seismic Intervals	Latitude ²	Longitude ²	Refer to Notation Number
CPT-01	24-59-27735_SP01	2024-05-28	855:T1500F15U35	15	6.2	41.99	12	47.86088	-121.96446	
CPT-02	24-59-27735_CP02	2024-05-28	855:T1500F15U35	15	6.2	34.53		47.86070	-121.96387	3
Totals	2 Soundings					76.52 ft	12			

1. The assumed phreatic surface was based off the shallowest pore pressure dissipation tests performed within or nearest the sounding. Hydrostatic conditions were assumed for the calculated parameters.
2. The coordinates were collected using consumer grade GPS. EPSG number: 4326 (WGS84 / LatLong).
3. The assumed phreatic surface was based on the shallowest pore pressure dissipation test performed in the adjacent sounding (CPT-01).

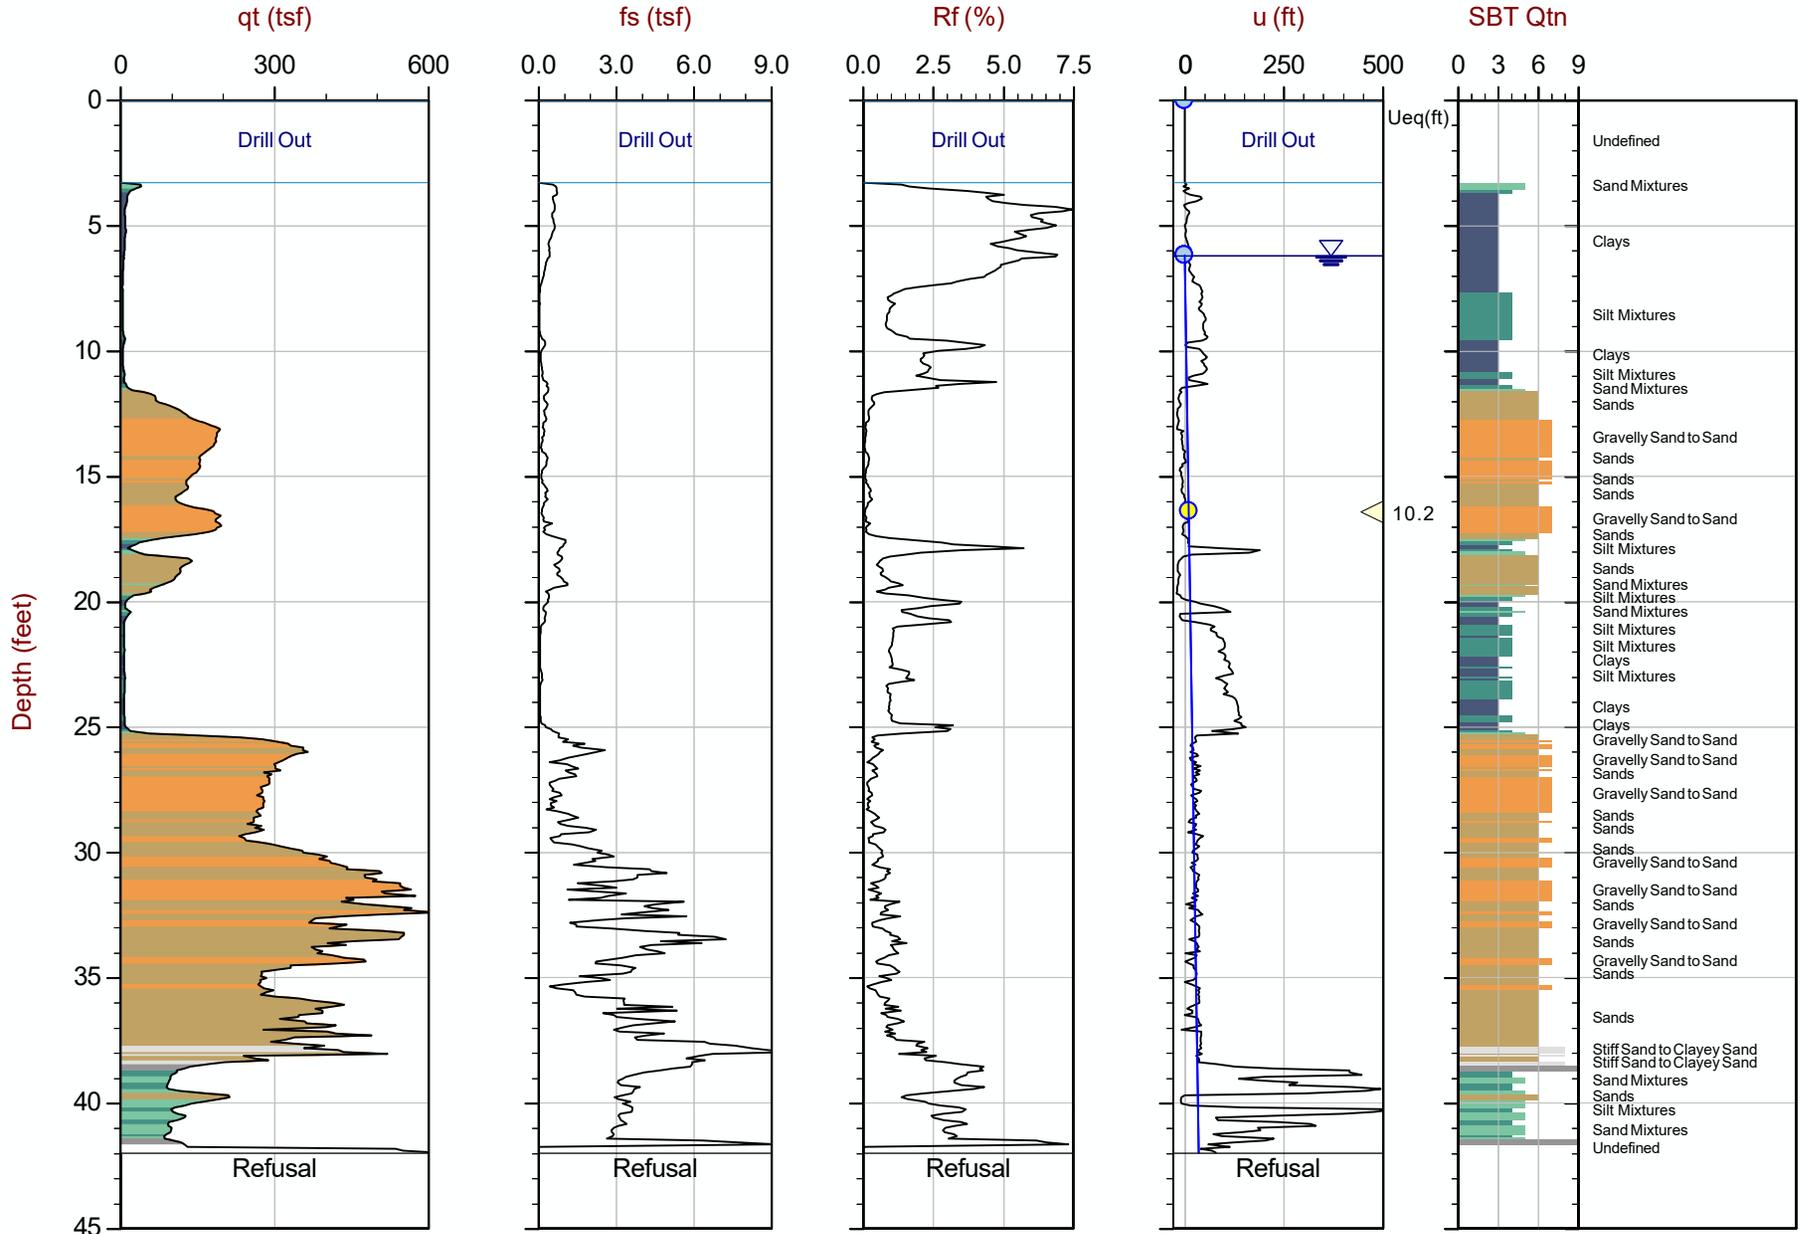


Max Depth: 12.800 m / 41.99 ft
 Depth Inc: 0.025 m / 0.082 ft
 Avg Int: Every Point

File: 24-59-27735_SP01.COR
 Unit Wt: SBTQtn(PKR2009)

SBT: Robertson, 2009 and 2010
 Coords: Lat: 47.86088 Long: -121.96446

Overplot Item: ● Ueq ● Assumed Ueq ◁ Dissipation, Ueq achieved ▲ Dissipation, Ueq not achieved ◁ Dissipation, Ueq assumed — Hydrostatic Line

The reported coordinates were acquired from consumer grade GPS equipment and are only approximate locations. The coordinates should not be used for design purposes.

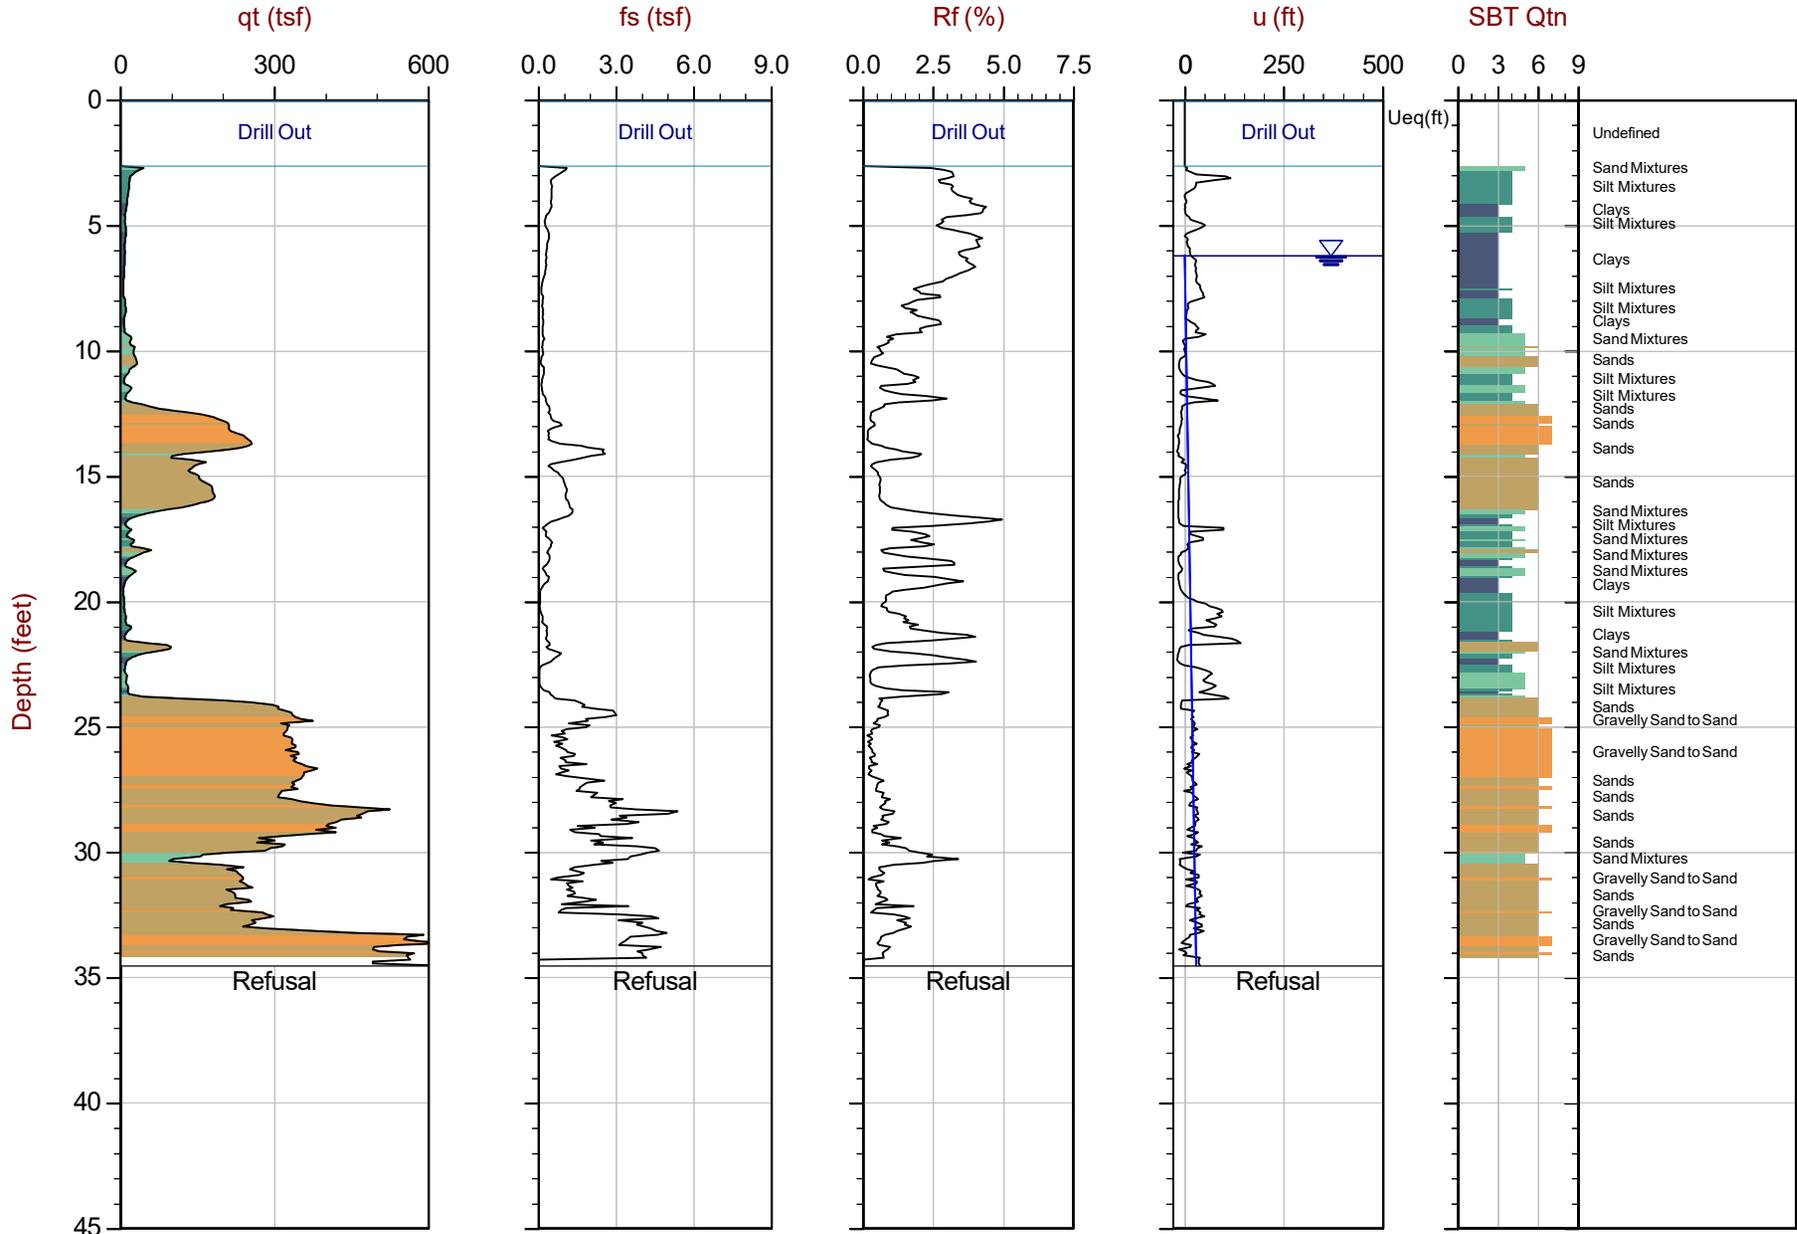


Max Depth: 10.525 m / 34.53 ft
 Depth Inc: 0.025 m / 0.082 ft
 Avg Int: Every Point

File: 24-59-27735_CP02.COR
 Unit Wt: SBTQtn(PKR2009)

SBT: Robertson, 2009 and 2010
 Coords: Lat: 47.86069 Long: -121.96387

Overplot Item: ● Ueq ● Assumed Ueq ◁ Dissipation, Ueq achieved ▷ Dissipation, Ueq not achieved ◁ Dissipation, Ueq assumed — Hydrostatic Line
 The reported coordinates were acquired from consumer grade GPS equipment and are only approximate locations. The coordinates should not be used for design purposes.

Advanced Cone Penetration Test Plots with I_c , $S_u(N_{kt})$, Φ , and $N1(60)I_c$

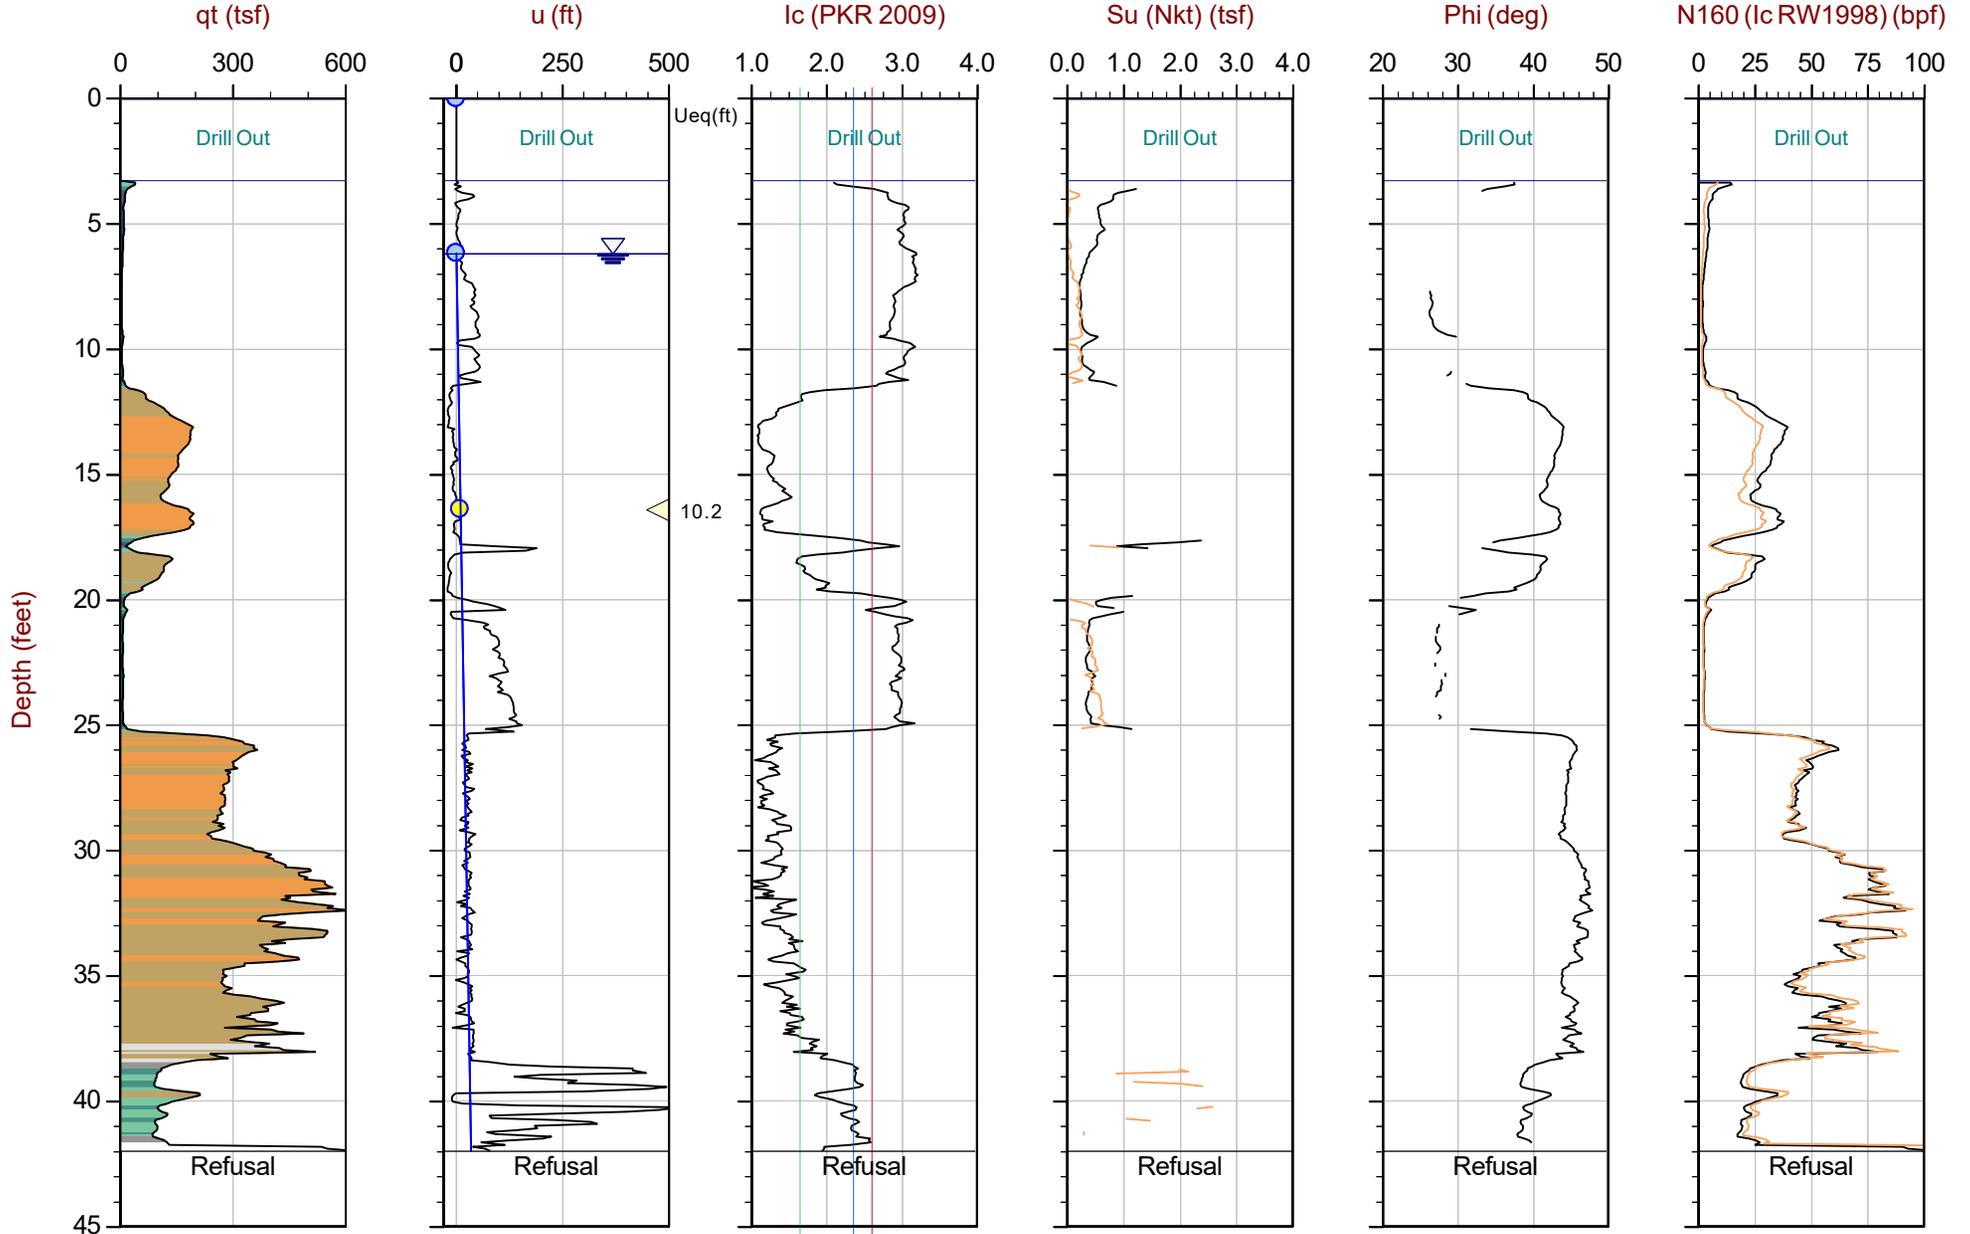


Max Depth: 12.800 m / 41.99 ft
 Depth Inc: 0.025 m / 0.082 ft
 Avg Int: Every Point

File: 24-59-27735_SP01.COR
 Unit Wt: SBTQtn(PKR2009)
 Su Nkt/Ndu: 15.0 / 6.0

SBT: Robertson, 2009 and 2010
 Coords: Lat: 47.86088 Long: -121.96446

Overplot Item: ● Ueq ● Assumed Ueq ◁ Dissipation, Ueq achieved ▷ Dissipation, Ueq not achieved ◁ Dissipation, Ueq assumed — Hydrostatic Line

The reported coordinates were acquired from consumer grade GPS equipment and are only approximate locations. The coordinates should not be used for design purposes.

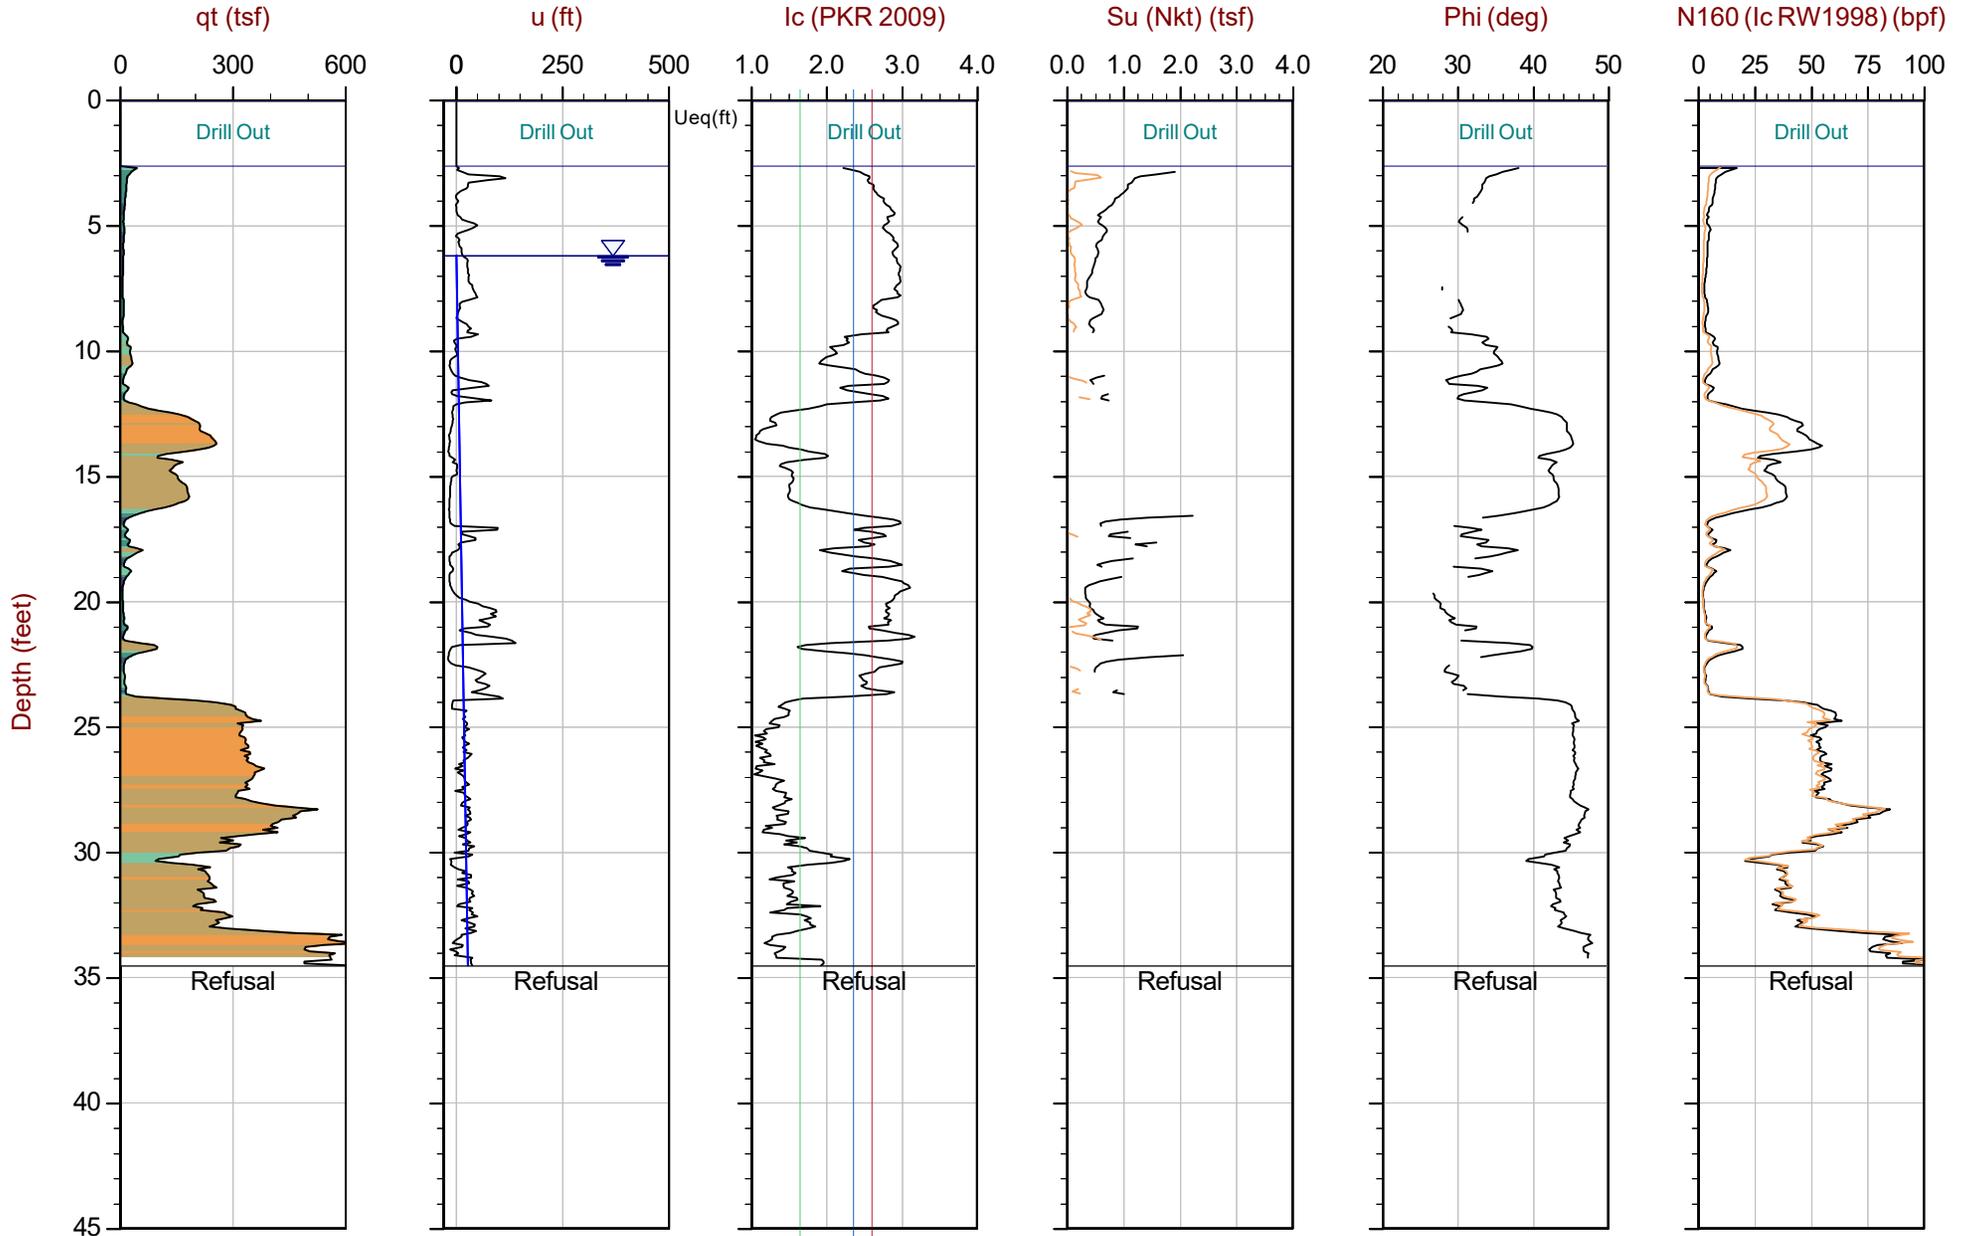

Max Depth: 10.525 m / 34.53 ft
 Depth Inc: 0.025 m / 0.082 ft
 Avg Int: Every Point




File: 24-59-27735_CP02.COR
 Unit Wt: SBTQtn(PKR2009)
 Su Nkt/Ndu: 15.0 / 6.0

SBT: Robertson, 2009 and 2010
 Coords: Lat: 47.86069 Long: -121.96387

Overplot Item: ● Ueq ● Assumed Ueq ◁ Dissipation, Ueq achieved ◁ Dissipation, Ueq not achieved ◁ Dissipation, Ueq assumed — Hydrostatic Line

The reported coordinates were acquired from consumer grade GPS equipment and are only approximate locations. The coordinates should not be used for design purposes.

Soil Behavior Type (SBT) Scatter Plots

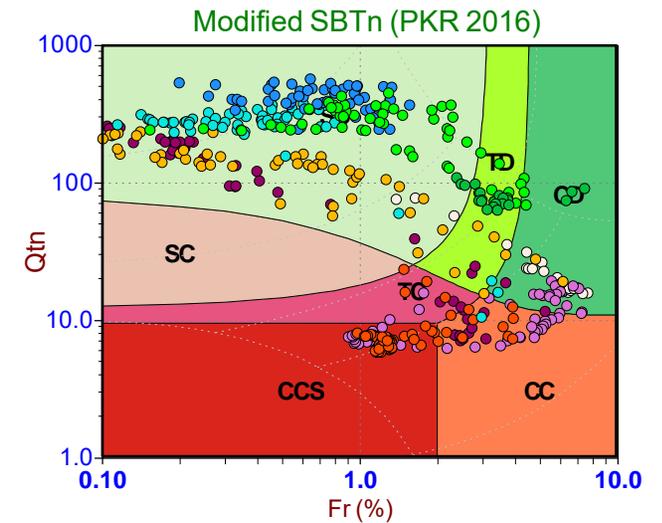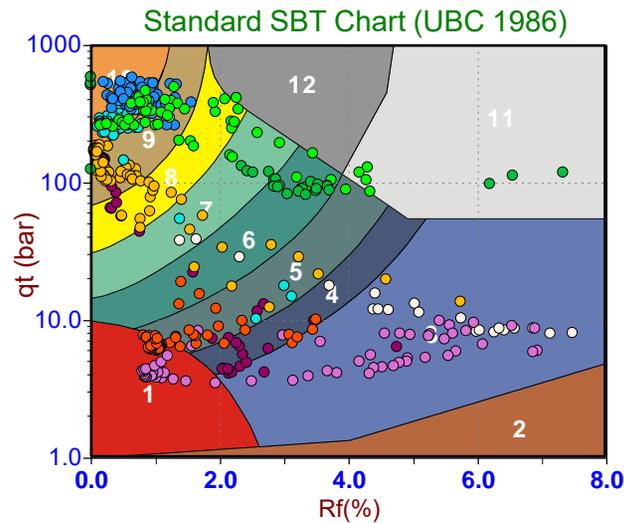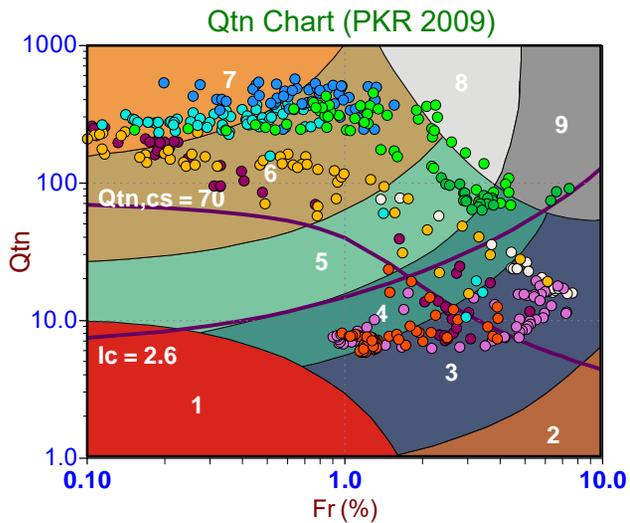

Depth Ranges

- >0.0 to 5.0 ft
- >5.0 to 10.0 ft
- >10.0 to 15.0 ft
- >15.0 to 20.0 ft
- >20.0 to 25.0 ft
- >25.0 to 30.0 ft
- >30.0 to 35.0 ft
- >35.0 to 40.0 ft
- >40.0 to 45.0 ft
- >45.0 to 50.0 ft
- >50.0 ft

Legend




- Sensitive, Fine Grained
- Organic Soils
- Clays
- Silt Mixtures
- Sand Mixtures
- Sands
- Gravelly Sand to Sand
- Stiff Sand to Clayey Sand
- Very Stiff Fine Grained

Legend

- Sensitive Fines
- Organic Soil
- Clay
- Silty Clay
- Clayey Silt
- Silt
- Sandy Silt
- Silty Sand/Sand
- Sand
- Gravelly Sand
- Stiff Fine Grained
- Cemented Sand

Legend

- CCS (Cont. sensitive clay like)
- CC (Cont. clay like)
- TC (Cont. transitional)
- SC (Cont. sand like)
- CD (Dil. clay like)
- TD (Dil. transitional)
- SD (Dil. sand like)

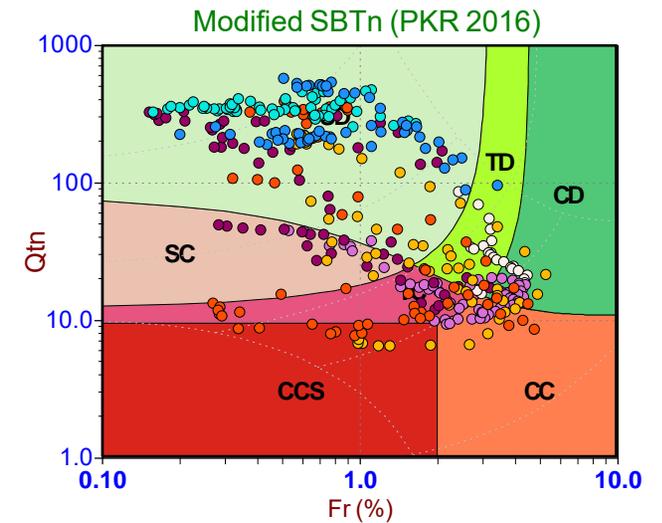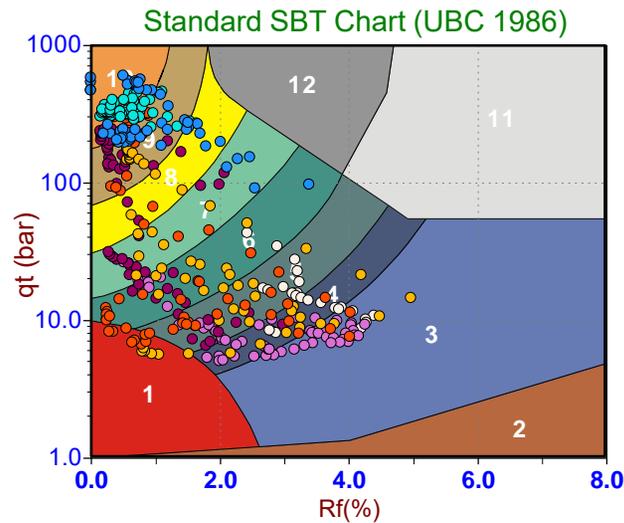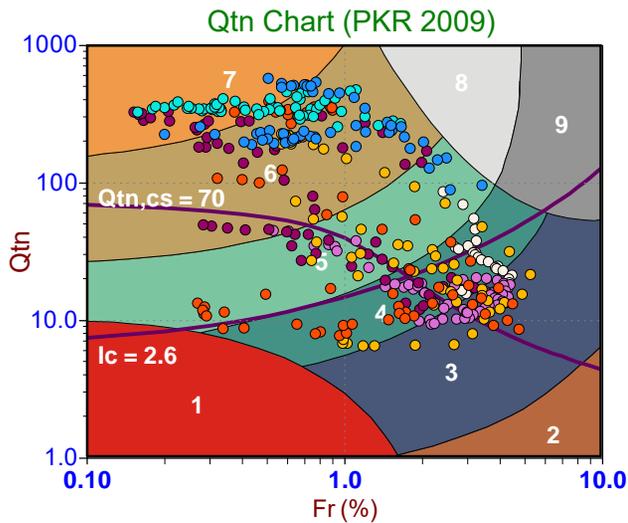

Depth Ranges

- >0.0 to 5.0 ft
- >5.0 to 10.0 ft
- >10.0 to 15.0 ft
- >15.0 to 20.0 ft
- >20.0 to 25.0 ft
- >25.0 to 30.0 ft
- >30.0 to 35.0 ft
- >35.0 to 40.0 ft
- >40.0 to 45.0 ft
- >45.0 to 50.0 ft
- >50.0 ft

Legend

- Sensitive, Fine Grained
- Organic Soils
- Clays
- Silt Mixtures
- Sand Mixtures
- Sands
- Gravelly Sand to Sand
- Stiff Sand to Clayey Sand
- Very Stiff Fine Grained

Legend

- Sensitive Fines
- Organic Soil
- Clay
- Silty Clay
- Clayey Silt
- Silt
- Sandy Silt
- Silty Sand/Sand
- Sand
- Gravelly Sand
- Stiff Fine Grained
- Cemented Sand

Legend

- CCS (Cont. sensitive clay like)
- CC (Cont. clay like)
- TC (Cont. transitional)
- SC (Cont. sand like)
- CD (Dil. clay like)
- TD (Dil. transitional)
- SD (Dil. sand like)

Pore Pressure Dissipation Test (PPDT) Summary and PPDT Plots



Job No: 24-59-27735
Client: Otto Rosenau & Associates, Inc.
Project: Prospective Fire Station, Monroe, WA
Start Date: 2024-05-28
End Date: 2024-05-28

CPT_u PORE PRESSURE DISSIPATION SUMMARY

Sounding ID	File Name	Cone Area (cm ²)	Duration (s)	Test Depth (ft)	Estimated Equilibrium Pore Pressure U _{eq} (ft)	Calculated Phreatic Surface (ft)	Refer to Notation Number
CPT-01	24-59-27735_SP01	15	490	16.40	10.2	6.2	
Totals			8 min				



Otto Rosenau & Associates


Job No: 24-59-27735

Date: 2024-05-28 08:54

Site: Prospective Fire Station, Monroe, WA

Sounding: CPT-01

Cone: 855:T1500F15U35 Area=15 cm²

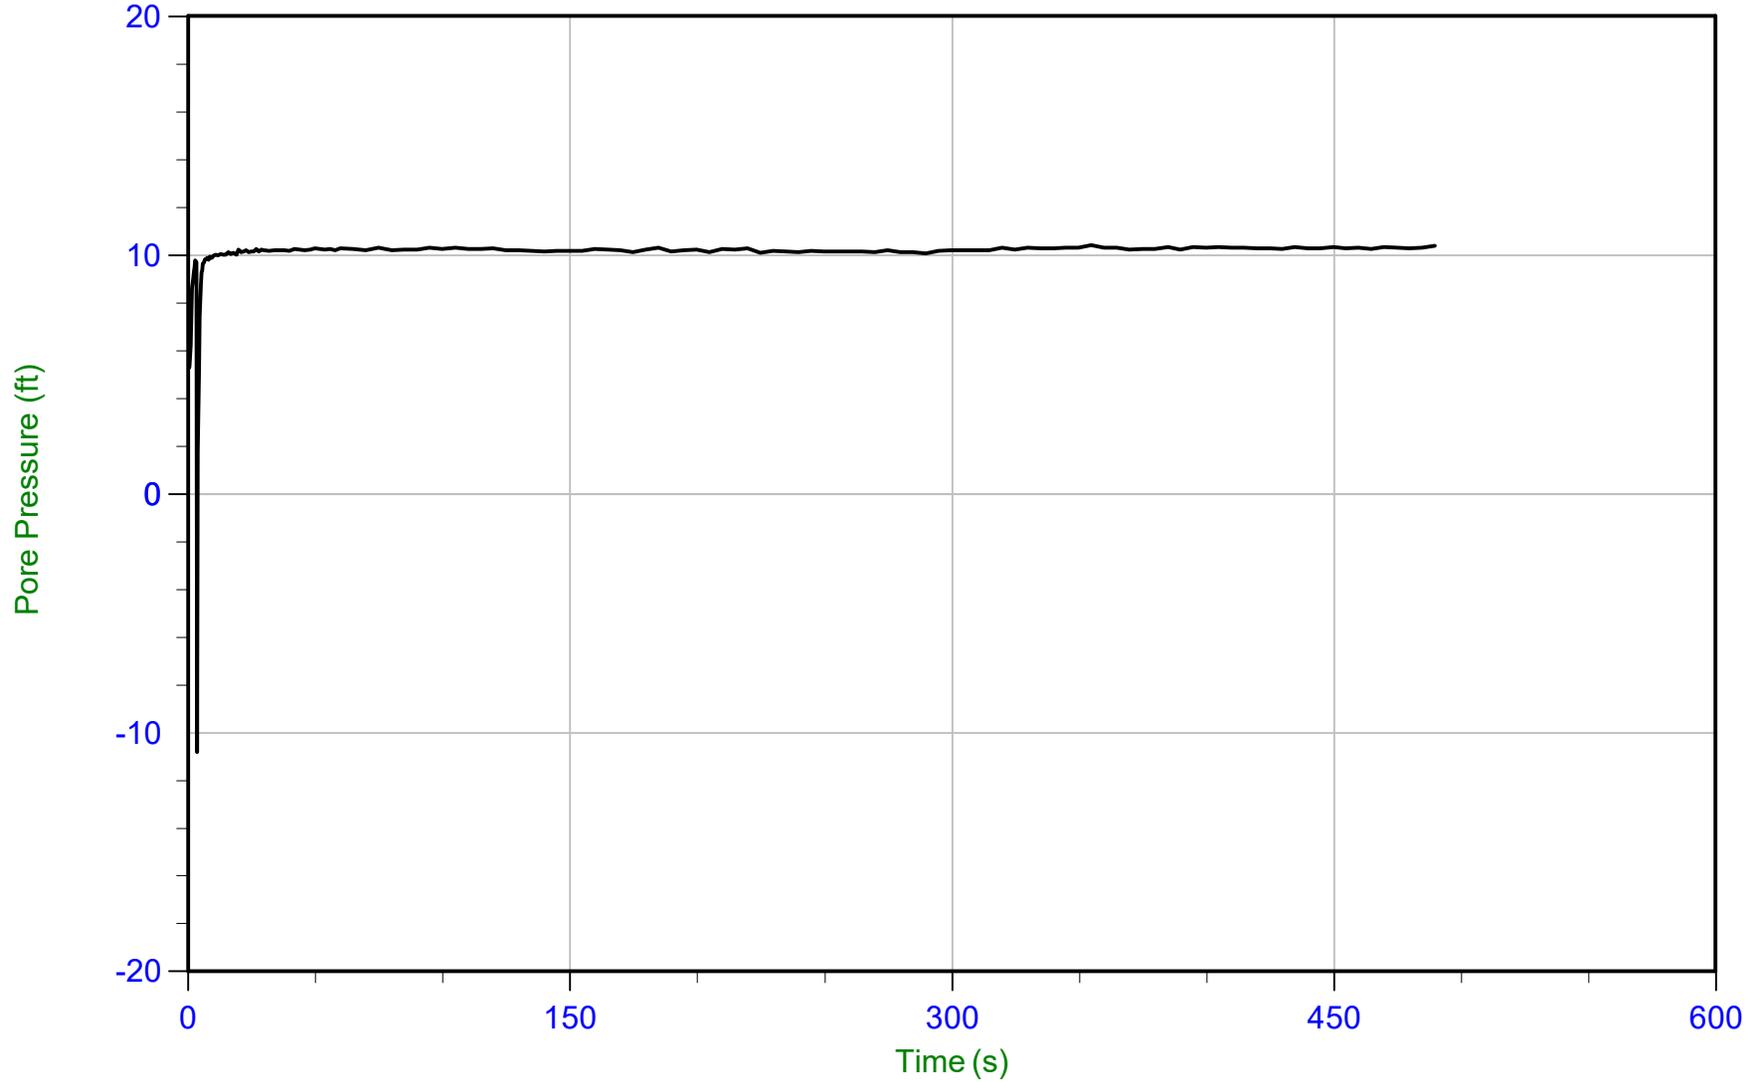

Trace Summary:

Filename: 24-59-27735_SP01.PPR3

Depth: 5.000 m / 16.404 ft

Duration: 490.0 s

u Min: -10.8 ft

u Max: 10.4 ft

u Final: 10.4 ft

WT: 1.888 m / 6.194 ft

Ueq: 10.2 ft

Seismic Cone Penetration Test (SCPTu) Tabular Results




Job No: 24-59-27735
Client: Otto Rosenau & Associates, Inc.
Project: Prospective Fire Station, Monroe, WA
Sounding ID: CPT-01
Date: 2024-05-28

Seismic Source: Beam
Seismic Offset (ft): 1.74
Source Depth (ft): 0.00
Geophone Offset (ft): 0.66

SCPT_u SHEAR WAVE VELOCITY TEST RESULTS - V_s

Tip Depth (ft)	Geophone Depth (ft)	Ray Path (ft)	Ray Path Difference (ft)	Travel Time Interval (ms)	Interval Velocity (ft/s)
6.56	5.91	6.16			
9.84	9.19	9.35	3.19	7.59	421
13.12	12.47	12.59	3.24	9.12	355
16.40	15.75	15.84	3.26	4.34	750
19.69	19.03	19.11	3.26	4.90	666
22.97	22.31	22.38	3.27	5.98	547
26.25	25.59	25.65	3.27	7.56	433
29.53	28.87	28.92	3.27	3.92	835
32.87	32.22	32.27	3.34	3.73	895
36.09	35.43	35.48	3.21	3.40	945
39.63	38.98	39.02	3.54	3.17	1118
42.00	41.34	41.38	2.36	3.30	716

SCPTu Test Plots

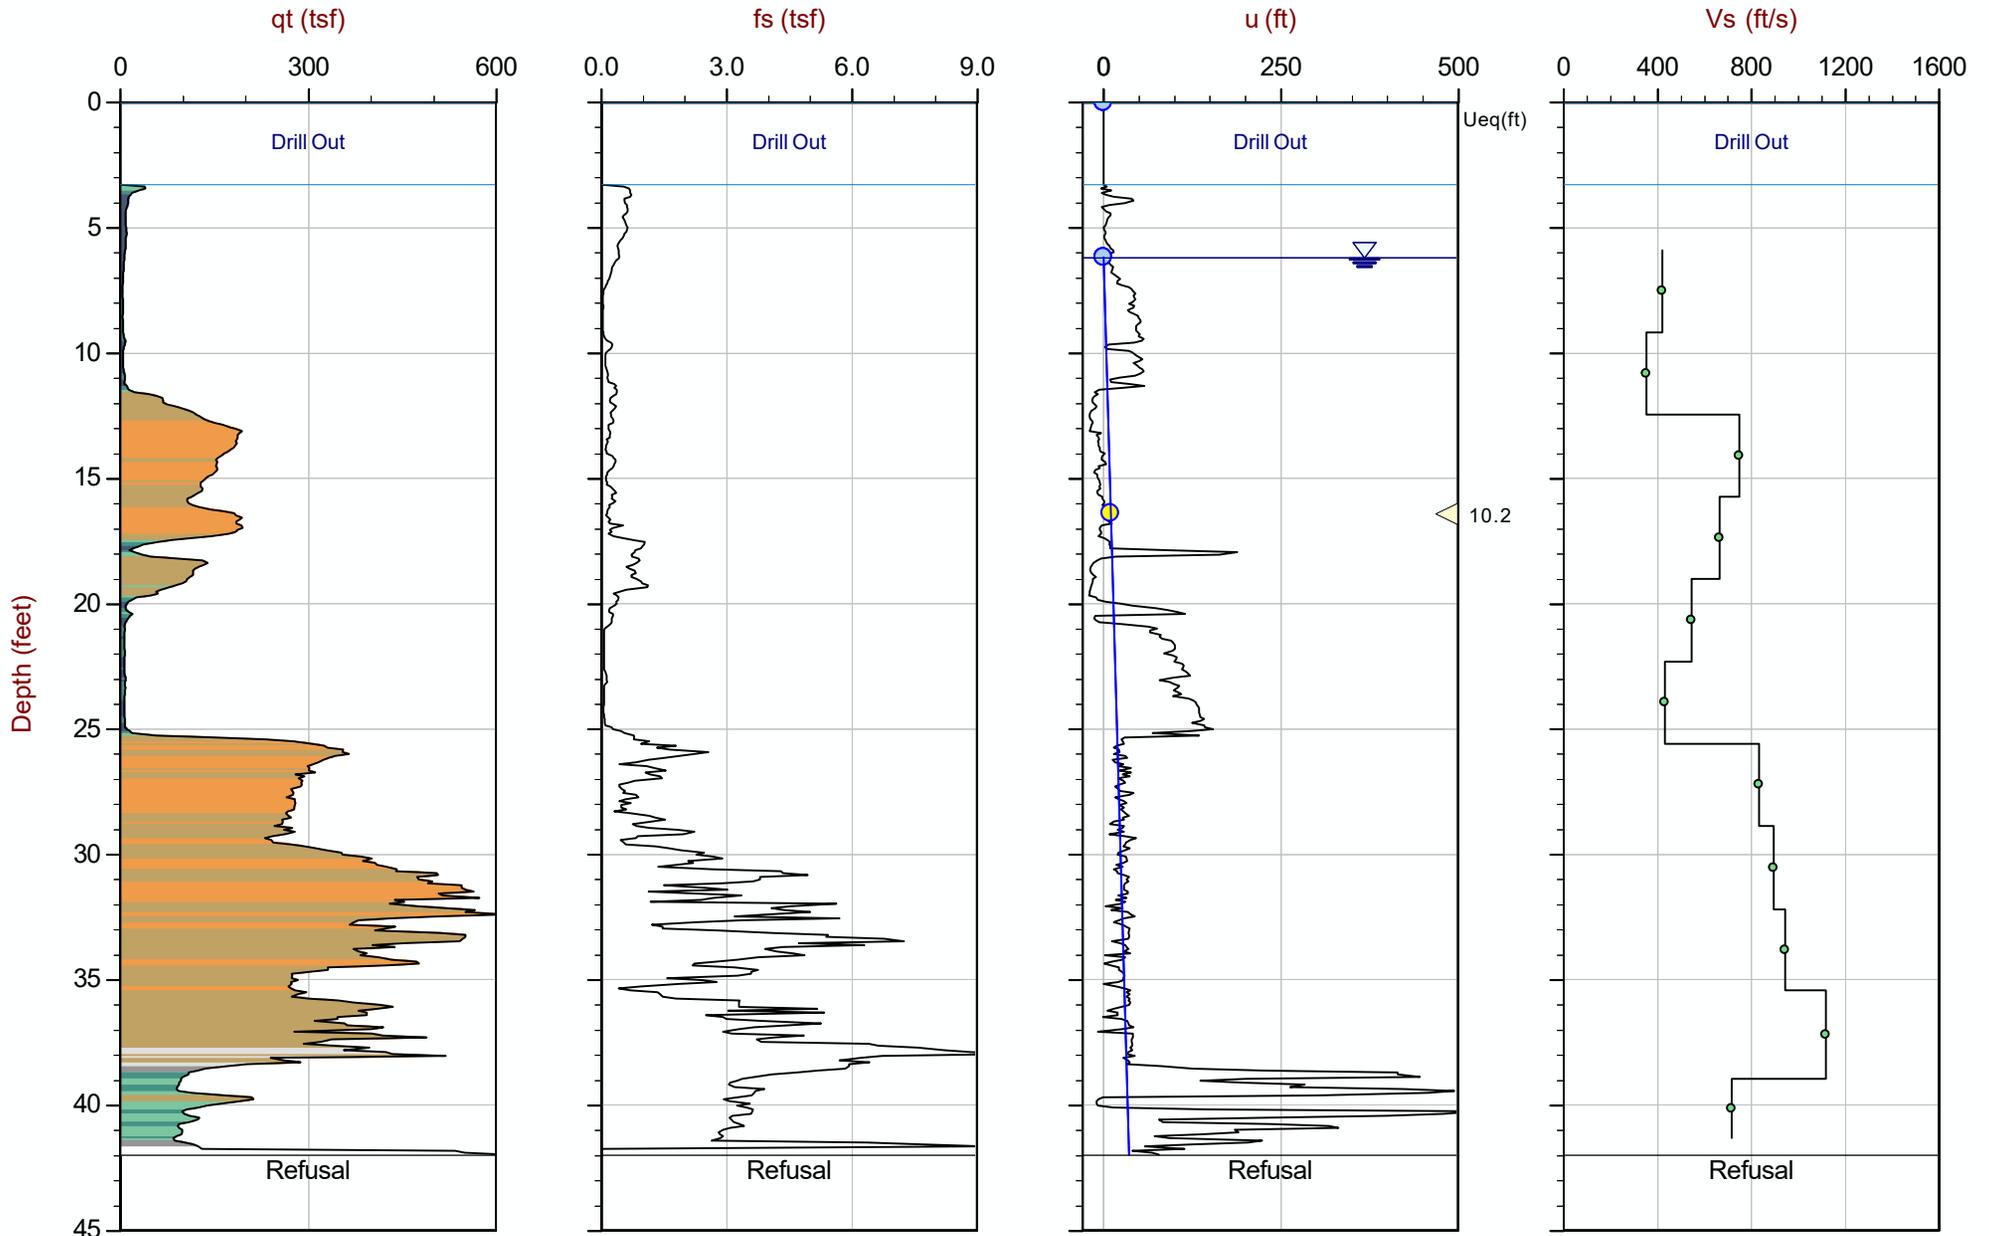


Max Depth: 12.800 m / 41.99 ft
 Depth Inc: 0.025 m / 0.082 ft
 Avg Int: Every Point

File: 24-59-27735_SP01.COR
 Unit Wt: SBTQtn(PKR2009)

SBT: Robertson, 2009 and 2010
 Coords: Lat: 47.86088 Long: -121.96446

Overplot Item: ● Ueq ● Assumed Ueq ◁ Dissipation, Ueq achieved ▷ Dissipation, Ueq not achieved ◁ Dissipation, Ueq assumed — Hydrostatic Line
 The reported coordinates were acquired from consumer grade GPS equipment and are only approximate locations. The coordinates should not be used for design purposes.

SCPTu Velocity Wave Traces

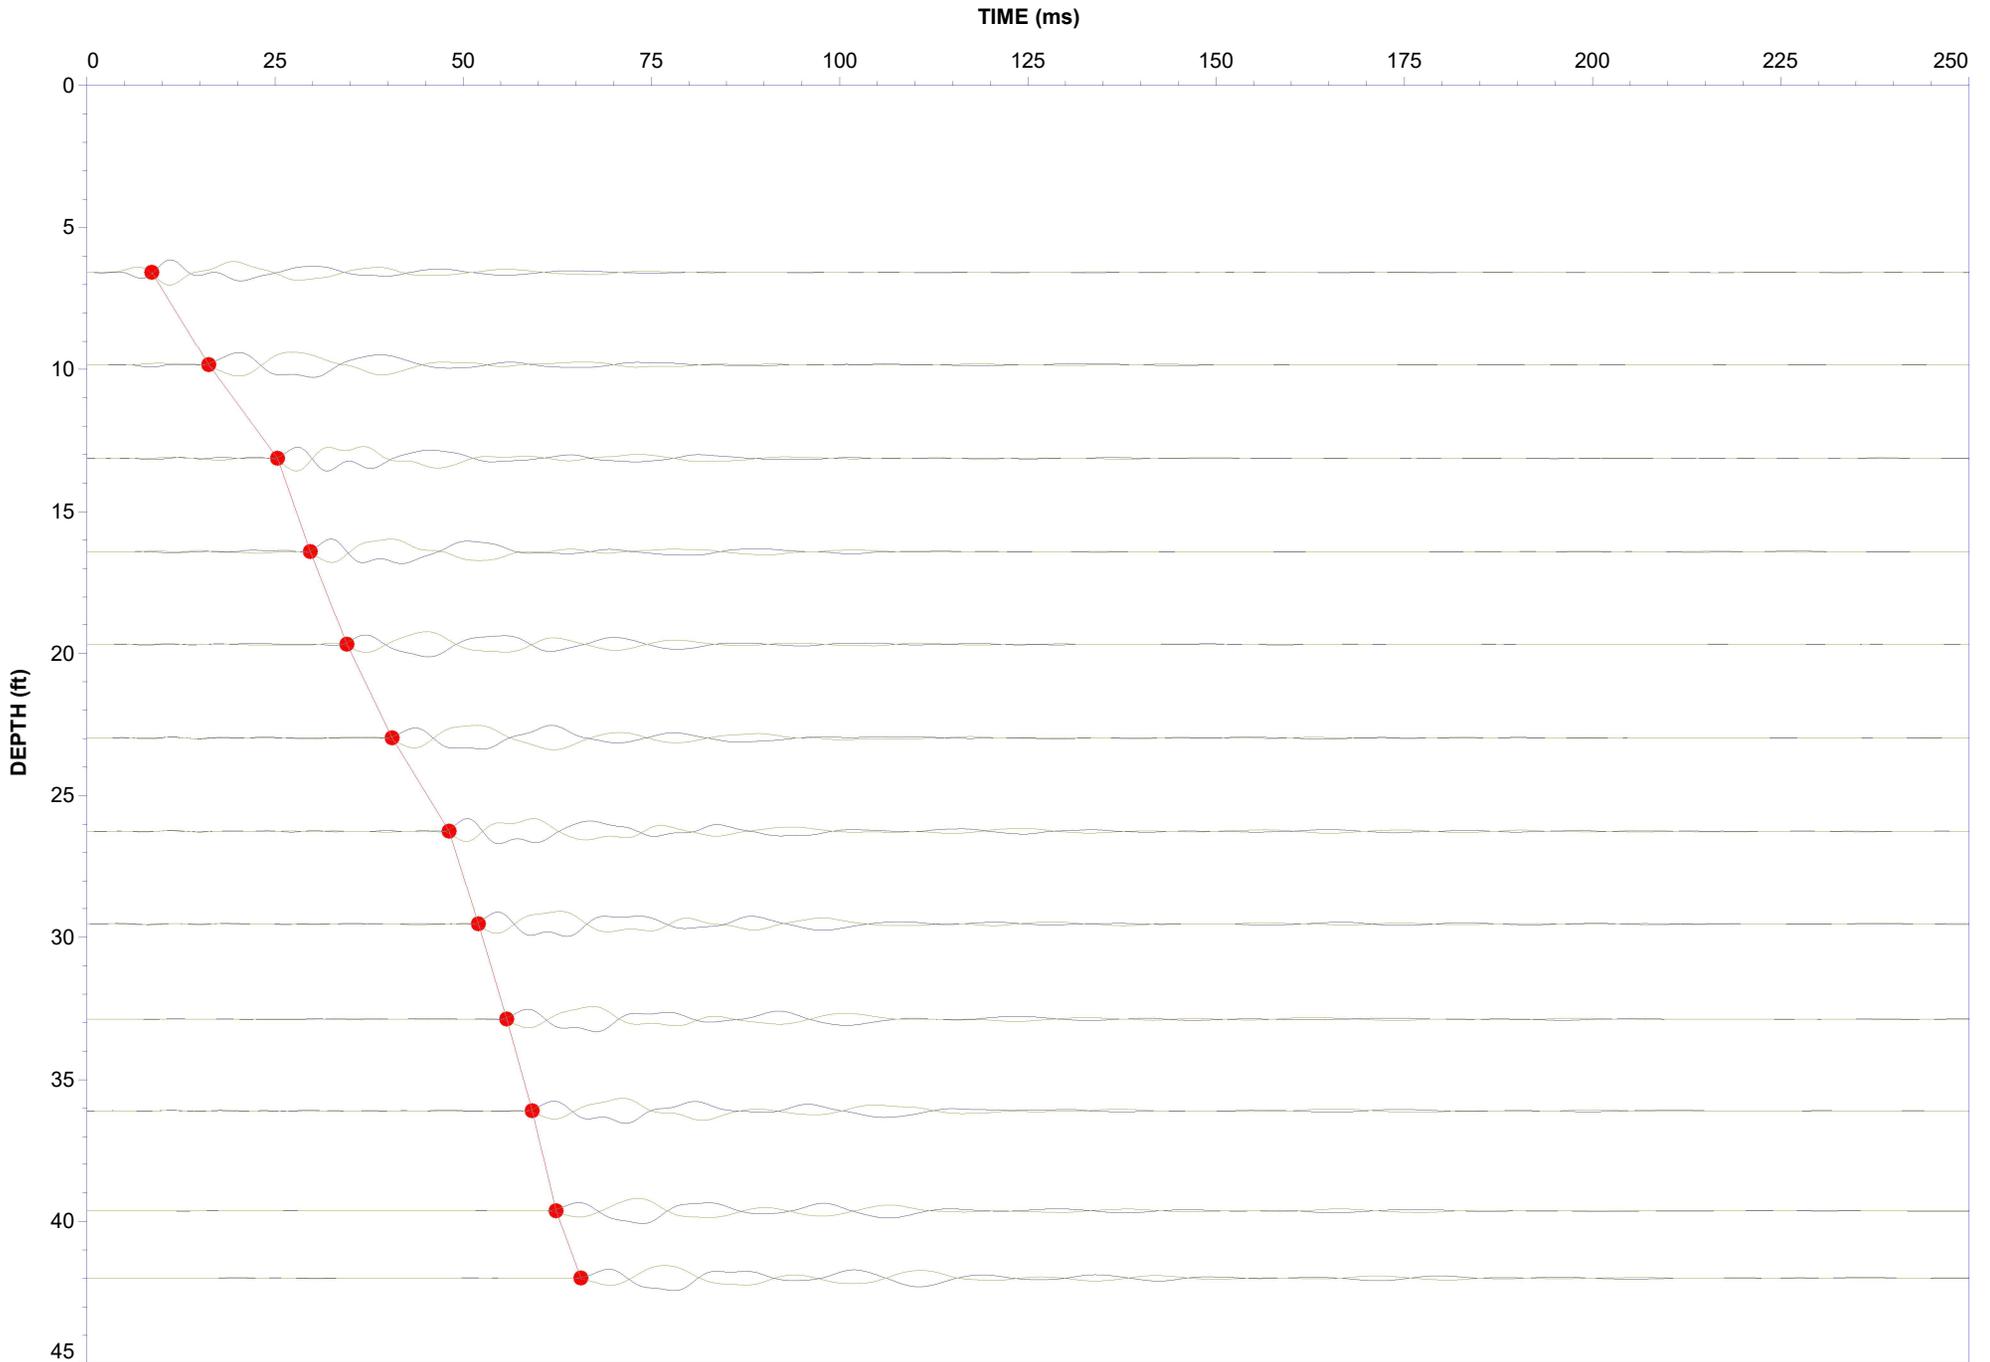

Supplementary Documents and Materials

Methodology Statements and Data File Formats

METHODOLOGY STATEMENTS



CONE PENETRATION TEST (CPTu) - eSeries

Cone penetration tests (CPTu) are conducted using an integrated electronic piezocone penetrometer and data acquisition system manufactured by Adara Systems Ltd., a subsidiary of ConeTec.

ConeTec's piezocone penetrometers are compression type designs in which the tip and friction sleeve load cells are independent and have separate load capacities. The piezocones use strain gauged load cells for tip and sleeve friction and a strain gauged diaphragm type transducer for recording pore pressure. The piezocones also have a platinum resistive temperature device (RTD) for monitoring the temperature of the sensors, an accelerometer type dual axis inclinometer and two geophone sensors for recording seismic signals. All signals are amplified and measured with minimum sixteen-bit resolution down hole within the cone body, and the signals are sent to the surface using a high bandwidth, error corrected digital interface through a shielded cable.

ConeTec penetrometers are manufactured with various tip, friction and pore pressure capacities in both 10 cm² and 15 cm² tip base area configurations in order to maximize signal resolution for various soil conditions. The specific piezocone used for each test is described in the CPT summary table. The 15 cm² penetrometers do not require friction reducers as they have a diameter larger than the deployment rods. The 10 cm² piezocones use a friction reducer consisting of a rod adapter extension behind the main cone body with an enlarged cross sectional area (typically 44 millimeters diameter over a length of 32 millimeters with tapered leading and trailing edges) located at a distance of 585 millimeters above the cone tip.

The penetrometers are designed with equal end area friction sleeves, a net end area ratio of 0.8 and cone tips with a 60 degree apex angle.

All ConeTec piezocones can record pore pressure at various locations. Unless otherwise noted, the pore pressure filter is located directly behind the cone tip in the "u₂" position (ASTM Type 2). The filter is six millimeters thick, made of porous plastic (polyethylene) having an average pore size of 125 microns (90-160 microns). The function of the filter is to allow rapid movements of extremely small volumes of water needed to activate the pressure transducer while preventing soil ingress or blockage.

The piezocone penetrometers are manufactured with dimensions, tolerances and sensor characteristics that are in general accordance with the current ASTM D5778 standard. ConeTec's calibration criteria also meets or exceeds those of the current ASTM D5778 standard. An illustration of the piezocone penetrometer is presented in Figure CPTu.

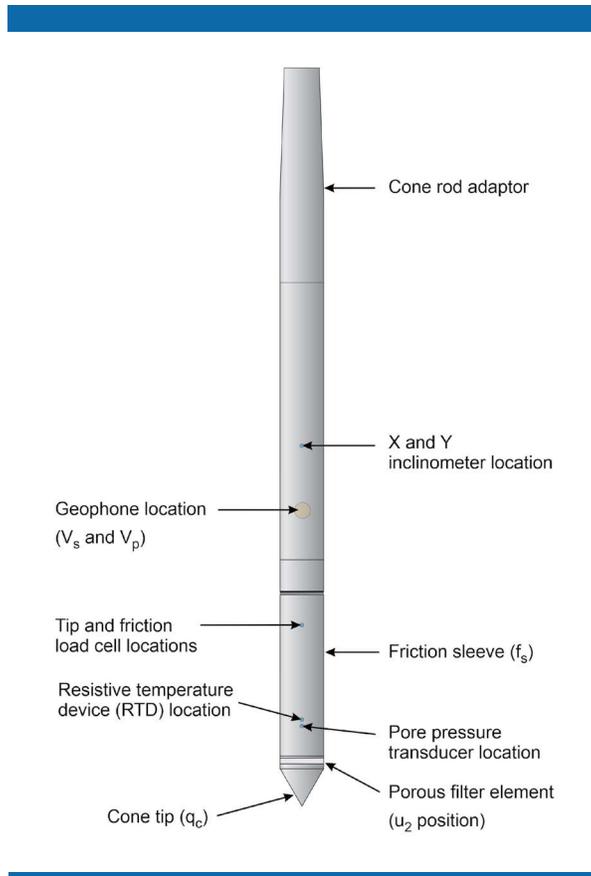


Figure CPTu. Piezocone Penetrometer (15 cm²)

The ConeTec data acquisition system consists of a Windows based computer, signal interface box, and power supply. The signal interface combines depth increment signals, seismic trigger signals and the downhole digital data. This combined data is then sent to the Windows based computer for collection and presentation. The data is recorded at fixed depth increments using a depth encoder that is either portable or integrated into the rig. The typical recording interval is 2.5 centimeters; custom recording intervals are possible.

The system displays the CPTu data in real time and records the following parameters to a storage media during penetration:

- Depth
- Uncorrected tip resistance (q_c)
- Sleeve friction (f_s)
- Dynamic pore pressure (u)
- Additional sensors such as resistivity, passive gamma, ultra violet induced fluorescence, if applicable

All testing is performed in accordance to ConeTec's CPTu operating procedures which are in general accordance with the current [ASTM D5778](#) standard.

Prior to the start of a CPTu sounding a suitable cone is selected, the cone and data acquisition system are powered on, the pore pressure system is saturated with silicone oil and the baseline readings are recorded with the cone hanging freely in a vertical position.

The CPTu is conducted at a steady rate of two centimeters per second, within acceptable tolerances. Typically one meter length rods with an outer diameter of 1.5 inches are added to advance the cone to the sounding termination depth. After cone retraction final baselines are recorded.

Additional information pertaining to ConeTec's cone penetration testing procedures:

- Each filter is saturated in silicone oil under vacuum pressure prior to use
- Baseline readings are compared to previous readings
- Soundings are terminated at the client's target depth or at a depth where an obstruction is encountered, excessive rod flex occurs, excessive inclination occurs, equipment damage is likely to take place, or a dangerous working environment arises
- Differences between initial and final baselines are calculated to ensure zero load offsets have not occurred and to ensure compliance with [ASTM](#) standards

The interpretation of piezocone data for this report is based on the corrected tip resistance (q_t), sleeve friction (f_s) and pore water pressure (u). The interpretation of soil type is based on the correlations developed by [Robertson, P.K., 2010](#). The Soil Behavior Type (SBT) classification chart developed by [Robertson, P.K., 2010](#) is presented in [Figure SBT](#). It should be noted that it is not always possible to accurately identify a soil behavior type based on these parameters. In these situations, experience, judgment and an assessment of other parameters may be used to infer soil behavior type.

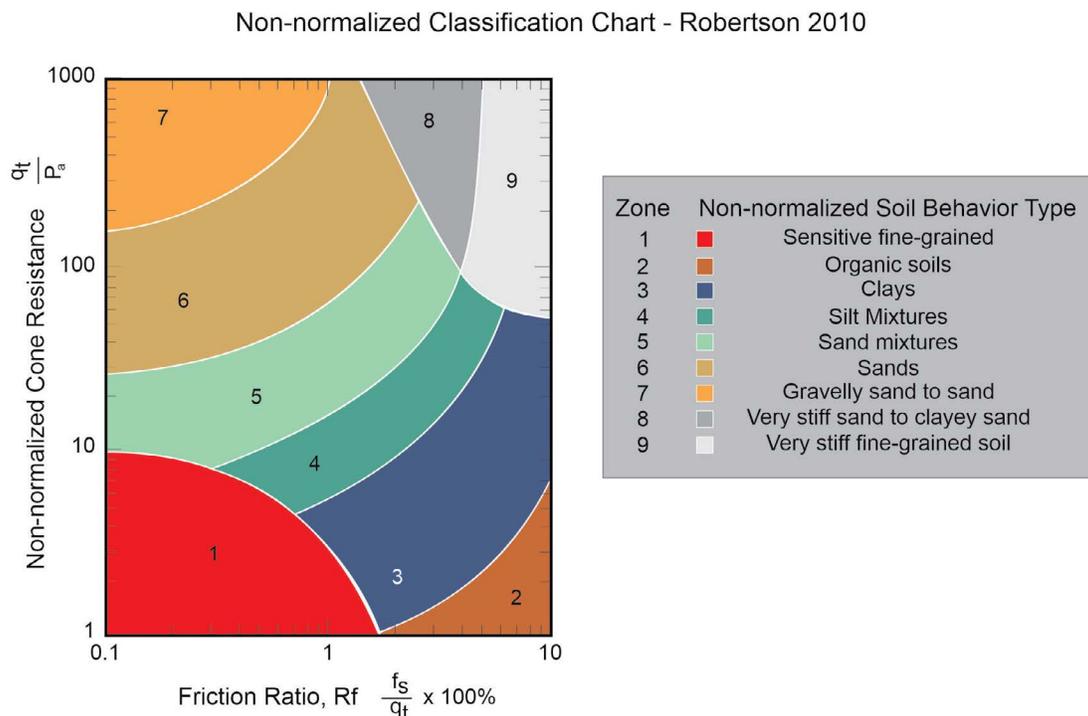


Figure SBT. Non-Normalized Soil Behavior Type Classification Chart (SBT)

The recorded tip resistance (q_c) is the total force acting on the piezocone tip divided by its base area. The tip resistance is corrected for pore pressure effects and termed corrected tip resistance (q_t) according to the following expression presented in [Robertson et al. \(1986\)](#):

$$q_t = q_c + (1-a) \cdot u_2$$

where: q_t is the corrected tip resistance

q_c is the recorded tip resistance

u_2 is the recorded dynamic pore pressure behind the tip (u_2 position)

a is the Net Area Ratio for the piezocone (0.8 for ConeTec probes)

The sleeve friction (f_s) is the frictional force on the sleeve divided by its surface area. As all ConeTec piezocones have equal end area friction sleeves, pore pressure corrections to the sleeve data are not required.

The dynamic pore pressure (u) is a measure of the pore pressures generated during cone penetration. To record equilibrium pore pressure, the penetration must be stopped to allow the dynamic pore pressures to stabilize. The rate at which this occurs is predominantly a function of the permeability of the soil and the diameter of the cone.

The friction ratio (R_f) is a calculated parameter. It is defined as the ratio of sleeve friction to the tip resistance expressed as a percentage. Generally, saturated cohesive soils have low tip resistance, high friction ratios and generate large excess pore water pressures. Cohesionless soils have higher tip resistances, lower friction ratios and do not generate significant excess pore water pressure.

For additional information on CPTu interpretations and calculated geotechnical parameters, refer to [Robertson et al. \(1986\)](#), [Lunne et al. \(1997\)](#), [Robertson \(2009\)](#), [Mayne \(2013, 2014\)](#) and [Mayne and Peuchen \(2012\)](#).

REFERENCES

ASTM D5778-20, 2020, "Standard Test Method for Performing Electronic Friction Cone and Piezocone Penetration Testing of Soils", ASTM International, West Conshohocken, PA. DOI: [10.1520/D5778-20](#).

Lunne, T., Robertson, P.K. and Powell, J. J. M., 1997, "Cone Penetration Testing in Geotechnical Practice", Blackie Academic and Professional.

Mayne, P.W., 2013, "Evaluating yield stress of soils from laboratory consolidation and in-situ cone penetration tests", Sound Geotechnical Research to Practice (Holtz Volume) GSP 230, ASCE, Reston/VA: 406-420. DOI: [10.1061/9780784412770.027](#).

Mayne, P.W. and Peuchen, J., 2012, "Unit weight trends with cone resistance in soft to firm clays", Geotechnical and Geophysical Site Characterization 4, Vol. 1 (Proc. ISC-4, Pernambuco), CRC Press, London: 903-910.

Mayne, P.W., 2014, "Interpretation of geotechnical parameters from seismic piezocone tests", CPT'14 Keynote Address, Las Vegas, NV, May 2014.

Robertson, P.K., Campanella, R.G., Gillespie, D. and Greig, J., 1986, "Use of Piezometer Cone Data", Proceedings of InSitu 86, ASCE Specialty Conference, Blacksburg, Virginia.

Robertson, P.K., 2009, "Interpretation of cone penetration tests – a unified approach", Canadian Geotechnical Journal, Volume 46: 1337-1355. DOI: [10.1139/T09-065](#).

Robertson, P.K., 2010. Soil behavior type from the CPT: an update. 2nd International Symposium on Cone Penetration Testing, CPT'10, Huntington Beach, CA, USA



PORE PRESSURE DISSIPATION TEST

The cone penetration test is halted at specific depths to carry out pore pressure dissipation (PPD) tests, shown in Figure PPD-1. For each dissipation test the cone and rods are decoupled from the rig and the data acquisition system measures and records the variation of the pore pressure (u) with time (t).

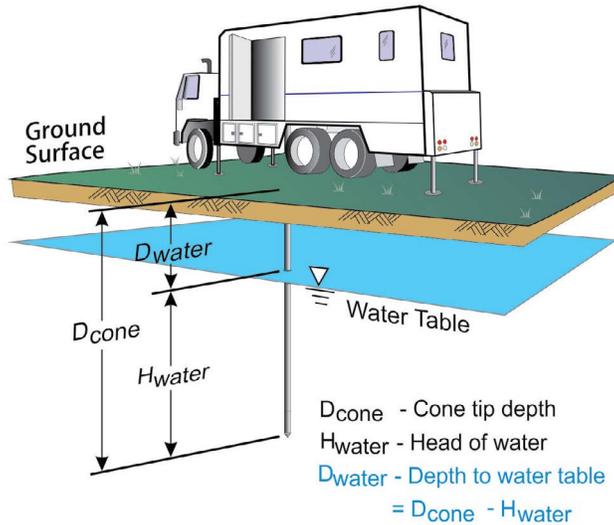


Figure PPD-1. Pore pressure dissipation test setup

Pore pressure dissipation data can be interpreted to provide estimates of ground water conditions, permeability, consolidation characteristics and soil behavior.

The typical shapes of dissipation curves shown in Figure PPD-2 are very useful in assessing soil type, drainage, in situ pore pressure and soil properties. A flat curve that stabilizes quickly is typical of a freely draining sand. Undrained soils such as clays will typically show positive excess pore pressure and have long dissipation times. Dilative soils will often exhibit dynamic pore pressures below equilibrium that then rise over time. Overconsolidated fine-grained soils will often exhibit an initial dilatatory response where there is an initial rise in pore pressure before reaching a peak and dissipating.

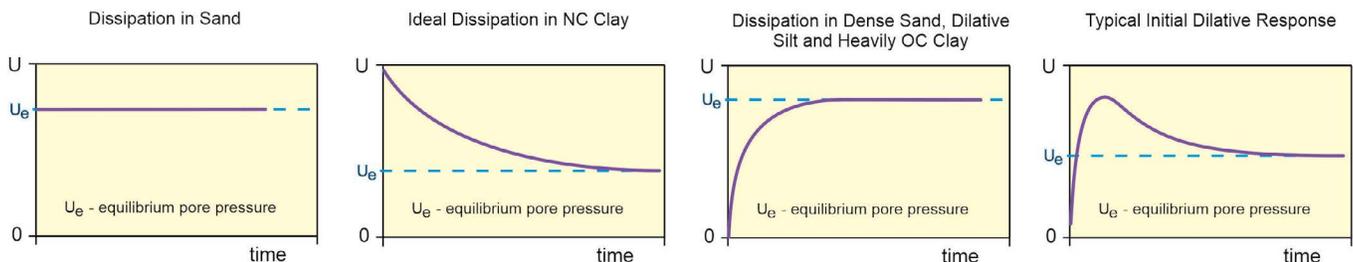


Figure PPD-2. Pore pressure dissipation curve examples

In order to interpret the equilibrium pore pressure (u_{eq}) and the apparent phreatic surface, the pore pressure should be monitored until such time as there is no variation in pore pressure with time as shown for each curve in Figure PPD-2.



SEISMIC CONE PENETRATION TEST (SCPTu) - eSeries

Shear wave velocity (V_s) testing is performed in conjunction with the piezocone penetration test (SCPTu) in order to collect interval velocities. For some projects seismic compression wave velocity (V_p) testing is also performed.

ConeTec's piezocone penetrometers are manufactured with one horizontally active geophone (28 hertz) and one vertically active geophone (28 hertz). Both geophones are rigidly mounted in the body of the cone penetrometer, 0.2 meters behind the cone tip. The vertically mounted geophone is more sensitive to compression waves.

Shear waves are typically generated by using an impact hammer horizontally striking a beam that is held in place by a normal load. In some instances, an auger source or an imbedded impulsive source may be used for both shear waves and compression waves. The hammer and beam act as a contact trigger that initiates the recording of the seismic wave traces. For impulsive devices an accelerometer trigger may be used. The traces are recorded in the memory of the cone using a fast analog to digital converter. The seismic trace is then transmitted digitally uphole to a Windows based computer through a signal interface box for recording and analysis. An illustration of the shear wave testing configuration is presented in [Figure SCPTu-1](#).

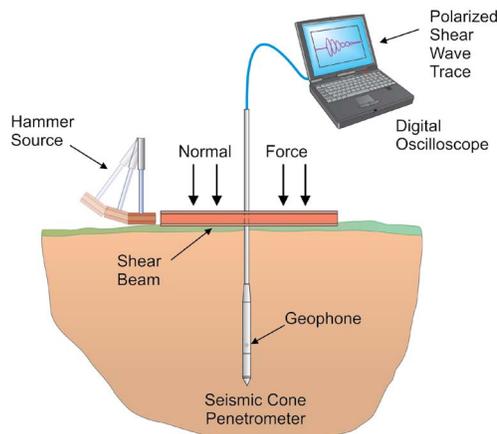


Figure SCPTu-1. Illustration of the SCPTu system

All testing is performed in accordance to ConeTec's SCPTu operating procedures which are in general accordance with the current [ASTM D5778](#) and [ASTM D7400](#) standards.

Prior to the start of a SCPTu sounding, the procedures described in the Cone Penetration Test section are followed. In addition, the active axis of the geophone is aligned parallel to the beam (or source) and the horizontal offset between the cone and the source is measured and recorded.

Prior to recording seismic waves at each test depth, cone penetration is stopped and the rods are decoupled from the rig to avoid transmission of rig energy down the rods. Typically, five wave traces for each orientation are recorded for quality control and uncertainty analysis purposes. After reviewing wave traces for consistency the cone is pushed to the next test depth (typically one meter intervals or as requested by the client). [Figure SCPTu-2](#) presents an illustration of a SCPTu test.

For additional information on seismic cone penetration testing refer to [Robertson et al. \(1986\)](#).

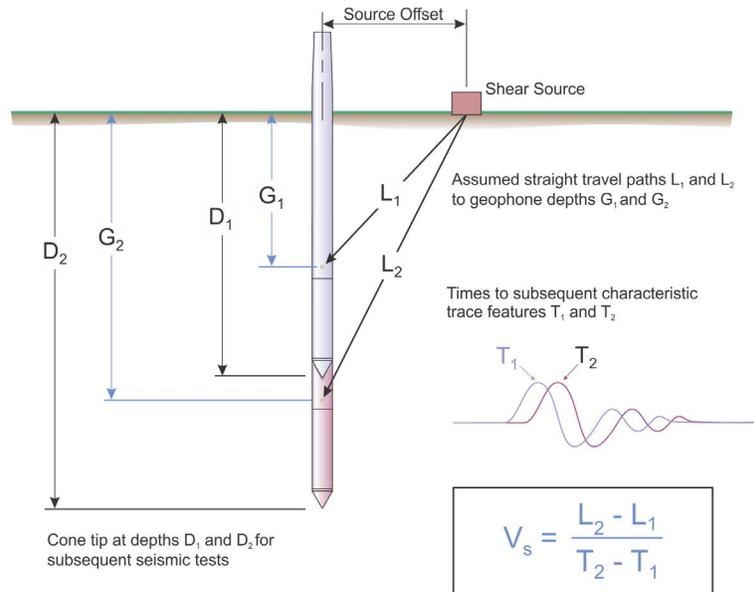


Figure SCPTu-2. Illustration of a seismic cone penetration test

For the determination of interval travel times the wave traces from all depths are displayed in analysis software. The results of the interval picks are supplied in the relevant appendix of this report. Standard practice for ConeTec is to record five wave traces for each source direction at each test depth. Outlier impacts are identified in the field and the impacts are repeated. For the final wave trace profile, the traces are stacked in the time domain to display a single average trace.

Calculation of the interval velocities are performed by visually picking a common feature (e.g. the first characteristic peak, trough, or crossover) on all of the recorded wave sets and taking the difference in ray path divided by the time difference between subsequent features. Ray path is defined as the straight line distance from the seismic source to the geophone, accounting for beam offset, source depth and geophone offset from the cone tip.

In some cases, usually for shear wave velocity testing, more than one characteristic marker may be used. If there is an overlap between different sets of characteristic markers, then the average time value for those sets of interval times is applied to the determination of velocity.

Ideally, all depths are used for the determination of the velocity profile. However, an interval may be skipped if there is some ambiguity or quality concern with a particular depth, resulting in a larger interval.

Tabular velocity results and SCPTu plots are presented in the relevant appendix.

For all SCPTu soundings that have achieved a depth of at least 100 feet (30 meters), the average shear wave velocity to a depth of 100 feet (\bar{v}_s) has been calculated and provided for all applicable soundings using the following equation presented in [ASCE \(2010\)](#).

$$\bar{v}_s = \frac{\sum_{i=1}^n d_i}{\sum_{i=1}^n \frac{d_i}{v_{si}}}$$

where: \bar{v}_s = average shear wave velocity ft/s (m/s)
 d_i = the thickness of any layer between 0 and 100 ft (30 m)
 v_{si} = the shear wave velocity in ft/s (m/s)
 $\sum_{i=1}^n d_i$ = the total thickness of all layers between 0 and 100 ft (30 m)

Average shear wave velocity, \bar{v}_s is also referenced to V_{s100} or V_{s30} .

The layer travel times refers to the travel times propagating in the vertical direction, not the measured travel times from an offset source.

REFERENCES

American Society of Civil Engineers (ASCE), 2010, "Minimum Design Loads for Buildings and Other Structures", Standard ASCE/SEI 7-10, American Society of Civil Engineers, ISBN 978-0-7844-1085-1, Reston, Virginia. DOI: [10.1061/9780784412916](https://doi.org/10.1061/9780784412916).

ASTM D5778-20, 2020, "Standard Test Method for Performing Electronic Friction Cone and Piezocone Penetration Testing of Soils", ASTM International, West Conshohocken, PA. DOI: [10.1520/D5778-20](https://doi.org/10.1520/D5778-20).

ASTM D7400/D7400M-19, 2019, "Standard Test Methods for Downhole Seismic Testing", ASTM International, West Conshohocken, PA. DOI: [10.1520/D7400_D7400M-19](https://doi.org/10.1520/D7400_D7400M-19).

Robertson, P.K., Campanella, R.G., Gillespie D and Rice, A., 1986, "Seismic CPT to Measure In-Situ Shear Wave Velocity", Journal of Geotechnical Engineering ASCE, Vol. 112, No. 8: 791-803. DOI: [10.1061/\(ASCE\)0733-9410\(1986\)112:8\(791\)](https://doi.org/10.1061/(ASCE)0733-9410(1986)112:8(791)).



CONE PENETRATION DIGITAL FILE FORMATS - eSeries

CPT Data Files (COR Extension)

ConeTec CPT data files are stored in ASCII text files that are readable by almost any text editor. ConeTec file names start with the job number (which includes the two digit year number) an underscore as a separating character, followed by two letters based on the type of test and the sounding ID. The last character position is reserved for an identifier letter (such as b, c, d etc) used to uniquely distinguish multiple soundings at the same location. The CPT sounding file has the extension COR. As an example, for job number 21-02-00001 the first CPT sounding will have file name 21-02-00001_CP01.COR

The sounding (COR) file consists of the following components:

1. Two lines of header information
2. Data records
3. End of data marker
4. Units information

Header Lines

Line 1: Columns 1-6 may be blank or may indicate the version number of the recording software

Columns 7-21 contain the sounding Date and Time (Date is MM:DD:YY)

Columns 23-38 contain the sounding Operator

Columns 51-100 contain extended Job Location information

Line 2: Columns 1-16 contain the Job Location

Columns 17-32 contain the Cone ID

Columns 33-47 contain the sounding number

Columns 51-100 may contain extended sounding ID information

Data Records

The data records contain 4 or more columns of data in floating point format. A comma and spaces separate each data item:

Column 1: Sounding Depth (meters)

Column 2: Tip (q_c), recorded in units selected by the operator

Column 3: Sleeve (f_s), recorded in units selected by the operator

Column 4: Dynamic pore pressure (u), recorded in units selected by the operator

Column 5: Empty or may contain other requested data such as Gamma, Resistivity or UVIF data

End of Data Marker

After the last line of data there is a line containing an ASCII 26 (CTL-Z) character (small rectangular shaped character) followed by a newline (carriage return / line feed). This is used to mark the end of data.

Units Information

The last section of the file contains information about the units that were selected for the sounding. A separator bar makes up the first line. The second line contains the type of units used for depth, q_c , f_s and u . The third line contains the conversion values required for ConeTec's software to convert the recorded data to an internal set of base units (bar for q_c , bar for f_s and meters for u). Additional lines intended for internal ConeTec use may appear following the conversion values.

CPT Data Files (XLS Extension)

Excel format files of ConeTec CPT data are also generated from corresponding COR files. The XLS files have the same base file name as the COR file with a -BSC suffix. The information in the file is presented in table format and contains additional information about the sounding such as coordinate information, and tip net area ratio.

The BSCI suffix is given to XLS files which are enhanced versions of the BSC files and include the same data records in addition to inclination data collected for each sounding.

CPT Dissipation Files (XLS Extension)

Pore pressure dissipation files are provided in Excel format and contain each dissipation trace that exceeds a minimum duration (selected during post-processing) formatted column wise within the spreadsheet. The first column (Column A) contains the time in seconds and the second column (Column B) contains the time in minutes. Subsequent columns contain the dissipation trace data. The columns extend to the longest trace of the data set.

Detailed header information is provided at the top of the worksheet. The test depth in meters and feet, the number of points in the trace and the particular units are all presented at the top of each trace column.

CPT Dissipation files have the same naming convention as the CPT sounding files with a “-PPD” suffix.

Data Records

Each file will contain dissipation traces that exceed a minimum duration (selected during post-processing) in a particular column. The dissipation pore pressure values are typically recorded at varying time intervals throughout the trace; rapidly to start and increasing as the duration of the test lengthens. The test depth in meters and feet, the number of points in the trace and the trace number are identified at the top of each trace column.

Cone Type Designations

Cone ID	Cone Description	Tip Cross Sect. Area (cm ²)	Tip Capacity (bar)	Sleeve Area (cm ²)**	Sleeve Capacity (bar)	Pore Pressure Capacity (bar)
EC###	A15T1500F15U35	15	1500	225	15	35
EC###	A15T375F10U35	15	375	225	10	35
EC###	A10T1000F10U35	10	1000	150	10	35

refers to the Cone ID number

**Outer Cylindrical Area

Description of Methods for Calculated CPT Geotechnical Parameters

CALCULATED CPT GEOTECHNICAL PARAMETERS

A Detailed Description of the Methods Used in ConeTec's CPT Geotechnical Parameter Calculation and Plotting Software



Revision SZW-Rev 18

Revised February 10, 2023

Prepared by Jim Greig, M.A.Sc, P.Eng (BC, AB, ON)



Limitations

The geotechnical parameter output was prepared specifically for the site and project named in the accompanying report subject to objectives, site conditions and criteria provided to ConeTec by the client. The output may not be relied upon by any other party or for any other site without the express written permission of ConeTec Group (ConeTec) or any of its affiliates. For this project, ConeTec has provided site investigation services, prepared factual data reporting and produced geotechnical parameter calculations consistent with current best practices. No other warranty, expressed or implied, is made.

To understand the calculations that have been performed and to be able to reproduce the calculated parameters the user is directed to the basic descriptions for the methods in this document and the detailed descriptions and their associated limitations and appropriateness in the technical references cited for each parameter.

ConeTec’s Calculated CPT Geotechnical Parameters as of February 10, 2023.

ConeTec’s CPT parameter calculation and plotting routine provides a tabular output of geotechnical parameters based on current published CPT correlations and is subject to change to reflect the current state of practice. Due to drainage conditions and the basic assumptions and limitations of the correlations, not all geotechnical parameters provided are considered applicable for all soil types. The results are presented only as a guide for geotechnical use and should be carefully examined for consideration in any geotechnical design. Reference to current literature is strongly recommended. ConeTec does not warranty the correctness or the applicability of any of the geotechnical parameters calculated by the program and does not assume liability for any use of the results in any design or review. For verification purposes we recommend that representative hand calculations be done for any parameter that is critical for design purposes. The end user of the parameter output should also be fully aware of the techniques and the limitations of any method used by the program. The purpose of this document is to inform the user as to which methods were used and to direct the end user to the appropriate technical papers and/or publications for further reference.

The geotechnical parameter output was prepared specifically for the site and project named in the accompanying report subject to objectives, site conditions and criteria provided to ConeTec by the client. The output may not be relied upon by any other party or for any other site without the express written permission of ConeTec Group (ConeTec) or any of its affiliates.

The CPT calculations are based on values of tip resistance, sleeve friction and pore pressures considered at each data point or averaged over a user specified layer thickness (e.g., 0.20 m). Note that q_t is the tip resistance corrected for pore pressure effects and q_c is the recorded tip resistance. The corrected tip resistance (corrected using u_2 pore pressure values) is used for all calculations. Since all ConeTec cones have equal end area friction sleeves pore pressure corrections to sleeve friction, f_s , are not performed.

Corrected tip resistance: $q_t = q_c + (1-a) \cdot u_2$ (consistent units are required)

where: q_t is the corrected tip resistance

q_c is the recorded tip resistance

u_2 is the recorded dynamic pore pressure from behind the tip (u_2 position)

a is the Net Area Ratio for the cone (typically 0.80 for ConeTec cones)

The total stress calculations are based on soil unit weight values that have been assigned to the Soil Behavior Type (SBT) zones, from a user defined unit weight profile, by using a single uniform value throughout the profile, through unit weight estimation techniques described in various technical papers or from a combination of these methods. The parameter output files indicate the method(s) used.

Effective vertical overburden stresses are calculated using the total stress and equilibrium pore pressure (u_{eq} or u_o) values derived from an assumed hydrostatic distribution of pore pressures below the water table or from a user defined equilibrium pore pressure profile (typically obtained from CPT dissipation tests) or a combination of the two. For over water projects the stress effects of the column of water above the mudline are taken into account as is the appropriate unit weight of water. How this is done depends on where the instruments are zeroed (i.e. on deck or at the mudline). The parameter output files indicate the method(s) used.

A majority of parameter calculations are derived from or driven by results based on material types as determined by the various soil behavior type charts depicted in Figures 1 through 6. The parameter output files indicate the method(s) used.

The Soil Behavior Type classification chart shown in Figure 1 is the classic non-normalized SBT Chart developed at the University of British Columbia and reported in Robertson, Campanella, Gillespie and Greig (1986). Figure 2 shows the original normalized (linear method) SBTn chart developed by Robertson (1990). The Bq classification charts



shown in Figures 3a and 3b incorporate pore pressures into the SBT classification and are based on the methods described in Robertson (1990). Many of these charts have been summarized in Lunne, Robertson and Powell (1997). The Jefferies and Davies SBT chart shown in Figure 3c is based on the techniques discussed in Jefferies and Davies (1993) which introduced the concept of the Soil Behavior Type Index parameter, I_c . Take note that the I_c parameter developed by Robertson and Fear (1995) and Robertson and Wride (1998) is similar in concept but uses a slightly different calculation method than that defined by Jefferies and Davies (1993) as the latter incorporates pore pressure in their technique through the use of the B_q parameter. The normalized Q_{tn} SBT chart shown in Figure 4 is based on the work by Robertson (2009) utilizing a variable stress ratio exponent, n , for normalization based on a slightly modified redefinition and iterative approach for I_c . The boundary curves drawn on the chart are based on the work described in Robertson (2010).

Figure 5 shows a revised 1986 SBT Chart presented to CPT'10 by Robertson (2010b). It is known as the Updated non-normalized Soil Behavior Chart (also referred to as the Rev SBT Chart (PKR2010) in our output files). This chart was produced to be more in line with all post-1986 Robertson charts having the same 9 soil type zones, a \log_{10} axis for friction ratio, R_f in this case, and a unitless tip resistance axis.

Figure 6 shows a revised behavior based chart by Robertson (2016) depicting contractive-dilative zones. As the zones represent material behavior rather than soil gradation ConeTec has chosen a set of zone colors that are less likely to be confused with material type colors from previous SBT charts. These colors differ from those used by Dr. Robertson. A green palette was selected for the dilative (desirable) side of the chart and a red palette for the contractive side of the chart.

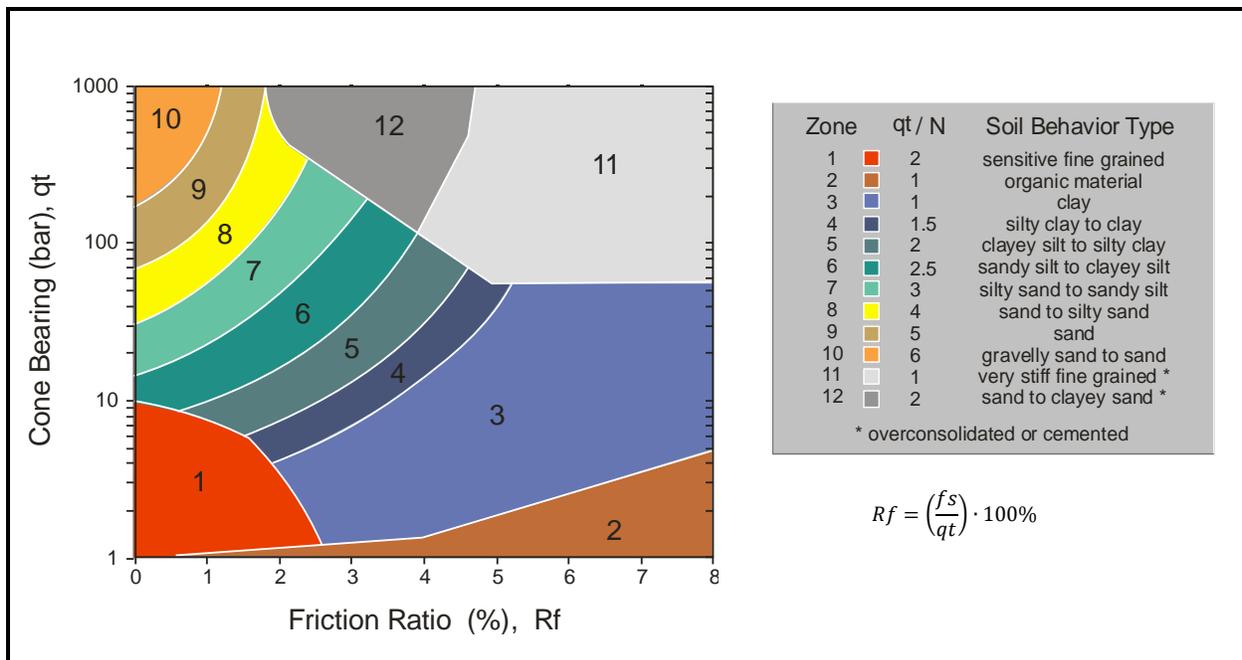


Figure 1. Non-normalized Soil Behavior Type Classification Chart (SBT)

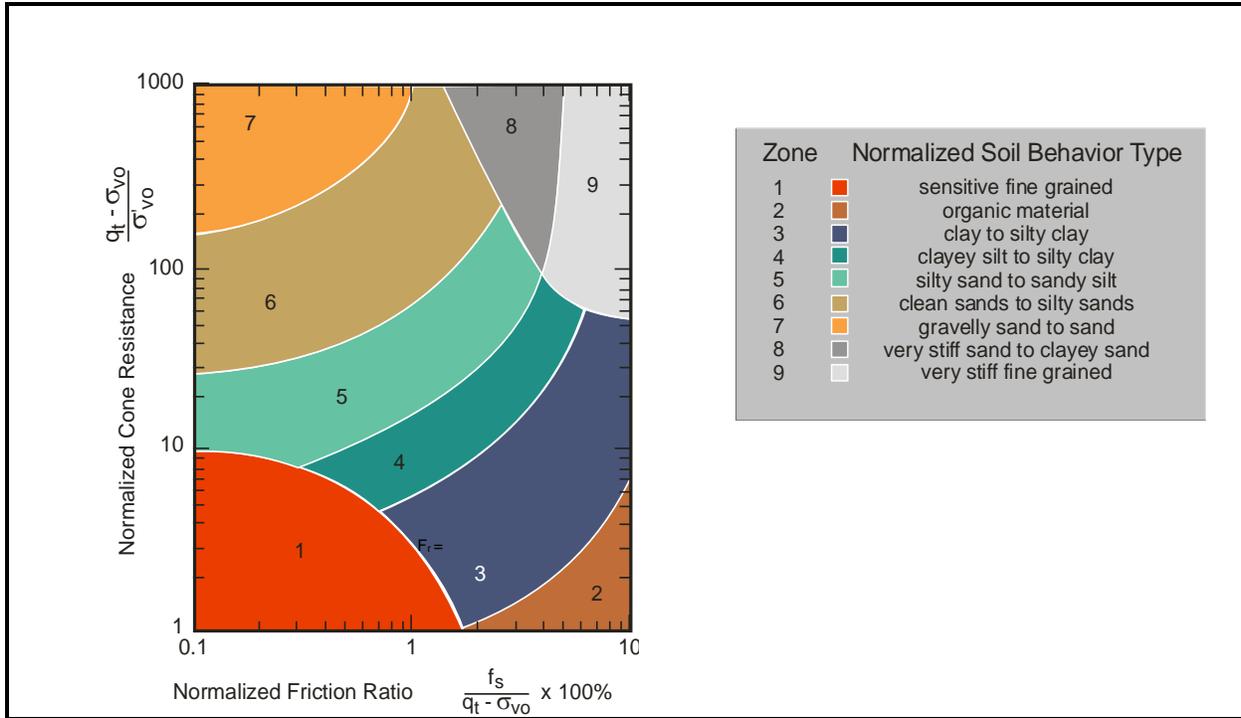


Figure 2. Normalized Soil Behavior Type Classification Chart (SBTn)

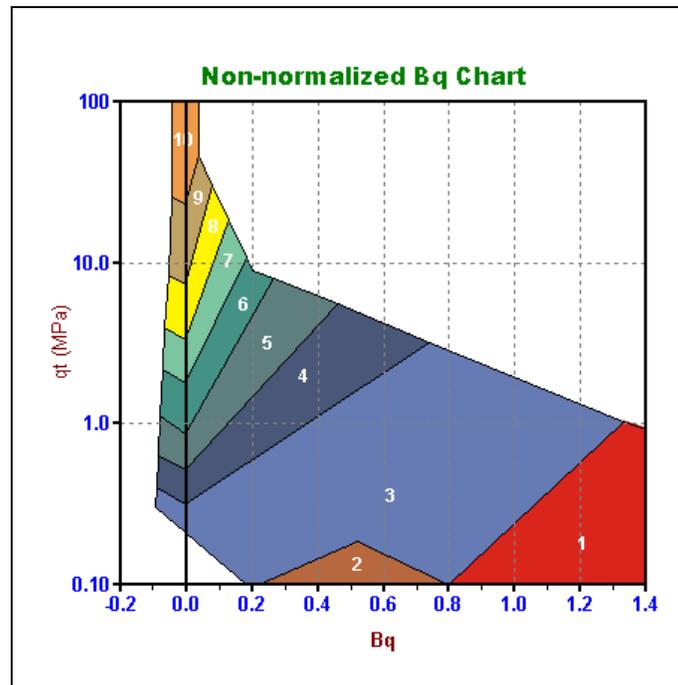


Figure 3a. Alternate Soil Behavior Type Chart (SBT Bq): $q_t - B_q$

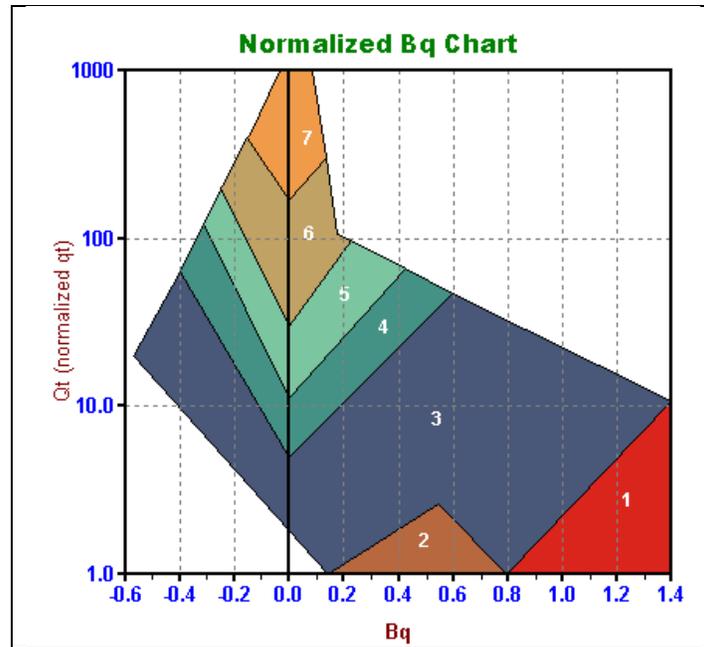


Figure 3b. Alternate Soil Behavior Type Charts (SBT B_q): Q_t - B_q

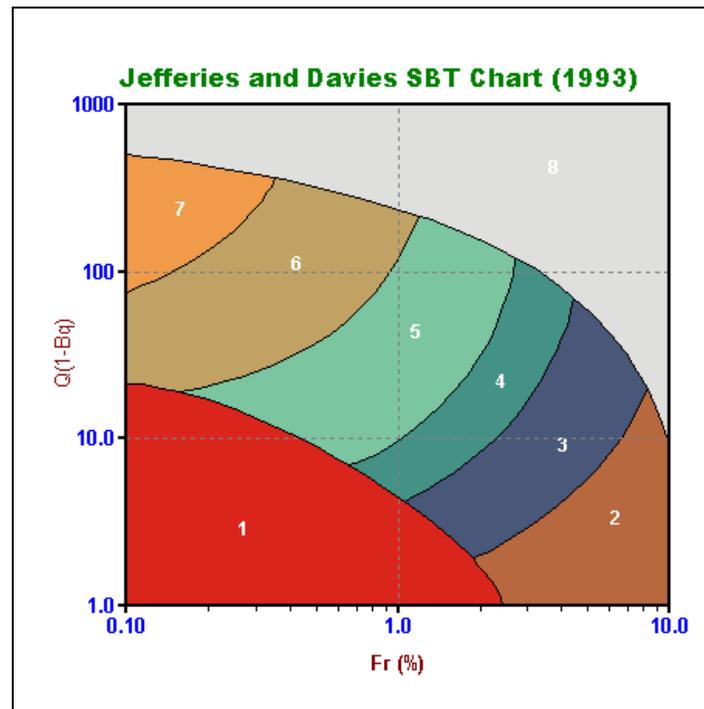


Figure 3c. Alternate Soil Behavior Type Charts: $Q(1-B_q)$ - F_r

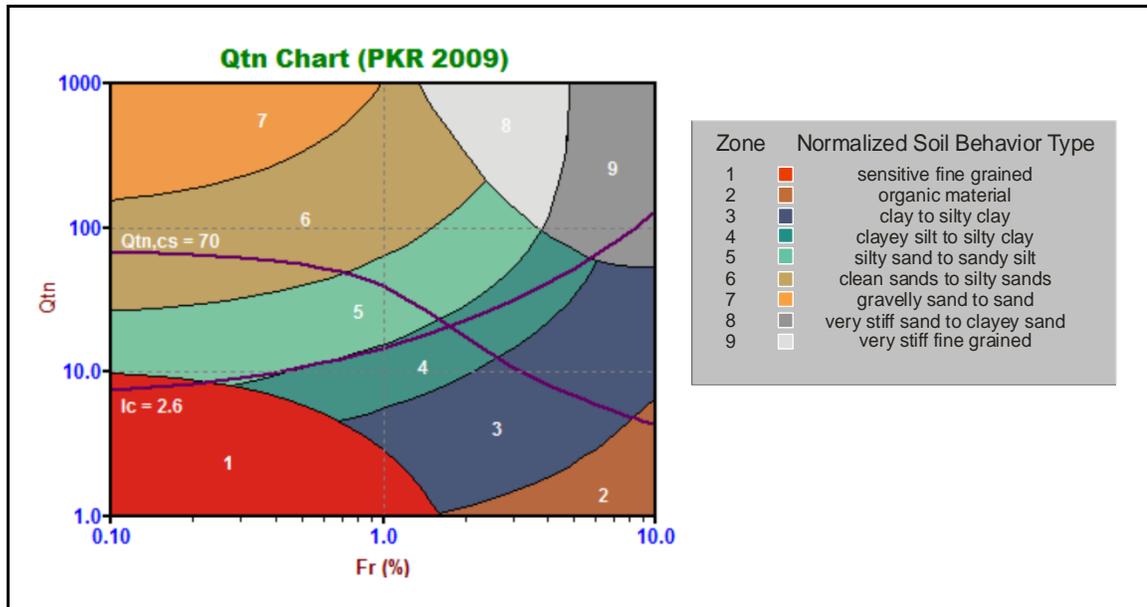


Figure 4. Normalized Soil Behavior Type Chart using Q_{tn} (SBT Q_{tn})

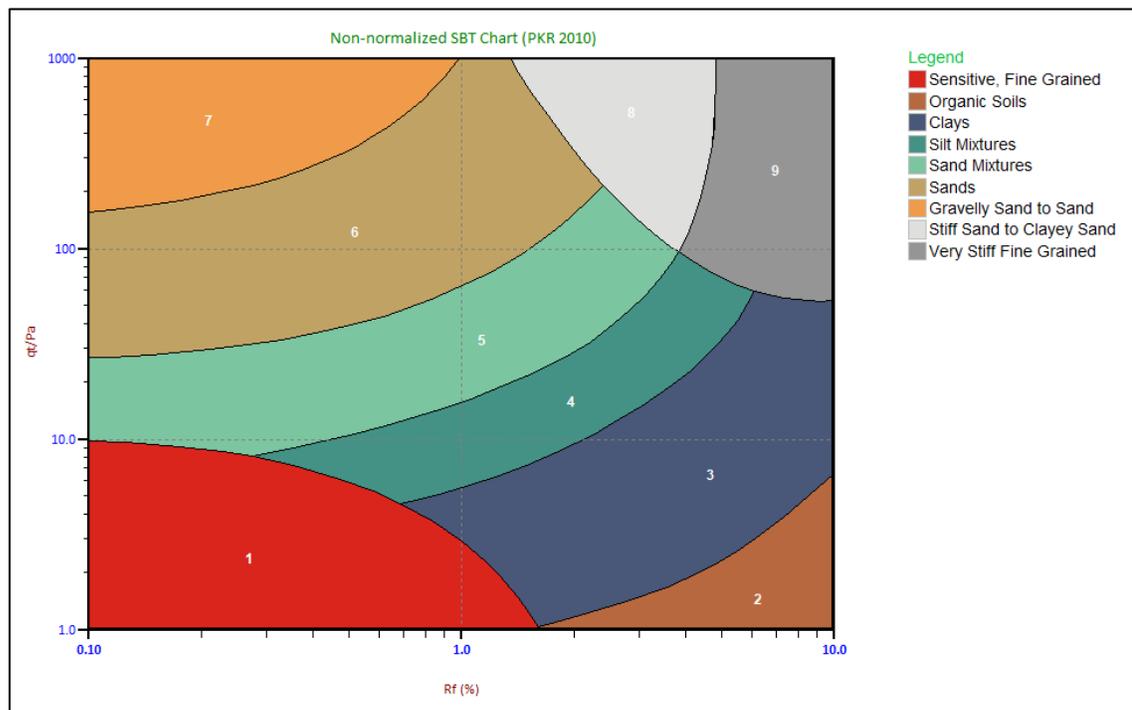


Figure 5. Non-normalized Soil Behavior Type Chart (2010)

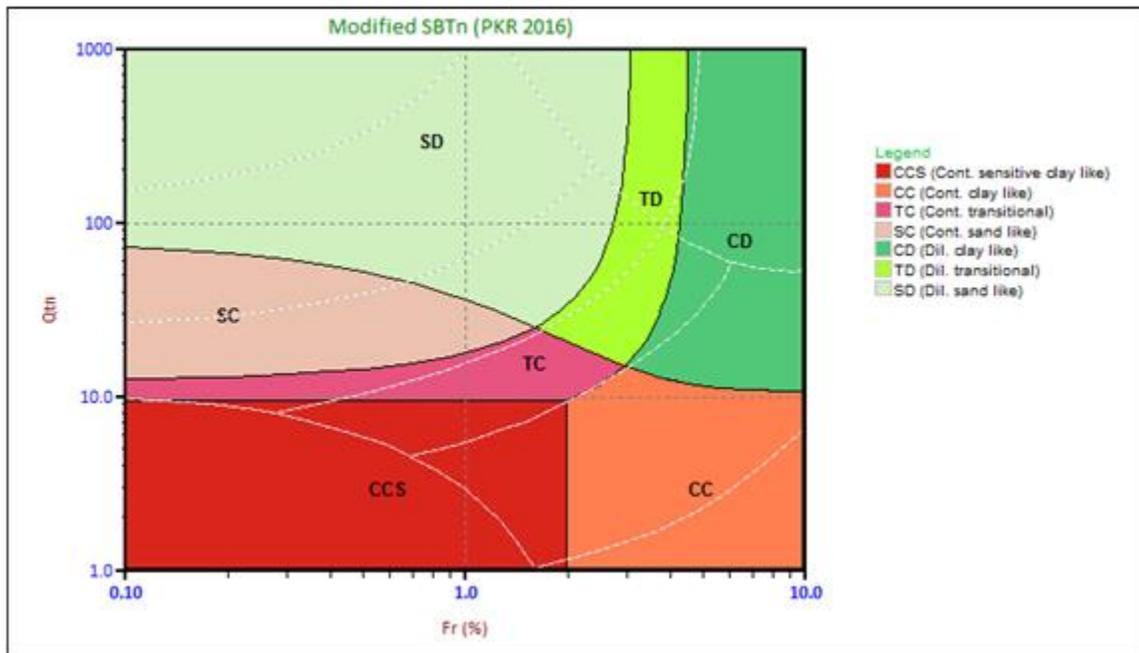


Figure 6. Modified SBTn Behavior Based Chart

Details regarding the geotechnical parameter calculations are provided in Tables 1a and 1b. The appropriate references cited are listed in Table 2. Non-liquefaction specific parameters are detailed in Table 1a and liquefaction specific parameters are detailed in Table 1b.

Where methods are based on charts or techniques that are too complex to describe in this summary, we recommend that the user refer to the cited material. Specific limitations for each method are described in the cited material.

Where the results of a calculation/correlation are deemed *'invalid'* the value will be represented by the text strings "-9999", "-9999.0", the value 0.0 (Zero) or an empty cell. Invalid results will occur because of (and not limited to) one or a combination of:

1. Invalid or undefined CPT data (e.g., drilled out section or data gap).
2. Where the calculation method is inappropriate, for example, drained parameters in a material behaving in an undrained manner (and vice versa).
3. Where input values are beyond the range of the referenced charts or specified limitations of the correlation method.
4. Where pre-requisite or intermediate parameter calculations are invalid.

The parameters selected for output from the program are often specific to a particular project. As such, not all of the calculated parameters listed in Tables 1a and 1b may be included in the output files delivered with this report.

The output files are typically provided in Microsoft Excel XLS, XLSX or CSV format. The ConeTec software has several options for output depending on the number or types of calculated parameters desired or those specifically contracted for by the client. Each output file is named using the original file base name (from the .COR file) followed

by a three or four character indicator of the output set selected (e.g. BSC, TBL, NLI, NL2, IFI, IFI2, IFI3) and possibly followed by an operator selected suffix identifying the characteristics of the particular calculation run.

Table 1a. CPT Parameter Calculation Methods – Non liquefaction Parameters

Reference Notes: CK* - Common Knowledge, U* - Unpublished

Calculated Parameter	Description	Equation	Ref
Depth	Mid Layer Depth <i>(where calculations are done at each point then Mid Layer Depth = Recorded Depth)</i>	$[Depth (Layer Top) + Depth (Layer Bottom)] / 2.0$	CK*
Elevation	Elevation of Mid Layer is based on the sounding collar elevation supplied by the client or through a site survey In Sweden a variation of elevation is used where the elevation increases with depth. We refer to this as inverse elevation.	Elevation = Collar Elevation – Depth InverseElevation = Collar Elevation + Depth	CK* N/A
Avg qc	Averaged recorded tip value (q_c)	$Avgqc = \frac{1}{n} \sum_{i=1}^n q_c$ <i>n=1 when calculations are done at each point</i>	CK*
Avg qt	Averaged corrected tip (q_t) where: $q_t = q_c + (1 - a) \cdot u_2$ Averaged q_t is not calculated using the average q_c and averaged u values. Averaged q_t is based on the average of the q_t values calculated at each data point.	$Avgqt = \frac{1}{n} \sum_{i=1}^n q_t$ <i>n=1 when calculations are done at each point</i>	1
Avg fs	Averaged sleeve friction (f_s) No pore pressure corrections are applied to f_s .	$Avgfs = \frac{1}{n} \sum_{i=1}^n fs$ <i>n=1 when calculations are done at each point</i>	CK*
Avg Rf	Averaged friction ratio (R_f) where friction ratio is defined as: $R_f = 100\% \cdot \frac{fs}{qt}$	$AvgRf = 100\% \cdot \frac{Avgfs}{Avgqt}$ <i>not an average of individual R_f values</i>	CK*
Avg u	Averaged dynamic pore pressure (u)	$Avgu = \frac{1}{n} \sum_{i=1}^n u_i$ <i>n=1 when calculations are done at each point</i>	CK*
Avg Res	Averaged Resistivity (this data is not always available since it is a specialized test requiring an additional module)	$AvgRes = \frac{1}{n} \sum_{i=1}^n Resistivity_i$ <i>n=1 when calculations are done at each point</i>	CK*
Avg UVIF	Averaged UVIF ultra-violet induced fluorescence (this data is not always available since it is a specialized test requiring an additional module)	$AvgUVIF = \frac{1}{n} \sum_{i=1}^n UVIF_i$ <i>n=1 when calculations are done at each point</i>	CK*
Avg Temp	Averaged Temperature (this data is not always available)	$AvgTemp = \frac{1}{n} \sum_{i=1}^n Temperature_i$ <i>n=1 when calculations are done at each point</i>	CK*
Avg Gamma	Averaged Gamma Counts (this data is not always available since it is a specialized test requiring an additional module)	$AvgGamma = \frac{1}{n} \sum_{i=1}^n Gamma_i$ <i>n=1 when calculations are done at each point</i>	CK*
SBT	Soil Behavior Type as defined by Robertson et al 1986 (often referred to as Robertson and Campanella, 1986)	See Figure 1	1, 5
SBTn	Normalized Soil Behavior Type as defined by Robertson 1990 (linear normalization using Q_t , now referred to as Q_{t1})	See Figure 2	2, 5



Calculated Parameter	Description	Equation	Ref
SBT-Bq	Non-normalized Soil Behavior type based on non-normalized tip resistance and the B _q parameter	See Figure 3a	1, 2, 5
SBT-Bqn	Normalized Soil Behavior type based on normalized tip resistance (Q _t , now called Q _{t1}) and the B _q parameter	See Figure 3b	2, 5
SBT-JandD	Soil Behavior Type as defined by Jeffries and Davies	See Figure 3c	7
SBT Qtn	Soil Behavior Type as defined by Robertson (2009) using a variable stress ratio exponent for normalization based on I _c (PKR 2009)	See Figure 4	15
Modified Non-normalized SBT Chart SBT (PKR2010)	This is a revised version of the simple 1986 non-normalized SBT chart (presented at CPT '10). The revised version has been reduced from 12 zones to 9 zones to be similar to the normalized Robertson charts. Other updates include a dimensionless tip resistance normalized to atmospheric pressure, q _t /P _a , on the vertical axis and a log scale for non-normalized friction ratio, R _f , along the horizontal axis.	See Figure 5	33
Modified SBTn (contractive /dilative)	Modified SBTn chart as defined by Robertson (2016) indicating zones of contractive/dilative behavior. Note that ConeTec displays the chart with colors different from Robertson. ConeTec's colors were chosen to avoid confusion with soil type descriptions.	See Figure 6	30
Unit Wt.	<p>Unit Weight of soil determined from one of the following user selectable options:</p> <ol style="list-style-type: none"> 1) uniform value 2) value assigned to each SBT zone 3) value assigned to each SBTn zone 4) value assigned to SBTn zone as determined from Robertson and Wride (1998) based on q_{c1n} 5) values assigned to SBT Qtn zones 6) values based on Robertson updated non-normalized Soil Behavior Type Chart (2010b) 6) Mayne f_s (sleeve friction) method 7) Robertson and Cabal 2010 method 8) user supplied unit weight profile <p>The last option may co-exist with any of the other options.</p>	See references	3, 5, 15, 21, 24, 29, 33



Calculated Parameter	Description	Equation	Ref
TStress σ_v	<p>Total vertical overburden stress at Mid Layer Depth</p> <p><i>A layer is defined as the averaging interval specified by the user where depths are reported at their respective mid-layer depth.</i></p> <p>For data calculated at each point layers are defined using the recorded depth as the mid-point of the layer. Thus, a layer starts half-way between the previous depth and the current depth unless this is the first point in which case the layer start is at zero depth. The layer bottom is half-way from the current depth to the next depth unless it is the last data point.</p> <p>Defining layers affects how stresses are calculated since the unit weight attributed to a data point is used throughout the entire layer. This means that to calculate the stresses the total stress at the top and bottom of a layer are required. The stress at mid layer is determined by adding the incremental stress from the layer top to the mid-layer depth. The stress at the layer bottom becomes the stress at the top of the subsequent layer. Stresses are NOT calculated from mid-point to mid-point.</p> <p>For over-water work the total stress due to the column of water above the mud line is taken into account where appropriate.</p>	$TStress = \sum_{i=1}^n \gamma_i h_i$ <p>where γ_i is layer unit weight h_i is layer thickness</p>	CK*
EStress σ_v'	<p>Effective vertical overburden stress at mid-layer depth.</p>	$\sigma_v' = \sigma_v - u_{eq}$	CK*
Equil u u_{eq} or u_0	<p>Equilibrium pore pressures are determined from one of the following user selectable options:</p> <ol style="list-style-type: none"> 1) hydrostatic below the water table 2) user supplied profile 3) combination of those above <p>When a user supplied profile is used/provided a linear interpolation is performed between equilibrium pore pressures defined at specific depths. If the profile values start below the water table then a linear transition from zero pressure at the water table to the first defined pointed is used.</p> <p>Equilibrium pore pressures may come from dissipation tests, adjacent piezometers or other sources. Occasionally, an extra equilibrium point (“assumed value”) will be provided in the profile that does not come from a recorded value to smooth out any abrupt changes or to deal with material interfaces. These “assumed” values will be indicated on our plots and in tabular summaries.</p>	<p>For the hydrostatic option:</p> $u_{eq} = \gamma_w \cdot (D - D_{wt})$ <p>where u_{eq} is equilibrium pore pressure γ_w is the unit weight of water D is the current depth D_{wt} is the depth to the water table</p>	CK*
K_0	<p>Coefficient of earth pressure at rest, K_0.</p>	$K_0 = (1 - \sin\Phi') OCR^{\sin\Phi'}$	17
C_n	<p>Overburden stress correction factor used for $(N_1)_{60}$ and older CPT parameters.</p>	$C_n = (P_a/\sigma_v')^{0.5}$ <p>where $0.0 < C_n < 2.0$ (user adjustable, typically ranging from 1.7 to 2.0) P_a is atmospheric pressure (100 kPa)</p>	4, 12




Calculated Parameter	Description	Equation	Ref
C_q	Overburden stress normalizing factor.	$C_q = 1.8 / [0.8 + (\sigma'_v / P_a)]$ where $0.0 < C_q < 2.0$ (user adjustable) P_a is atmospheric pressure (100 kPa) Robertson and Wride define C_q to be the same as C_n . The Olson definition above is used in the program.	3, 12
N_{60}	SPT N value at 60% energy calculated from q_t/N ratios assigned to each SBT zone. This method has abrupt N value changes at zone boundaries.	See Figure 1	5
$(N_1)_{60}$	SPT N_{60} value corrected for overburden pressure.	$(N_1)_{60} = C_n \cdot N_{60}$	4
N_{60lc}	SPT N_{60} values based on the I_c parameter, as defined by Robertson and Wride 1998 (3), or by Robertson 2009 (15).	$(q_t/P_a) / N_{60} = 8.5 (1 - I_c/4.6)$ $(q_t/P_a) / N_{60} = 10^{(1.1268 - 0.2817I_c)}$ P_a being atmospheric pressure	3, 5 15, 31
$(N_1)_{60lc}$	SPT N_{60} value corrected for overburden pressure (using $N_{60} I_c$). User has 3 options.	1) $(N_1)_{60lc} = C_n \cdot (N_{60} I_c)$ 2) $q_{c1n} / (N_1)_{60lc} = 8.5 (1 - I_c/4.6)$ 3) $(Q_{tn}) / (N_1)_{60lc} = 10^{(1.1268 - 0.2817I_c)}$	4 5 15, 31
S_u or $S_u (N_{kt})$	Undrained shear strength based on q_t S_u factor N_{kt} is user selectable.	$S_u = \frac{q_t - \sigma_v}{N_{kt}}$	1, 5
S_u or $S_u (N_{du})$ or $S_u (N_{\Delta u})$	Undrained shear strength based on pore pressure S_u factor $N_{\Delta u}$ is user selectable.	$S_u = \frac{u_2 - u_{eq}}{N_{\Delta u}}$	1, 5
D_r	Relative Density determined from one of the following user selectable options: 1) Ticino Sand 2) Hokksund Sand 3) Schmertmann (1978) 4) Jamiolkowski (1985) - All Sands 5) Jamiolkowski et al (2003) (various compressibilities, K_o)	See reference (methods 1 through 4) Jamiolkowski et al (2003) reference	5 14
PHI ϕ	Friction Angle determined from one of the following user selectable options (methods 1 through 4 are for sands and method 5 is for silts and clays): 1) Campanella and Robertson 2) Durgunoglu and Mitchel 3) Janbu 4) Kulhawy and Mayne 5) NTH method (clays and silts)	See appropriate reference	5 5 5 11 23
Delta U/ q_t $\Delta u/q_t$ du/q_t	Differential pore pressure ratio (older parameter used before B_q was established)	$= \frac{\Delta u}{q_t}$ where: $\Delta u = u - u_{eq}$ and u = dynamic pore pressure u_{eq} = equilibrium pore pressure	39



Calculated Parameter	Description	Equation	Ref
B _q	Pore pressure parameter	$Bq = \frac{\Delta u}{qt - \sigma_v}$ where: $\Delta u = u - u_{eq}$ and $u = \text{dynamic pore pressure}$ $u_{eq} = \text{equilibrium pore pressure}$	1, 2, 5
Net q _t or qtNet	Net tip resistance (used in many subsequent correlations)	$qt - \sigma_v$	36
q _e or qE or qE	Effective tip resistance (using the dynamic pore pressure u ₂ and not equilibrium pore pressure)	$q_t - u_2$	36
qeNorm	Normalized effective tip resistance	$\frac{qt - u_2}{\sigma_v}$	36
Q _t or Norm: Qt or Q _{t1}	Normalized q _t for Soil Behavior Type classification as defined by Robertson (1990) using a linear stress normalization. Note this is different from Q _{tn} . This parameter was renamed to Q _{t1} in Robertson, 2009. Without normalization limits this parameter calculates to very high unrealistic values at low stresses.	$Q_t = \frac{qt - \sigma_v}{\sigma_v}$	2, 5, 15
F _r or Norm: Fr	Normalized Friction Ratio for Soil Behavior Type classification as defined by Robertson (1990)	$Fr = 100\% \cdot \frac{fs}{qt - \sigma_v}$	2, 5
Q(1-B _q) Q(1-B _q) + 1	Q(1-B _q) grouping as suggested by Jefferies and Davies for their classification chart and the establishment of their l _c parameter. Later papers added the +1 term to the equation.	$Q \cdot (1 - Bq)$ $Q \cdot (1 - Bq) + 1$ where Bq is defined as above and Q is the same as the normalized tip resistance, Q _{t1} , defined above	6, 7, 34
q _{c1}	Normalized tip resistance, q _{c1} , using a fixed stress ratio exponent, n (this method has stress units)	$q_{c1} = q_t \cdot (P_a / \sigma_v')^{0.5}$ where: P _a = atmospheric pressure	21
q _{c1} (0.5)	Normalized tip resistance, q _{c1} , using a fixed stress ratio exponent, n (this method is unit-less)	$q_{c1} (0.5) = (q_t / P_a) \cdot (P_a / \sigma_v')^{0.5}$ where: P _a = atmospheric pressure	5
q _{c1} (C _n)	Normalized tip resistance, q _{c1} , based on C _n (this method has stress units)	$q_{c1}(C_n) = C_n * q_t$	5, 12
q _{c1} (C _q)	Normalized tip resistance, q _{c1} , based on C _q (this method has stress units)	$q_{c1}(C_q) = C_q * q_t$ (some papers use q _c)	5, 12
q _{c1n}	normalized tip resistance, q _{c1n} , using a variable stress ratio exponent, n (where n=0.0, 0.70, or 1.0) (this method is unit-less)	$q_{c1n} = (q_t / P_a)(P_a / \sigma_v')^n$ where: P _a = atm. Pressure and n varies as described below	3



Calculated Parameter	Description	Equation	Ref
I_B	Hyperbolic fit defining the boundary between SBT soil types proposed by Schneider as a better fit than the I_c circles. $I_B = 32$ represents the boundary for most sand like soils. $I_B = 22$ represents the upper boundary for most clay like soils. The region between $I_B=22$ and $I_B=32$ is the “transitional soil” zone.	$I_B = 100 (Q_{tn} + 10) / (70 + Q_{tn} F_r)$	30
State Param or State Parameter or ψ	The state parameter index, ψ , is defined as the difference between the current void ratio, e , and the critical void ratio, e_c . Positive ψ - contractive soil Negative ψ - dilative soil This is based on the work by Been and Jefferies (1985) and Plewes, Davies and Jefferies (1992) This method uses mean normal stresses based on a uniform value of K_0 or a calculated K_0 using methods described elsewhere in this document	See reference	6, 8
Yield Stress σ_p'	Yield stress is calculated using the following methods 1) General method 2) 1 st order approximation using q_t Net (clays) 3) 1 st order approximation using Δu_2 (clays) 4) 1 st order approximation using q_e (clays) 5) Based on V_s	All stresses in kPa 1) $\sigma_p' = 0.33 \cdot (q_t - \sigma_v)^{m'} \cdot (\sigma_{atm}/100)^{1-m'}$ where $m' = 1 - \frac{0.28}{1 + (I_c / 2.65)^{25}}$ 2) $\sigma_p' = 0.33 \cdot (q_t - \sigma_v)$ 3) $\sigma_p' = 0.54 \cdot (\Delta u_2)$ $\Delta u_2 = u_2 - u_0$ 4) $\sigma_p' = 0.60 \cdot (q_t - u_2)$ 5) $\sigma_p' = (V_s/4.59)^{1.47}$	19 20 20 20 18
OCR OCR(JS1978) YSR(Mayne2014) YSR (qtNet) YSR (deltaU) YSR (qe) YSR (Vs) OCR (PKR2015)	Over Consolidation Ratio based on 1) Schmertmann (1978) method involving a plot of $S_u/\sigma_v' / (S_u/\sigma_v')_{NC}$ and OCR  2) based on Yield stresses described above 3) approximate version based on qtNet 4) approximate version based on Δu 5) approximate version based on effective tip, q_e 6) approximate version based on shear wave velocity, V_s and σ_v' 7) based on Q_t	1) requires a user defined value for NC S_u/P_c' ratio 2 through 5) based on yield stresses 6) $YSR (Vs) = \sigma_p' (Vs) / \sigma_v'$ 7) $OCR = 0.25 \cdot (Q_t)^{1.25}$	9 19 20 20 20 18 32
E_s/q_t	Intermediate parameter for calculating Young’s Modulus, E , in sands. It is the Y axis of the reference chart. Note that Figure 5.59 from reference 5, Lunne, Robertson and Powell, (LRP) has an error. The X axis values are too high by a factor of 10. The plot is based on Baldi’s (not Bellotti as cited in	Based on Figure 5.59 in the reference	5, 37

Calculated Parameter	Description	Equation	Ref
	<p>LRP) original Figure 3 where the X axis is: $\frac{q_c}{\sqrt{\sigma'_v}}$ (both in kPa) with a range of 200 to 3000.</p> <p>Figure 5.59 from LRP shows a dimensionless form of the equation, q_{c1}, displaying the same range of values.</p> <p>Figure 5.59's X axis uses $q_{c1} = \left(\frac{q_c}{P_a}\right) \left(\frac{P_a}{\sigma'_v}\right)^{0.5}$</p> <p>The two expressions are not the same: they differ by a factor of $\frac{\sqrt{P_a}}{P_a}$. With P_a taken to be 100 kPa the factor is 1/10.</p> <p>Substituting typical values of 200 bar (20000 kPa) for q_c and 225 kPa for σ'_v one gets: $20000 / 15 = 1333.33$ for Bellotti's axis and $(200/1)(100/225)^{0.5} = 200 * (10/15) = 133.3$ for LRP's axis (noting that $P_a = 1$ bar) showing a factor of 10 difference.</p>		
Es or Es Young's Modulus E	<p>Young's Modulus based on the work done in Italy. There are three types of sands considered in this technique. The user selects the appropriate type for the site from:</p> <ul style="list-style-type: none"> a) OC Sands b) Aged NC Sands c) Recent NC Sands <p>Each sand type has a family of curves that depend on mean normal stress. The program calculates mean normal stress and linearly interpolates between the two extremes provided in the E_s/q_t chart. E_s is evaluated for an axial strain of 0.1%.</p>	<p>Mean normal stress is evaluated from:</p> $\sigma'_m = \frac{1}{3}(\sigma'_v + \sigma'_h + \sigma'_h)$ <p>where σ'_v = vertical effective stress σ'_h = horizontal effective stress</p> <p>and $\sigma'_h = K_o \cdot \sigma'_v$ with K_o assumed to be 0.5</p>	5
Delta U/TStress $\Delta u / \sigma_v$	Differential pore pressure ratio with respect to total stress	$= \frac{\Delta u}{\sigma_v}$ where: $\Delta u = u - u_{eq}$	39
Delta U/EStress, P Value, Excess Pore Pressure Ratio $\Delta u / \sigma'_v$	Differential pore pressure ratio with respect to effective stress. Key parameter (P, Normalized Pore Pressure Parameter, Excess Pore Pressure Ratio) in the Winckler et. al. static liquefaction method.	$= \frac{\Delta u}{\sigma'_v}$ where: $\Delta u = u - u_{eq}$	25, 25a
Su/EStress S_u / σ'_v	Undrained shear strength ratio with respect to vertical effective overburden stress using the $S_u (N_{kt})$ method	$= S_u (N_{kt}) / \sigma'_v$	9, 23
Vs or Vs	Recorded shear wave velocities (not estimated). The shear wave velocities are typically collected over 1 m depth intervals. Each data point over the relevant depth range is assigned the same V_s value.	recorded data	27
Vp or Vp	Recorded compression wave (or P wave) velocities (not estimated). The P wave velocities are typically collected over 1 m depth intervals. Each data point over the relevant depth range is assigned the same V_p value.	recorded data	27



Table 1b. CPT Parameter Calculation Methods – Liquefaction Parameters

Calculated Parameter	Description	Equation	Ref
K_{SPT} or K_s	Equivalent clean sand factor for $(N_1)_{60}$	$K_{SPT} = 1 + ((0.75/30) \cdot (FC - 5))$	10
K_{CPT} or K_C (RW1998)	Equivalent clean sand correction for q_{c1N}	$K_{cpt} = 1.0$ for $l_c \leq 1.64$ $K_{cpt} = f(l_c)$ for $l_c > 1.64$ (see reference) $K_C = -0.403 l_c^4 + 5.581 l_c^3 - 21.63 l_c^2 + 33.75 l_c - 17.88$	3, 10
K_C (PKR 2010)	Clean sand equivalent factor to be applied to Q_{tn}	$K_C = 1.0$ for $l_c \leq 1.64$ $K_C = -0.403 l_c^4 + 5.581 l_c^3 - 21.63 l_c^2 + 33.75 l_c - 17.88$ for $l_c > 1.64$	16
$(N_1)_{60cs} l_c$	Clean sand equivalent SPT $(N_1)_{60} l_c$. User has 3 options.	1) $(N_1)_{60cs} l_c = \alpha + \beta((N_1)_{60} l_c)$ 2) $(N_1)_{60cs} l_c = K_{SPT} * ((N_1)_{60} l_c)$ 3) $(q_{c1ncs}) / (N_1)_{60cs} l_c = 8.5 (1 - l_c/4.6)$ FC \leq 5%: $\alpha = 0, \beta = 1.0$ FC \geq 35% $\alpha = 5.0, \beta = 1.2$ 5% < FC < 35% $\alpha = \exp[1.76 - (190/FC^2)]$ $\beta = [0.99 + (FC^{1.5}/1000)]$	10 10 5
q_{c1ncs}	Clean sand equivalent q_{c1n}	$q_{c1ncs} = q_{c1n} \cdot K_{cpt}$	3
$Q_{tn,cs}$ (PKR 2010)	Clean sand equivalent for Q_{tn} described above - Q_{tn} being the normalized tip resistance based on a variable stress exponent as defined by Robertson (2009)	$Q_{tn,cs} = Q_{tn} \cdot K_C$ (PKR 2016)	16
$S_u(Liq)/ES_v$ or $S_u(Liq)/\sigma'_v$	Liquefied shear strength ratio as defined by Olson and Stark	$\frac{S_u(Liq)}{\sigma'_v} = 0.03 + 0.0143(q_{c1})$ Note: σ'_v and s'_v are synonymous	13
$S_u(Liq)/ES_v$ or $S_u(Liq)/\sigma'_v$ (PKR 2010)	Liquefied shear strength ratio as defined by Robertson (2010)	$\frac{S_u(Liq)}{\sigma'_v}$ Based on a function involving $Q_{tn,cs}$	16
$S_u(Liq)$ (PKR 2010)	Liquefied shear strength derived from the liquefied shear strength ratio and effective overburden stress	$S_u(Liq) = \sigma'_v \cdot \left(\frac{S_u(Liq)}{\sigma'_v} \right)$	16
Cont/Dilat Tip	Contractive / Dilative q_{c1} Boundary based on $(N_1)_{60}$	$(\sigma'_v)_{boundary} = 9.58 \times 10^{-4} [(N_1)_{60}]^{4.79}$ q_{c1} is calculated from specified q_t (MPa)/N ratio	13
CRR	Cyclic Resistance Ratio (for Magnitude 7.5)	$q_{c1ncs} < 50$: $CRR_{7.5} = 0.833 [q_{c1ncs}/1000] + 0.05$ $50 \leq q_{c1ncs} < 160$: $CRR_{7.5} = 93 [q_{c1ncs}/1000]^3 + 0.08$	10
K_g or K_g	Small strain Stiffness Ratio Factor, K_g	$[G_{max}/q_t]/[q_{c1n}^{-m}]$ $m =$ empirical exponent, typically 0.75	26



Calculated Parameter	Description	Equation	Ref
K_g^*	Revised K_g factor extended to fine grained soils (Robertson).	$K_g^* = (G_o / q_n)(Q_{tn})^{0.75}$ where q_n is the net tip resistance = $q_t - \sigma_v$	30
SP Distance	State Parameter Distance, Winckler static liquefaction method	Perpendicular distance on Q_{tn} chart from plotted point to state parameter $\Psi = -0.05$ curve	25
URS NP Fr	Normalized friction ratio point on $\Psi = -0.05$ curve used in SP distance calculation		25
URS NP Q_{tn}	Normalized tip resistance (Q_{tn}) point on $\Psi = -0.05$ curve used in SP Distance calculation		25



Table 2. References

No.	Reference
1	Robertson, P.K., Campanella, R.G., Gillespie, D. and Greig, J., 1986, "Use of Piezometer Cone Data", Proceedings of InSitu 86, ASCE Specialty Conference, Blacksburg, Virginia.
2	Robertson, P.K., 1990, "Soil Classification Using the Cone Penetration Test", Canadian Geotechnical Journal, Volume 27. This includes the discussions and replies.
3	Robertson, P.K. and Wride (Fear), C.E., 1998, "Evaluating cyclic liquefaction potential using the cone penetration test", Canadian Geotechnical Journal, 35: 442-459.
4	Robertson, P.K. and Wride, C.E., 1997, "Cyclic Liquefaction and its Evaluation Based on SPT and CPT", NCEER Workshop Paper, January 22, 1997.
5	Lunne, T., Robertson, P.K. and Powell, J. J. M., 1997, "Cone Penetration Testing in Geotechnical Practice," Blackie Academic and Professional.
6	Plewes, H.D., Davies, M.P. and Jefferies, M.G., 1992, "CPT Based Screening Procedure for Evaluating Liquefaction Susceptibility", 45 th Canadian Geotechnical Conference, Toronto, Ontario, October 1992.
7	Jefferies, M.G. and Davies, M.P., 1993, "Use of CPTu to Estimate equivalent N_{60} ", Geotechnical Testing Journal, 16(4): 458-467.
8	Been, K. and Jefferies, M.P., 1985, "A state parameter for sands", Geotechnique, 35(2), 99-112.
9	Schmertmann, 1978, "Guidelines for Cone Penetration Test Performance and Design", Federal Highway Administration Report FHWA-TS-78-209, U.S. Department of Transportation.
10	Proceedings of the NCEER Workshop on Evaluation of Liquefaction Resistance of Soils, Salt Lake City, 1996, chaired by Leslie Youd.
11	Kulhawy, F.H. and Mayne, P.W., 1990, "Manual on Estimating Soil Properties for Foundation Design, Report No. EL-6800", Electric Power Research Institute, Palo Alto, CA, August 1990, 306 p.
12	Olson, S.M. and Stark, T.D., 2002, "Liquefied strength ratio from liquefied flow failure case histories", Canadian Geotechnical Journal, 39: 951-966.
13	Olson, Scott M. and Stark, Timothy D., 2003, "Yield Strength Ratio and Liquefaction Analysis of Slopes and Embankments", Journal of Geotechnical and Geoenvironmental Engineering, ASCE, August 2003.
14	Jamiolkowski, M.B., Lo Presti, D.C.F. and Manassero, M., 2003, "Evaluation of Relative Density and Shear Strength of Sands from CPT and DMT", Soil Behaviour and Soft Ground Construction, ASCE, GSP NO. 119, 201-238.
15	Robertson, P.K., 2009, "Interpretation of cone penetration tests – a unified approach", Canadian Geotechnical Journal, 46: 1337-1355.
16	Robertson, P.K., 2010a, "Evaluation of Flow Liquefaction and Liquefied Strength Using the Cone Penetration Test", Journal of Geotechnical and Geoenvironmental Engineering, ASCE, June 2010.
17	Mayne, P.W. and Kulhawy, F.H., 1982, "Ko-OCR Relationships in Soil", Journal of the Geotechnical Engineering Division, ASCE, Vol. 108, GT6, pp. 851-872.
18	Mayne, P.W., Robertson P.K. and Lunne T., 1998, "Clay stress history evaluated from seismic piezocone tests", Proceedings of the First International Conference on Site Characterization – ISC '98, Atlanta Georgia, Volume 2, 1113-1118.

No.	Reference
19	Mayne, P.W., 2014, "Generalized CPT Method for Evaluating Yield Stress in Soils", Geocharacterization for Modeling and Sustainability (GSP 235: Proc. GeoCongress 2014, Atlanta, GA), ASCE, Reston, Virginia: 1336-1346.
20	Mayne, P.W., 2015, "Geocharacterization by In-Situ Testing", Continuing Education Course, Vancouver, BC, January 6-8, 2015.
21	Robertson, P.K. and Fear, C.E., 1995, "Liquefaction of sands and its evaluation", Proceedings of the First International Conference on Earthquake Engineering, Keynote Lecture IS Tokyo '95, Tokyo Japan, 1995.
22	Mayne, P.W., Peuchen, J. and Boumeester, D., 2010, "Soil unit weight estimation from CPTs", Proceeding of the 2 nd International Symposium on Cone Penetration Testing (CPT '10), Vol 2, Huntington Beach, California; Omnipress: 169-176.
23	Mayne, P.W., 2007, "NCHRP Synthesis 368 on Cone Penetration Test", Transportation Research Board, National Academies Press, Washington, D.C., 118 pages.
24	Mayne, P.W., 2014, "Interpretation of geotechnical parameters from seismic piezocone tests.", Key note address #2, proceedings, 3 rd International Symposium on Cone Penetration Testing (CPT'14, Las Vegas), ISSMGE Technical Committee TC102.
25	Winckler, Christina, Davidson, Richard, Yenne, Lisa, Pilz, Jorgen, 2014, "CPTu-Based State Characterization of Tailings Liquefaction Susceptibility", Tailings and Mine Waste, 2014.
25a	Winckler, Christina, Davidson, Richard, Yenne, Lisa, Pilz, Jorgen, 2014, "CPTu-Based State Characterization of Tailings Liquefaction Susceptibility", Powerpoint presentation, Tailings and Mine Waste, 2014.
26	Schneider, J.A. and Moss, R.E.S., 2011, "Linking cyclic stress and cyclic strain based methods for assessment of cyclic liquefaction triggering in sands", Geotechnique Letters 1, 31-36.
27	Rice, A., 1984, "The Seismic Cone Penetrometer", M.A.Sc. thesis submitted to the University of British Columbia, Dept. of Civil Engineering, Vancouver, BC, Canada.
28	Gillespie, D.G., 1990, "Evaluating Shear Wave Velocity and Pore Pressure Data from the Seismic Cone Penetration Test", Ph.D. thesis submitted to the University of British Columbia, Dept. of Civil Engineering, Vancouver, BC, Canada.
29	Robertson, P.K and Cabal, K.L., 2010, "Estimating soil unit weight from CPT", Proceedings of the 2 nd International Symposium on Cone Penetration Testing (CPT '10), Huntington Beach, California.
30	Robertson, P.K., 2016, "Cone penetration test (CPT)-based soil behaviour type (SBT) classification system – an update", Canadian Geotechnical Journal, July 2016.
31	Robertson, P.K., 2012, "Interpretation of in-situ tests – some insights", Mitchell Lecture, ISC'4, Recife, Brazil.
32	Robertson, P.K., Cabal, K.L. 2015, "Guide to Cone Penetration Testing for Geotechnical Engineering", 6 th Edition.
33	Robertson, P.K., 2010b, "Soil behaviour type from CPT: an update", Proceedings of the 2 nd International Symposium on Cone Penetration Testing (CPT '10), Huntington Beach, California.
34	Been, K., Romero, S., Obermeyer, J. and Hebel, G., 2012, "Determining in situ state of sand and silt tailings from the CPT", Tailings and Mine Waster 2012, 325-333.
35	Robertson, P.K., 2010, "Estimating in-situ soil permeability from CPT & CPTu", Proceedings of the 2 nd International Symposium on Cone Penetration Testing (CPT '10), Huntington Beach, California.
36	Mayne, P.W., Cargill, E. and Greig, J., 2023, "The Cone Penetration Test: A CPT Design Parameter Manual", ConeTec Group
37	Baldi, G., Bellotti, R., Ghionna, V., Jamiolkowski, M. and Lo Presti, D. 1989. Modulus of sands from CPTs and DMTs. <i>Proc. Intl. Conf. on Soil Mechanics & Foundation Engineering</i> , Vol. 1 (ICSMFE, Rio de Janeiro), Balkema, Rotterdam: 165–170. www.issmge.org
38	Crow, H.L, Hunter, J.A. and Bobrowsky, P.T., 2012, "National shear wave measurement guidelines for Canadian seismic site assessment", Proceedings of GeoManitoba 2012, the 65 th Canadian Geotechnical Conference.
39	Campanella, R.G., Robertson, P.K., Gillespie, D., 1982, "Cone penetration testing in deltaic soils", Canadian Geotechnical Journal, 20: 23-35.

Piezocone Calibration Sheets





CERTIFICATE OF CALIBRATION

Calibration Information			
Cone Serial Number	EC855	Model	A15 T1500 F15 U35
Date	2024-02-08	Signature	
Technician Performing Calibration	Richard Chen		
Calibration Approved By	Vishrut Khunt	Signature	

Lab Condition	As Found	As Left		
Lab Temperature	N/A	23°C		
Lab Humidity	N/A	29%	Reason for Calibration	Repair

Cone Information				
Tip Stress Limit	1500	bar	Tip End Area	15 cm ²
Friction Stress Limit	15	bar	Friction Surface Area	225 cm ²
Pressure Limit	35	bar	RTD Location	Pressure Carrier
X-Inclinometer Limit	30	degrees	Geophone	X and Z
Y-Inclinometer Limit	30	degrees	Temperature Range	-20°C to 60°C

Baseline Summary: (For Reference Only)

Channel	Units	As Found	As Left
Tip	bar	-0.001	0.503
Sleeve	bar	0.000	-0.012
Pressure	bar	0.037	1.012
X-Inclinometer	degrees	-0.675	0.000
Y-Inclinometer	degrees	1.925	0.000
Temperature	°C	24.574	22.279

Classified in accordance with ISO 22476-1:2012 Class 1




Classified in accordance with ISO 22476-1:2012 Class 2

Calibrated in general accordance with the ASTM D5778-20 and D7400-08 standards

Calibrated with Adara calibration procedure EC_CPTCAL-2.2

Collective uncertainty of the measurement standards conforms to a test uncertainty ratio (TUR) of 3:1 for tip and sleeve measurement and 4:1 for pressure measurement with a confidence level k=2

Cone Output vs Reference Stress/Pressure Plots

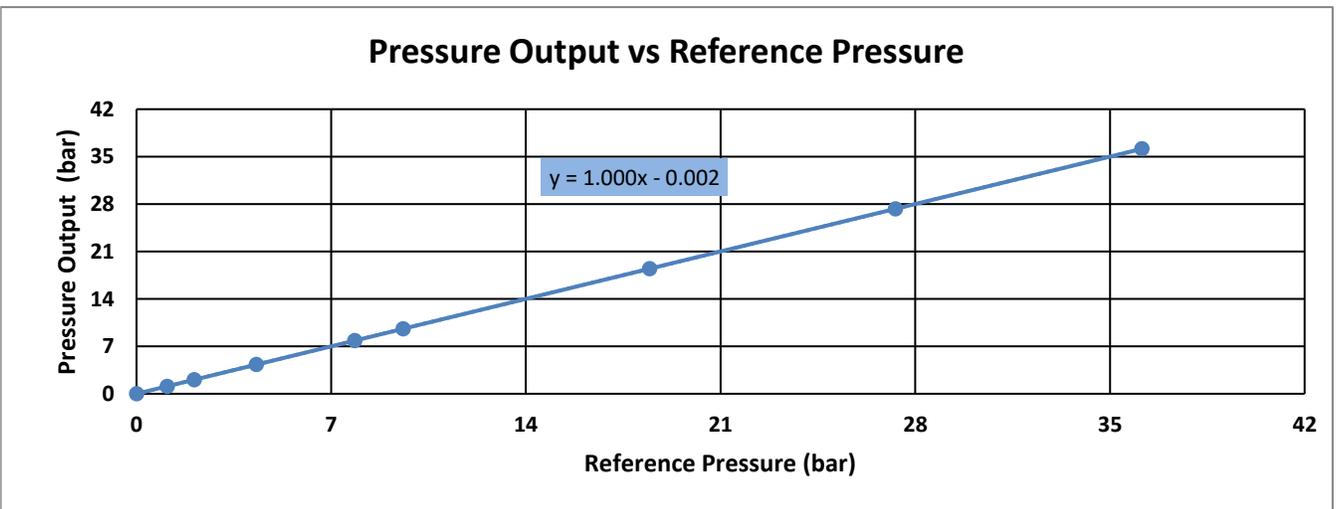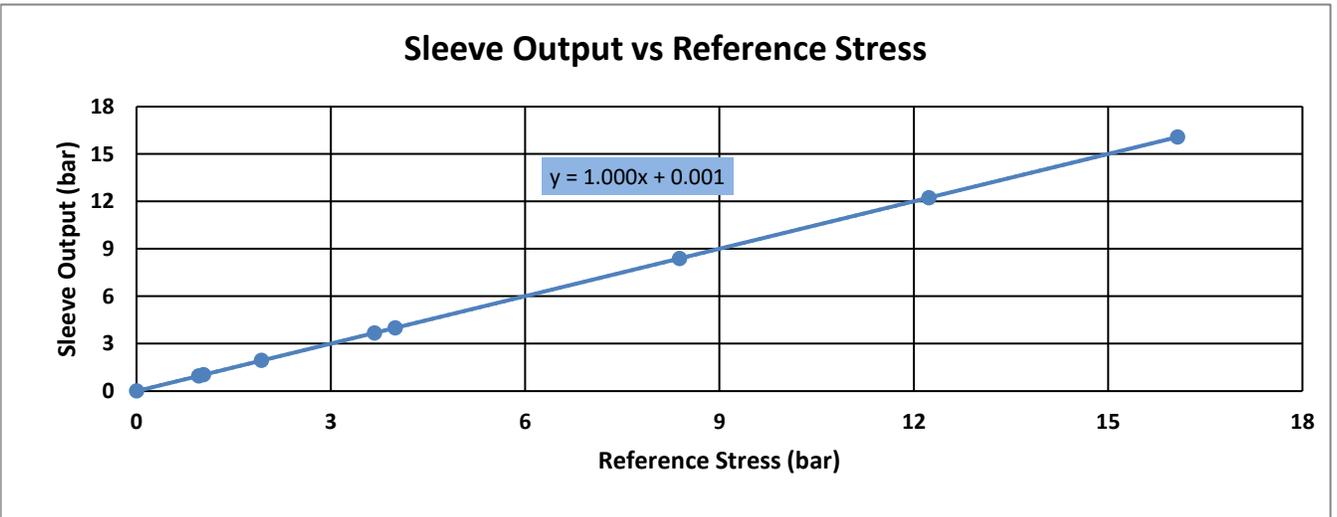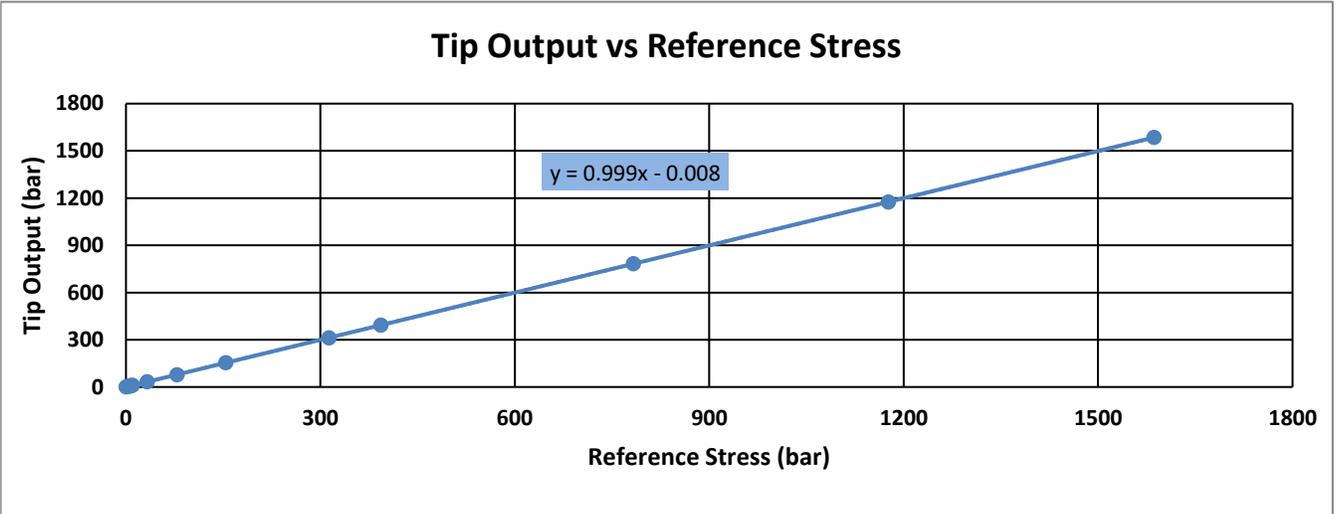



Calibration Results

Tip Calibration					
As Found			As Left		
Max. Non Linearity	N/A	N/A	Max. Non Linearity	0.08%	PASS
Calibration Error	N/A	N/A	Calibration Error	0.10%	PASS

Sleeve Calibration					
As Found			As Left		
Max. Non Linearity	N/A	N/A	Max. Non Linearity	0.05%	PASS
Calibration Error	N/A	N/A	Calibration Error	0.14%	PASS

Pressure Calibration					
As Found			As Left		
Max. Non Linearity	N/A	N/A	Max. Non Linearity	0.02%	PASS
Calibration Error	N/A	N/A	Calibration Error	0.18%	PASS

X-Inclinometer Calibration					
As Found			As Left		
Max. Non Linearity	N/A	N/A	Max. Non Linearity	-0.37%	PASS
Calibration Error	N/A	N/A	Calibration Error	0.75%	PASS

Y-Inclinometer Calibration					
As Found			As Left		
Max. Non Linearity	N/A	N/A	Max. Non Linearity	-0.25%	PASS
Calibration Error	N/A	N/A	Calibration Error	0.50%	PASS

Seismic Calibration					
As Found			As Left		
Trigger Delay Error	N/A	N/A	Trigger Delay Error	0.01%	PASS

Temperature Calibration					
Full Scale Error	0.18%	PASS			

Channel	Cold	Room	Hot	Units
Ref_Temp	4.8	22.1	42.7	°C
Tip	-2.473	-0.197	2.769	bar
Sleeve	0.012	-0.016	-0.038	bar
Pressure	1.042	1.057	1.054	bar
Temperature	4.941	21.927	42.790	°C

Tip Temperature Coefficient	0.138 bar/°C	PASS
Sleeve Temperature Coefficient	-0.001 bar/°C	PASS
Pressure Temperature Coefficient	0.000 bar/°C	PASS



Testing Equipment Details

Testing Machines	Model Number	Serial Number	Calibration Number	Due Date
Tip Load Cell	Precision	P-10289	100490	2025-09-18
Sleeve Load Cell	Precision	P-10868	100579	2025-10-01
Digital Loadcell Indicator	4215	62140	100490	2024-07-18
Fluke Reference Pressure Monitor	RPM4 A10Ms	3910	100835	2024-12-12
Tektronix Function Generator	AFG3021B	C030955	100751	2024-10-20
Thermometer	THS-222-555	D23255834	100410	2024-07-11
Thermometer	THS-222-555	D23255829	100410	2024-07-11
Thermometer	THS-222-555	D20345575	100565	2024-07-14

Adara Error Definitions

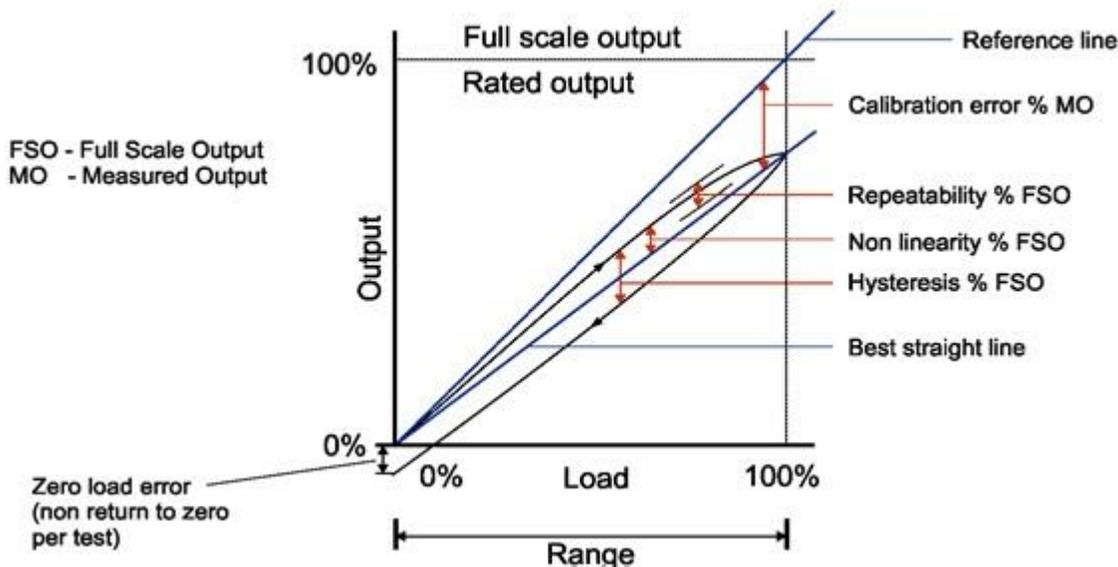


Figure 1: Definition of Calibration Terms for Load Cell and Transducers (Adapted from [1])

Actual Sensitivity	The slope of the best fit line through all data points starting at zero load.
Slope Error	The error in the best fit line compared to the ideal linear calibration in % . Slope Error = (Best Fit Slope - Ideal Slope) / Ideal Slope
Maximum Non Linearity	This value represents the maximum error (absolute value) relative to the best fit line considering each calibration point starting at loads greater than approximately 10% of FSO. The reported errors are a percent error of FSO. Adara's Pass/Fail criteria is 0.5% of FSO (ASTM is 0.5% of FSO at loads > 20% FSO).
Calibration Error	This value represents the maximum error (absolute value) in the recorded load value as compared to the actual load value for each calibration point for loads greater than approximately 10% of FSO. Adara's Pass/Fail criteria for the tip and sleeve is 0.5% of MO and 1.0% of MO for the pore pressure (ASTM for the tip and sleeve is 1.5% and 1.0% of MO respectively at loads greater than 20% of FSO)

Temperature Check Passing Criteria

Tip Temperature Coefficient	<0.200 bar/°C
Sleeve Temperature Coefficient	<0.005 bar/°C
Pressure Temperature Coefficient	<0.0196 bar/°C



ASTM D5778-20 Annex A Summary [1]

A1.4 Force Transducer Calibration Requirements

A1.4.1 states the following limits:

Non Linearity	Tip	$\leq +0.5\%$ of FSO
	Sleeve	$\leq +1.0\%$ of FSO
Calibration Error	Tip	$\leq +1.5\%$ of MO at loads > 20% FSO
	Sleeve	$\leq +1.0\%$ of MO at loads > 20% FSO

A1.5 Pressure Transducer Calibrations

A1.5.1 limits:

Non Linearity	Pore Pressure	$\leq +1.0\%$ of FSO
Calibration Error	Pore Pressure	not specified

ISO 22476 -1:2012 Summary [2]

Section 5.2 states the following allowable minimum accuracy

Class 1	Cone Resistance	35 kPa or 5%
	Sleeve Friction	5 kPa or 10%
	Pore Pressure	10 kPa or 2%
Class 2	Cone Resistance	100 kPa or 5%
	Sleeve Friction	15 kPa or 15%
	Pore Pressure	25 kPa or 3%

Note: ISO Compliance is based on low end calibration only.

References

[1] ASTM D5778-20. "Standard Test Method for Electronic Friction Cone and Piezocone Penetration Testing of Soils". ASTM, West Conshohocken, PA, USA.

[2] ISO 22476-1:2012. "Geotechnical investigation and testing - Field Testing - Part 1: Electrical cone and piezocone penetration test". ISO, Geneva, Switzerland.

ASTM D7400-08. "Standard Test Methods for Downhole Seismic Testing". ASTM, West Conshohocken, PA, USA.


APPENDIX B

LABORATORY TESTING

Grain Size Analyses	B-1
Liquid And Plastic Limit Determinations.....	B-6

Particle Size Distribution Report

ASTM D422 & D1140

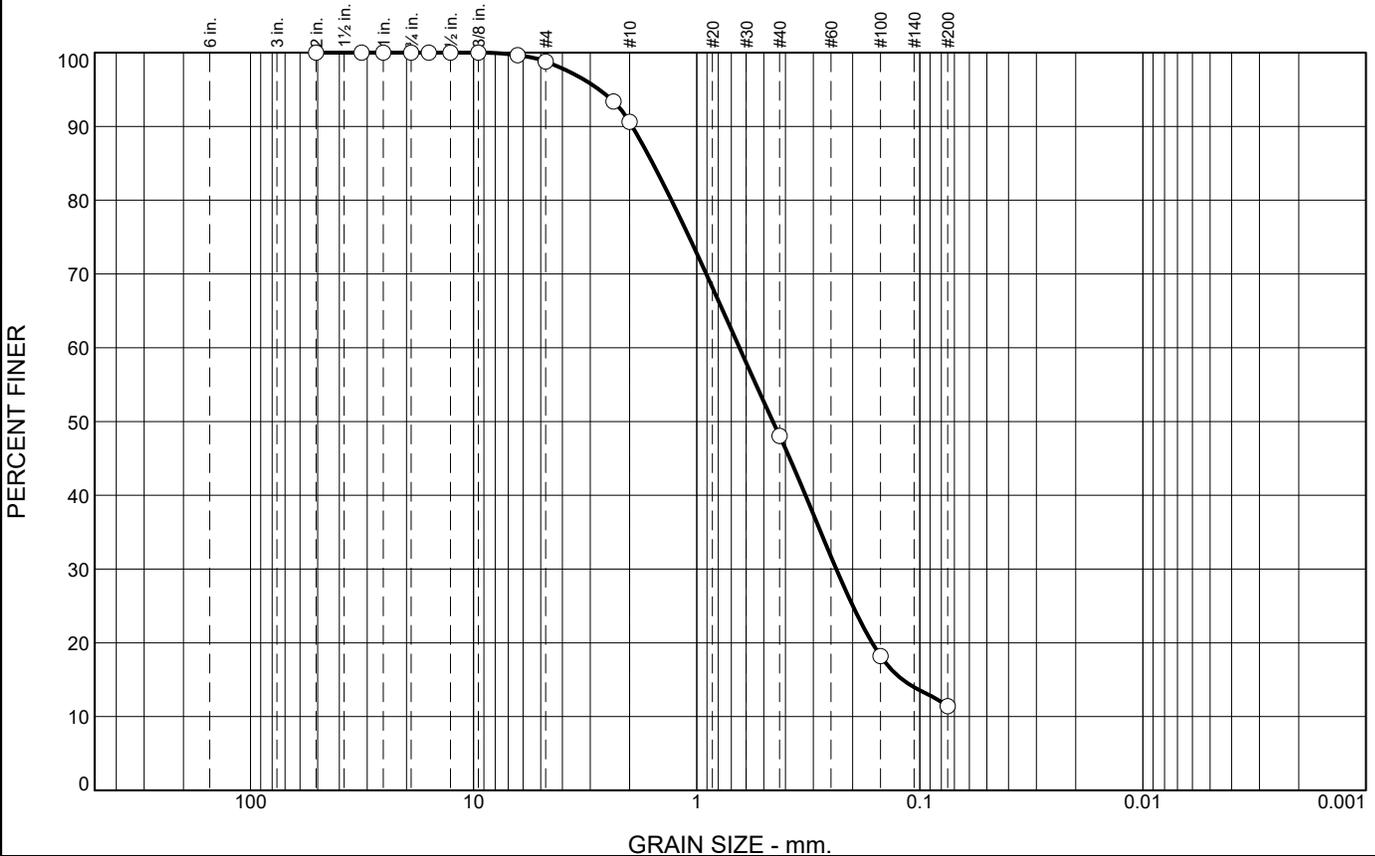

% +3"	% Gravel		% Sand			% Fines	
	Coarse	Fine	Coarse	Medium	Fine	Silt	Clay
0	0	1	8	43	37	11	

Test Results (ASTM D422 & D1140)				
Sieve Size or Diam. (mm.)	Finer (%)	Spec.* (%)	Out of Spec. (%)	Pct. of Fines
2	100			
1 1/4	100			
1	100			
3/4	100			
5/8	100			
1/2	100			
3/8	100			
1/4	100			
#4	99			
#8	93			
#10	91			
#40	48			
#100	18			
#200	11			

* (no specification provided)

Material Description
ORA sample ID: 1801-1

Atterberg Limits
 PL= LL= NP PI=

Coefficients
 D₉₀= 1.9443 D₈₅= 1.5746 D₆₀= 0.6430
 D₅₀= 0.4554 D₃₀= 0.2369 D₁₅= 0.1194
 D₁₀= C_u= C_c=

Classification
 USCS= SP-SM AASHTO=

Test Remarks
 Test equipment ID: Set 5
 Was sample soaked? No
 As received MC: 24.4%

Location: B-4, S-4, Depth: 10.0' - 11.5'
 Sample Number: 1801-1

Sample Date: 3/26/2025

OTTO ROSENAU & ASSOCIATES, INC.

Client: Snohomish Regional Fire & Rescue
 Project: Fire Station 32 - Monroe
 19959 Oaks Street, Monroe
 Project No: 24-0267

Figure 1801-1


Tested By: Andy Duong

Checked By: Anthony Coyne, P.E.
 B-2

This report applies to the items tested or reported and is the exclusive property of Otto Rosenau & Associates, Inc. Reproduction of this report, except in full, without written permission from our firm is strictly prohibited. Classification: ASTM D2488, Natural Moisture: ASTM D2216, Sieve Analysis: ASTM D422 or ASTM C136, Percent Finer than No. 200: ASTM D1140 or ASTM C117, Hydrometer: ASTM D422. NOTE: Simple acceptance/refectoin decision rule was utilized

Particle Size Distribution Report

ASTM D422 & D1140

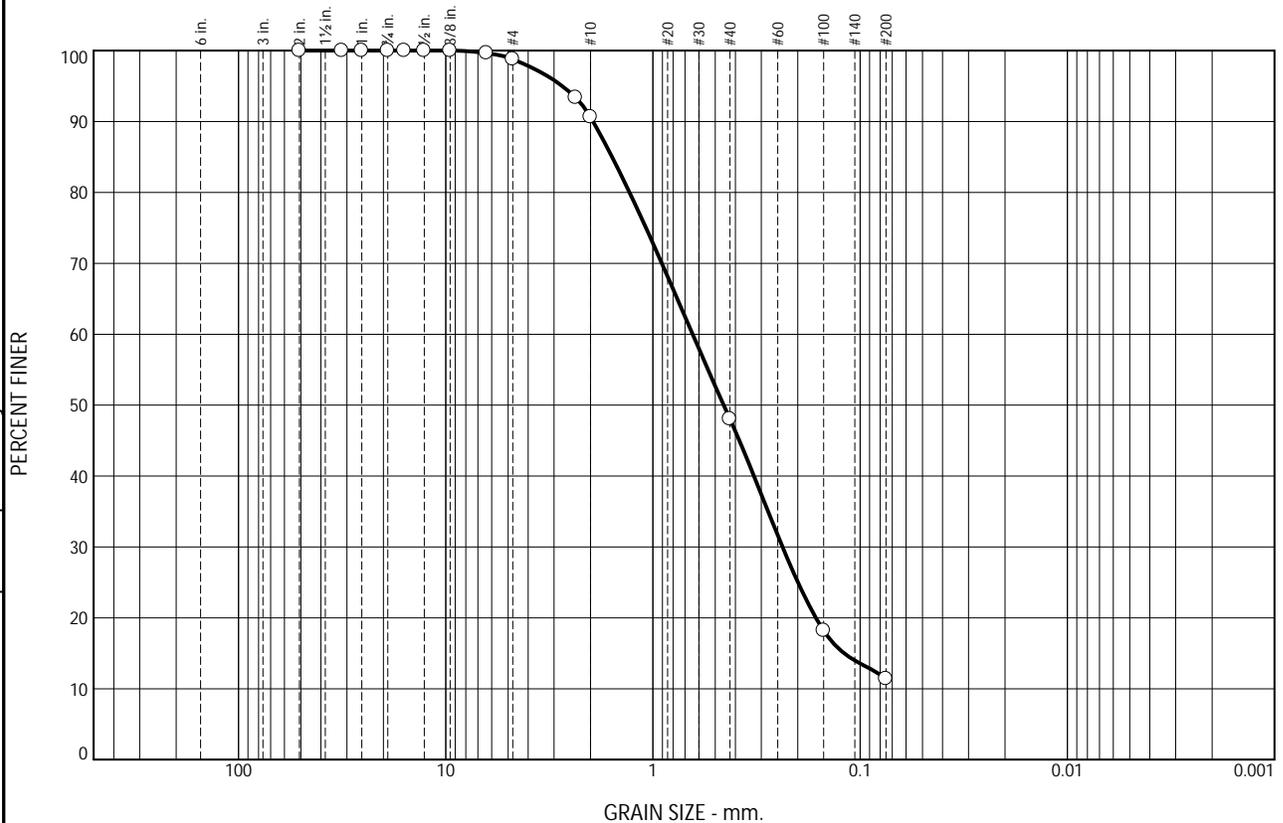

% +3"	% Gravel		% Sand			% Fines	
	Coarse	Fine	Coarse	Medium	Fine	Silt	Clay
0	0	1	8	43	37	11	

Test Results (ASTM D422 & D1140)				
Sieve Size or Diam. (mm.)	Finer (%)	Spec.* (%)	Out of Spec. (%)	Pct. of Fines
2	100			
1 1/4	100			
1	100			
3/4	100			
5/8	100			
1/2	100			
3/8	100			
1/4	100			
#4	99			
#8	93			
#10	91			
#40	48			
#100	18			
#200	11			

* (no specification provided)

Material Description

ORA sample ID: 1801-1

Atterberg Limits

PL= LL= NP PI=

Coefficients

D₉₀= 1.9443 D₈₅= 1.5746 D₆₀= 0.6430

D₅₀= 0.4554 D₃₀= 0.2369 D₁₅= 0.1194

D₁₀= C_u= C_c=

Classification

USCS= SP-SM AASHTO=

Test Remarks

Test equipment ID: Set 5
 Was sample soaked? No
 As received MC: 24.4%

Location: B-4, S-4, Depth: 10.0' - 11.5'
 Sample Number: 1801-1

Sample Date: 3/26/2025

OTTO ROSENAU & ASSOCIATES, INC.

Client: Snohomish Regional Fire & Rescue
 Project: Fire Station 32 - Monroe
 19959 Oaks Street, Monroe
 Project No: 24-0267


Figure 1801-1

This report applies to the items tested or reported and is the exclusive property of Otto Rosenau & Associates, Inc. Reproduction of this report, except in full, without written permission from our firm is strictly prohibited. Classification: ASTM D2488, Natural Moisture: ASTM D2216, Sieve Analysis: ASTM D422 or ASTM C136, Percent Finer than No. 200: ASTM D1140 or ASTM C117, Hydrometer: ASTM D422. NOTE: Simple acceptance/rejectoin decision rule was utilized

Tested By: Andy Duong Checked By: Anthony Coyne, P.E.

Particle Size Distribution Report

ASTM D422 & D1140

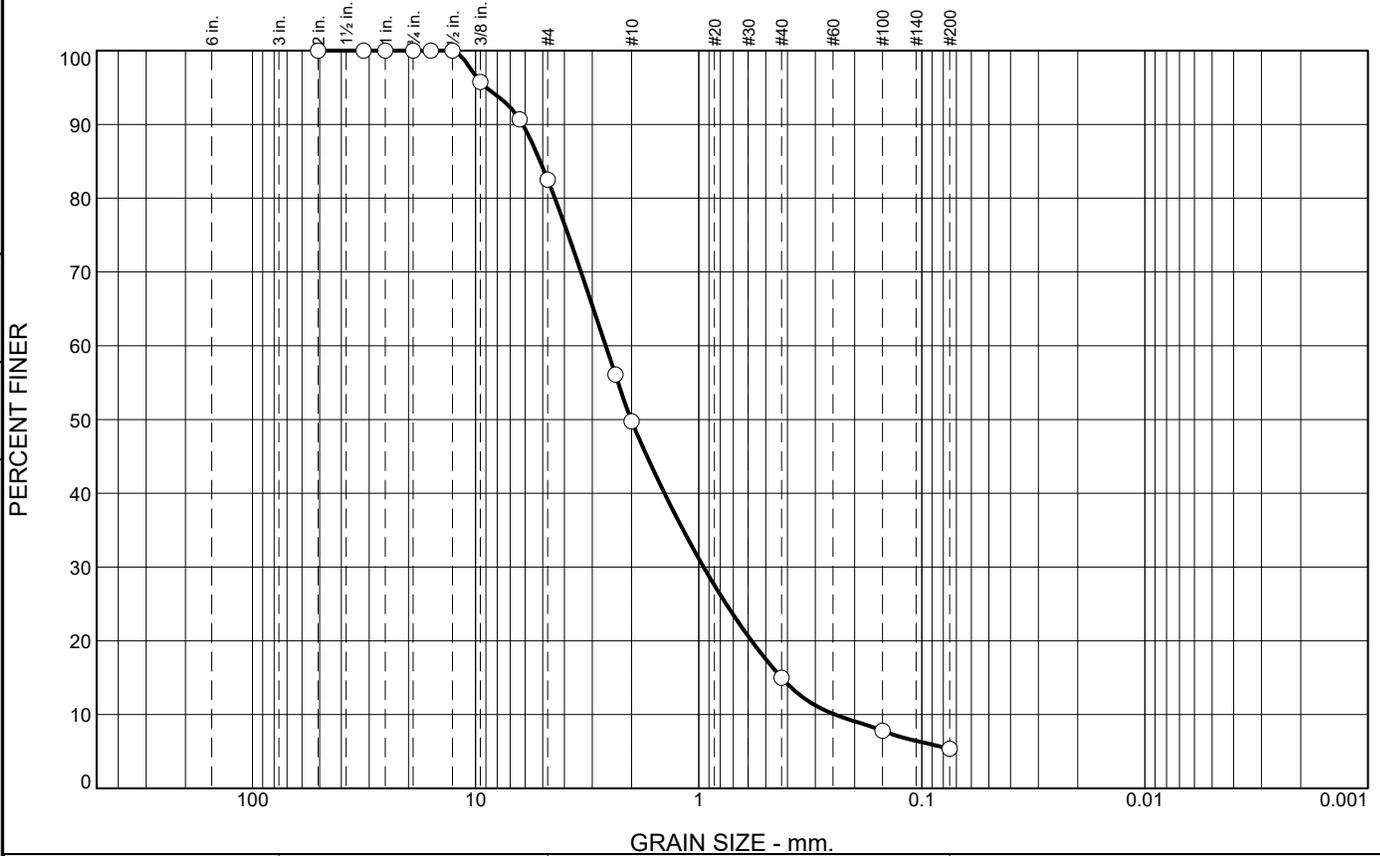

% +3"	% Gravel		% Sand			% Fines	
	Coarse	Fine	Coarse	Medium	Fine	Silt	Clay
0	0	17	33	35	10	5	

Test Results (ASTM D422 & D1140)				
Sieve Size or Diam. (mm.)	Finer (%)	Spec.* (%)	Out of Spec. (%)	Pct. of Fines
2	100			
1 1/4	100			
1	100			
3/4	100			
5/8	100			
1/2	100			
3/8	96			
1/4	91			
#4	83			
#8	56			
#10	50			
#40	15			
#100	8			
#200	5.4			

* (no specification provided)

Material Description
ORA sample ID: 1801-3 well-graded sand with silt and gravel

Atterberg Limits
PL= LL= PI=

Coefficients
D₉₀= 6.1498 D₈₅= 5.1321 D₆₀= 2.6113
D₅₀= 2.0165 D₃₀= 0.9505 D₁₅= 0.4255
D₁₀= 0.2446 C_u= 10.68 C_c= 1.41

Classification
USCS= SW-SM AASHTO= A-1-a

Test Remarks
Test equipment ID: Set 5
Was sample soaked? Not required
As received MC: 13.5%

Location: B-6, S-3, Depth: 15.0' - 16.5'
Sample Number: 1801-3

Sample Date: 3/26/2025

OTTO ROSENAU & ASSOCIATES, INC.

Client: Snohomish Regional Fire & Rescue
Project: Fire Station 32 - Monroe
19959 Oaks Street, Monroe
Project No: 24-0267

Figure 1801-3

Tested By: Andy Duong

Checked By: Anthony Coyne, P.E.
B-4

This report applies to the items tested or reported and is the exclusive property of Otto Rosenau & Associates, Inc. Reproduction of this report, except in full, without written permission from our firm is strictly prohibited. Classification: ASTM D2488, Natural Moisture: ASTM D2216, Sieve Analysis: ASTM D422 or ASTM C136, Percent Finer than No. 200: ASTM D1140 or ASTM C117, Hydrometer: ASTM D422. NOTE: Simple acceptance/refectoin decision rule was utilized

This report applies to the items tested or reported and is the exclusive property of Otto Rosenau & Associates, Inc. Reproduction of this report, except in full, without written permission from our firm is strictly prohibited. Classification: ASTM D2488, Natural Moisture: ASTM D2216, Sieve Analysis: ASTM D422 or ASTM C136, Percent Finer than No. 200: ASTM D1140 or ASTM C117, Hydrometer: ASTM D422. NOTE: Simple acceptance/rejectoin decision rule was utilized

Particle Size Distribution Report

ASTM D422 & D1140



% +3"	% Gravel		% Sand			% Fines	
	Coarse	Fine	Coarse	Medium	Fine	Silt	Clay
0	0	1	6	27	45	21	

Test Results (ASTM D422 & D1140)				
Sieve Size or Diam. (mm.)	Finer (%)	Spec.* (%)	Out of Spec. (%)	Pct. of Fines
2	100			
1 1/4	100			
1	100			
3/4	100			
5/8	100			
1/2	100			
3/8	100			
1/4	100			
#4	99			
#8	95			
#10	93			
#40	66			
#100	37			
#200	21			

* (no specification provided)

Material Description

ORA sample ID: 1801-4 silty sand

Atterberg Limits

PL= LL= PI=

Coefficients

D₉₀= 1.5762 D₈₅= 1.1387 D₆₀= 0.3327
 D₅₀= 0.2350 D₃₀= 0.1114 D₁₅=
 D₁₀= C_u= C_c=

Classification

USCS= SM AASHTO= A-2-4(0)

Test Remarks

Test equipment ID: Set 5
 Was sample soaked? Not required
 As received MC: 25.1%

Location: B-7, S-2, Depth: 10.0' - 11.5'
 Sample Number: 1801-4

Sample Date: 3/26/2025

OTTO ROSENAU & ASSOCIATES, INC.



Client: Snohomish Regional Fire & Rescue
 Project: Fire Station 32 - Monroe
 19959 Oaks Street, Monroe
 Project No: 24-0267

Figure 1801-4

Tested By: Andy Duong Checked By: Anthony Coyne, P.E.

This report applies to the items tested or reported and is the exclusive property of Otto Rosenau & Associates, Inc. Reproduction of this report, except in full, without written permission from our firm is strictly prohibited. Classification: ASTM D2216, Natural Moisture: ASTM D2488, Sieve Analysis: ASTM D422 or ASTM C136, Percent Finer than No. 200: ASTM D1140 or ASTM C117, Hydrometer: ASTM D422. NOTE: Simple acceptance/rejectoin decision rule was utilized

LIQUID AND PLASTIC LIMITS TEST REPORT

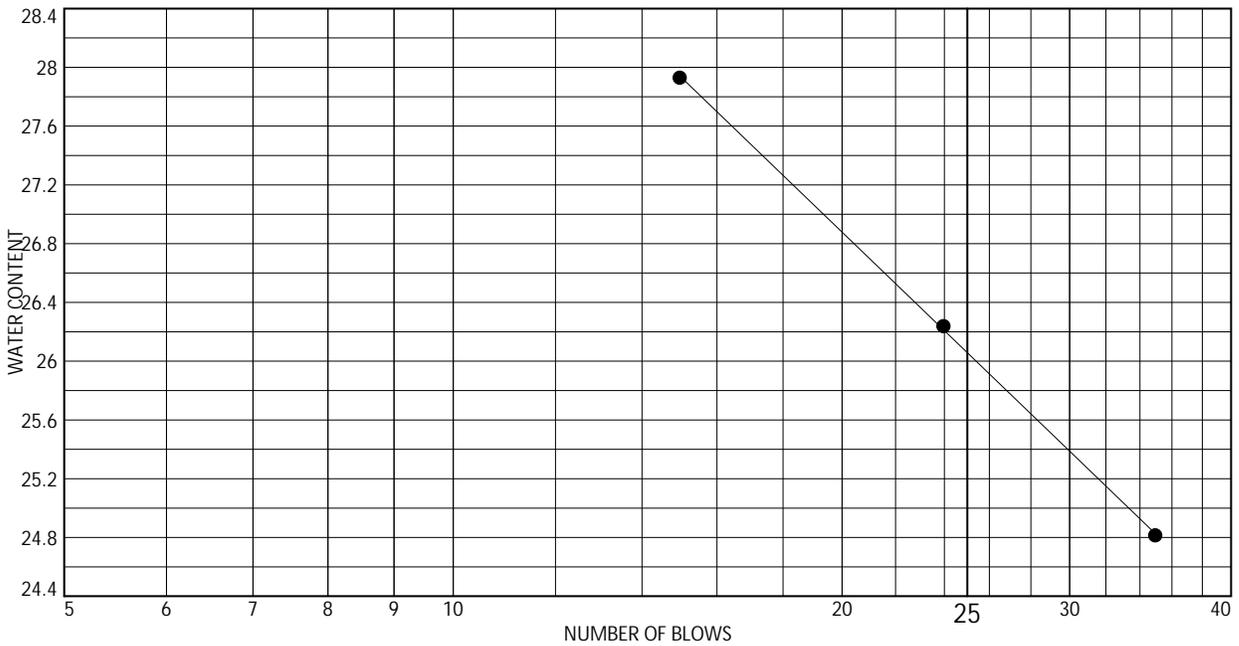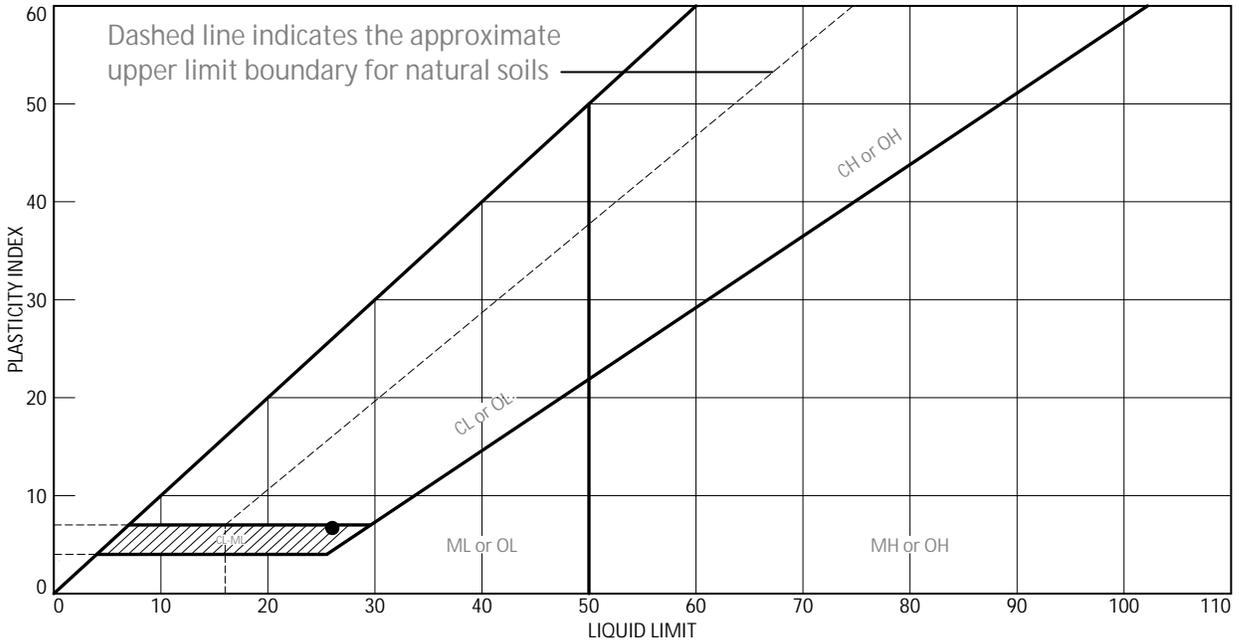

MATERIAL DESCRIPTION	LL	PL	PI	%<#40	%<#200	USCS
● ORA sample ID: 1801-6 Gray lean silty clay	26.1	19.5	6.6			CL-ML

Project No. 24-0267 Client: Snohomish Regional Fire & Rescue
 Project: Fire Station 32 - Monroe
 19959 Oaks Street, Monroe
 Location: B-4, S-6, Depth: 5.0'-6.5'
 Sample Number: 1801-6

Remarks:
 ● Natural Moisture Content = 30.3%

OTTO ROSENAU & ASSOCIATES, INC.


Figure 1801-6

Tested By: Joe Tester Checked By: Anthony Coyne, P.E.

APPENDIX C

RESULTS OF GEOPHYSICAL (REMI) SURVEY

Report for REMI Survey at a proposed fire station in Monroe, WA by Global Geophysics (2024) C-1



Global Geophysics

P.O. Box 2229
Redmond, WA 98073-2229

Tel: 425-890-4321
Fax: 206-5820-0838

August 15, 2024

Our ref: 114-0813.000

Otto Rosenau & Associates, Inc.
Geotechnical Engineering, Construction Inspection & Materials Testing
6747 M.L. King Way South
Seattle, WA 98118

Attention: Mr. Anthony Coyne

RE: REPORT FOR REFRACTION MICROTREMOR SURVEY AT A PROPOSED FIRE STATION IN MONROE, WA

Dear Mr. Coyne:

Global Geophysics LLC. conducted a refraction microtremor (ReMi) survey at proposed fire station in Monroe, WA on August 13, 2024. The objective of the survey was to provide Vs100.

GEOPHYSICAL METHODS AND FIELD PROCEDURES

Refraction microtremor was used for this project. The following paragraphs describe the method and field procedure.

Refraction Microtremor

The refraction microtremor (ReMi) method determines variations in surface wave velocities with increasing distances and wavelengths. The data from these measurements are used to model the shear wave velocities of the subsurface. This information can then be used to infer rock/soil types, stratigraphy and soil conditions.

The ReMi survey requires a seismic source, to generate surface-waves, and at least 24 geophones, to measure the ground response at increasing distances from the source. Surface waves are a special type of seismic wave whose propagation is confined to the near surface medium. The depth of subsurface penetration of a surface-wave is directly proportional to its wavelength. In a non-homogeneous medium, surface-waves are dispersive, i.e. each wavelength has a characteristic velocity stemming from subsurface heterogeneities. The relationship between surface-wave velocity and wavelength is used to calculate the shear-wave velocity of the medium with increasing depth.

The seismic source can be either active or passive, depending on the application and location of the survey. Examples of active sources include explosives, weight-drops, and vibrating pads. Examples of passive sources are drill rigs, road traffic, micro-tremors, and water-wave action (in near-shore environments). Geophone measures the arrival time of the various components of the surface wave-train traveling from the seismic source.

The surface-wave velocity with respect to frequency (called the ‘dispersion curve’) is determined by measuring the delay time in wave propagation between the geophones. The dispersion curve is then matched to a theoretical dispersion curve using an iterative forward-modeling procedure. The result is a profile of shear-wave velocity versus depth. This shear wave profile can be with used other parameters such as density, to estimate the dynamic shear modulus of the medium as a function of depth.

The ReMi survey was conducted using one Geometrics Geode 24-channel digital seismograph. The 24 geophones were placed at 10 ft spacing and the seismic energy source was the traffic vibration. The signal was detected by the geophones and recorded in a computer for further processing.


RESULTS

The data were collected along 1 transect. The approximate line location is shown below.




The 1D Vs100 models are shown below:

- Vs30 = 828.2 ft/s

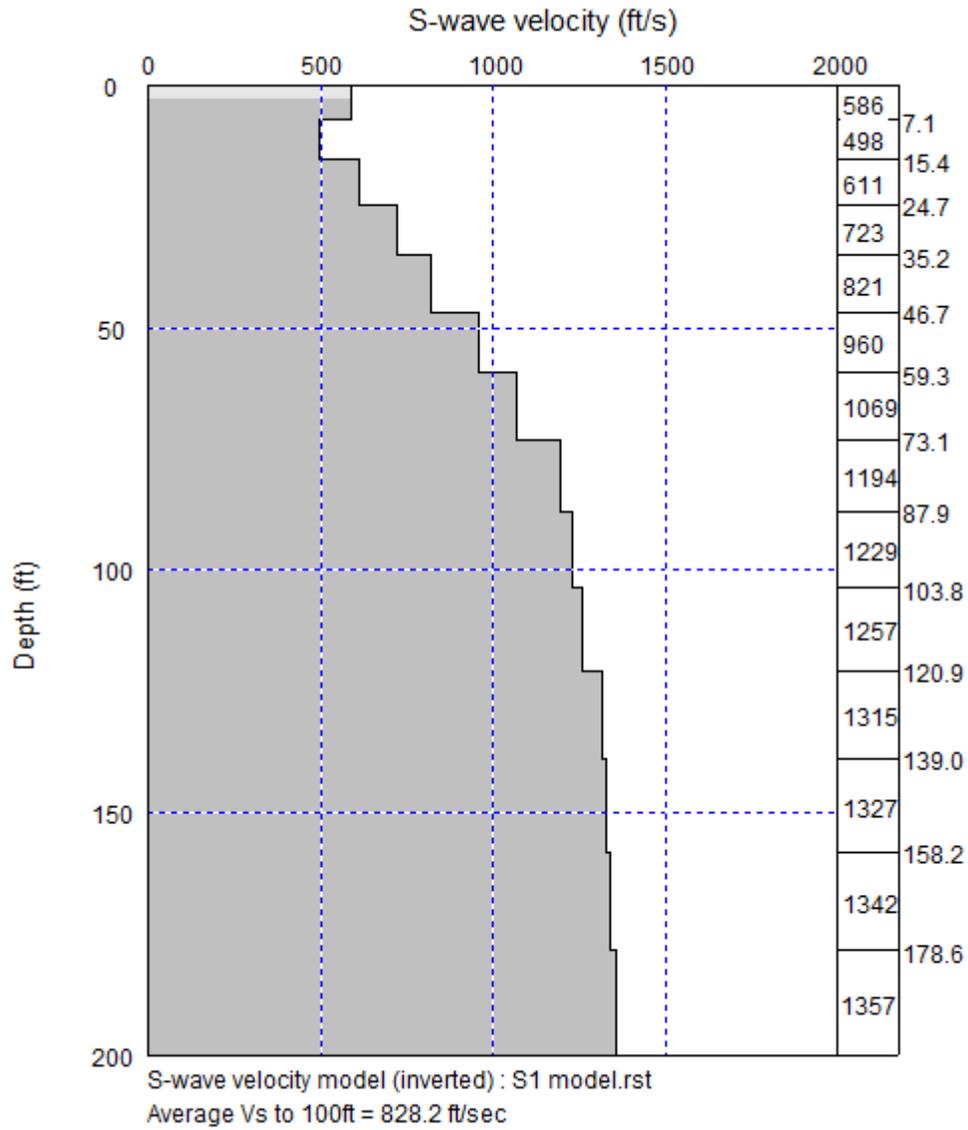

The dispersion curve is shown below:

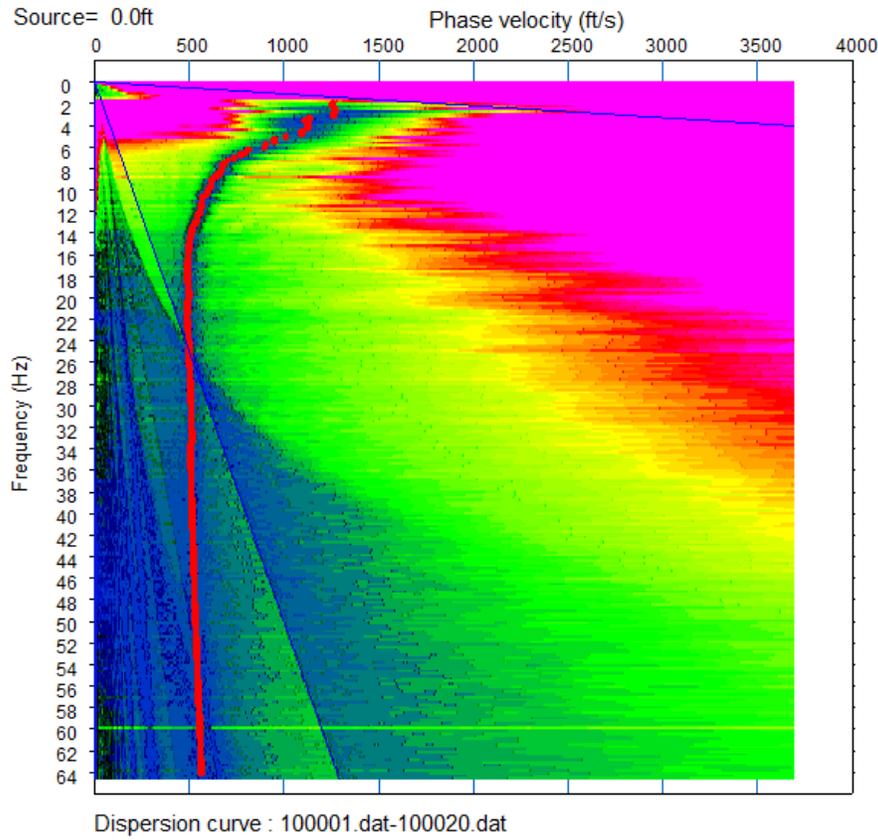

Depth(ft)	S-wave velocity(ft/s)
0	586
7	498
15	611
25	723
35	821
47	960
59	1069
73	1195
88	1230
104	1258
121	1315
139	1328
158	1342
179	1358
200	1358

LIMITATION OF GEOPHYSICAL METHODS

Global geophysics services are conducted in a manner consistent with the level of care and skill ordinarily exercised by other members of the geophysical community currently practicing under similar conditions subject to the time limits and financial and physical constraints applicable to the services. ReMi is a remote sensing geophysical method that may not detect all subsurface conditions due to the limitations of the methods, soil conditions, size of the features and their depths.

Sincerely,

Global Geophysics

A handwritten signature in black ink, appearing to read "John Liu", with a stylized flourish at the end.

John Liu, Ph.D., R.G.
Principal Geophysicist

APPENDIX D
SEISMIC DESIGN CRITERIA

ASCE 7-16 Hazards Report D-1
USGS Deaggregation D-4





ASCE Hazards Report

Address:
No Address at This Location

Standard: ASCE/SEI 7-16
Risk Category: IV
Soil Class: D - Stiff Soil

Latitude: 47.860741
Longitude: -121.964541
Elevation: 73.714946994705 ft (NAVD 88)

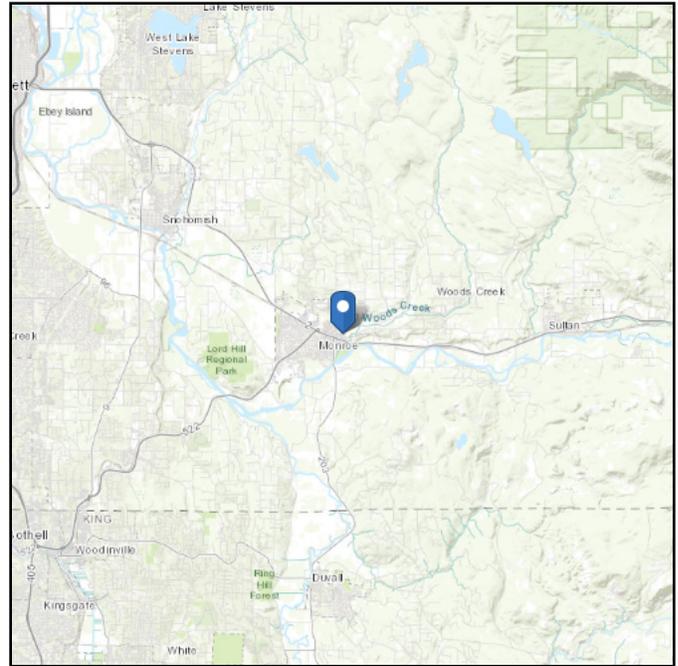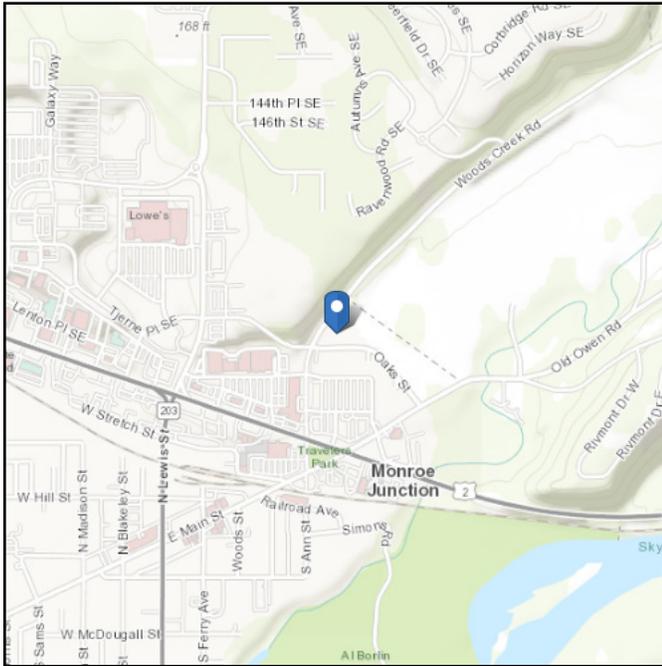

Site Soil Class: D - Stiff Soil

Results:

S_s :	1.144	S_{D1} :	N/A
S_1 :	0.402	T_L :	6
F_a :	1.042	PGA :	0.49
F_v :	N/A	PGA _M :	0.544
S_{MS} :	1.193	F_{PGA} :	1.11
S_{M1} :	N/A	I_e :	1.5
S_{DS} :	0.795	C_v :	1.329

Ground motion hazard analysis may be required. See ASCE/SEI 7-16 Section 11.4.8.

Data Accessed: Wed Oct 23 2024

Date Source: [USGS Seismic Design Maps](#)

The ASCE Hazard Tool is provided for your convenience, for informational purposes only, and is provided “as is” and without warranties of any kind. The location data included herein has been obtained from information developed, produced, and maintained by third party providers; or has been extrapolated from maps incorporated in the ASCE standard. While ASCE has made every effort to use data obtained from reliable sources or methodologies, ASCE does not make any representations or warranties as to the accuracy, completeness, reliability, currency, or quality of any data provided herein. Any third-party links provided by this Tool should not be construed as an endorsement, affiliation, relationship, or sponsorship of such third-party content by or from ASCE.

ASCE does not intend, nor should anyone interpret, the results provided by this Tool to replace the sound judgment of a competent professional, having knowledge and experience in the appropriate field(s) of practice, nor to substitute for the standard of care required of such professionals in interpreting and applying the contents of this Tool or the ASCE standard.

In using this Tool, you expressly assume all risks associated with your use. Under no circumstances shall ASCE or its officers, directors, employees, members, affiliates, or agents be liable to you or any other person for any direct, indirect, special, incidental, or consequential damages arising from or related to your use of, or reliance on, the Tool or any information obtained therein. To the fullest extent permitted by law, you agree to release and hold harmless ASCE from any and all liability of any nature arising out of or resulting from any use of data provided by the ASCE Hazard Tool.

Unified Hazard Tool



Please do not use this tool to obtain ground motion parameter values for the design code reference documents covered by the [U.S. Seismic Design Maps web tools](#) (e.g., the International Building Code and the ASCE 7 or 41 Standard). The values returned by the two applications are not identical.


Please also see the new [USGS Earthquake Hazard Toolbox](#) for access to the most recent NSHMs for the conterminous U.S. and Hawaii.

^ Input


Edition Dynamic: Conterminous U.S. 2014 (u...	Spectral Period Peak Ground Acceleration
Latitude Decimal degrees 47.860741	Time Horizon Return period in years 2475
Longitude Decimal degrees, negative values for western longitudes -121.964541	
Site Class 259 m/s (Site class D)	

^ Hazard Curve


Hazard Curves

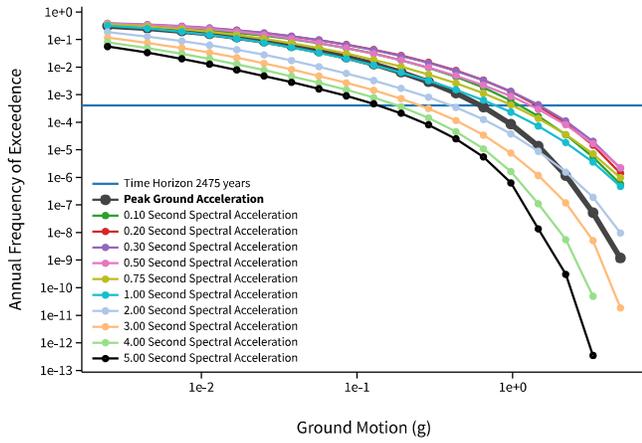

Uniform Hazard Response Spectrum

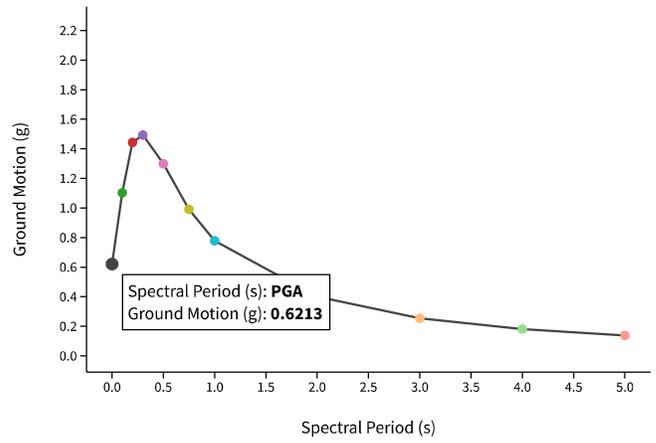

Component Curves for Peak Ground Acceleration

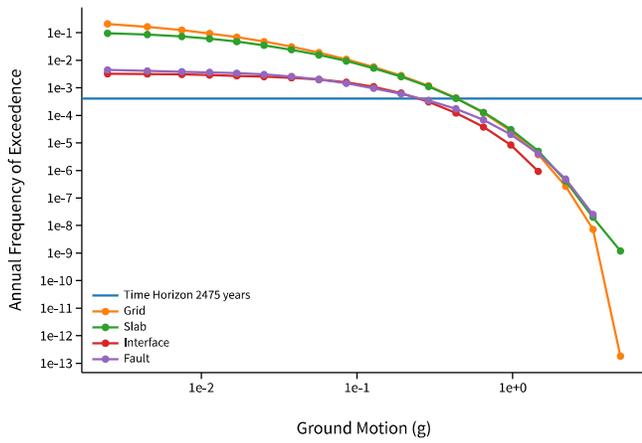


[View Raw Data](#)

^ Deaggregation

Component

Total

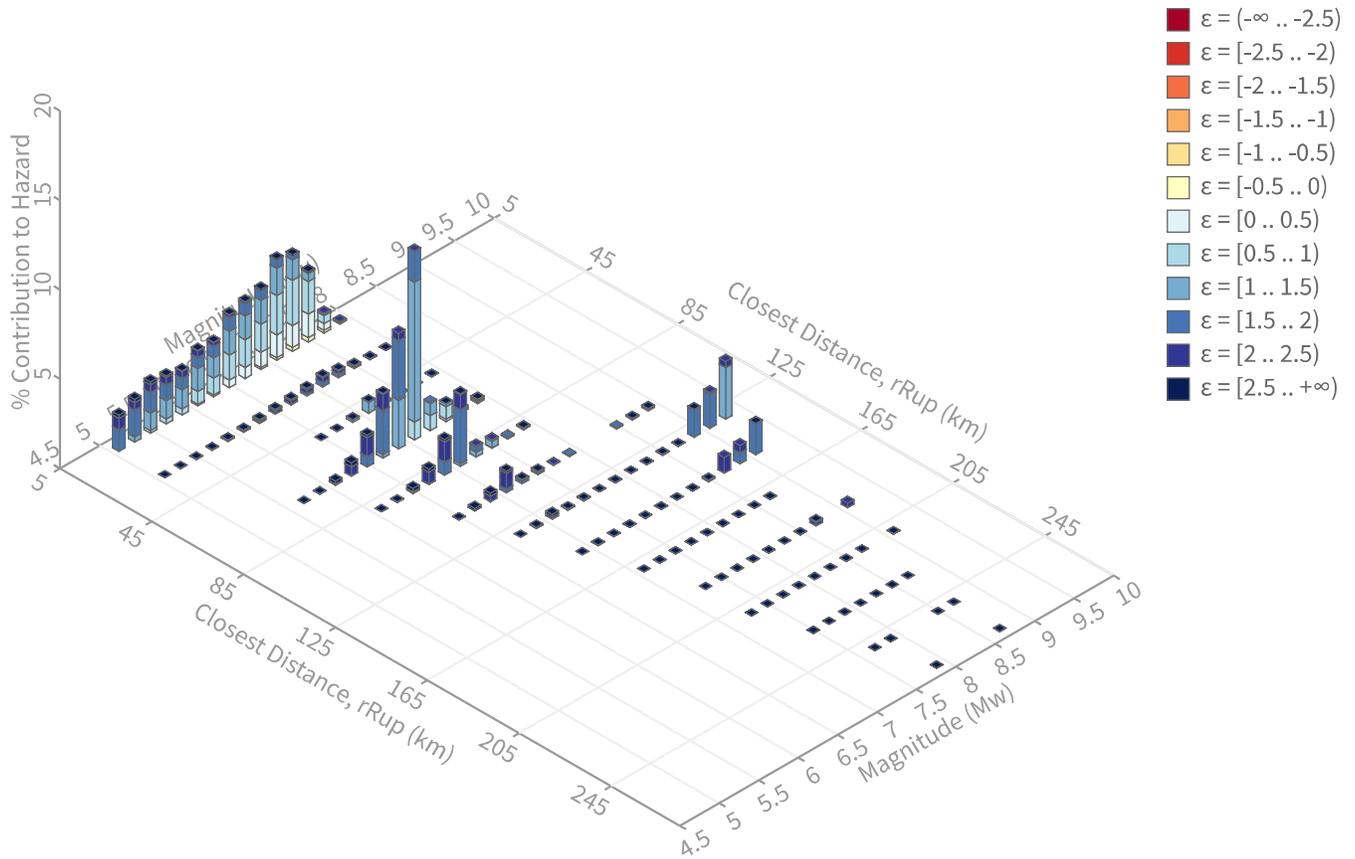

Summary statistics for, Deaggregation: Total

Deaggregation targets

Return period: 2475 yrs
Exceedance rate: 0.0004040404 yr⁻¹
PGA ground motion: 0.62125637 g

Recovered targets

Return period: 2626.882 yrs
Exceedance rate: 0.00038067946 yr⁻¹

Totals

Binned: 100 %
Residual: 0 %
Trace: 0.33 %

Mean (over all sources)

m: 7.01
r: 49.53 km
ε₀: 1.41 σ

Mode (largest m-r bin)

m: 7.11
r: 67.93 km
ε₀: 1.29 σ
Contribution: 10.55 %

Mode (largest m-r-ε₀ bin)

m: 7.1
r: 67.3 km
ε₀: 1.24 σ
Contribution: 7.82 %

Discretization

r: min = 0.0, max = 1000.0, Δ = 20.0 km
m: min = 4.4, max = 9.4, Δ = 0.2
ε: min = -3.0, max = 3.0, Δ = 0.5 σ

Epsilon keys

ε0: [-∞ .. -2.5)
ε1: [-2.5 .. -2.0)
ε2: [-2.0 .. -1.5)
ε3: [-1.5 .. -1.0)
ε4: [-1.0 .. -0.5)
ε5: [-0.5 .. 0.0)
ε6: [0.0 .. 0.5)
ε7: [0.5 .. 1.0)
ε8: [1.0 .. 1.5)
ε9: [1.5 .. 2.0)
ε10: [2.0 .. 2.5)
ε11: [2.5 .. +∞]

Deaggregation Contributors

Source Set ↴ Source	Type	r	m	ϵ_0	lon	lat	az	%
pacnwdeep.2014.in	Slab							16.78
pacnwdeep.2014.in	Slab							16.04
Geologic Model Partial Rupture	Fault							9.83
Southern Whidbey Island North Alt2		9.31	6.99	0.65	122.001°W	47.766°N	194.52	3.51
Southern Whidbey Island Middle Alt2		12.98	7.00	1.04	122.017°W	47.716°N	193.75	1.98
Southern Whidbey Island North		9.23	6.97	0.71	122.052°W	47.811°N	229.49	1.59
Southern Whidbey Island South Alt2		15.98	7.01	1.35	122.214°W	47.818°N	255.86	1.15
Southern Whidbey Island Middle		13.05	6.98	1.07	122.099°W	47.780°N	228.37	1.03
puget_2014.ch.in	Grid							8.29
PointSourceFixedStrike: -122.000, 47.900		6.28	5.86	1.10	122.000°W	47.900°N	328.81	1.22
PointSourceFixedStrike: -121.900, 47.900		6.52	5.92	1.11	121.900°W	47.900°N	47.77	1.09
puget_2014.gr.in	Grid							7.32
PointSourceFixedStrike: -122.000, 47.900		6.28	5.86	1.10	122.000°W	47.900°N	328.81	1.22
PointSourceFixedStrike: -121.900, 47.900		6.52	5.92	1.11	121.900°W	47.900°N	47.77	1.09
sub0_ch_bot.in	Interface							6.75
Cascadia Megathrust - whole CSZ Characteristic		120.35	9.13	1.54	123.509°W	47.780°N	266.14	6.75
Geologic Model Full Rupture	Fault							5.45
Southern Whidbey Island North Alt2		8.62	7.47	0.36	122.001°W	47.766°N	194.52	1.46
Southern Whidbey Island North		7.50	7.37	0.28	122.052°W	47.811°N	229.49	1.34
WUSmap_2014_fixSm.ch.in (opt)	Grid							3.89
sub0_ch_mid.in	Interface							3.53
Cascadia Megathrust - whole CSZ Characteristic		150.77	8.94	1.97	123.916°W	47.709°N	264.12	3.53
WUSmap_2014_fixSm.gr.in (opt)	Grid							3.09
puget_2014_M8.in	Grid							2.36
pacnwdeep_Mmax75.2014.in	Slab							2.08
WUSmap_2014_adSm.ch.in (opt)	Grid							1.78
WUSmap_2014_adSm.gr.in (opt)	Grid							1.42
pacnwdeep_Mmax75.2014.in	Slab							1.40

APPENDIX E

LIQUEFACTION ANALYSIS

Combined Liquefaction Analysis Results for CPT-1 and CPT-2 E-1

TABLE OF CONTENTS

CPT-1 results	
Summary data report	1
Input field data	8
Cyclic stress resistance results	19
Cyclic resistance ratio results	30
Liquefaction potential index data	41
Vertical settlements summary report	47
Vertical settlements data report	48
Lateral displacements summary report	53
Lateral displacements data report	54
Strength loss data report	64
CPT-2 results	
Summary data report	77
Input field data	84
Cyclic stress resistance results	93
Cyclic resistance ratio results	102
Liquefaction potential index data	111
Vertical settlements summary report	116
Vertical settlements data report	117
Lateral displacements summary report	122
Lateral displacements data report	123
Strength loss data report	131

LIQUEFACTION ANALYSIS REPORT




Project title : Fire Station #32 - Site Evaluation

Location : 19959 Oaks St, Monroe, WA


CPT file : CPT-1

Input parameters and analysis data

Analysis method:	Robertson (2009)	G.W.T. (in-situ):	4.00 ft	Use fill:	No	Clay like behavior applied:	All soils
Fines correction method:	Robertson (2009)	G.W.T. (earthq.):	4.00 ft	Fill height:	N/A	Limit depth applied:	No
Points to test:	Based on Ic value	Average results interval:	3	Fill weight:	N/A	Limit depth:	N/A
Earthquake magnitude M_w :	7.10	Ic cut-off value:	2.60	Trans. detect. applied:	No	MSF method:	Method based
Peak ground acceleration:	0.54	Unit weight calculation:	Based on SBT	K_o applied:	No		

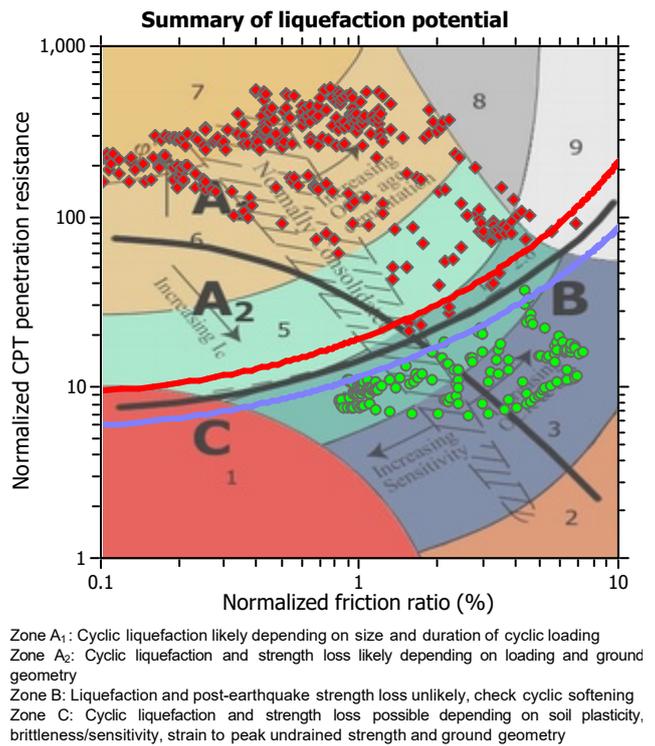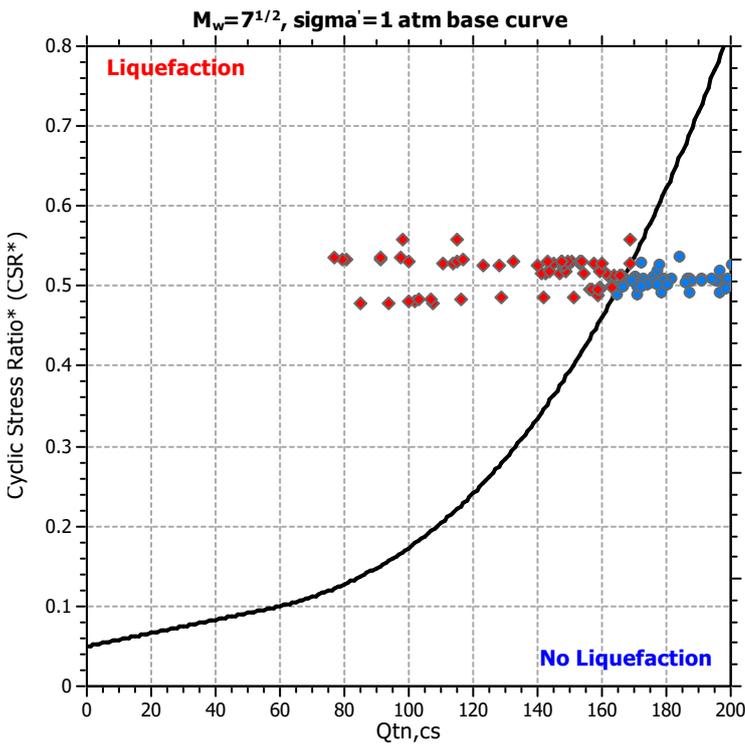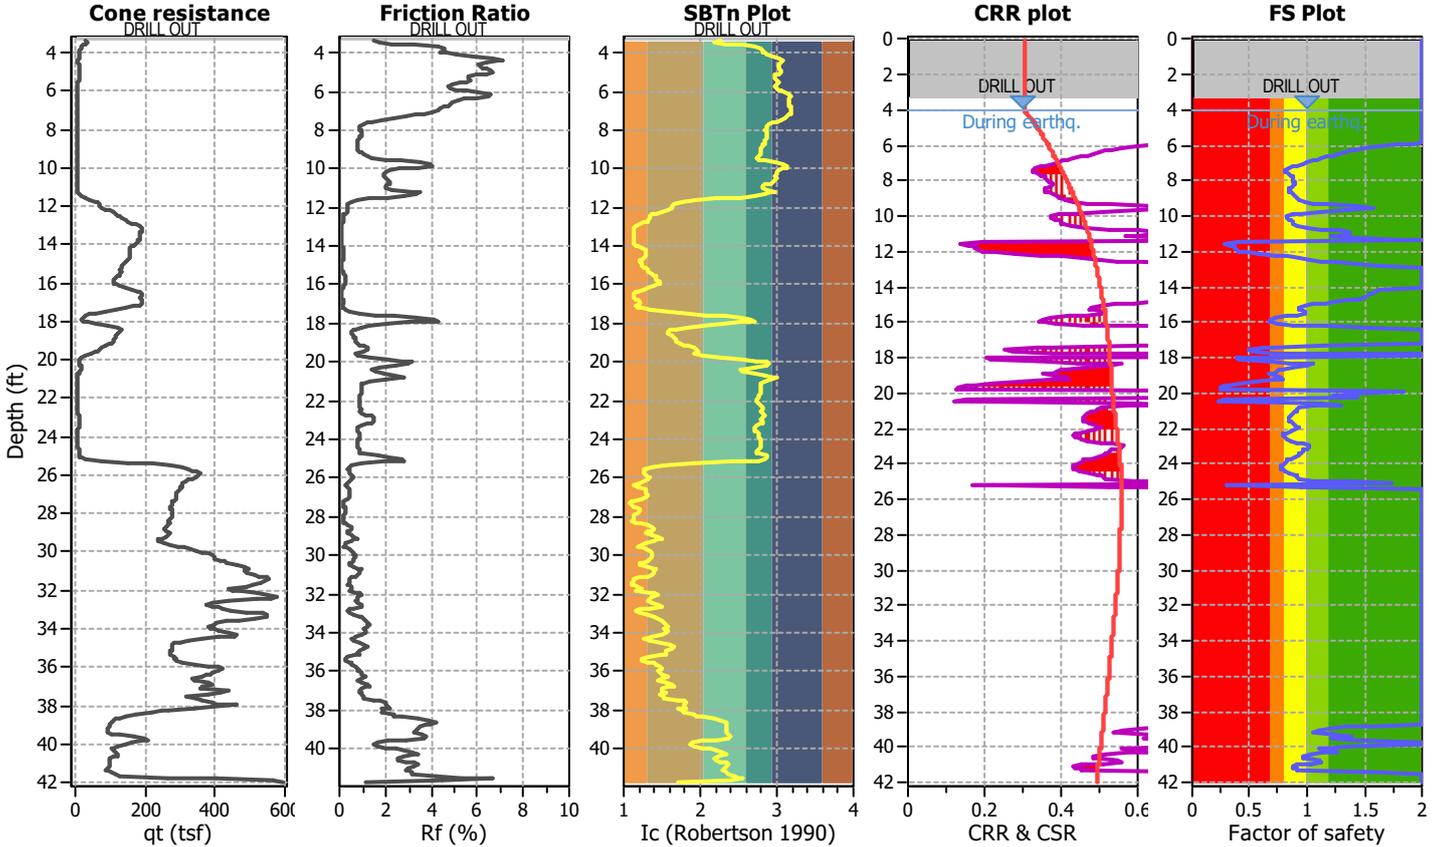

CPT basic interpretation plots

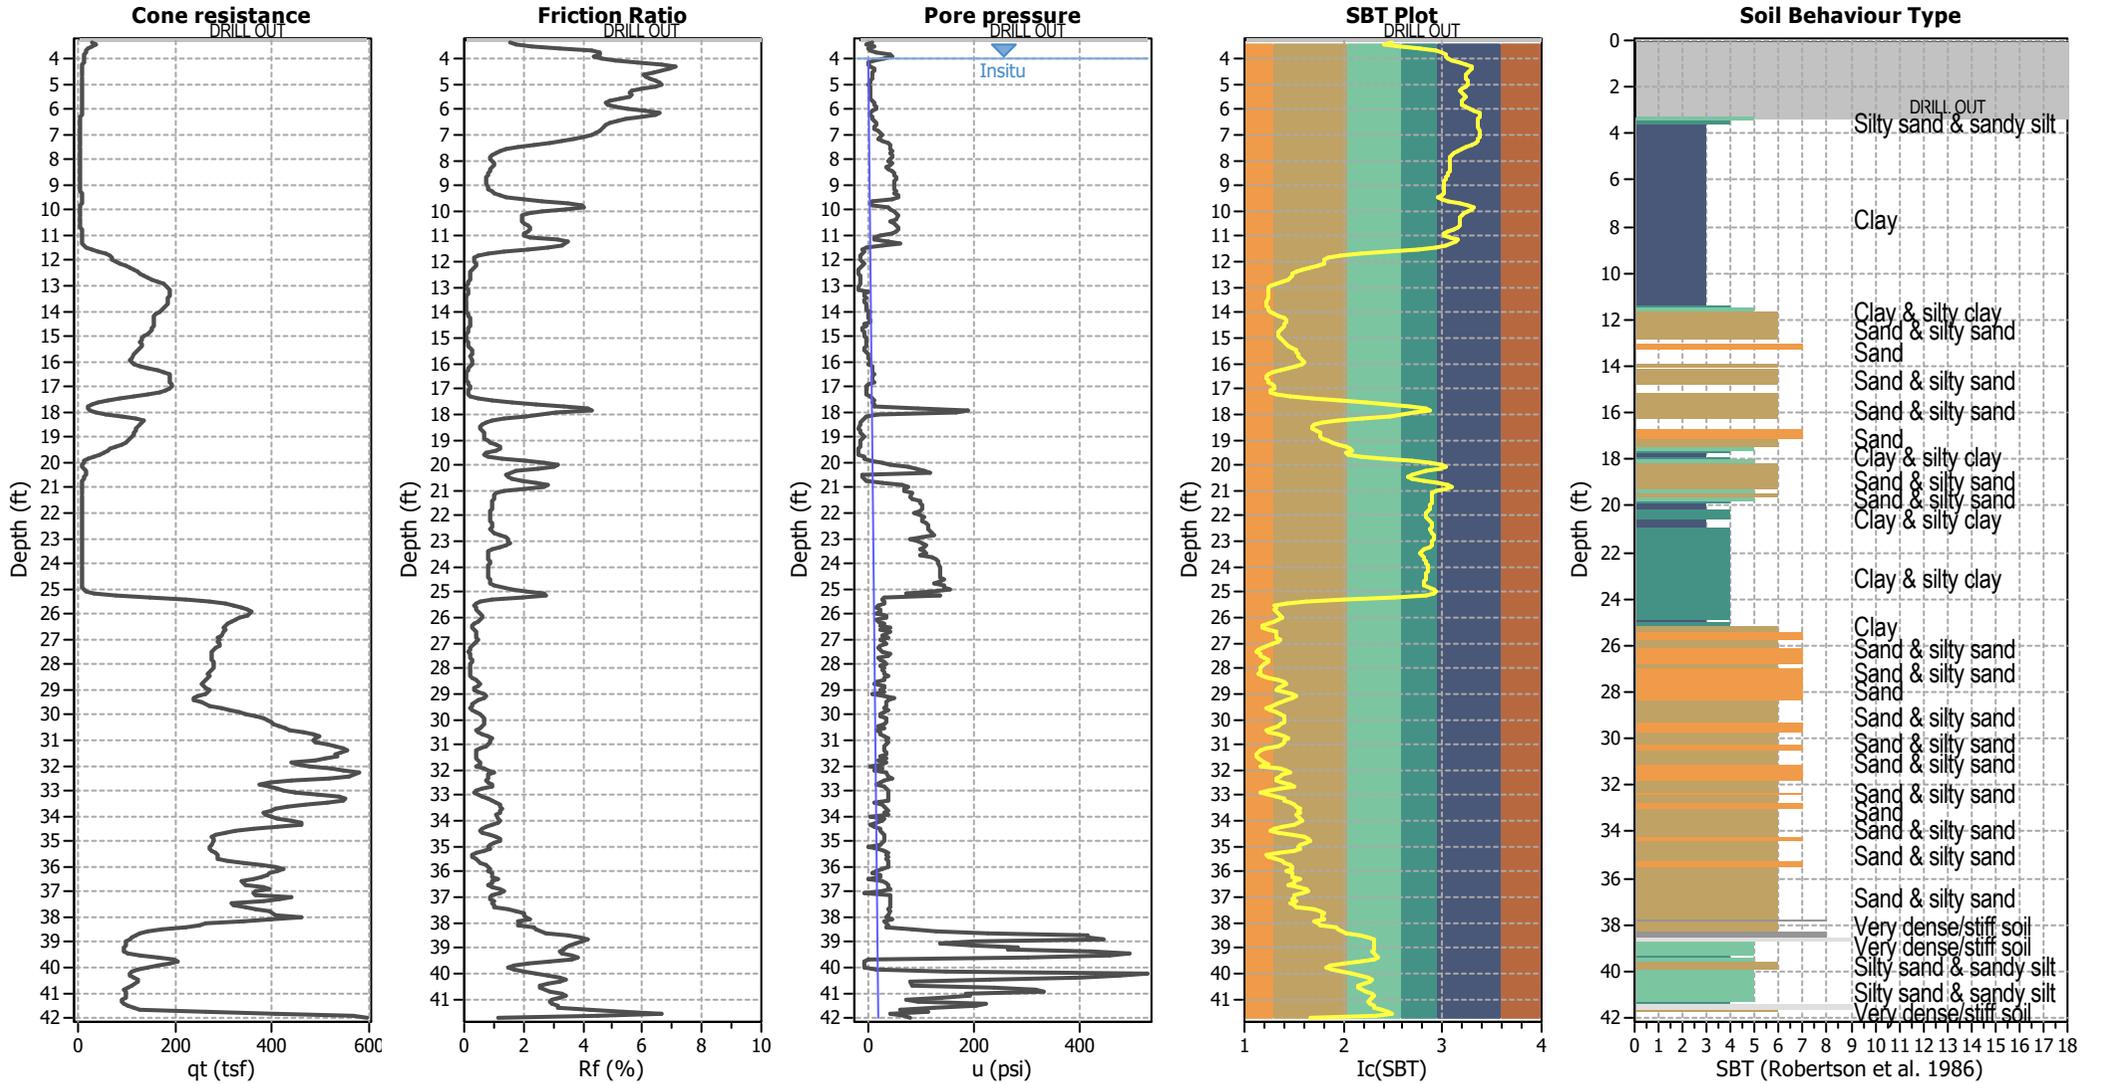


Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	4.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	3	Transition detect. applied:	No
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_0 applied:	No
Earthquake magnitude M_w :	7.10	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.54	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	4.00 ft	Fill height:	N/A	Limit depth:	N/A

SBT legend

1. Sensitive fine grained	4. Clayey silt to silty	7. Gravely sand to sand
2. Organic material	5. Silty sand to sandy silt	8. Very stiff sand to
3. Clay to silty clay	6. Clean sand to silty sand	9. Very stiff fine grained

CPT basic interpretation plots (normalized)

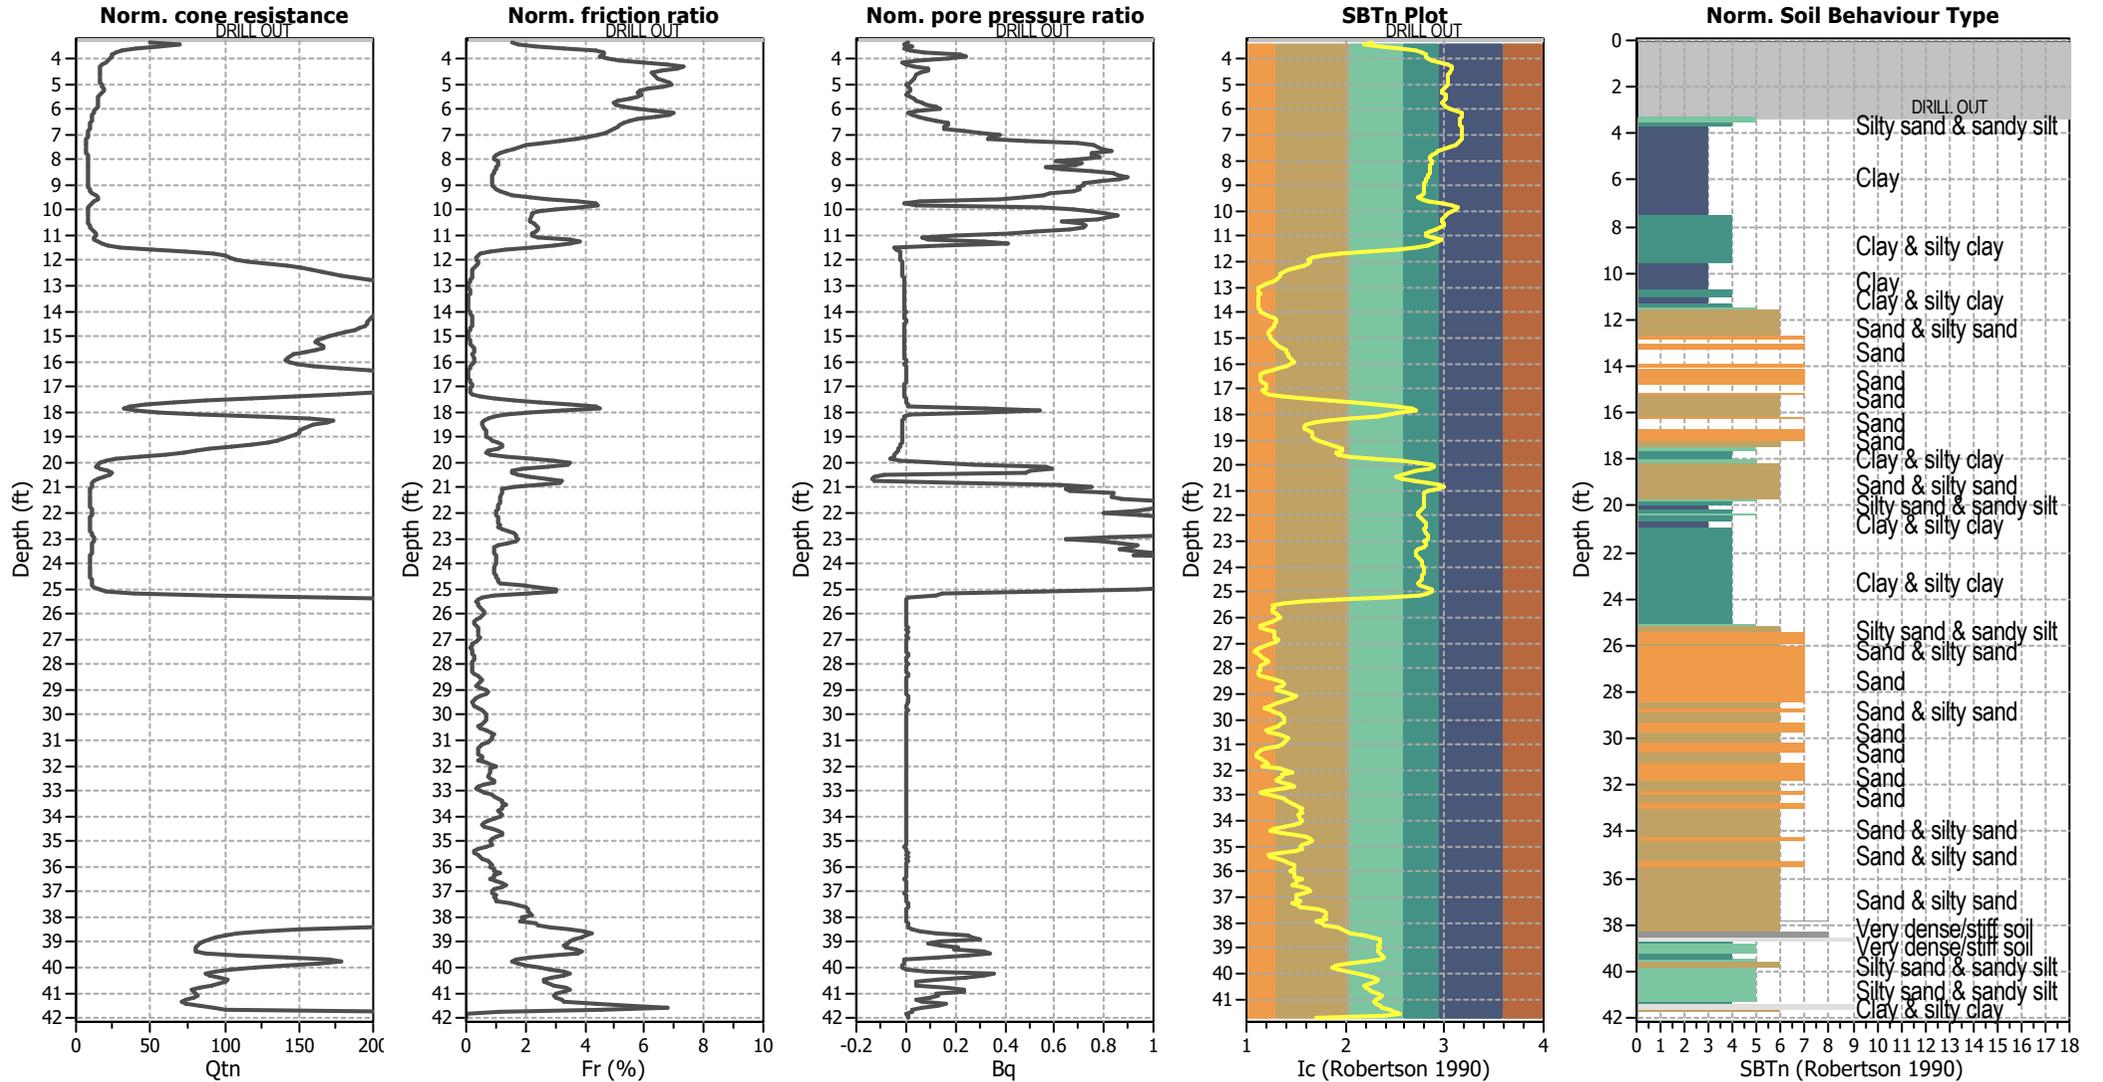


Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	4.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	3	Transition detect. applied:	No
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K ₀ applied:	No
Earthquake magnitude M _w :	7.10	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.54	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	4.00 ft	Fill height:	N/A	Limit depth:	N/A

SBTn legend

1. Sensitive fine grained	4. Clayey silt to silty	7. Gravely sand to sand
2. Organic material	5. Silty sand to sandy silt	8. Very stiff sand to
3. Clay to silty clay	6. Clean sand to silty sand	9. Very stiff fine grained


Liquefaction analysis overall plots (intermediate results)

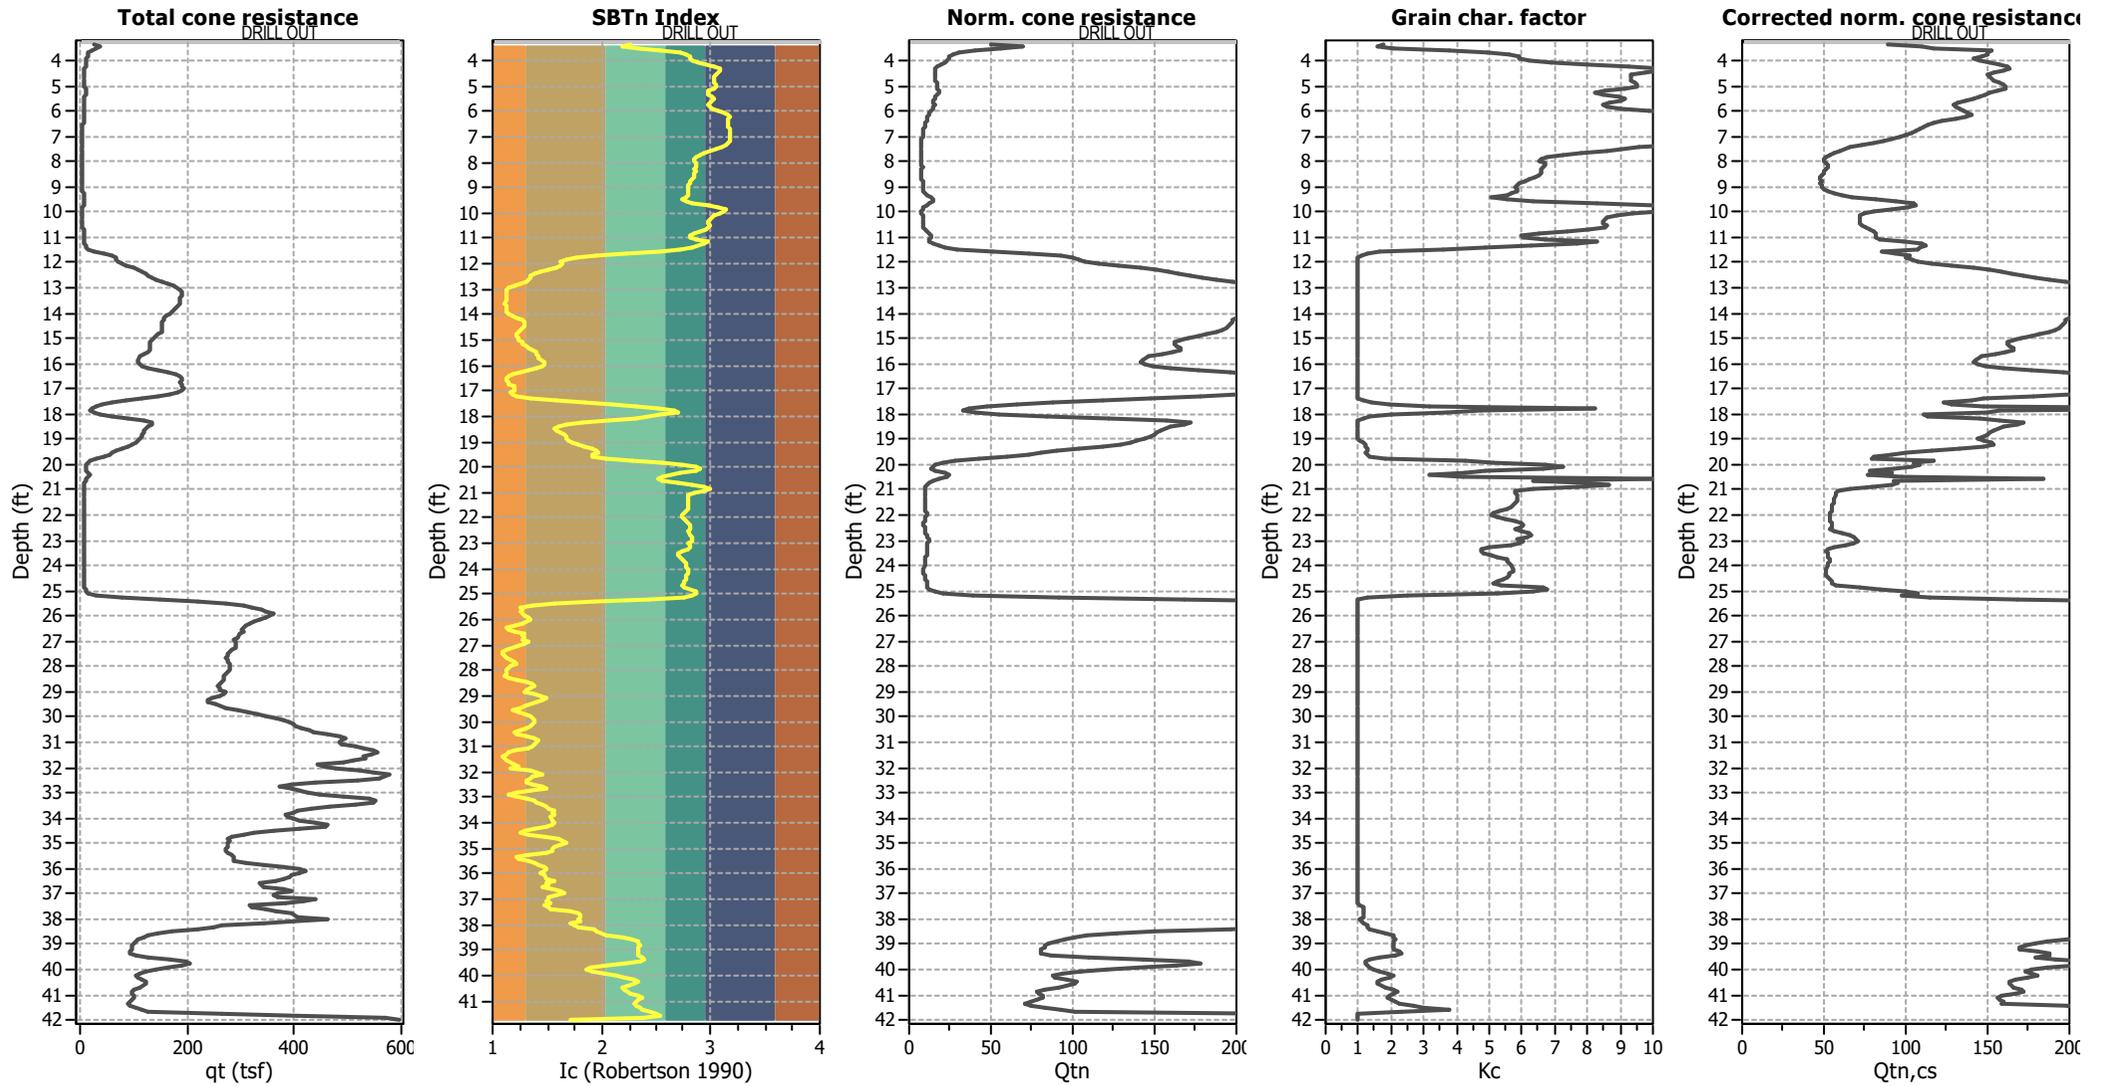

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	4.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	3	Transition detect. applied:	No
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_0 applied:	No
Earthquake magnitude M_w :	7.10	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.54	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	4.00 ft	Fill height:	N/A	Limit depth:	N/A

Liquefaction analysis overall plots

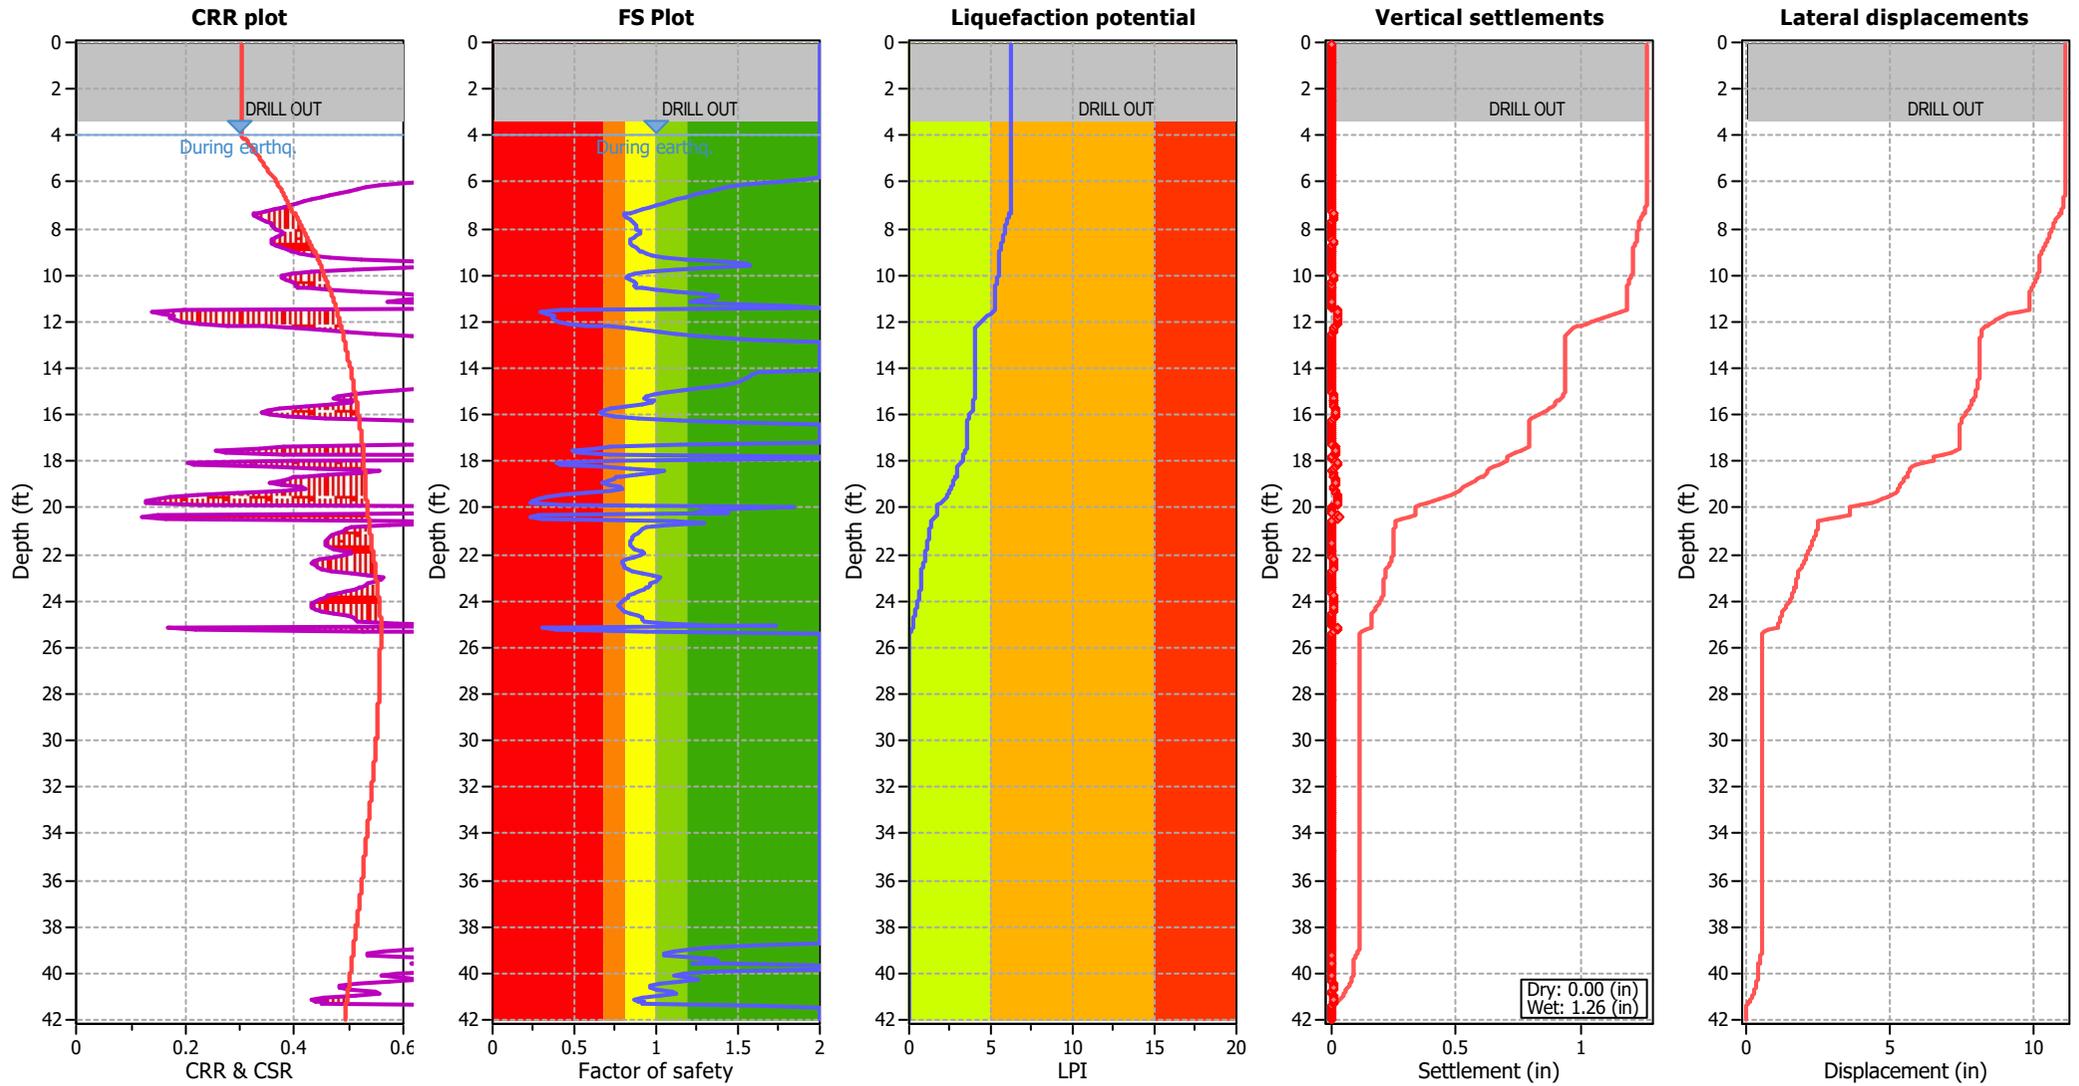

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (earthq.):	4.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	3	Transition detect. applied:	No
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_o applied:	No
Earthquake magnitude M_w :	7.10	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.54	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	4.00 ft	Fill height:	N/A	Limit depth:	N/A




F.S. color scheme

- Almost certain it will liquefy
- Very likely to liquefy
- Liquefaction and no liq. are equally likely
- Unlike to liquefy
- Almost certain it will not liquefy

LPI color scheme

- Very high risk
- High risk
- Low risk


Liquefaction analysis summary plots

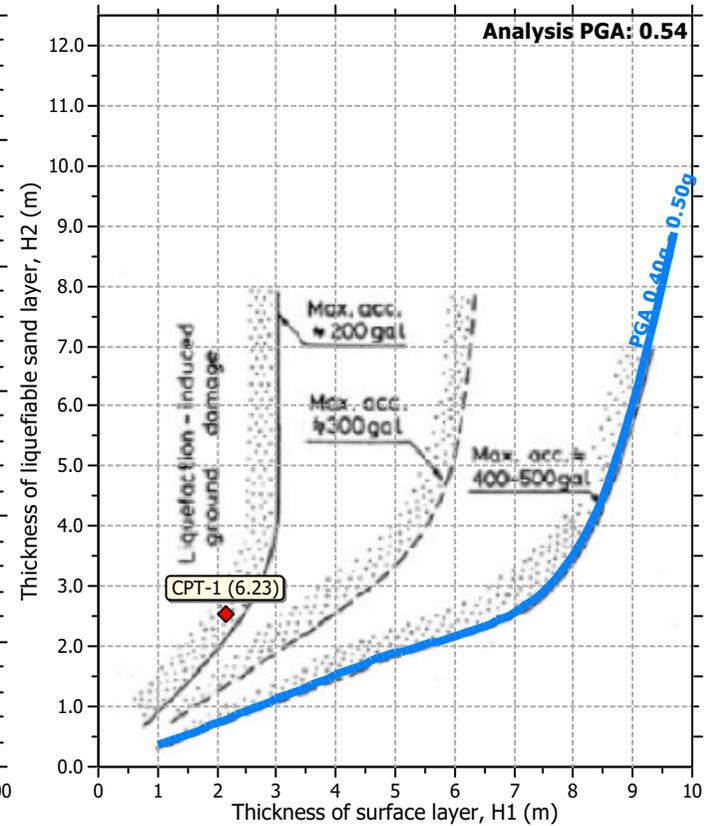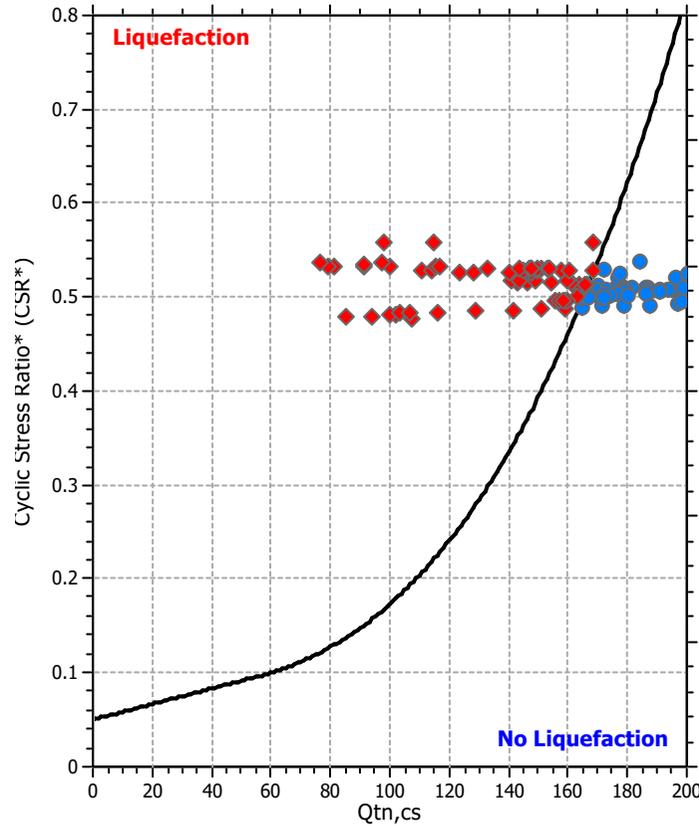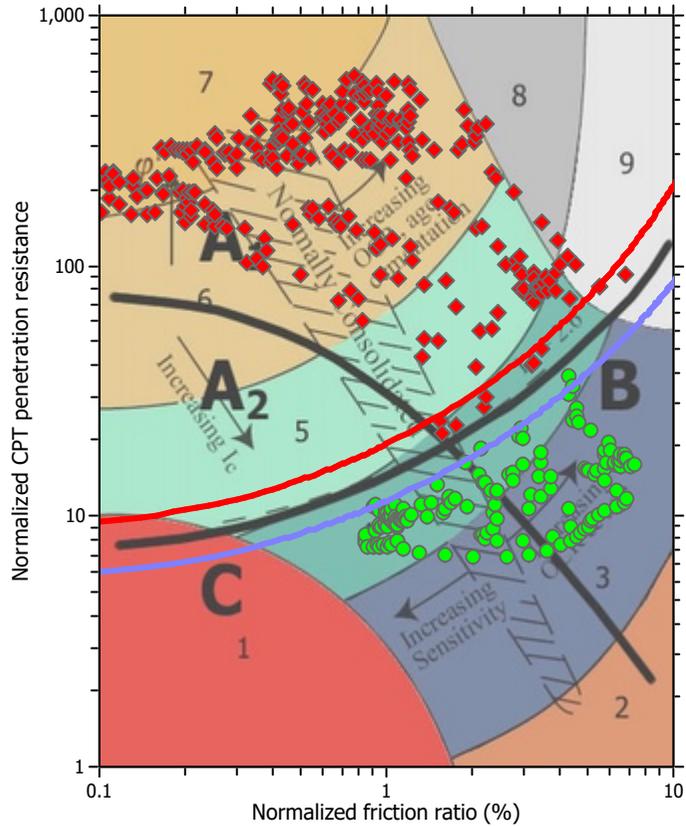

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	4.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	3	Transition detect. applied:	No
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_v applied:	No
Earthquake magnitude M_w :	7.10	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.54	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	4.00 ft	Fill height:	N/A	Limit depth:	N/A

Check for strength loss plots (Robertson (2010))

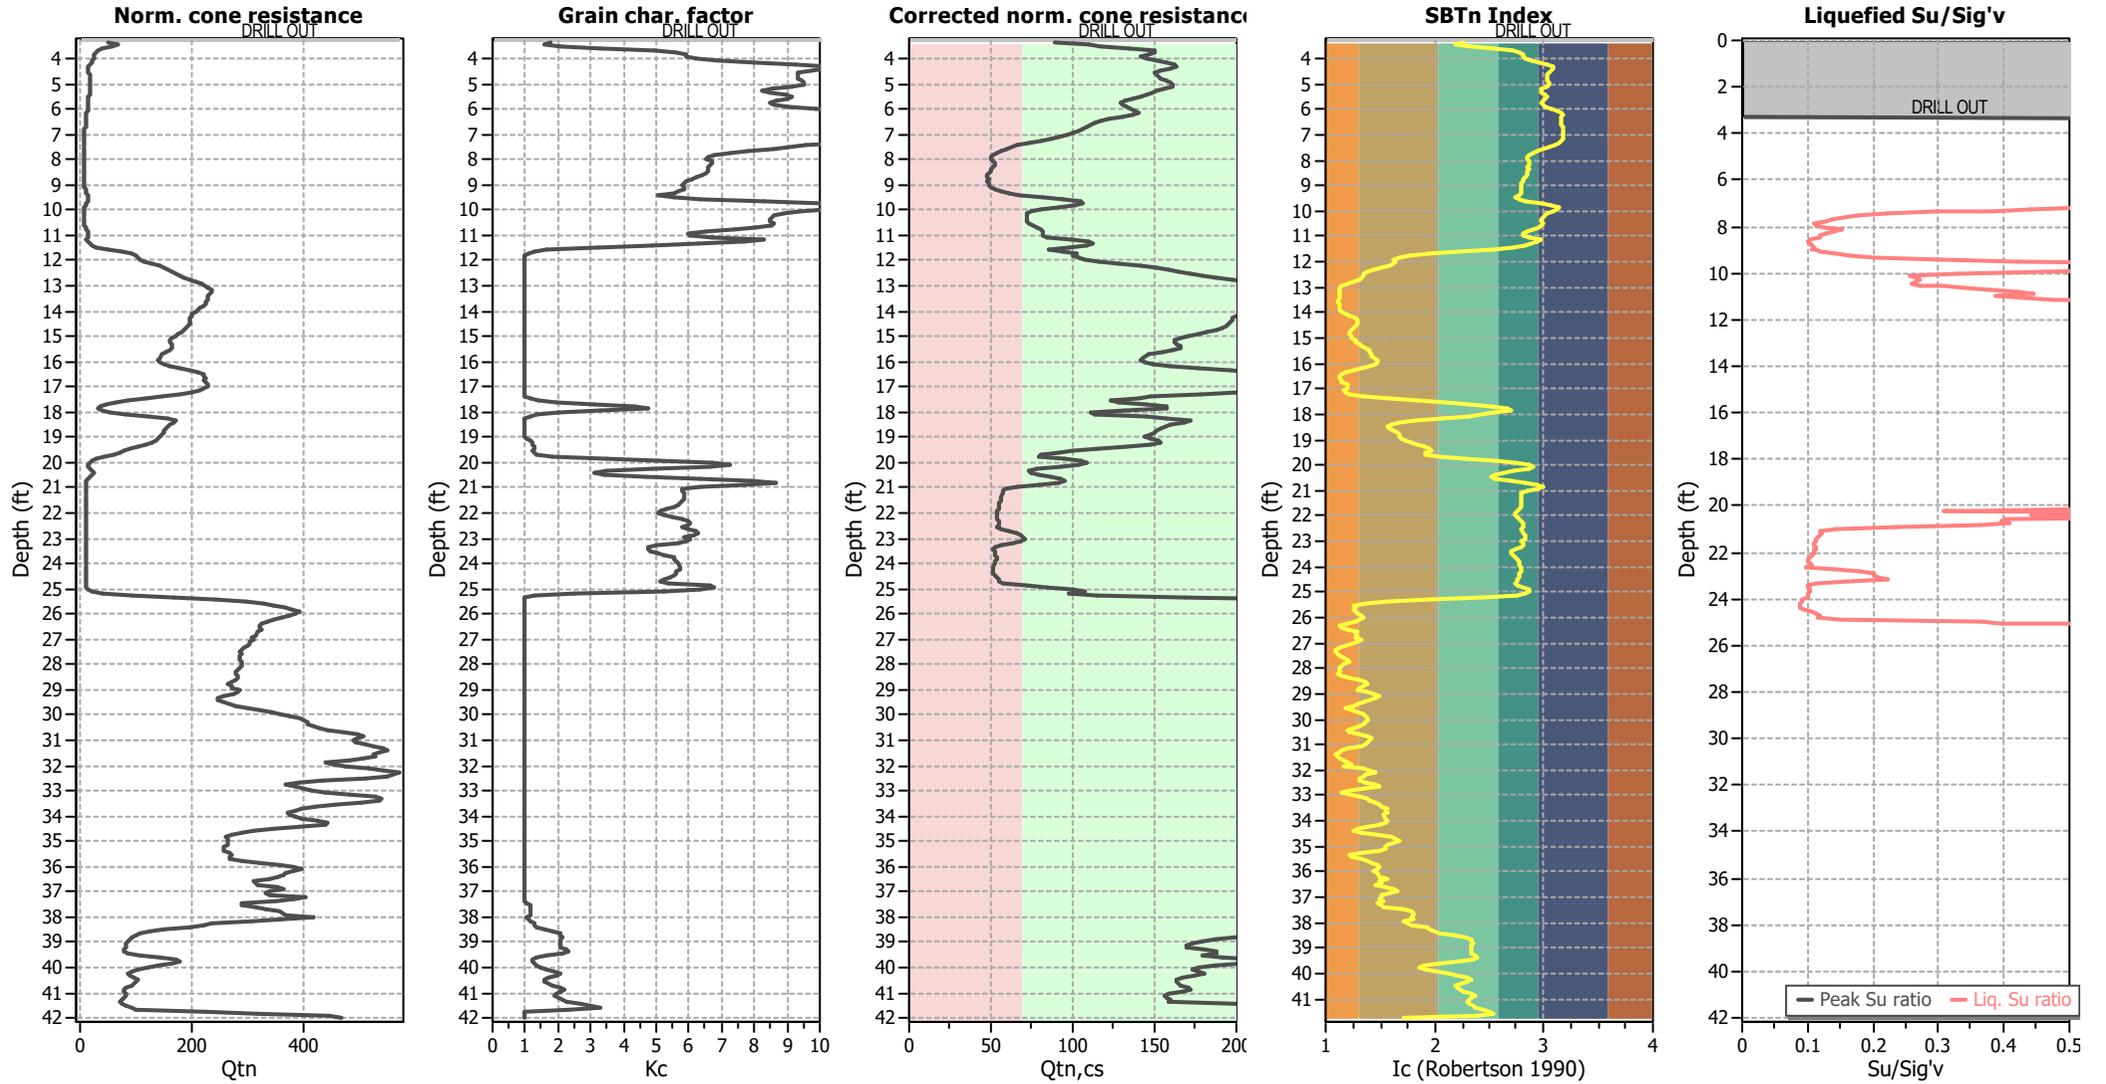

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	4.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	3	Transition detect. applied:	No
Points to test:	Based on I_c value	I_c cut-off value:	2.60	K_o applied:	No
Earthquake magnitude M_w :	7.10	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.54	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	4.00 ft	Fill height:	N/A	Limit depth:	N/A

:: Field input data ::						
Point ID	Depth (ft)	q _c (tsf)	f _s (tsf)	u (tsf)	Fines content (%)	Unit weight (pcf)
1	0.08	-8888.00	-8888.00	-8888.00	N/A	120.90
2	0.16	-8888.00	-8888.00	-8888.00	N/A	120.90
3	0.25	-8888.00	-8888.00	-8888.00	N/A	120.90
4	0.33	-8888.00	-8888.00	-8888.00	N/A	120.90
5	0.41	-8888.00	-8888.00	-8888.00	N/A	120.90
6	0.49	-8888.00	-8888.00	-8888.00	N/A	120.90
7	0.57	-8888.00	-8888.00	-8888.00	N/A	120.90
8	0.66	-8888.00	-8888.00	-8888.00	N/A	120.90
9	0.74	-8888.00	-8888.00	-8888.00	N/A	120.90
10	0.82	-8888.00	-8888.00	-8888.00	N/A	120.90
11	0.90	-8888.00	-8888.00	-8888.00	N/A	120.90
12	0.98	-8888.00	-8888.00	-8888.00	N/A	120.90
13	1.07	-8888.00	-8888.00	-8888.00	N/A	120.90
14	1.15	-8888.00	-8888.00	-8888.00	N/A	120.90
15	1.23	-8888.00	-8888.00	-8888.00	N/A	120.90
16	1.31	-8888.00	-8888.00	-8888.00	N/A	120.90
17	1.39	-8888.00	-8888.00	-8888.00	N/A	120.90
18	1.48	-8888.00	-8888.00	-8888.00	N/A	120.90
19	1.56	-8888.00	-8888.00	-8888.00	N/A	120.90
20	1.64	-8888.00	-8888.00	-8888.00	N/A	120.90
21	1.72	-8888.00	-8888.00	-8888.00	N/A	120.90
22	1.80	-8888.00	-8888.00	-8888.00	N/A	120.90
23	1.89	-8888.00	-8888.00	-8888.00	N/A	120.90
24	1.97	-8888.00	-8888.00	-8888.00	N/A	120.90
25	2.05	-8888.00	-8888.00	-8888.00	N/A	120.90
26	2.13	-8888.00	-8888.00	-8888.00	N/A	120.90
27	2.21	-8888.00	-8888.00	-8888.00	N/A	120.90
28	2.30	-8888.00	-8888.00	-8888.00	N/A	120.90
29	2.38	-8888.00	-8888.00	-8888.00	N/A	120.90
30	2.46	-8888.00	-8888.00	-8888.00	N/A	120.90
31	2.54	-8888.00	-8888.00	-8888.00	N/A	120.90
32	2.62	-8888.00	-8888.00	-8888.00	N/A	120.90
33	2.71	-8888.00	-8888.00	-8888.00	N/A	120.90
34	2.79	-8888.00	-8888.00	-8888.00	N/A	120.90
35	2.87	-8888.00	-8888.00	-8888.00	N/A	120.90
36	2.95	-8888.00	-8888.00	-8888.00	N/A	120.90
37	3.03	-8888.00	-8888.00	-8888.00	N/A	120.90
38	3.12	-8888.00	-8888.00	-8888.00	N/A	120.90
39	3.20	-8888.00	-8888.00	-8888.00	N/A	120.90
40	3.28	-8888.00	-8888.00	-8888.00	N/A	120.90
41	3.36	39.58	0.55	4.70	21.03	111.67
42	3.44	40.57	0.67	-3.52	18.64	115.77
43	3.53	30.01	0.70	11.01	24.07	115.78
44	3.61	18.67	0.69	-2.70	32.68	115.22
45	3.69	16.41	0.73	3.40	41.59	114.53
46	3.77	13.76	0.70	14.50	44.75	113.73
47	3.85	12.37	0.55	39.73	46.35	112.90
48	3.94	12.33	0.56	42.58	46.35	112.33

:: Field input data :: (continued)

Point ID	Depth (ft)	q _c (tsf)	f _s (tsf)	u (tsf)	Fines content (%)	Unit weight (pcf)
49	4.02	12.31	0.58	29.68	47.78	112.52
50	4.10	11.93	0.61	8.59	50.57	112.62
51	4.18	10.86	0.62	-2.62	55.28	112.58
52	4.27	9.19	0.63	-0.17	60.50	112.36
53	4.35	8.41	0.63	4.05	64.04	112.06
54	4.43	8.33	0.60	10.29	63.88	111.63
55	4.51	8.52	0.54	10.37	62.16	111.17
56	4.59	8.59	0.52	7.11	60.67	110.92
57	4.68	8.82	0.54	5.51	60.72	111.08
58	4.76	8.83	0.57	4.55	60.71	111.40
59	4.84	9.12	0.58	3.91	61.12	111.70
60	4.92	9.10	0.60	2.34	61.43	111.98
61	5.00	9.16	0.63	0.17	61.39	112.18
62	5.09	9.48	0.62	1.20	59.95	112.24
63	5.17	10.02	0.60	3.12	57.45	112.05
64	5.25	10.31	0.56	2.56	56.36	111.70
65	5.33	9.58	0.54	1.30	57.24	111.20
66	5.41	8.74	0.51	0.59	59.19	110.61
67	5.50	8.34	0.47	2.46	60.02	110.00
68	5.58	8.28	0.44	4.09	59.43	109.40
69	5.66	8.19	0.41	5.47	58.01	108.91
70	5.74	8.34	0.38	8.38	57.26	108.73
71	5.82	8.34	0.40	10.04	57.68	108.80
72	5.91	7.96	0.42	13.66	59.55	108.93
73	5.99	7.49	0.42	14.69	62.63	108.91
74	6.07	6.96	0.43	5.59	66.76	108.80
75	6.15	6.30	0.44	2.02	70.49	108.66
76	6.23	6.16	0.42	2.74	71.29	108.13
77	6.32	6.19	0.35	4.69	70.47	107.33
78	6.40	5.74	0.32	7.11	69.20	106.32
79	6.48	5.55	0.29	10.37	69.23	105.58
80	6.56	5.42	0.27	13.52	69.21	104.96
81	6.64	5.15	0.26	12.80	69.51	104.47
82	6.73	5.06	0.25	11.45	70.52	103.96
83	6.81	4.79	0.23	11.21	70.82	103.47
84	6.89	4.67	0.22	16.22	70.92	102.98
85	6.97	4.58	0.21	19.57	71.26	102.41
86	7.05	4.15	0.19	23.44	71.15	101.69
87	7.14	4.18	0.17	20.29	70.94	100.63
88	7.22	3.99	0.14	19.15	70.03	99.49
89	7.30	3.65	0.12	26.45	68.43	98.06
90	7.38	3.53	0.09	36.23	65.92	96.44
91	7.46	3.42	0.07	39.60	61.65	94.60
92	7.55	3.50	0.06	41.78	57.76	93.01
93	7.63	3.59	0.05	45.26	54.50	91.86
94	7.71	3.70	0.04	41.92	52.34	91.14
95	7.79	3.75	0.04	43.08	50.22	90.40
96	7.87	3.89	0.04	44.89	49.26	89.98

:: Field input data :: (continued)

Point ID	Depth (ft)	q _c (tsf)	f _s (tsf)	u (tsf)	Fines content (%)	Unit weight (pcf)
97	7.96	3.82	0.04	41.47	49.03	90.00
98	8.04	3.94	0.04	36.13	49.91	90.87
99	8.12	4.07	0.05	43.03	49.88	91.42
100	8.20	4.11	0.05	41.91	49.64	91.50
101	8.28	4.10	0.04	34.37	49.30	90.85
102	8.37	3.95	0.04	37.27	49.41	90.39
103	8.45	3.84	0.04	43.27	49.33	89.92
104	8.53	3.70	0.04	48.33	48.98	89.58
105	8.61	3.73	0.03	49.51	48.38	89.32
106	8.69	3.78	0.04	52.63	47.70	89.44
107	8.78	3.94	0.04	52.20	47.00	89.71
108	8.86	4.12	0.04	48.69	46.33	89.83
109	8.94	4.18	0.04	45.95	45.94	90.01
110	9.02	4.26	0.04	46.14	45.80	90.23
111	9.10	4.33	0.04	46.01	45.93	91.09
112	9.19	4.56	0.05	48.57	45.89	92.21
113	9.27	4.85	0.06	50.93	45.29	93.71
114	9.35	5.46	0.07	49.41	44.63	96.04
115	9.43	6.39	0.11	56.81	42.37	98.84
116	9.51	8.40	0.15	54.20	44.53	102.23
117	9.60	7.83	0.24	43.44	48.24	104.24
118	9.68	7.26	0.26	7.64	56.56	105.03
119	9.76	5.85	0.26	1.75	63.18	104.41
120	9.84	5.20	0.22	5.35	67.91	103.02
121	9.92	4.26	0.17	35.88	67.22	101.06
122	10.01	4.11	0.12	41.74	64.20	98.84
123	10.09	4.00	0.09	46.21	60.85	97.35
124	10.17	4.06	0.10	50.35	58.88	96.91
125	10.25	4.21	0.10	55.17	57.85	97.08
126	10.33	4.34	0.10	50.76	57.25	97.09
127	10.42	4.38	0.10	41.91	57.32	97.11
128	10.50	4.33	0.10	47.37	57.72	97.53
129	10.58	4.50	0.11	50.29	57.41	98.31
130	10.66	4.82	0.13	54.58	55.54	99.36
131	10.74	5.57	0.14	56.34	52.66	100.45
132	10.83	6.47	0.16	51.26	49.04	101.44
133	10.91	7.51	0.17	44.50	46.63	101.70
134	10.99	7.57	0.15	22.98	46.79	101.78
135	11.07	7.08	0.16	8.83	49.87	101.81
136	11.15	6.45	0.18	11.30	56.49	103.92
137	11.24	6.46	0.32	36.60	54.06	106.24
138	11.32	10.03	0.36	57.55	48.01	107.82
139	11.40	11.96	0.32	26.79	41.45	108.68
140	11.48	13.80	0.37	-6.40	32.40	109.46
141	11.56	23.36	0.37	-12.39	19.67	111.00
142	11.65	46.19	0.35	-7.82	11.78	111.49
143	11.73	59.77	0.29	-12.38	7.39	111.03
144	11.81	67.66	0.22	-15.51	5.00	110.02

:: Field input data :: (continued)						
Point ID	Depth (ft)	q _c (tsf)	f _s (tsf)	u (tsf)	Fines content (%)	Unit weight (pcf)
145	11.89	68.60	0.21	-16.05	4.87	109.49
146	11.98	68.84	0.23	-14.94	4.94	110.45
147	12.06	74.87	0.30	-12.40	4.69	111.93
148	12.14	88.53	0.35	-10.02	4.01	113.00
149	12.22	98.26	0.33	-11.38	2.92	113.06
150	12.30	110.13	0.27	-17.16	1.92	112.15
151	12.39	117.55	0.22	-18.72	1.28	111.52
152	12.47	122.11	0.24	-19.57	0.93	111.33
153	12.55	128.16	0.24	-19.49	0.84	112.07
154	12.63	133.53	0.28	-18.46	0.69	112.70
155	12.71	141.32	0.30	-15.80	0.49	113.21
156	12.80	151.25	0.28	-15.28	0.00	112.47
157	12.88	163.88	0.18	-16.82	0.00	111.35
158	12.96	175.73	0.17	-17.90	0.00	110.06
159	13.04	186.24	0.17	-18.99	0.00	110.55
160	13.12	194.73	0.20	-19.77	0.00	111.29
161	13.21	191.01	0.23	-3.46	0.00	111.70
162	13.29	187.30	0.20	-9.88	0.00	111.61
163	13.37	187.45	0.20	-7.49	0.00	110.40
164	13.45	186.89	0.13	-6.64	0.00	109.78
165	13.53	185.08	0.16	-7.62	0.00	108.96
166	13.62	186.69	0.15	-7.46	0.00	108.53
167	13.70	183.32	0.11	-6.91	0.00	107.55
168	13.78	181.68	0.11	-5.41	0.00	106.38
169	13.86	176.40	0.10	-5.11	0.00	106.94
170	13.94	172.21	0.13	-4.39	0.00	107.41
171	14.03	166.57	0.14	2.08	0.00	110.23
172	14.11	161.08	0.27	-1.97	0.00	112.08
173	14.19	155.98	0.30	-2.20	0.18	113.93
174	14.27	153.18	0.35	-2.17	0.36	114.41
175	14.35	155.25	0.34	1.59	0.40	114.48
176	14.44	154.20	0.31	3.28	0.32	114.10
177	14.52	153.46	0.30	-7.39	0.21	113.57
178	14.60	155.18	0.27	-5.24	0.04	112.65
179	14.68	154.71	0.20	-11.14	0.00	110.99
180	14.76	150.60	0.14	-12.97	0.00	109.19
181	14.85	148.41	0.14	-8.58	0.00	107.56
182	14.93	141.25	0.11	-9.31	0.00	106.89
183	15.01	137.11	0.11	-8.05	0.00	106.30
184	15.09	133.64	0.12	-6.25	0.06	107.02
185	15.17	128.55	0.15	-4.95	0.19	107.27
186	15.26	128.27	0.13	-4.73	0.45	108.92
187	15.34	128.76	0.22	-6.43	0.65	110.44
188	15.42	131.69	0.26	-4.62	1.08	112.62
189	15.50	130.45	0.33	-8.53	1.45	113.76
190	15.58	124.77	0.36	-8.97	1.64	113.59
191	15.67	119.45	0.25	-7.10	1.79	112.98
192	15.75	114.05	0.27	-1.58	1.88	111.97

:: Field input data :: (continued)						
Point ID	Depth (ft)	q _c (tsf)	f _s (tsf)	u (tsf)	Fines content (%)	Unit weight (pcf)
193	15.83	106.91	0.26	-2.01	2.38	112.71
194	15.91	107.33	0.34	1.23	2.53	112.82
195	15.99	109.63	0.29	1.21	2.19	112.35
196	16.08	115.43	0.20	-1.85	1.48	111.10
197	16.16	125.53	0.20	5.47	0.67	109.88
198	16.24	143.44	0.17	7.46	0.00	109.38
199	16.32	166.62	0.14	6.75	0.00	108.72
200	16.40	182.12	0.14	7.75	0.00	108.11
201	16.49	184.20	0.12	9.13	0.00	108.82
202	16.57	194.91	0.17	6.47	0.00	110.12
203	16.65	190.72	0.22	5.74	0.00	110.90
204	16.73	185.68	0.18	6.88	0.00	111.21
205	16.81	185.53	0.20	11.62	0.00	114.22
206	16.90	193.32	0.52	-2.25	0.00	115.04
207	16.98	195.99	0.28	-4.96	0.00	115.12
208	17.06	187.29	0.21	-4.90	0.00	112.80
209	17.14	184.99	0.25	-3.85	0.00	111.64
210	17.22	174.55	0.18	-3.57	0.00	112.42
211	17.31	145.51	0.30	-6.76	1.00	114.41
212	17.39	113.25	0.53	0.77	4.01	117.19
213	17.47	81.83	0.76	5.39	8.88	119.30
214	17.55	60.02	1.05	8.84	15.55	119.86
215	17.63	36.73	1.03	7.89	22.87	119.57
216	17.72	30.23	0.98	10.40	31.46	118.42
217	17.80	20.64	0.95	9.14	38.66	117.19
218	17.88	13.74	0.82	91.82	40.84	116.44
219	17.96	21.36	0.80	189.00	32.66	116.35
220	18.04	34.33	0.72	163.62	23.37	116.96
221	18.13	47.78	0.74	17.15	14.50	118.41
222	18.21	91.23	0.89	-3.86	8.78	120.07
223	18.29	131.58	0.93	-8.55	5.66	121.07
224	18.37	139.44	0.84	-13.96	4.35	120.96
225	18.45	134.03	0.75	-16.22	3.94	119.93
226	18.54	125.82	0.61	-18.13	4.14	119.26
227	18.62	119.20	0.68	-18.74	4.67	119.29
228	18.70	116.32	0.79	-18.46	5.37	119.99
229	18.78	116.99	0.83	-17.29	5.56	120.12
230	18.86	116.44	0.73	-14.41	5.59	119.88
231	18.95	111.29	0.73	-10.97	5.91	119.83
232	19.03	107.21	0.84	-14.73	6.76	120.42
233	19.11	105.05	0.95	-15.55	7.73	121.02
234	19.19	99.05	0.98	-15.68	9.06	121.57
235	19.27	89.06	1.12	-16.98	10.68	121.70
236	19.36	78.67	1.11	-18.00	11.81	120.44
237	19.44	65.23	0.60	-19.04	12.18	118.09
238	19.52	57.20	0.44	-19.61	10.62	114.37
239	19.60	60.70	0.29	-19.68	10.93	112.83
240	19.69	49.16	0.38	-20.56	13.95	112.12

:: Field input data :: (continued)						
Point ID	Depth (ft)	q _c (tsf)	f _s (tsf)	u (tsf)	Fines content (%)	Unit weight (pcf)
241	19.77	25.61	0.41	-10.96	21.65	111.92
242	19.85	18.51	0.41	-8.40	33.59	110.62
243	19.93	12.96	0.36	3.39	42.43	109.63
244	20.01	10.43	0.37	25.01	49.97	108.38
245	20.10	8.70	0.31	40.43	52.14	106.98
246	20.18	8.41	0.21	73.79	49.63	105.26
247	20.26	8.88	0.19	91.00	41.25	104.31
248	20.34	13.06	0.19	104.61	33.62	105.81
249	20.42	19.28	0.28	115.38	31.54	107.03
250	20.51	16.33	0.28	-11.80	33.49	107.48
251	20.59	12.75	0.25	-13.26	40.35	106.56
252	20.67	10.48	0.24	-10.42	48.10	105.77
253	20.75	8.21	0.25	-6.33	55.04	105.10
254	20.83	7.01	0.23	26.45	57.92	103.76
255	20.92	6.68	0.15	62.86	53.90	101.51
256	21.00	6.71	0.09	75.65	48.32	98.66
257	21.08	6.73	0.07	65.63	45.71	96.75
258	21.16	6.46	0.08	66.04	45.61	96.24
259	21.24	6.30	0.07	80.65	45.94	96.15
260	21.33	6.31	0.07	79.46	45.97	96.01
261	21.41	6.12	0.07	82.89	45.94	95.90
262	21.49	6.06	0.07	95.42	45.84	95.80
263	21.57	6.06	0.07	97.77	45.52	95.71
264	21.65	6.00	0.07	100.81	45.15	95.74
265	21.74	6.25	0.07	100.58	44.50	95.82
266	21.82	6.48	0.07	100.76	43.31	95.99
267	21.90	6.94	0.07	97.12	42.56	96.00
268	21.98	6.99	0.07	85.46	42.34	96.02
269	22.06	6.73	0.07	96.94	43.11	95.86
270	22.15	6.26	0.07	103.18	44.22	95.67
271	22.23	5.94	0.07	102.33	45.64	95.34
272	22.31	5.67	0.07	99.38	46.48	95.21
273	22.39	5.64	0.07	110.16	46.74	95.24
274	22.47	5.70	0.07	113.42	46.47	95.42
275	22.56	5.79	0.07	112.38	45.83	95.35
276	22.64	5.95	0.06	110.85	46.60	96.28
277	22.72	6.00	0.09	117.18	47.71	97.76
278	22.80	6.35	0.12	119.93	48.01	99.56
279	22.88	7.30	0.13	122.03	47.30	100.46
280	22.97	7.62	0.13	99.29	45.96	100.94
281	23.05	8.36	0.14	78.88	46.74	101.21
282	23.13	7.54	0.15	93.58	46.39	100.72
283	23.21	7.35	0.11	99.23	45.24	99.39
284	23.29	7.35	0.07	107.15	42.06	97.33
285	23.38	7.51	0.07	104.20	40.69	96.17
286	23.46	7.26	0.07	98.55	40.69	95.94
287	23.54	7.21	0.07	104.82	41.12	95.99
288	23.62	7.21	0.07	109.58	42.24	95.92

:: Field input data :: (continued)						
Point ID	Depth (ft)	q _c (tsf)	f _s (tsf)	u (tsf)	Fines content (%)	Unit weight (pcf)
289	23.70	6.48	0.07	97.67	43.26	95.85
290	23.79	6.31	0.07	120.47	44.48	95.69
291	23.87	6.11	0.07	126.54	44.44	95.58
292	23.95	5.98	0.07	129.96	44.89	95.32
293	24.03	5.70	0.06	131.64	45.27	95.05
294	24.11	5.61	0.06	133.71	45.37	94.70
295	24.20	5.63	0.06	134.67	45.31	94.67
296	24.28	5.69	0.06	135.03	45.00	94.65
297	24.36	5.78	0.06	135.20	44.81	94.88
298	24.44	5.93	0.06	135.91	44.68	95.39
299	24.52	6.19	0.07	136.74	43.97	96.11
300	24.61	6.74	0.08	141.97	43.02	96.79
301	24.69	7.18	0.08	136.62	42.65	97.05
302	24.77	6.89	0.08	124.81	43.58	97.86
303	24.85	6.92	0.10	141.97	49.70	101.53
304	24.93	7.00	0.25	142.53	50.12	104.50
305	25.02	9.73	0.28	154.60	48.15	108.50
306	25.10	14.76	0.49	121.60	43.25	111.02
307	25.18	18.20	0.56	69.49	27.20	115.08
308	25.26	56.16	0.79	135.09	11.01	118.35
309	25.34	151.60	0.78	29.79	3.78	120.67
310	25.43	233.35	0.78	25.03	1.12	122.71
311	25.51	277.42	1.16	27.04	0.01	123.68
312	25.59	306.32	0.96	28.91	0.18	126.13
313	25.67	325.92	1.79	18.01	0.00	126.60
314	25.75	331.10	1.33	14.50	0.12	127.85
315	25.84	356.25	1.64	21.33	0.40	129.02
316	25.92	355.00	2.56	22.62	0.69	130.19
317	26.00	365.44	2.22	14.37	0.90	130.42
318	26.08	342.74	1.87	30.87	0.46	129.12
319	26.16	333.24	1.52	32.99	0.06	127.46
320	26.25	325.33	1.14	12.91	0.00	125.47
321	26.33	316.82	0.82	16.45	0.00	122.68
322	26.41	308.31	0.44	27.97	0.00	122.46
323	26.49	299.10	1.09	20.95	0.00	123.70
324	26.57	301.84	1.27	39.14	0.28	126.12
325	26.66	301.12	1.55	22.86	0.18	126.10
326	26.74	311.95	1.06	38.59	0.25	125.85
327	26.82	279.63	1.17	26.62	0.21	125.57
328	26.90	293.84	1.41	36.77	0.70	126.26
329	26.98	285.05	1.46	20.88	0.35	125.59
330	27.07	290.75	0.80	28.22	0.00	123.88
331	27.15	289.58	0.65	30.86	0.00	120.72
332	27.23	290.39	0.44	22.54	0.00	119.17
333	27.31	287.85	0.44	16.11	0.00	118.38
334	27.40	273.16	0.50	20.70	0.00	119.04
335	27.48	274.92	0.58	23.32	0.00	119.38
336	27.56	276.39	0.52	41.89	0.00	120.75

:: Field input data :: (continued)						
Point ID	Depth (ft)	q _c (tsf)	f _s (tsf)	u (tsf)	Fines content (%)	Unit weight (pcf)
337	27.64	275.95	0.83	36.94	0.00	121.84
338	27.72	266.16	0.90	16.23	0.00	122.07
339	27.81	278.63	0.59	21.39	0.00	120.73
340	27.89	278.68	0.44	29.24	0.00	120.03
341	27.97	280.21	0.71	32.18	0.00	119.56
342	28.05	278.56	0.48	22.70	0.00	119.75
343	28.13	278.45	0.48	28.47	0.00	119.28
344	28.22	277.94	0.61	24.36	0.00	118.38
345	28.30	267.78	0.31	27.59	0.00	119.46
346	28.38	264.29	0.71	30.56	0.00	121.54
347	28.46	269.11	1.15	36.18	0.47	124.32
348	28.54	272.82	1.30	27.26	1.20	125.97
349	28.63	259.10	1.53	28.96	1.34	126.06
350	28.71	259.98	1.21	14.80	1.00	124.96
351	28.79	259.05	0.76	9.06	0.50	123.37
352	28.87	246.91	0.85	28.44	0.34	123.26
353	28.95	274.61	1.16	27.48	1.27	125.67
354	29.04	261.52	1.84	19.92	2.07	128.01
355	29.12	279.48	2.23	28.73	2.78	129.01
356	29.20	262.89	1.95	7.73	2.25	127.68
357	29.28	243.05	0.87	29.70	1.54	125.14
358	29.36	231.47	0.83	46.03	0.27	121.22
359	29.45	240.97	0.46	37.58	0.00	119.99
360	29.53	244.23	0.54	31.10	0.00	119.13
361	29.61	273.27	0.59	30.86	0.00	122.41
362	29.69	295.75	1.30	27.59	0.28	125.31
363	29.77	312.16	1.63	36.84	0.84	127.77
364	29.86	328.41	1.90	30.61	1.17	129.48
365	29.94	353.22	2.46	20.74	1.25	130.35
366	30.02	355.78	2.28	19.49	1.30	131.29
367	30.10	385.23	2.68	31.43	1.22	131.83
368	30.18	401.50	2.91	32.40	0.94	131.70
369	30.27	387.28	2.08	33.23	0.60	131.28
370	30.35	406.82	2.21	28.16	0.04	130.09
371	30.43	409.75	1.81	17.98	0.00	129.26
372	30.51	425.58	1.37	27.21	0.00	129.93
373	30.59	442.07	2.67	14.48	0.56	132.58
374	30.68	440.47	4.30	19.35	1.33	134.96
375	30.76	505.64	4.35	19.95	1.79	136.41
376	30.84	508.15	4.95	28.54	1.46	136.20
377	30.92	474.63	3.81	36.11	1.42	135.85
378	31.00	476.76	3.81	32.70	1.03	135.03
379	31.09	498.27	3.64	34.88	0.63	134.44
380	31.17	491.19	2.90	30.85	0.00	132.70
381	31.25	545.28	1.51	28.40	0.00	131.64
382	31.33	545.28	2.48	28.40	0.00	131.86
383	31.41	551.36	3.02	28.67	0.00	131.49
384	31.50	565.16	1.13	33.78	0.00	131.18

:: Field input data :: (continued)						
Point ID	Depth (ft)	q _c (tsf)	f _s (tsf)	u (tsf)	Fines content (%)	Unit weight (pcf)
385	31.58	509.23	2.25	34.05	0.00	131.51
386	31.66	514.74	3.37	20.63	0.00	133.04
387	31.74	574.35	2.68	32.79	0.00	133.06
388	31.82	439.03	2.41	17.34	0.00	130.76
389	31.91	453.57	1.18	30.79	0.91	133.33
390	31.99	430.24	5.63	24.84	1.56	134.92
391	32.07	474.51	4.54	2.45	2.23	136.71
392	32.15	520.36	4.09	26.70	1.16	136.27
393	32.23	566.90	4.39	10.64	0.98	136.65
394	32.32	551.77	5.02	34.05	0.59	136.71
395	32.40	612.21	3.96	38.29	0.46	135.95
396	32.48	508.13	3.20	44.50	1.16	136.17
397	32.56	432.16	5.71	28.70	2.15	135.43
398	32.64	380.36	3.37	22.02	2.67	134.61
399	32.73	373.59	2.29	14.44	0.99	130.79
400	32.81	366.82	1.21	27.48	0.00	128.55
401	32.89	439.93	1.48	31.34	0.00	127.34
402	32.97	423.25	1.48	36.93	0.00	129.78
403	33.05	406.57	2.79	35.98	0.52	132.68
404	33.14	512.00	4.12	35.38	1.40	135.74
405	33.22	551.95	5.44	36.28	1.55	137.28
406	33.30	551.95	5.39	36.28	2.16	137.28
407	33.38	547.01	6.79	35.37	2.71	137.28
408	33.46	542.08	7.25	11.57	3.05	137.28
409	33.55	454.43	4.74	23.41	3.78	137.28
410	33.63	403.38	6.30	30.56	3.52	137.05
411	33.71	439.03	4.36	32.28	3.82	136.49
412	33.79	372.03	3.93	34.78	3.17	135.30
413	33.87	380.22	4.20	28.40	3.62	135.35
414	33.96	393.74	4.60	38.23	3.93	135.90
415	34.04	384.20	4.88	1.86	3.51	135.74
416	34.12	412.52	3.78	30.22	2.68	135.04
417	34.20	433.82	3.26	25.87	1.27	133.77
418	34.28	473.50	2.75	11.86	0.32	132.63
419	34.37	477.85	2.23	1.40	0.00	131.60
420	34.45	422.22	2.19	11.22	0.81	131.77
421	34.53	331.93	3.19	21.52	2.50	132.80
422	34.61	331.93	3.75	21.52	4.29	133.55
423	34.69	302.62	3.59	26.50	5.13	133.67
424	34.78	274.30	3.59	29.10	5.56	133.18
425	34.86	275.12	3.27	29.96	4.69	131.53
426	34.94	273.67	1.57	28.26	3.80	130.48
427	35.02	284.16	2.43	27.55	3.48	129.95
428	35.10	272.60	2.77	20.69	3.69	130.24
429	35.19	273.66	1.85	-0.23	2.77	128.45
430	35.27	268.56	0.94	18.07	0.81	124.43
431	35.35	273.03	0.42	29.39	0.00	121.16
432	35.43	279.14	0.69	38.02	0.00	122.58

:: Field input data :: (continued)						
Point ID	Depth (ft)	q _c (tsf)	f _s (tsf)	u (tsf)	Fines content (%)	Unit weight (pcf)
433	35.52	297.59	1.34	32.79	0.66	125.09
434	35.60	284.47	1.41	37.13	1.35	126.57
435	35.68	273.50	1.47	32.74	1.69	127.32
436	35.76	299.91	1.79	36.59	2.47	130.01
437	35.84	349.35	3.32	35.34	2.71	132.04
438	35.93	371.16	3.29	37.42	2.57	133.51
439	36.01	416.19	3.30	36.20	1.97	133.67
440	36.09	435.62	3.30	25.36	2.51	135.02
441	36.17	411.36	5.18	14.27	2.65	134.79
442	36.25	380.38	3.05	5.89	3.82	135.90
443	36.34	393.80	5.35	19.42	2.82	134.26
444	36.42	393.80	2.51	19.42	3.01	134.10
445	36.50	347.65	2.92	-0.72	2.23	132.21
446	36.58	346.92	3.00	25.20	3.63	133.08
447	36.66	310.15	3.83	33.43	4.73	134.69
448	36.75	358.14	5.27	34.74	5.27	135.56
449	36.83	362.35	4.47	36.30	4.16	135.72
450	36.91	419.91	3.67	42.05	2.98	134.65
451	36.99	400.95	3.30	25.97	2.92	133.40
452	37.07	278.20	2.92	-7.98	2.79	132.95
453	37.16	401.93	3.13	41.52	3.41	134.12
454	37.24	419.15	4.86	41.63	2.41	135.34
455	37.32	489.16	4.16	41.76	3.08	135.57
456	37.40	338.29	3.73	39.57	3.40	134.75
457	37.48	320.17	3.83	39.68	6.41	135.58
458	37.57	292.98	6.41	40.40	7.73	136.97
459	37.65	341.79	6.64	40.77	8.28	137.28
460	37.73	397.44	7.59	38.20	8.17	137.28
461	37.81	357.67	8.22	40.76	8.00	137.28
462	37.89	424.07	8.86	35.21	8.32	137.28
463	37.98	434.61	9.86	32.81	6.37	137.28
464	38.06	520.01	6.73	43.81	7.26	137.28
465	38.14	239.87	6.22	28.16	7.71	137.28
466	38.22	260.18	5.71	34.33	11.20	137.12
467	38.30	287.80	6.43	37.05	11.83	136.89
468	38.39	202.21	5.94	33.35	14.03	136.68
469	38.47	171.67	5.94	80.66	18.59	135.81
470	38.55	135.24	5.86	126.21	21.57	135.10
471	38.63	122.81	5.19	225.59	24.04	134.18
472	38.71	106.87	4.69	415.18	24.09	133.15
473	38.80	106.87	4.09	415.18	24.22	132.15
474	38.88	97.17	3.68	446.58	23.90	131.23
475	38.96	95.56	3.38	201.13	24.09	130.55
476	39.04	96.19	3.26	136.65	23.98	130.05
477	39.12	93.28	3.09	196.76	23.78	129.79
478	39.21	92.05	3.06	283.59	24.12	129.70
479	39.29	89.66	3.20	262.87	25.44	130.30
480	39.37	87.56	3.91	422.43	26.17	130.75

:: Field input data :: (continued)						
Point ID	Depth (ft)	q _c (tsf)	f _s (tsf)	u (tsf)	Fines content (%)	Unit weight (pcf)
481	39.45	90.14	3.69	494.74	24.65	131.26
482	39.53	111.57	3.67	456.94	19.34	131.59
483	39.62	164.09	3.60	303.68	13.90	131.93
484	39.70	210.46	3.27	-0.57	10.44	131.83
485	39.78	212.88	2.94	-7.54	9.43	131.53
486	39.86	192.59	3.08	-9.63	10.93	131.56
487	39.94	161.65	3.56	-10.03	13.54	131.45
488	40.03	138.71	3.26	-7.63	16.63	131.39
489	40.11	125.79	3.49	13.68	19.52	131.11
490	40.19	105.25	3.64	145.79	22.21	131.12
491	40.27	95.39	3.63	529.95	23.84	131.04
492	40.35	98.87	3.60	478.50	22.79	130.77
493	40.44	108.29	3.16	399.49	20.42	130.55
494	40.52	125.03	3.08	231.25	18.75	130.33
495	40.60	123.56	3.13	78.24	18.96	130.32
496	40.68	109.89	3.18	83.42	21.29	130.28
497	40.76	92.91	3.31	236.55	23.91	130.26
498	40.85	90.21	3.42	318.34	25.04	130.08
499	40.93	91.82	3.09	331.35	24.14	129.82
500	41.01	98.25	2.92	185.18	22.88	129.38
501	41.09	97.67	2.81	190.83	22.37	129.20
502	41.17	96.99	2.85	140.44	23.20	129.11
503	41.26	89.72	2.92	71.93	24.53	129.02
504	41.34	84.82	2.86	92.27	25.24	128.76
505	41.42	85.22	2.65	223.91	28.60	131.39
506	41.50	101.44	6.36	204.20	30.65	134.17
507	41.58	117.15	7.73	123.83	32.72	136.85
508	41.67	124.42	9.16	58.79	25.79	134.70
509	41.75	130.13	0.00	113.80	6.21	132.04
510	41.83	535.63	0.00	40.14	N/A	87.36
511	41.91	550.55	0.00	68.02	N/A	87.36
512	41.99	616.17	0.00	78.54	N/A	87.36

Abbreviations

Depth:	Depth from free surface, at which CPT was performed (ft)
q _c :	Measured cone resistance (tsf)
f _s :	Sleeve friction resistance (tsf)
u:	Pore pressure (tsf)
Fines content:	Percentage of fines in soil (%)
Unit weight:	Bulk soil unit weight (pcf)

:: Cyclic Stress Ratio fully adjusted (CSR*) calculation data ::												
Point ID	Depth (ft)	σ_v (tsf)	u_0 (tsf)	σ'_v (tsf)	r_d	CSR	MSF	CSR _{eq}	K_G	User FS	CSR*	Belongs to transition
1	0.08	0.00	0.00	0.00	1.00	0.351	1.15	0.305	1.00	1.00	2.000	No
2	0.16	0.01	0.00	0.01	1.00	0.351	1.15	0.305	1.00	1.00	2.000	No
3	0.25	0.01	0.00	0.01	1.00	0.351	1.15	0.305	1.00	1.00	2.000	No
4	0.33	0.02	0.00	0.02	1.00	0.351	1.15	0.305	1.00	1.00	2.000	No
5	0.41	0.02	0.00	0.02	1.00	0.351	1.15	0.305	1.00	1.00	2.000	No
6	0.49	0.03	0.00	0.03	1.00	0.351	1.15	0.305	1.00	1.00	2.000	No
7	0.57	0.03	0.00	0.03	1.00	0.351	1.15	0.305	1.00	1.00	2.000	No
8	0.66	0.04	0.00	0.04	1.00	0.351	1.15	0.305	1.00	1.00	2.000	No
9	0.74	0.04	0.00	0.04	1.00	0.351	1.15	0.305	1.00	1.00	2.000	No
10	0.82	0.05	0.00	0.05	1.00	0.351	1.15	0.305	1.00	1.00	2.000	No
11	0.90	0.05	0.00	0.05	1.00	0.351	1.15	0.305	1.00	1.00	2.000	No
12	0.98	0.06	0.00	0.06	1.00	0.351	1.15	0.305	1.00	1.00	2.000	No
13	1.07	0.06	0.00	0.06	1.00	0.351	1.15	0.305	1.00	1.00	2.000	No
14	1.15	0.07	0.00	0.07	1.00	0.351	1.15	0.305	1.00	1.00	2.000	No
15	1.23	0.07	0.00	0.07	1.00	0.351	1.15	0.305	1.00	1.00	2.000	No
16	1.31	0.08	0.00	0.08	1.00	0.351	1.15	0.305	1.00	1.00	2.000	No
17	1.39	0.08	0.00	0.08	1.00	0.351	1.15	0.305	1.00	1.00	2.000	No
18	1.48	0.09	0.00	0.09	1.00	0.350	1.15	0.305	1.00	1.00	2.000	No
19	1.56	0.09	0.00	0.09	1.00	0.350	1.15	0.305	1.00	1.00	2.000	No
20	1.64	0.10	0.00	0.10	1.00	0.350	1.15	0.305	1.00	1.00	2.000	No
21	1.72	0.10	0.00	0.10	1.00	0.350	1.15	0.305	1.00	1.00	2.000	No
22	1.80	0.11	0.00	0.11	1.00	0.350	1.15	0.304	1.00	1.00	2.000	No
23	1.89	0.11	0.00	0.11	1.00	0.350	1.15	0.304	1.00	1.00	2.000	No
24	1.97	0.12	0.00	0.12	1.00	0.350	1.15	0.304	1.00	1.00	2.000	No
25	2.05	0.12	0.00	0.12	1.00	0.350	1.15	0.304	1.00	1.00	2.000	No
26	2.13	0.13	0.00	0.13	1.00	0.350	1.15	0.304	1.00	1.00	2.000	No
27	2.21	0.13	0.00	0.13	1.00	0.350	1.15	0.304	1.00	1.00	2.000	No
28	2.30	0.14	0.00	0.14	1.00	0.350	1.15	0.304	1.00	1.00	2.000	No
29	2.38	0.14	0.00	0.14	1.00	0.350	1.15	0.304	1.00	1.00	2.000	No
30	2.46	0.15	0.00	0.15	1.00	0.350	1.15	0.304	1.00	1.00	2.000	No
31	2.54	0.15	0.00	0.15	1.00	0.350	1.15	0.304	1.00	1.00	2.000	No
32	2.62	0.16	0.00	0.16	1.00	0.350	1.15	0.304	1.00	1.00	2.000	No
33	2.71	0.16	0.00	0.16	1.00	0.349	1.15	0.304	1.00	1.00	2.000	No
34	2.79	0.17	0.00	0.17	1.00	0.349	1.15	0.304	1.00	1.00	2.000	No
35	2.87	0.17	0.00	0.17	1.00	0.349	1.15	0.304	1.00	1.00	2.000	No
36	2.95	0.18	0.00	0.18	1.00	0.349	1.15	0.304	1.00	1.00	2.000	No
37	3.03	0.18	0.00	0.18	0.99	0.349	1.15	0.304	1.00	1.00	2.000	No
38	3.12	0.19	0.00	0.19	0.99	0.349	1.15	0.304	1.00	1.00	2.000	No
39	3.20	0.19	0.00	0.19	0.99	0.349	1.15	0.303	1.00	1.00	2.000	No
40	3.28	0.20	0.00	0.20	0.99	0.349	1.15	0.303	1.00	1.00	2.000	No
41	3.36	0.20	0.00	0.20	0.99	0.349	1.15	0.303	1.00	1.00	2.000	No
42	3.44	0.21	0.00	0.21	0.99	0.349	1.15	0.303	1.00	1.00	2.000	No
43	3.53	0.21	0.00	0.21	0.99	0.349	1.15	0.303	1.00	1.00	2.000	No
44	3.61	0.22	0.00	0.22	0.99	0.349	1.15	0.303	1.00	1.00	2.000	No
45	3.69	0.22	0.00	0.22	0.99	0.349	1.15	0.303	1.00	1.00	2.000	No
46	3.77	0.23	0.00	0.23	0.99	0.349	1.15	0.303	1.00	1.00	2.000	No
47	3.85	0.23	0.00	0.23	0.99	0.349	1.15	0.303	1.00	1.00	2.000	No
48	3.94	0.24	0.00	0.24	0.99	0.348	1.15	0.303	1.00	1.00	2.000	No

:: Cyclic Stress Ratio fully adjusted (CSR*) calculation data :: (continued)												
Point ID	Depth (ft)	σ_v (tsf)	u_0 (tsf)	σ'_v (tsf)	r_d	CSR	MSF	CSR_{eq}	K_G	User FS	CSR*	Belongs to transition
49	4.02	0.24	0.00	0.24	0.99	0.349	1.15	0.304	1.00	1.00	0.304	No
50	4.10	0.24	0.00	0.24	0.99	0.353	1.15	0.307	1.00	1.00	0.307	No
51	4.18	0.25	0.01	0.24	0.99	0.356	1.15	0.310	1.00	1.00	0.310	No
52	4.27	0.25	0.01	0.25	0.99	0.360	1.15	0.313	1.00	1.00	0.313	No
53	4.35	0.26	0.01	0.25	0.99	0.363	1.15	0.316	1.00	1.00	0.316	No
54	4.43	0.26	0.01	0.25	0.99	0.367	1.15	0.319	1.00	1.00	0.319	No
55	4.51	0.27	0.02	0.25	0.99	0.370	1.15	0.322	1.00	1.00	0.322	No
56	4.59	0.27	0.02	0.25	0.99	0.373	1.15	0.325	1.00	1.00	0.325	No
57	4.68	0.28	0.02	0.26	0.99	0.376	1.15	0.327	1.00	1.00	0.327	No
58	4.76	0.28	0.02	0.26	0.99	0.380	1.15	0.330	1.00	1.00	0.330	No
59	4.84	0.29	0.03	0.26	0.99	0.383	1.15	0.333	1.00	1.00	0.333	No
60	4.92	0.29	0.03	0.26	0.99	0.386	1.15	0.335	1.00	1.00	0.335	No
61	5.00	0.30	0.03	0.26	0.99	0.389	1.15	0.338	1.00	1.00	0.338	No
62	5.09	0.30	0.03	0.27	0.99	0.392	1.15	0.341	1.00	1.00	0.341	No
63	5.17	0.30	0.04	0.27	0.99	0.395	1.15	0.343	1.00	1.00	0.343	No
64	5.25	0.31	0.04	0.27	0.99	0.397	1.15	0.346	1.00	1.00	0.346	No
65	5.33	0.31	0.04	0.27	0.99	0.400	1.15	0.348	1.00	1.00	0.348	No
66	5.41	0.32	0.04	0.27	0.99	0.403	1.15	0.350	1.00	1.00	0.350	No
67	5.50	0.32	0.05	0.28	0.99	0.406	1.15	0.353	1.00	1.00	0.353	No
68	5.58	0.33	0.05	0.28	0.99	0.409	1.15	0.355	1.00	1.00	0.355	No
69	5.66	0.33	0.05	0.28	0.99	0.411	1.15	0.358	1.00	1.00	0.358	No
70	5.74	0.34	0.05	0.28	0.99	0.414	1.15	0.360	1.00	1.00	0.360	No
71	5.82	0.34	0.06	0.28	0.99	0.416	1.15	0.362	1.00	1.00	0.362	No
72	5.91	0.35	0.06	0.29	0.99	0.419	1.15	0.364	1.00	1.00	0.364	No
73	5.99	0.35	0.06	0.29	0.99	0.422	1.15	0.367	1.00	1.00	0.367	No
74	6.07	0.35	0.06	0.29	0.99	0.424	1.15	0.369	1.00	1.00	0.369	No
75	6.15	0.36	0.07	0.29	0.99	0.427	1.15	0.371	1.00	1.00	0.371	No
76	6.23	0.36	0.07	0.29	0.99	0.429	1.15	0.373	1.00	1.00	0.373	No
77	6.32	0.37	0.07	0.30	0.99	0.431	1.15	0.375	1.00	1.00	0.375	No
78	6.40	0.37	0.07	0.30	0.99	0.434	1.15	0.377	1.00	1.00	0.377	No
79	6.48	0.38	0.08	0.30	0.99	0.436	1.15	0.379	1.00	1.00	0.379	No
80	6.56	0.38	0.08	0.30	0.99	0.438	1.15	0.381	1.00	1.00	0.381	No
81	6.64	0.38	0.08	0.30	0.99	0.441	1.15	0.383	1.00	1.00	0.383	No
82	6.73	0.39	0.09	0.30	0.99	0.443	1.15	0.385	1.00	1.00	0.385	No
83	6.81	0.39	0.09	0.31	0.99	0.445	1.15	0.387	1.00	1.00	0.387	No
84	6.89	0.40	0.09	0.31	0.99	0.448	1.15	0.389	1.00	1.00	0.389	No
85	6.97	0.40	0.09	0.31	0.99	0.450	1.15	0.391	1.00	1.00	0.391	No
86	7.05	0.41	0.10	0.31	0.99	0.452	1.15	0.393	1.00	1.00	0.393	No
87	7.14	0.41	0.10	0.31	0.99	0.454	1.15	0.395	1.00	1.00	0.395	No
88	7.22	0.41	0.10	0.31	0.99	0.457	1.15	0.397	1.00	1.00	0.397	No
89	7.30	0.42	0.10	0.31	0.99	0.459	1.15	0.399	1.00	1.00	0.399	No
90	7.38	0.42	0.11	0.32	0.98	0.461	1.15	0.401	1.00	1.00	0.401	No
91	7.46	0.43	0.11	0.32	0.98	0.463	1.15	0.403	1.00	1.00	0.403	No
92	7.55	0.43	0.11	0.32	0.98	0.465	1.15	0.405	1.00	1.00	0.405	No
93	7.63	0.43	0.11	0.32	0.98	0.468	1.15	0.407	1.00	1.00	0.407	No
94	7.71	0.44	0.12	0.32	0.98	0.470	1.15	0.408	1.00	1.00	0.408	No
95	7.79	0.44	0.12	0.32	0.98	0.472	1.15	0.410	1.00	1.00	0.410	No
96	7.87	0.44	0.12	0.32	0.98	0.474	1.15	0.412	1.00	1.00	0.412	No

:: Cyclic Stress Ratio fully adjusted (CSR*) calculation data :: (continued)												
Point ID	Depth (ft)	σ_v (tsf)	u_0 (tsf)	σ'_v (tsf)	r_d	CSR	MSF	CSR_{eq}	K_G	User FS	CSR*	Belongs to transition
97	7.96	0.45	0.12	0.32	0.98	0.476	1.15	0.414	1.00	1.00	0.414	No
98	8.04	0.45	0.13	0.33	0.98	0.479	1.15	0.416	1.00	1.00	0.416	No
99	8.12	0.46	0.13	0.33	0.98	0.481	1.15	0.418	1.00	1.00	0.418	No
100	8.20	0.46	0.13	0.33	0.98	0.483	1.15	0.420	1.00	1.00	0.420	No
101	8.28	0.46	0.13	0.33	0.98	0.485	1.15	0.422	1.00	1.00	0.422	No
102	8.37	0.47	0.14	0.33	0.98	0.487	1.15	0.423	1.00	1.00	0.423	No
103	8.45	0.47	0.14	0.33	0.98	0.489	1.15	0.425	1.00	1.00	0.425	No
104	8.53	0.47	0.14	0.33	0.98	0.491	1.15	0.427	1.00	1.00	0.427	No
105	8.61	0.48	0.14	0.33	0.98	0.493	1.15	0.429	1.00	1.00	0.429	No
106	8.69	0.48	0.15	0.34	0.98	0.495	1.15	0.431	1.00	1.00	0.431	No
107	8.78	0.49	0.15	0.34	0.98	0.497	1.15	0.432	1.00	1.00	0.432	No
108	8.86	0.49	0.15	0.34	0.98	0.499	1.15	0.434	1.00	1.00	0.434	No
109	8.94	0.49	0.15	0.34	0.98	0.501	1.15	0.436	1.00	1.00	0.436	No
110	9.02	0.50	0.16	0.34	0.98	0.503	1.15	0.438	1.00	1.00	0.438	No
111	9.10	0.50	0.16	0.34	0.98	0.505	1.15	0.439	1.00	1.00	0.439	No
112	9.19	0.50	0.16	0.34	0.98	0.507	1.15	0.441	1.00	1.00	0.441	No
113	9.27	0.51	0.16	0.34	0.98	0.509	1.15	0.443	1.00	1.00	0.443	No
114	9.35	0.51	0.17	0.34	0.98	0.511	1.15	0.444	1.00	1.00	0.444	No
115	9.43	0.52	0.17	0.35	0.98	0.513	1.15	0.446	1.00	1.00	0.446	No
116	9.51	0.52	0.17	0.35	0.98	0.514	1.15	0.447	1.00	1.00	0.447	No
117	9.60	0.52	0.17	0.35	0.98	0.516	1.15	0.448	1.00	1.00	0.448	No
118	9.68	0.53	0.18	0.35	0.98	0.517	1.15	0.450	1.00	1.00	0.450	No
119	9.76	0.53	0.18	0.35	0.98	0.519	1.15	0.451	1.00	1.00	0.451	No
120	9.84	0.54	0.18	0.35	0.98	0.521	1.15	0.453	1.00	1.00	0.453	No
121	9.92	0.54	0.18	0.36	0.98	0.522	1.15	0.454	1.00	1.00	0.454	No
122	10.01	0.55	0.19	0.36	0.98	0.524	1.15	0.455	1.00	1.00	0.455	No
123	10.09	0.55	0.19	0.36	0.98	0.525	1.15	0.457	1.00	1.00	0.457	No
124	10.17	0.55	0.19	0.36	0.98	0.527	1.15	0.458	1.00	1.00	0.458	No
125	10.25	0.56	0.20	0.36	0.98	0.529	1.15	0.460	1.00	1.00	0.460	No
126	10.33	0.56	0.20	0.36	0.98	0.530	1.15	0.461	1.00	1.00	0.461	No
127	10.42	0.57	0.20	0.36	0.98	0.532	1.15	0.462	1.00	1.00	0.462	No
128	10.50	0.57	0.20	0.37	0.98	0.533	1.15	0.464	1.00	1.00	0.464	No
129	10.58	0.57	0.21	0.37	0.98	0.535	1.15	0.465	1.00	1.00	0.465	No
130	10.66	0.58	0.21	0.37	0.98	0.536	1.15	0.466	1.00	1.00	0.466	No
131	10.74	0.58	0.21	0.37	0.98	0.538	1.15	0.468	1.00	1.00	0.468	No
132	10.83	0.59	0.21	0.37	0.98	0.539	1.15	0.469	1.00	1.00	0.469	No
133	10.91	0.59	0.22	0.37	0.98	0.541	1.15	0.470	1.00	1.00	0.470	No
134	10.99	0.59	0.22	0.38	0.98	0.542	1.15	0.471	1.00	1.00	0.471	No
135	11.07	0.60	0.22	0.38	0.98	0.543	1.15	0.472	1.00	1.00	0.472	No
136	11.15	0.60	0.22	0.38	0.98	0.545	1.15	0.474	1.00	1.00	0.474	No
137	11.24	0.61	0.23	0.38	0.98	0.546	1.15	0.475	1.00	1.00	0.475	No
138	11.32	0.61	0.23	0.38	0.98	0.547	1.15	0.476	1.00	1.00	0.476	No
139	11.40	0.62	0.23	0.38	0.98	0.548	1.15	0.477	1.00	1.00	0.477	No
140	11.48	0.62	0.23	0.39	0.98	0.550	1.15	0.478	1.00	1.00	0.478	No
141	11.56	0.62	0.24	0.39	0.98	0.551	1.15	0.479	1.00	1.00	0.479	No
142	11.65	0.63	0.24	0.39	0.98	0.552	1.15	0.480	1.00	1.00	0.480	No
143	11.73	0.63	0.24	0.39	0.98	0.553	1.15	0.481	1.00	1.00	0.481	No
144	11.81	0.64	0.24	0.39	0.98	0.554	1.15	0.482	1.00	1.00	0.482	No

:: Cyclic Stress Ratio fully adjusted (CSR*) calculation data :: (continued)												
Point ID	Depth (ft)	σ_v (tsf)	u_0 (tsf)	σ'_v (tsf)	r_d	CSR	MSF	CSR_{eq}	K_G	User FS	CSR*	Belongs to transition
145	11.89	0.64	0.25	0.40	0.98	0.555	1.15	0.482	1.00	1.00	0.482	No
146	11.98	0.65	0.25	0.40	0.97	0.556	1.15	0.483	1.00	1.00	0.483	No
147	12.06	0.65	0.25	0.40	0.97	0.557	1.15	0.484	1.00	1.00	0.484	No
148	12.14	0.66	0.25	0.40	0.97	0.558	1.15	0.485	1.00	1.00	0.485	No
149	12.22	0.66	0.26	0.40	0.97	0.559	1.15	0.486	1.00	1.00	0.486	No
150	12.30	0.67	0.26	0.41	0.97	0.560	1.15	0.487	1.00	1.00	0.487	No
151	12.39	0.67	0.26	0.41	0.97	0.561	1.15	0.488	1.00	1.00	0.488	No
152	12.47	0.67	0.26	0.41	0.97	0.562	1.15	0.488	1.00	1.00	0.488	No
153	12.55	0.68	0.27	0.41	0.97	0.563	1.15	0.489	1.00	1.00	0.489	No
154	12.63	0.68	0.27	0.41	0.97	0.564	1.15	0.490	1.00	1.00	0.490	No
155	12.71	0.69	0.27	0.42	0.97	0.565	1.15	0.491	1.00	1.00	0.491	No
156	12.80	0.69	0.27	0.42	0.97	0.565	1.15	0.492	1.00	1.00	0.492	No
157	12.88	0.70	0.28	0.42	0.97	0.566	1.15	0.492	1.00	1.00	0.492	No
158	12.96	0.70	0.28	0.42	0.97	0.567	1.15	0.493	1.00	1.00	0.493	No
159	13.04	0.71	0.28	0.42	0.97	0.568	1.15	0.494	1.00	1.00	0.494	No
160	13.12	0.71	0.28	0.43	0.97	0.569	1.15	0.495	1.00	1.00	0.495	No
161	13.21	0.72	0.29	0.43	0.97	0.570	1.15	0.496	1.00	1.00	0.496	No
162	13.29	0.72	0.29	0.43	0.97	0.571	1.15	0.496	1.00	1.00	0.496	No
163	13.37	0.73	0.29	0.43	0.97	0.572	1.15	0.497	1.00	1.00	0.497	No
164	13.45	0.73	0.29	0.43	0.97	0.573	1.15	0.498	1.00	1.00	0.498	No
165	13.53	0.73	0.30	0.44	0.97	0.573	1.15	0.499	1.00	1.00	0.499	No
166	13.62	0.74	0.30	0.44	0.97	0.574	1.15	0.499	1.00	1.00	0.499	No
167	13.70	0.74	0.30	0.44	0.97	0.575	1.15	0.500	1.00	1.00	0.500	No
168	13.78	0.75	0.31	0.44	0.97	0.576	1.15	0.501	1.00	1.00	0.501	No
169	13.86	0.75	0.31	0.44	0.97	0.577	1.15	0.502	1.00	1.00	0.502	No
170	13.94	0.76	0.31	0.45	0.97	0.578	1.15	0.502	1.00	1.00	0.502	No
171	14.03	0.76	0.31	0.45	0.97	0.579	1.15	0.503	1.00	1.00	0.503	No
172	14.11	0.77	0.32	0.45	0.97	0.579	1.15	0.504	1.00	1.00	0.504	No
173	14.19	0.77	0.32	0.45	0.97	0.580	1.15	0.504	1.00	1.00	0.504	No
174	14.27	0.77	0.32	0.45	0.97	0.581	1.15	0.505	1.00	1.00	0.505	No
175	14.35	0.78	0.32	0.46	0.97	0.582	1.15	0.506	1.00	1.00	0.506	No
176	14.44	0.78	0.33	0.46	0.97	0.582	1.15	0.506	1.00	1.00	0.506	No
177	14.52	0.79	0.33	0.46	0.97	0.583	1.15	0.507	1.00	1.00	0.507	No
178	14.60	0.79	0.33	0.46	0.97	0.584	1.15	0.507	1.00	1.00	0.507	No
179	14.68	0.80	0.33	0.46	0.97	0.584	1.15	0.508	1.00	1.00	0.508	No
180	14.76	0.80	0.34	0.47	0.97	0.585	1.15	0.509	1.00	1.00	0.509	No
181	14.85	0.81	0.34	0.47	0.97	0.586	1.15	0.509	1.00	1.00	0.509	No
182	14.93	0.81	0.34	0.47	0.97	0.587	1.15	0.510	1.00	1.00	0.510	No
183	15.01	0.82	0.34	0.47	0.97	0.587	1.15	0.511	1.00	1.00	0.511	No
184	15.09	0.82	0.35	0.47	0.97	0.588	1.15	0.511	1.00	1.00	0.511	No
185	15.17	0.82	0.35	0.48	0.97	0.589	1.15	0.512	1.00	1.00	0.512	No
186	15.26	0.83	0.35	0.48	0.97	0.590	1.15	0.513	1.00	1.00	0.513	No
187	15.34	0.83	0.35	0.48	0.97	0.590	1.15	0.513	1.00	1.00	0.513	No
188	15.42	0.84	0.36	0.48	0.97	0.591	1.15	0.514	1.00	1.00	0.514	No
189	15.50	0.84	0.36	0.48	0.97	0.592	1.15	0.514	1.00	1.00	0.514	No
190	15.58	0.85	0.36	0.49	0.97	0.592	1.15	0.515	1.00	1.00	0.515	No
191	15.67	0.85	0.36	0.49	0.97	0.593	1.15	0.515	1.00	1.00	0.515	No
192	15.75	0.86	0.37	0.49	0.97	0.593	1.15	0.516	1.00	1.00	0.516	No

:: Cyclic Stress Ratio fully adjusted (CSR*) calculation data :: (continued)												
Point ID	Depth (ft)	σ_v (tsf)	u_0 (tsf)	σ'_v (tsf)	r_d	CSR	MSF	CSR _{eq}	K_G	User FS	CSR*	Belongs to transition
193	15.83	0.86	0.37	0.49	0.97	0.594	1.15	0.516	1.00	1.00	0.516	No
194	15.91	0.87	0.37	0.49	0.97	0.595	1.15	0.517	1.00	1.00	0.517	No
195	15.99	0.87	0.37	0.50	0.97	0.595	1.15	0.517	1.00	1.00	0.517	No
196	16.08	0.87	0.38	0.50	0.97	0.596	1.15	0.518	1.00	1.00	0.518	No
197	16.16	0.88	0.38	0.50	0.97	0.596	1.15	0.518	1.00	1.00	0.518	No
198	16.24	0.88	0.38	0.50	0.97	0.597	1.15	0.519	1.00	1.00	0.519	No
199	16.32	0.89	0.38	0.50	0.97	0.598	1.15	0.520	1.00	1.00	0.520	No
200	16.40	0.89	0.39	0.51	0.97	0.598	1.15	0.520	1.00	1.00	0.520	No
201	16.49	0.90	0.39	0.51	0.97	0.599	1.15	0.521	1.00	1.00	0.521	No
202	16.57	0.90	0.39	0.51	0.97	0.599	1.15	0.521	1.00	1.00	0.521	No
203	16.65	0.91	0.39	0.51	0.96	0.600	1.15	0.522	1.00	1.00	0.522	No
204	16.73	0.91	0.40	0.51	0.96	0.601	1.15	0.522	1.00	1.00	0.522	No
205	16.81	0.92	0.40	0.52	0.96	0.601	1.15	0.523	1.00	1.00	0.523	No
206	16.90	0.92	0.40	0.52	0.96	0.602	1.15	0.523	1.00	1.00	0.523	No
207	16.98	0.92	0.40	0.52	0.96	0.602	1.15	0.523	1.00	1.00	0.523	No
208	17.06	0.93	0.41	0.52	0.96	0.603	1.15	0.524	1.00	1.00	0.524	No
209	17.14	0.93	0.41	0.52	0.96	0.603	1.15	0.524	1.00	1.00	0.524	No
210	17.22	0.94	0.41	0.53	0.96	0.604	1.15	0.525	1.00	1.00	0.525	No
211	17.31	0.94	0.42	0.53	0.96	0.604	1.15	0.525	1.00	1.00	0.525	No
212	17.39	0.95	0.42	0.53	0.96	0.604	1.15	0.525	1.00	1.00	0.525	No
213	17.47	0.95	0.42	0.53	0.96	0.605	1.15	0.526	1.00	1.00	0.526	No
214	17.55	0.96	0.42	0.54	0.96	0.605	1.15	0.526	1.00	1.00	0.526	No
215	17.63	0.96	0.43	0.54	0.96	0.605	1.15	0.526	1.00	1.00	0.526	No
216	17.72	0.97	0.43	0.54	0.96	0.606	1.15	0.527	1.00	1.00	0.527	No
217	17.80	0.97	0.43	0.54	0.96	0.606	1.15	0.527	1.00	1.00	0.527	No
218	17.88	0.98	0.43	0.54	0.96	0.606	1.15	0.527	1.00	1.00	0.527	No
219	17.96	0.98	0.44	0.55	0.96	0.607	1.15	0.528	1.00	1.00	0.528	No
220	18.04	0.99	0.44	0.55	0.96	0.607	1.15	0.528	1.00	1.00	0.528	No
221	18.13	0.99	0.44	0.55	0.96	0.607	1.15	0.528	1.00	1.00	0.528	No
222	18.21	1.00	0.44	0.55	0.96	0.608	1.15	0.528	1.00	1.00	0.528	No
223	18.29	1.00	0.45	0.56	0.96	0.608	1.15	0.529	1.00	1.00	0.529	No
224	18.37	1.01	0.45	0.56	0.96	0.608	1.15	0.529	1.00	1.00	0.529	No
225	18.45	1.01	0.45	0.56	0.96	0.609	1.15	0.529	1.00	1.00	0.529	No
226	18.54	1.02	0.45	0.56	0.96	0.609	1.15	0.529	1.00	1.00	0.529	No
227	18.62	1.02	0.46	0.57	0.96	0.609	1.15	0.530	1.00	1.00	0.530	No
228	18.70	1.03	0.46	0.57	0.96	0.609	1.15	0.530	1.00	1.00	0.530	No
229	18.78	1.03	0.46	0.57	0.96	0.610	1.15	0.530	1.00	1.00	0.530	No
230	18.86	1.04	0.46	0.57	0.96	0.610	1.15	0.530	1.00	1.00	0.530	No
231	18.95	1.04	0.47	0.57	0.96	0.610	1.15	0.530	1.00	1.00	0.530	No
232	19.03	1.05	0.47	0.58	0.96	0.610	1.15	0.531	1.00	1.00	0.531	No
233	19.11	1.05	0.47	0.58	0.96	0.611	1.15	0.531	1.00	1.00	0.531	No
234	19.19	1.06	0.47	0.58	0.96	0.611	1.15	0.531	1.00	1.00	0.531	No
235	19.27	1.06	0.48	0.58	0.96	0.611	1.15	0.531	1.00	1.00	0.531	No
236	19.36	1.07	0.48	0.59	0.96	0.611	1.15	0.531	1.00	1.00	0.531	No
237	19.44	1.07	0.48	0.59	0.96	0.612	1.15	0.532	1.00	1.00	0.532	No
238	19.52	1.08	0.48	0.59	0.96	0.612	1.15	0.532	1.00	1.00	0.532	No
239	19.60	1.08	0.49	0.59	0.96	0.612	1.15	0.532	1.00	1.00	0.532	No
240	19.69	1.08	0.49	0.60	0.96	0.613	1.15	0.533	1.00	1.00	0.533	No

:: Cyclic Stress Ratio fully adjusted (CSR*) calculation data :: (continued)												
Point ID	Depth (ft)	σ_v (tsf)	u_0 (tsf)	σ'_v (tsf)	r_d	CSR	MSF	CSR _{eq}	K_G	User FS	CSR*	Belongs to transition
241	19.77	1.09	0.49	0.60	0.96	0.613	1.15	0.533	1.00	1.00	0.533	No
242	19.85	1.09	0.49	0.60	0.96	0.613	1.15	0.533	1.00	1.00	0.533	No
243	19.93	1.10	0.50	0.60	0.96	0.614	1.15	0.534	1.00	1.00	0.534	No
244	20.01	1.10	0.50	0.60	0.96	0.614	1.15	0.534	1.00	1.00	0.534	No
245	20.10	1.11	0.50	0.60	0.96	0.615	1.15	0.534	1.00	1.00	0.534	No
246	20.18	1.11	0.50	0.61	0.96	0.615	1.15	0.535	1.00	1.00	0.535	No
247	20.26	1.12	0.51	0.61	0.96	0.616	1.15	0.535	1.00	1.00	0.535	No
248	20.34	1.12	0.51	0.61	0.96	0.616	1.15	0.536	1.00	1.00	0.536	No
249	20.42	1.12	0.51	0.61	0.96	0.616	1.15	0.536	1.00	1.00	0.536	No
250	20.51	1.13	0.51	0.61	0.96	0.617	1.15	0.536	1.00	1.00	0.536	No
251	20.59	1.13	0.52	0.62	0.96	0.617	1.15	0.537	1.00	1.00	0.537	No
252	20.67	1.14	0.52	0.62	0.96	0.618	1.15	0.537	1.00	1.00	0.537	No
253	20.75	1.14	0.52	0.62	0.95	0.618	1.15	0.537	1.00	1.00	0.537	No
254	20.83	1.15	0.53	0.62	0.95	0.619	1.15	0.538	1.00	1.00	0.538	No
255	20.92	1.15	0.53	0.62	0.95	0.619	1.15	0.538	1.00	1.00	0.538	No
256	21.00	1.15	0.53	0.62	0.95	0.620	1.15	0.539	1.00	1.00	0.539	No
257	21.08	1.16	0.53	0.63	0.95	0.620	1.15	0.539	1.00	1.00	0.539	No
258	21.16	1.16	0.54	0.63	0.95	0.621	1.15	0.540	1.00	1.00	0.540	No
259	21.24	1.17	0.54	0.63	0.95	0.621	1.15	0.540	1.00	1.00	0.540	No
260	21.33	1.17	0.54	0.63	0.95	0.622	1.15	0.541	1.00	1.00	0.541	No
261	21.41	1.17	0.54	0.63	0.95	0.623	1.15	0.541	1.00	1.00	0.541	No
262	21.49	1.18	0.55	0.63	0.95	0.623	1.15	0.542	1.00	1.00	0.542	No
263	21.57	1.18	0.55	0.63	0.95	0.624	1.15	0.542	1.00	1.00	0.542	No
264	21.65	1.19	0.55	0.63	0.95	0.624	1.15	0.543	1.00	1.00	0.543	No
265	21.74	1.19	0.55	0.64	0.95	0.625	1.15	0.543	1.00	1.00	0.543	No
266	21.82	1.19	0.56	0.64	0.95	0.625	1.15	0.544	1.00	1.00	0.544	No
267	21.90	1.20	0.56	0.64	0.95	0.626	1.15	0.544	1.00	1.00	0.544	No
268	21.98	1.20	0.56	0.64	0.95	0.627	1.15	0.545	1.00	1.00	0.545	No
269	22.06	1.21	0.56	0.64	0.95	0.627	1.15	0.545	1.00	1.00	0.545	No
270	22.15	1.21	0.57	0.64	0.95	0.628	1.15	0.546	1.00	1.00	0.546	No
271	22.23	1.21	0.57	0.64	0.95	0.628	1.15	0.546	1.00	1.00	0.546	No
272	22.31	1.22	0.57	0.65	0.95	0.629	1.15	0.547	1.00	1.00	0.547	No
273	22.39	1.22	0.57	0.65	0.95	0.629	1.15	0.547	1.00	1.00	0.547	No
274	22.47	1.22	0.58	0.65	0.95	0.630	1.15	0.548	1.00	1.00	0.548	No
275	22.56	1.23	0.58	0.65	0.95	0.630	1.15	0.548	1.00	1.00	0.548	No
276	22.64	1.23	0.58	0.65	0.95	0.631	1.15	0.548	1.00	1.00	0.548	No
277	22.72	1.24	0.58	0.65	0.95	0.631	1.15	0.549	1.00	1.00	0.549	No
278	22.80	1.24	0.59	0.65	0.95	0.632	1.15	0.549	1.00	1.00	0.549	No
279	22.88	1.24	0.59	0.66	0.95	0.632	1.15	0.550	1.00	1.00	0.550	No
280	22.97	1.25	0.59	0.66	0.95	0.633	1.15	0.550	1.00	1.00	0.550	No
281	23.05	1.25	0.59	0.66	0.95	0.633	1.15	0.550	1.00	1.00	0.550	No
282	23.13	1.26	0.60	0.66	0.95	0.633	1.15	0.551	1.00	1.00	0.551	No
283	23.21	1.26	0.60	0.66	0.95	0.634	1.15	0.551	1.00	1.00	0.551	No
284	23.29	1.27	0.60	0.66	0.95	0.634	1.15	0.551	1.00	1.00	0.551	No
285	23.38	1.27	0.60	0.66	0.95	0.635	1.15	0.552	1.00	1.00	0.552	No
286	23.46	1.27	0.61	0.67	0.95	0.635	1.15	0.552	1.00	1.00	0.552	No
287	23.54	1.28	0.61	0.67	0.95	0.636	1.15	0.553	1.00	1.00	0.553	No
288	23.62	1.28	0.61	0.67	0.95	0.636	1.15	0.553	1.00	1.00	0.553	No

:: Cyclic Stress Ratio fully adjusted (CSR*) calculation data :: (continued)												
Point ID	Depth (ft)	σ_v (tsf)	u_0 (tsf)	σ_v' (tsf)	r_d	CSR	MSF	CSR _{eq}	K_G	User FS	CSR*	Belongs to transition
289	23.70	1.29	0.61	0.67	0.95	0.637	1.15	0.554	1.00	1.00	0.554	No
290	23.79	1.29	0.62	0.67	0.95	0.637	1.15	0.554	1.00	1.00	0.554	No
291	23.87	1.29	0.62	0.67	0.95	0.638	1.15	0.554	1.00	1.00	0.554	No
292	23.95	1.30	0.62	0.67	0.95	0.638	1.15	0.555	1.00	1.00	0.555	No
293	24.03	1.30	0.63	0.68	0.95	0.639	1.15	0.555	1.00	1.00	0.555	No
294	24.11	1.30	0.63	0.68	0.94	0.639	1.15	0.556	1.00	1.00	0.556	No
295	24.20	1.31	0.63	0.68	0.94	0.639	1.15	0.556	1.00	1.00	0.556	No
296	24.28	1.31	0.63	0.68	0.94	0.640	1.15	0.556	1.00	1.00	0.556	No
297	24.36	1.32	0.64	0.68	0.94	0.640	1.15	0.557	1.00	1.00	0.557	No
298	24.44	1.32	0.64	0.68	0.94	0.641	1.15	0.557	1.00	1.00	0.557	No
299	24.52	1.32	0.64	0.68	0.94	0.641	1.15	0.558	1.00	1.00	0.558	No
300	24.61	1.33	0.64	0.69	0.94	0.642	1.15	0.558	1.00	1.00	0.558	No
301	24.69	1.33	0.65	0.69	0.94	0.642	1.15	0.558	1.00	1.00	0.558	No
302	24.77	1.34	0.65	0.69	0.94	0.642	1.15	0.559	1.00	1.00	0.559	No
303	24.85	1.34	0.65	0.69	0.94	0.643	1.15	0.559	1.00	1.00	0.559	No
304	24.93	1.34	0.65	0.69	0.94	0.643	1.15	0.559	1.00	1.00	0.559	No
305	25.02	1.35	0.66	0.69	0.94	0.643	1.15	0.559	1.00	1.00	0.559	No
306	25.10	1.35	0.66	0.70	0.94	0.643	1.15	0.559	1.00	1.00	0.559	No
307	25.18	1.36	0.66	0.70	0.94	0.643	1.15	0.559	1.00	1.00	0.559	No
308	25.26	1.36	0.66	0.70	0.94	0.643	1.15	0.559	1.00	1.00	0.559	No
309	25.34	1.37	0.67	0.70	0.94	0.643	1.15	0.559	1.00	1.00	0.559	No
310	25.43	1.37	0.67	0.70	0.94	0.643	1.15	0.559	1.00	1.00	0.559	No
311	25.51	1.38	0.67	0.71	0.94	0.643	1.15	0.559	1.00	1.00	0.559	No
312	25.59	1.38	0.67	0.71	0.94	0.643	1.15	0.559	1.00	1.00	0.559	No
313	25.67	1.39	0.68	0.71	0.94	0.643	1.15	0.559	1.00	1.00	0.559	No
314	25.75	1.39	0.68	0.72	0.94	0.642	1.15	0.559	1.00	1.00	0.559	No
315	25.84	1.40	0.68	0.72	0.94	0.642	1.15	0.558	1.00	1.00	0.558	No
316	25.92	1.40	0.68	0.72	0.94	0.642	1.15	0.558	1.00	1.00	0.558	No
317	26.00	1.41	0.69	0.72	0.94	0.642	1.15	0.558	1.00	1.00	0.558	No
318	26.08	1.42	0.69	0.73	0.94	0.642	1.15	0.558	1.00	1.00	0.558	No
319	26.16	1.42	0.69	0.73	0.94	0.641	1.15	0.558	1.00	1.00	0.558	No
320	26.25	1.43	0.69	0.73	0.94	0.641	1.15	0.557	1.00	1.00	0.557	No
321	26.33	1.43	0.70	0.73	0.94	0.641	1.15	0.557	1.00	1.00	0.557	No
322	26.41	1.44	0.70	0.74	0.94	0.641	1.15	0.557	1.00	1.00	0.557	No
323	26.49	1.44	0.70	0.74	0.94	0.641	1.15	0.557	1.00	1.00	0.557	No
324	26.57	1.45	0.70	0.74	0.94	0.641	1.15	0.557	1.00	1.00	0.557	No
325	26.66	1.45	0.71	0.74	0.94	0.640	1.15	0.557	1.00	1.00	0.557	No
326	26.74	1.46	0.71	0.75	0.94	0.640	1.15	0.557	1.00	1.00	0.557	No
327	26.82	1.46	0.71	0.75	0.93	0.640	1.15	0.556	1.00	1.00	0.556	No
328	26.90	1.47	0.71	0.75	0.93	0.640	1.15	0.556	1.00	1.00	0.556	No
329	26.98	1.47	0.72	0.75	0.93	0.640	1.15	0.556	1.00	1.00	0.556	No
330	27.07	1.48	0.72	0.76	0.93	0.639	1.15	0.556	1.00	1.00	0.556	No
331	27.15	1.48	0.72	0.76	0.93	0.639	1.15	0.556	1.00	1.00	0.556	No
332	27.23	1.49	0.72	0.76	0.93	0.639	1.15	0.556	1.00	1.00	0.556	No
333	27.31	1.49	0.73	0.76	0.93	0.639	1.15	0.556	1.00	1.00	0.556	No
334	27.40	1.50	0.73	0.77	0.93	0.639	1.15	0.556	1.00	1.00	0.556	No
335	27.48	1.50	0.73	0.77	0.93	0.639	1.15	0.556	1.00	1.00	0.556	No
336	27.56	1.51	0.74	0.77	0.93	0.639	1.15	0.555	1.00	1.00	0.555	No

:: Cyclic Stress Ratio fully adjusted (CSR*) calculation data :: (continued)												
Point ID	Depth (ft)	σ_v (tsf)	u_0 (tsf)	σ'_v (tsf)	r_d	CSR	MSF	CSR_{eq}	K_G	User FS	CSR*	Belongs to transition
337	27.64	1.51	0.74	0.77	0.93	0.639	1.15	0.555	1.00	1.00	0.555	No
338	27.72	1.52	0.74	0.78	0.93	0.639	1.15	0.555	1.00	1.00	0.555	No
339	27.81	1.52	0.74	0.78	0.93	0.639	1.15	0.555	1.00	1.00	0.555	No
340	27.89	1.53	0.75	0.78	0.93	0.638	1.15	0.555	1.00	1.00	0.555	No
341	27.97	1.53	0.75	0.78	0.93	0.638	1.15	0.555	1.00	1.00	0.555	No
342	28.05	1.54	0.75	0.79	0.93	0.638	1.15	0.555	1.00	1.00	0.555	No
343	28.13	1.54	0.75	0.79	0.93	0.638	1.15	0.555	1.00	1.00	0.555	No
344	28.22	1.55	0.76	0.79	0.93	0.638	1.15	0.555	1.00	1.00	0.555	No
345	28.30	1.55	0.76	0.79	0.93	0.638	1.15	0.555	1.00	1.00	0.555	No
346	28.38	1.56	0.76	0.79	0.93	0.638	1.15	0.554	1.00	1.00	0.554	No
347	28.46	1.56	0.76	0.80	0.93	0.637	1.15	0.554	1.00	1.00	0.554	No
348	28.54	1.57	0.77	0.80	0.93	0.637	1.15	0.554	1.00	1.00	0.554	No
349	28.63	1.57	0.77	0.80	0.93	0.637	1.15	0.554	1.00	1.00	0.554	No
350	28.71	1.58	0.77	0.81	0.93	0.637	1.15	0.554	1.00	1.00	0.554	No
351	28.79	1.58	0.77	0.81	0.93	0.637	1.15	0.553	1.00	1.00	0.553	No
352	28.87	1.59	0.78	0.81	0.93	0.636	1.15	0.553	1.00	1.00	0.553	No
353	28.95	1.59	0.78	0.81	0.93	0.636	1.15	0.553	1.00	1.00	0.553	No
354	29.04	1.60	0.78	0.82	0.93	0.636	1.15	0.553	1.00	1.00	0.553	No
355	29.12	1.60	0.78	0.82	0.92	0.636	1.15	0.553	1.00	1.00	0.553	No
356	29.20	1.61	0.79	0.82	0.92	0.635	1.15	0.552	1.00	1.00	0.552	No
357	29.28	1.61	0.79	0.82	0.92	0.635	1.15	0.552	1.00	1.00	0.552	No
358	29.36	1.62	0.79	0.83	0.92	0.635	1.15	0.552	1.00	1.00	0.552	No
359	29.45	1.62	0.79	0.83	0.92	0.635	1.15	0.552	1.00	1.00	0.552	No
360	29.53	1.63	0.80	0.83	0.92	0.635	1.15	0.552	1.00	1.00	0.552	No
361	29.61	1.63	0.80	0.83	0.92	0.634	1.15	0.552	1.00	1.00	0.552	No
362	29.69	1.64	0.80	0.84	0.92	0.634	1.15	0.551	1.00	1.00	0.551	No
363	29.77	1.64	0.80	0.84	0.92	0.634	1.15	0.551	1.00	1.00	0.551	No
364	29.86	1.65	0.81	0.84	0.92	0.634	1.15	0.551	1.00	1.00	0.551	No
365	29.94	1.65	0.81	0.84	0.92	0.633	1.15	0.551	1.00	1.00	0.551	No
366	30.02	1.66	0.81	0.85	0.92	0.633	1.15	0.550	1.00	1.00	0.550	No
367	30.10	1.66	0.81	0.85	0.92	0.633	1.15	0.550	1.00	1.00	0.550	No
368	30.18	1.67	0.82	0.85	0.92	0.632	1.15	0.550	1.00	1.00	0.550	No
369	30.27	1.67	0.82	0.86	0.92	0.632	1.15	0.549	1.00	1.00	0.549	No
370	30.35	1.68	0.82	0.86	0.92	0.632	1.15	0.549	1.00	1.00	0.549	No
371	30.43	1.69	0.82	0.86	0.92	0.631	1.15	0.549	1.00	1.00	0.549	No
372	30.51	1.69	0.83	0.86	0.92	0.631	1.15	0.548	1.00	1.00	0.548	No
373	30.59	1.70	0.83	0.87	0.92	0.631	1.15	0.548	1.00	1.00	0.548	No
374	30.68	1.70	0.83	0.87	0.92	0.630	1.15	0.548	1.00	1.00	0.548	No
375	30.76	1.71	0.83	0.87	0.92	0.630	1.15	0.547	1.00	1.00	0.547	No
376	30.84	1.71	0.84	0.88	0.92	0.629	1.15	0.547	1.00	1.00	0.547	No
377	30.92	1.72	0.84	0.88	0.92	0.629	1.15	0.547	1.00	1.00	0.547	No
378	31.00	1.72	0.84	0.88	0.92	0.628	1.15	0.546	1.00	1.00	0.546	No
379	31.09	1.73	0.85	0.88	0.91	0.628	1.15	0.546	1.00	1.00	0.546	No
380	31.17	1.73	0.85	0.89	0.91	0.628	1.15	0.546	1.00	1.00	0.546	No
381	31.25	1.74	0.85	0.89	0.91	0.627	1.15	0.545	1.00	1.00	0.545	No
382	31.33	1.75	0.85	0.89	0.91	0.627	1.15	0.545	1.00	1.00	0.545	No
383	31.41	1.75	0.86	0.90	0.91	0.627	1.15	0.545	1.00	1.00	0.545	No
384	31.50	1.76	0.86	0.90	0.91	0.626	1.15	0.544	1.00	1.00	0.544	No

:: Cyclic Stress Ratio fully adjusted (CSR*) calculation data :: (continued)												
Point ID	Depth (ft)	σ_v (tsf)	u_0 (tsf)	σ'_v (tsf)	r_d	CSR	MSF	CSR _{eq}	K_G	User FS	CSR*	Belongs to transition
385	31.58	1.76	0.86	0.90	0.91	0.626	1.15	0.544	1.00	1.00	0.544	No
386	31.66	1.77	0.86	0.90	0.91	0.625	1.15	0.544	1.00	1.00	0.544	No
387	31.74	1.77	0.87	0.91	0.91	0.625	1.15	0.543	1.00	1.00	0.543	No
388	31.82	1.78	0.87	0.91	0.91	0.625	1.15	0.543	1.00	1.00	0.543	No
389	31.91	1.78	0.87	0.91	0.91	0.624	1.15	0.543	1.00	1.00	0.543	No
390	31.99	1.79	0.87	0.92	0.91	0.624	1.15	0.542	1.00	1.00	0.542	No
391	32.07	1.79	0.88	0.92	0.91	0.623	1.15	0.542	1.00	1.00	0.542	No
392	32.15	1.80	0.88	0.92	0.91	0.623	1.15	0.542	1.00	1.00	0.542	No
393	32.23	1.81	0.88	0.92	0.91	0.623	1.15	0.541	1.00	1.00	0.541	No
394	32.32	1.81	0.88	0.93	0.91	0.622	1.15	0.541	1.00	1.00	0.541	No
395	32.40	1.82	0.89	0.93	0.91	0.622	1.15	0.540	1.00	1.00	0.540	No
396	32.48	1.82	0.89	0.93	0.91	0.621	1.15	0.540	1.00	1.00	0.540	No
397	32.56	1.83	0.89	0.94	0.91	0.621	1.15	0.540	1.00	1.00	0.540	No
398	32.64	1.83	0.89	0.94	0.91	0.620	1.15	0.539	1.00	1.00	0.539	No
399	32.73	1.84	0.90	0.94	0.91	0.620	1.15	0.539	1.00	1.00	0.539	No
400	32.81	1.84	0.90	0.95	0.90	0.620	1.15	0.539	1.00	1.00	0.539	No
401	32.89	1.85	0.90	0.95	0.90	0.619	1.15	0.538	1.00	1.00	0.538	No
402	32.97	1.85	0.90	0.95	0.90	0.619	1.15	0.538	1.00	1.00	0.538	No
403	33.05	1.86	0.91	0.95	0.90	0.618	1.15	0.538	1.00	1.00	0.538	No
404	33.14	1.87	0.91	0.96	0.90	0.618	1.15	0.537	1.00	1.00	0.537	No
405	33.22	1.87	0.91	0.96	0.90	0.618	1.15	0.537	1.00	1.00	0.537	No
406	33.30	1.88	0.91	0.96	0.90	0.617	1.15	0.537	1.00	1.00	0.537	No
407	33.38	1.88	0.92	0.97	0.90	0.617	1.15	0.536	1.00	1.00	0.536	No
408	33.46	1.89	0.92	0.97	0.90	0.616	1.15	0.536	1.00	1.00	0.536	No
409	33.55	1.89	0.92	0.97	0.90	0.616	1.15	0.535	1.00	1.00	0.535	No
410	33.63	1.90	0.92	0.98	0.90	0.615	1.15	0.535	1.00	1.00	0.535	No
411	33.71	1.91	0.93	0.98	0.90	0.615	1.15	0.534	1.00	1.00	0.534	No
412	33.79	1.91	0.93	0.98	0.90	0.614	1.15	0.534	1.00	1.00	0.534	No
413	33.87	1.92	0.93	0.98	0.90	0.614	1.15	0.534	1.00	1.00	0.534	No
414	33.96	1.92	0.93	0.99	0.90	0.613	1.15	0.533	1.00	1.00	0.533	No
415	34.04	1.93	0.94	0.99	0.90	0.613	1.15	0.533	1.00	1.00	0.533	No
416	34.12	1.93	0.94	0.99	0.90	0.612	1.15	0.532	1.00	1.00	0.532	No
417	34.20	1.94	0.94	1.00	0.90	0.612	1.15	0.532	1.00	1.00	0.532	No
418	34.28	1.94	0.94	1.00	0.90	0.612	1.15	0.532	1.00	1.00	0.532	No
419	34.37	1.95	0.95	1.00	0.89	0.611	1.15	0.531	1.00	1.00	0.531	No
420	34.45	1.95	0.95	1.00	0.89	0.611	1.15	0.531	1.00	1.00	0.531	No
421	34.53	1.96	0.95	1.01	0.89	0.610	1.15	0.531	1.00	1.00	0.531	No
422	34.61	1.97	0.96	1.01	0.89	0.610	1.15	0.530	1.00	1.00	0.530	No
423	34.69	1.97	0.96	1.01	0.89	0.609	1.15	0.530	1.00	1.00	0.530	No
424	34.78	1.98	0.96	1.02	0.89	0.609	1.15	0.529	1.00	1.00	0.529	No
425	34.86	1.98	0.96	1.02	0.89	0.609	1.15	0.529	1.00	1.00	0.529	No
426	34.94	1.99	0.97	1.02	0.89	0.608	1.15	0.529	1.00	1.00	0.529	No
427	35.02	1.99	0.97	1.02	0.89	0.608	1.15	0.528	1.00	1.00	0.528	No
428	35.10	2.00	0.97	1.03	0.89	0.607	1.15	0.528	1.00	1.00	0.528	No
429	35.19	2.00	0.97	1.03	0.89	0.607	1.15	0.528	1.00	1.00	0.528	No
430	35.27	2.01	0.98	1.03	0.89	0.607	1.15	0.527	1.00	1.00	0.527	No
431	35.35	2.01	0.98	1.04	0.89	0.606	1.15	0.527	1.00	1.00	0.527	No
432	35.43	2.02	0.98	1.04	0.89	0.606	1.15	0.527	1.00	1.00	0.527	No

:: Cyclic Stress Ratio fully adjusted (CSR*) calculation data :: (continued)												
Point ID	Depth (ft)	σ_v (tsf)	u_0 (tsf)	σ'_v (tsf)	r_d	CSR	MSF	CSR _{eq}	K_G	User FS	CSR*	Belongs to transition
433	35.52	2.02	0.98	1.04	0.89	0.606	1.15	0.527	1.00	1.00	0.527	No
434	35.60	2.03	0.99	1.04	0.89	0.605	1.15	0.526	1.00	1.00	0.526	No
435	35.68	2.03	0.99	1.05	0.89	0.605	1.15	0.526	1.00	1.00	0.526	No
436	35.76	2.04	0.99	1.05	0.89	0.604	1.15	0.525	1.00	1.00	0.525	No
437	35.84	2.04	0.99	1.05	0.88	0.604	1.15	0.525	1.00	1.00	0.525	No
438	35.93	2.05	1.00	1.05	0.88	0.604	1.15	0.525	1.00	1.00	0.525	No
439	36.01	2.06	1.00	1.06	0.88	0.603	1.15	0.524	1.00	1.00	0.524	No
440	36.09	2.06	1.00	1.06	0.88	0.603	1.15	0.524	1.00	1.00	0.524	No
441	36.17	2.07	1.00	1.06	0.88	0.602	1.15	0.523	1.00	1.00	0.523	No
442	36.25	2.07	1.01	1.07	0.88	0.602	1.15	0.523	1.00	1.00	0.523	No
443	36.34	2.08	1.01	1.07	0.88	0.601	1.15	0.523	1.00	1.00	0.523	No
444	36.42	2.08	1.01	1.07	0.88	0.601	1.15	0.522	1.00	1.00	0.522	No
445	36.50	2.09	1.01	1.07	0.88	0.600	1.15	0.522	1.00	1.00	0.522	No
446	36.58	2.09	1.02	1.08	0.88	0.600	1.15	0.521	1.00	1.00	0.521	No
447	36.66	2.10	1.02	1.08	0.88	0.599	1.15	0.521	1.00	1.00	0.521	No
448	36.75	2.11	1.02	1.08	0.88	0.599	1.15	0.520	1.00	1.00	0.520	No
449	36.83	2.11	1.02	1.09	0.88	0.598	1.15	0.520	1.00	1.00	0.520	No
450	36.91	2.12	1.03	1.09	0.88	0.598	1.15	0.520	1.00	1.00	0.520	No
451	36.99	2.12	1.03	1.09	0.88	0.597	1.15	0.519	1.00	1.00	0.519	No
452	37.07	2.13	1.03	1.10	0.88	0.597	1.15	0.519	1.00	1.00	0.519	No
453	37.16	2.13	1.03	1.10	0.87	0.596	1.15	0.518	1.00	1.00	0.518	No
454	37.24	2.14	1.04	1.10	0.87	0.596	1.15	0.518	1.00	1.00	0.518	No
455	37.32	2.14	1.04	1.10	0.87	0.595	1.15	0.517	1.00	1.00	0.517	No
456	37.40	2.15	1.04	1.11	0.87	0.595	1.15	0.517	1.00	1.00	0.517	No
457	37.48	2.15	1.04	1.11	0.87	0.594	1.15	0.517	1.00	1.00	0.517	No
458	37.57	2.16	1.05	1.11	0.87	0.594	1.15	0.516	1.00	1.00	0.516	No
459	37.65	2.17	1.05	1.12	0.87	0.593	1.15	0.516	1.00	1.00	0.516	No
460	37.73	2.17	1.05	1.12	0.87	0.593	1.15	0.515	1.00	1.00	0.515	No
461	37.81	2.18	1.05	1.12	0.87	0.592	1.15	0.515	1.00	1.00	0.515	No
462	37.89	2.18	1.06	1.13	0.87	0.591	1.15	0.514	1.00	1.00	0.514	No
463	37.98	2.19	1.06	1.13	0.87	0.591	1.15	0.514	1.00	1.00	0.514	No
464	38.06	2.19	1.06	1.13	0.87	0.590	1.15	0.513	1.00	1.00	0.513	No
465	38.14	2.20	1.07	1.13	0.87	0.590	1.15	0.513	1.00	1.00	0.513	No
466	38.22	2.21	1.07	1.14	0.87	0.589	1.15	0.512	1.00	1.00	0.512	No
467	38.30	2.21	1.07	1.14	0.87	0.589	1.15	0.512	1.00	1.00	0.512	No
468	38.39	2.22	1.07	1.14	0.86	0.588	1.15	0.511	1.00	1.00	0.511	No
469	38.47	2.22	1.08	1.15	0.86	0.588	1.15	0.511	1.00	1.00	0.511	No
470	38.55	2.23	1.08	1.15	0.86	0.587	1.15	0.510	1.00	1.00	0.510	No
471	38.63	2.23	1.08	1.15	0.86	0.587	1.15	0.510	1.00	1.00	0.510	No
472	38.71	2.24	1.08	1.16	0.86	0.586	1.15	0.510	1.00	1.00	0.510	No
473	38.80	2.24	1.09	1.16	0.86	0.586	1.15	0.509	1.00	1.00	0.509	No
474	38.88	2.25	1.09	1.16	0.86	0.585	1.15	0.509	1.00	1.00	0.509	No
475	38.96	2.26	1.09	1.16	0.86	0.585	1.15	0.508	1.00	1.00	0.508	No
476	39.04	2.26	1.09	1.17	0.86	0.584	1.15	0.508	1.00	1.00	0.508	No
477	39.12	2.27	1.10	1.17	0.86	0.584	1.15	0.507	1.00	1.00	0.507	No
478	39.21	2.27	1.10	1.17	0.86	0.583	1.15	0.507	1.00	1.00	0.507	No
479	39.29	2.28	1.10	1.18	0.86	0.583	1.15	0.507	1.00	1.00	0.507	No
480	39.37	2.28	1.10	1.18	0.86	0.582	1.15	0.506	1.00	1.00	0.506	No

:: Cyclic Stress Ratio fully adjusted (CSR*) calculation data :: (continued)

Point ID	Depth (ft)	σ_v (tsf)	u_0 (tsf)	σ_v' (tsf)	r_d	CSR	MSF	CSR _{eq}	K_σ	User FS	CSR*	Belongs to transition
481	39.45	2.29	1.11	1.18	0.86	0.582	1.15	0.506	1.00	1.00	0.506	No
482	39.53	2.29	1.11	1.18	0.86	0.581	1.15	0.505	1.00	1.00	0.505	No
483	39.62	2.30	1.11	1.19	0.85	0.581	1.15	0.505	1.00	1.00	0.505	No
484	39.70	2.30	1.11	1.19	0.85	0.580	1.15	0.504	1.00	1.00	0.504	No
485	39.78	2.31	1.12	1.19	0.85	0.580	1.15	0.504	1.00	1.00	0.504	No
486	39.86	2.31	1.12	1.20	0.85	0.579	1.15	0.504	1.00	1.00	0.504	No
487	39.94	2.32	1.12	1.20	0.85	0.579	1.15	0.503	1.00	1.00	0.503	No
488	40.03	2.32	1.12	1.20	0.85	0.578	1.15	0.503	1.00	1.00	0.503	No
489	40.11	2.33	1.13	1.20	0.85	0.578	1.15	0.502	1.00	1.00	0.502	No
490	40.19	2.34	1.13	1.21	0.85	0.577	1.15	0.502	1.00	1.00	0.502	No
491	40.27	2.34	1.13	1.21	0.85	0.577	1.15	0.501	1.00	1.00	0.501	No
492	40.35	2.35	1.13	1.21	0.85	0.576	1.15	0.501	1.00	1.00	0.501	No
493	40.44	2.35	1.14	1.21	0.85	0.576	1.15	0.500	1.00	1.00	0.500	No
494	40.52	2.36	1.14	1.22	0.85	0.575	1.15	0.500	1.00	1.00	0.500	No
495	40.60	2.36	1.14	1.22	0.85	0.575	1.15	0.500	1.00	1.00	0.500	No
496	40.68	2.37	1.14	1.22	0.84	0.574	1.15	0.499	1.00	1.00	0.499	No
497	40.76	2.37	1.15	1.23	0.84	0.574	1.15	0.499	1.00	1.00	0.499	No
498	40.85	2.38	1.15	1.23	0.84	0.573	1.15	0.498	1.00	1.00	0.498	No
499	40.93	2.38	1.15	1.23	0.84	0.573	1.15	0.498	1.00	1.00	0.498	No
500	41.01	2.39	1.15	1.23	0.84	0.572	1.15	0.497	1.00	1.00	0.497	No
501	41.09	2.39	1.16	1.24	0.84	0.572	1.15	0.497	1.00	1.00	0.497	No
502	41.17	2.40	1.16	1.24	0.84	0.571	1.15	0.496	1.00	1.00	0.496	No
503	41.26	2.40	1.16	1.24	0.84	0.570	1.15	0.496	1.00	1.00	0.496	No
504	41.34	2.41	1.16	1.25	0.84	0.570	1.15	0.496	1.00	1.00	0.496	No
505	41.42	2.42	1.17	1.25	0.84	0.569	1.15	0.495	1.00	1.00	0.495	No
506	41.50	2.42	1.17	1.25	0.84	0.569	1.15	0.495	1.00	1.00	0.495	No
507	41.58	2.43	1.17	1.25	0.84	0.568	1.15	0.494	1.00	1.00	0.494	No
508	41.67	2.43	1.18	1.26	0.84	0.568	1.15	0.494	1.00	1.00	0.494	No
509	41.75	2.44	1.18	1.26	0.84	0.567	1.15	0.493	1.00	1.00	0.493	No
510	41.83	2.44	1.18	1.26	0.83	0.567	1.15	0.493	1.00	1.00	2.000	No
511	41.91	2.44	1.18	1.26	0.83	0.567	1.15	0.493	1.00	1.00	2.000	No
512	41.99	2.45	1.19	1.26	0.83	0.567	1.15	0.493	1.00	1.00	2.000	No

Abbreviations

- Depth: Depth from free surface, at which CPT was performed (ft)
- σ_v : Total overburden pressure at test point (tsf)
- u_0 : Water pressure at test point (tsf)
- σ_v' : Effective overburden pressure based on GWT during earthquake (tsf)
- r_d : Nonlinear shear mass factor
- CSR: Cyclic Stress Ratio
- MSF: Magnitude Scaling Factor
- CSR_{eq}: CSR adjusted for M=7.5
- K_σ : Effective overburden stress factor
- CSR*: CSR fully adjusted

:: Cyclic Resistance Ratio (CRR) calculation data ::												
Point ID	Depth (ft)	q _t (tsf)	I _c	Fr (%)	n	Q _{tn}	K _c	Q _{tn,cs}	CRR _{7.5}	Belongs to trans. layer	Clay-like behaviour	FS
1	0.08	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
2	0.16	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
3	0.25	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
4	0.33	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
5	0.41	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
6	0.49	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
7	0.57	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
8	0.66	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
9	0.74	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
10	0.82	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
11	0.90	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
12	0.98	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
13	1.07	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
14	1.15	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
15	1.23	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
16	1.31	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
17	1.39	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
18	1.48	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
19	1.56	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
20	1.64	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
21	1.72	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
22	1.80	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
23	1.89	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
24	1.97	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
25	2.05	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
26	2.13	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
27	2.21	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
28	2.30	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
29	2.38	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
30	2.46	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
31	2.54	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
32	2.62	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
33	2.71	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
34	2.79	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
35	2.87	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
36	2.95	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
37	3.03	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
38	3.12	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
39	3.20	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
40	3.28	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
41	3.36	26.72	2.26	1.53	0.72	50.13	1.78	89.32	4.000	No	No	2.00
42	3.44	36.78	2.19	1.74	0.69	69.13	1.59	109.81	4.000	No	No	2.00
43	3.53	29.77	2.34	2.32	0.75	55.87	2.09	116.82	4.000	No	No	2.00
44	3.61	21.75	2.54	3.27	0.83	40.70	3.75	152.74	4.000	No	No	2.00
45	3.69	16.35	2.72	4.37	0.90	30.49	4.93	150.38	4.000	No	Yes	2.00
46	3.77	14.45	2.78	4.63	0.92	26.89	5.59	150.26	4.000	No	Yes	2.00
47	3.85	13.28	2.81	4.63	0.93	24.67	5.93	146.25	4.000	No	Yes	2.00
48	3.94	12.87	2.81	4.47	0.93	23.89	5.93	141.63	4.000	No	Yes	2.00

:: Cyclic Resistance Ratio (CRR) calculation data :: (continued)												
Point ID	Depth (ft)	q _c (tsf)	I _c	Fr (%)	n	Q _{tn}	K _c	Q _{tn,cs}	CRR _{7.5}	Belongs to trans. layer	Clay-like behaviour	FS
49	4.02	12.58	2.83	4.74	0.94	23.32	6.24	145.60	1.112	No	Yes	2.00
50	4.10	11.87	2.88	5.20	0.96	21.98	6.87	151.08	1.048	No	Yes	2.00
51	4.18	10.69	2.95	5.96	0.99	19.73	7.99	157.64	0.941	No	Yes	2.00
52	4.27	9.49	3.03	6.81	1.00	17.46	9.30	162.32	0.833	No	Yes	2.00
53	4.35	8.71	3.08	7.34	1.00	15.98	10.23	163.41	0.762	No	Yes	2.00
54	4.43	8.54	3.08	7.12	1.00	15.65	10.19	159.37	0.746	No	Yes	2.00
55	4.51	8.61	3.05	6.61	1.00	15.77	9.73	153.47	0.752	No	Yes	2.00
56	4.59	8.75	3.03	6.25	1.00	16.03	9.34	149.78	0.765	No	Yes	2.00
57	4.68	8.83	3.03	6.32	1.00	16.16	9.35	151.18	0.771	No	Yes	2.00
58	4.76	8.99	3.03	6.45	1.00	16.46	9.35	153.92	0.785	No	Yes	2.00
59	4.84	9.07	3.04	6.64	1.00	16.60	9.46	156.97	0.792	No	Yes	2.00
60	4.92	9.16	3.04	6.81	1.00	16.76	9.54	159.83	0.799	No	Yes	2.00
61	5.00	9.26	3.04	6.89	1.00	16.95	9.53	161.53	0.809	No	Yes	2.00
62	5.09	9.57	3.02	6.65	1.00	17.53	9.16	160.47	0.836	No	Yes	2.00
63	5.17	9.97	2.98	6.13	1.00	18.27	8.52	155.70	0.871	No	Yes	2.00
64	5.25	10.00	2.97	5.82	0.99	18.32	8.26	151.27	0.874	No	Yes	2.00
65	5.33	9.57	2.98	5.78	1.00	17.49	8.47	148.19	0.834	No	Yes	2.00
66	5.41	8.91	3.01	5.88	1.00	16.23	8.96	145.52	0.774	No	Yes	2.00
67	5.50	8.48	3.02	5.79	1.00	15.43	9.17	141.54	0.736	No	Yes	2.00
68	5.58	8.32	3.01	5.48	1.00	15.11	9.02	136.40	0.721	No	Yes	2.00
69	5.66	8.35	2.99	5.10	1.00	15.16	8.66	131.35	0.723	No	Yes	2.00
70	5.74	8.40	2.98	4.94	1.00	15.25	8.48	129.27	0.727	No	Yes	2.00
71	5.82	8.37	2.99	5.02	1.00	15.17	8.58	130.22	0.724	No	Yes	2.00
72	5.91	8.12	3.02	5.33	1.00	14.69	9.05	132.98	0.701	No	Yes	1.92
73	5.99	7.63	3.06	5.79	1.00	13.77	9.85	135.66	0.657	No	Yes	1.79
74	6.07	7.02	3.12	6.40	1.00	12.61	10.97	138.26	0.601	No	Yes	1.63
75	6.15	6.52	3.17	6.96	1.00	11.65	12.01	139.93	0.556	No	Yes	1.50
76	6.23	6.26	3.18	6.86	1.00	11.15	12.24	136.46	0.532	No	Yes	1.43
77	6.32	6.10	3.17	6.38	1.00	10.84	12.00	130.06	0.517	No	Yes	1.38
78	6.40	5.93	3.15	5.79	1.00	10.51	11.64	122.40	0.501	No	Yes	1.33
79	6.48	5.72	3.15	5.51	1.00	10.10	11.65	117.67	0.482	No	Yes	1.27
80	6.56	5.55	3.15	5.29	1.00	9.77	11.65	113.82	0.466	No	Yes	1.22
81	6.64	5.39	3.15	5.15	1.00	9.47	11.73	111.06	0.452	No	Yes	1.18
82	6.73	5.17	3.17	5.10	1.00	9.04	12.02	108.64	0.431	No	Yes	1.12
83	6.81	5.03	3.17	4.97	1.00	8.76	12.10	106.03	0.418	No	Yes	1.08
84	6.89	4.91	3.17	4.82	1.00	8.53	12.13	103.44	0.407	No	Yes	1.05
85	6.97	4.75	3.18	4.67	1.00	8.22	12.23	100.54	0.392	No	Yes	1.00
86	7.05	4.61	3.18	4.43	1.00	7.94	12.20	96.87	0.379	No	Yes	0.96
87	7.14	4.41	3.17	4.09	1.00	7.56	12.14	91.72	0.360	No	Yes	0.91
88	7.22	4.26	3.16	3.68	1.00	7.26	11.88	86.28	0.346	No	Yes	0.87
89	7.30	4.12	3.14	3.18	1.00	6.99	11.43	79.89	0.333	No	Yes	0.84
90	7.38	4.02	3.11	2.64	1.00	6.81	10.73	73.07	0.325	No	Yes	0.81
91	7.46	4.05	3.05	2.04	1.00	6.84	9.60	65.65	0.326	No	Yes	0.81
92	7.55	4.11	2.99	1.60	1.00	6.96	8.60	59.83	0.332	No	Yes	0.82
93	7.63	4.22	2.94	1.32	0.99	7.15	7.80	55.77	0.341	No	Yes	0.84
94	7.71	4.31	2.91	1.16	0.97	7.32	7.29	53.31	0.349	No	Yes	0.85
95	7.79	4.40	2.87	1.02	0.96	7.49	6.79	50.89	0.357	No	Yes	0.87
96	7.87	4.44	2.86	0.95	0.95	7.55	6.58	49.67	0.360	No	Yes	0.87

:: Cyclic Resistance Ratio (CRR) calculation data :: (continued)												
Point ID	Depth (ft)	q _c (tsf)	I _c	Fr (%)	n	Q _{tn}	K _c	Q _{tn,cs}	CRR _{7.5}	Belongs to trans. layer	Clay-like behaviour	FS
97	7.96	4.47	2.85	0.94	0.95	7.60	6.52	49.60	0.363	No	Yes	0.88
98	8.04	4.52	2.87	1.05	0.96	7.70	6.72	51.73	0.367	No	Yes	0.88
99	8.12	4.62	2.87	1.10	0.96	7.87	6.72	52.88	0.376	No	Yes	0.90
100	8.20	4.66	2.86	1.09	0.96	7.95	6.66	52.94	0.379	No	Yes	0.90
101	8.28	4.59	2.86	1.02	0.95	7.81	6.59	51.42	0.372	No	Yes	0.88
102	8.37	4.51	2.86	0.99	0.95	7.65	6.61	50.52	0.365	No	Yes	0.86
103	8.45	4.45	2.86	0.95	0.95	7.52	6.59	49.55	0.359	No	Yes	0.84
104	8.53	4.43	2.85	0.91	0.95	7.49	6.51	48.75	0.357	No	Yes	0.84
105	8.61	4.46	2.84	0.87	0.95	7.53	6.38	48.02	0.359	No	Yes	0.84
106	8.69	4.56	2.83	0.86	0.94	7.70	6.23	47.97	0.368	No	Yes	0.85
107	8.78	4.68	2.82	0.86	0.94	7.93	6.07	48.18	0.378	No	Yes	0.88
108	8.86	4.78	2.81	0.85	0.93	8.12	5.93	48.11	0.387	No	Yes	0.89
109	8.94	4.86	2.80	0.85	0.93	8.26	5.84	48.25	0.394	No	Yes	0.90
110	9.02	4.92	2.80	0.86	0.93	8.36	5.81	48.61	0.399	No	Yes	0.91
111	9.10	5.06	2.80	0.93	0.93	8.62	5.84	50.34	0.411	No	Yes	0.94
112	9.19	5.28	2.80	1.02	0.93	9.03	5.83	52.65	0.431	No	Yes	0.98
113	9.27	5.67	2.79	1.13	0.93	9.77	5.70	55.68	0.466	No	Yes	1.05
114	9.35	6.32	2.78	1.33	0.92	10.99	5.56	61.10	0.524	No	Yes	1.18
115	9.43	7.52	2.74	1.53	0.91	13.25	5.09	67.44	0.632	No	Yes	1.42
116	9.51	8.28	2.77	2.12	0.92	14.68	5.54	81.31	0.700	No	Yes	1.57
117	9.60	8.34	2.84	2.77	0.95	14.77	6.35	93.72	0.705	No	Yes	1.57
118	9.68	7.24	2.97	3.77	1.00	12.68	8.30	105.29	0.605	No	Yes	1.34
119	9.76	6.17	3.07	4.34	1.00	10.66	10.00	106.64	0.509	No	Yes	1.13
120	9.84	5.31	3.13	4.46	1.00	9.02	11.28	101.79	0.430	No	Yes	0.95
121	9.92	4.92	3.12	3.81	1.00	8.28	11.09	91.80	0.395	No	Yes	0.87
122	10.01	4.72	3.08	3.00	1.00	7.88	10.27	80.97	0.376	No	Yes	0.83
123	10.09	4.72	3.03	2.45	1.00	7.88	9.39	74.00	0.376	No	Yes	0.82
124	10.17	4.82	3.01	2.24	1.00	8.06	8.88	71.61	0.384	No	Yes	0.84
125	10.25	4.96	2.99	2.20	1.00	8.31	8.62	71.70	0.397	No	Yes	0.86
126	10.33	5.02	2.98	2.16	1.00	8.43	8.47	71.43	0.402	No	Yes	0.87
127	10.42	5.02	2.98	2.17	1.00	8.42	8.49	71.54	0.402	No	Yes	0.87
128	10.50	5.07	2.99	2.26	1.00	8.51	8.59	73.14	0.406	No	Yes	0.88
129	10.58	5.28	2.98	2.38	1.00	8.89	8.51	75.73	0.424	No	Yes	0.91
130	10.66	5.74	2.96	2.44	0.99	9.75	8.05	78.55	0.465	No	Yes	1.00
131	10.74	6.40	2.91	2.42	0.98	10.99	7.36	80.91	0.524	No	Yes	1.12
132	10.83	7.25	2.85	2.32	0.95	12.59	6.52	82.14	0.601	No	Yes	1.28
133	10.91	7.75	2.81	2.19	0.94	13.54	5.99	81.11	0.646	No	Yes	1.37
134	10.99	7.75	2.81	2.21	0.94	13.53	6.03	81.56	0.645	No	Yes	1.37
135	11.07	7.24	2.87	2.45	0.96	12.56	6.71	84.30	0.599	No	Yes	1.27
136	11.15	6.94	2.97	3.47	1.00	11.97	8.29	99.20	0.571	No	Yes	1.21
137	11.24	8.15	2.93	3.80	0.99	14.26	7.69	109.73	0.680	No	Yes	1.43
138	11.32	10.06	2.83	3.51	0.95	17.86	6.29	112.44	0.852	No	Yes	1.79
139	11.40	12.30	2.72	2.98	0.90	22.09	4.90	108.35	1.054	No	Yes	2.00
140	11.48	16.41	2.54	2.23	0.84	29.85	3.60	107.56	0.196	No	No	0.41
141	11.56	27.66	2.22	1.35	0.71	51.10	1.67	85.11	0.137	No	No	0.29
142	11.65	42.95	1.96	0.80	0.61	73.73	1.27	93.93	0.157	No	No	0.33
143	11.73	57.70	1.76	0.50	0.54	92.19	1.11	102.13	0.179	No	No	0.37
144	11.81	65.13	1.67	0.37	0.50	100.19	1.00	100.19	0.174	No	No	0.36

:: Cyclic Resistance Ratio (CRR) calculation data :: (continued)												
Point ID	Depth (ft)	q _c (tsf)	I _c	Fr (%)	n	Q _{tn}	K _c	Q _{tn,cs}	CRR _{7.5}	Belongs to trans. layer	Clay-like behaviour	FS
145	11.89	68.14	1.63	0.33	0.49	103.14	1.00	103.14	0.182	No	No	0.38
146	11.98	70.56	1.63	0.35	0.49	106.73	1.00	106.73	0.193	No	No	0.40
147	12.06	77.24	1.62	0.38	0.49	116.01	1.00	116.01	0.225	No	No	0.47
148	12.14	87.06	1.58	0.38	0.47	128.57	1.00	128.57	0.278	No	No	0.57
149	12.22	98.79	1.51	0.32	0.44	141.87	1.00	141.87	0.346	No	No	0.71
150	12.30	108.42	1.43	0.25	0.41	151.27	1.00	151.27	0.402	No	No	0.83
151	12.39	116.33	1.38	0.21	0.39	159.01	1.00	159.01	0.454	No	No	0.93
152	12.47	122.33	1.35	0.19	0.38	165.09	1.00	165.09	0.498	No	No	1.02
153	12.55	127.66	1.34	0.20	0.38	171.52	1.00	171.52	0.549	No	No	1.12
154	12.63	134.08	1.33	0.20	0.37	179.00	1.00	179.00	0.613	No	No	1.25
155	12.71	141.80	1.31	0.20	0.37	187.70	1.00	187.70	0.695	No	No	1.42
156	12.80	151.92	1.26	0.17	0.35	197.15	1.00	197.15	0.793	No	No	1.61
157	12.88	163.38	1.20	0.13	0.33	207.91	1.00	207.91	4.000	No	No	2.00
158	12.96	175.02	1.15	0.10	0.31	218.70	1.00	218.70	4.000	No	No	2.00
159	13.04	185.29	1.13	0.10	0.30	229.56	1.00	229.56	4.000	No	No	2.00
160	13.12	190.46	1.12	0.11	0.30	235.26	1.00	235.26	4.000	No	No	2.00
161	13.21	190.85	1.13	0.11	0.30	235.78	1.00	235.78	4.000	No	No	2.00
162	13.29	188.49	1.13	0.11	0.30	232.97	1.00	232.97	4.000	No	No	2.00
163	13.37	187.10	1.13	0.10	0.30	230.24	1.00	230.24	4.000	No	No	2.00
164	13.45	186.37	1.12	0.09	0.30	228.82	1.00	228.82	4.000	No	No	2.00
165	13.53	186.12	1.12	0.08	0.30	227.89	1.00	227.89	4.000	No	No	2.00
166	13.62	184.93	1.12	0.08	0.30	226.23	1.00	226.23	4.000	No	No	2.00
167	13.70	183.80	1.12	0.07	0.30	224.57	1.00	224.57	4.000	No	No	2.00
168	13.78	180.39	1.13	0.06	0.30	220.64	1.00	220.64	4.000	No	No	2.00
169	13.86	176.69	1.13	0.06	0.30	216.46	1.00	216.46	4.000	No	No	2.00
170	13.94	171.69	1.15	0.07	0.31	210.96	1.00	210.96	4.000	No	No	2.00
171	14.03	166.60	1.18	0.11	0.32	206.74	1.00	206.74	4.000	No	No	2.00
172	14.11	161.20	1.23	0.15	0.34	202.33	1.00	202.33	4.000	No	No	2.00
173	14.19	156.72	1.28	0.20	0.36	199.66	1.00	199.66	0.820	No	No	1.63
174	14.27	154.79	1.30	0.21	0.36	198.03	1.00	198.03	0.802	No	No	1.59
175	14.35	154.22	1.30	0.22	0.37	197.25	1.00	197.25	0.794	No	No	1.57
176	14.44	154.29	1.29	0.20	0.36	196.49	1.00	196.49	0.786	No	No	1.55
177	14.52	154.24	1.28	0.19	0.36	195.46	1.00	195.46	0.774	No	No	1.53
178	14.60	154.34	1.26	0.17	0.35	194.18	1.00	194.18	0.761	No	No	1.50
179	14.68	153.36	1.24	0.14	0.34	191.20	1.00	191.20	0.730	No	No	1.44
180	14.76	151.08	1.22	0.11	0.34	187.40	1.00	187.40	0.692	No	No	1.36
181	14.85	146.61	1.22	0.09	0.34	181.57	1.00	181.57	0.637	No	No	1.25
182	14.93	142.13	1.23	0.09	0.34	176.30	1.00	176.30	0.590	No	No	1.16
183	15.01	137.22	1.25	0.08	0.35	170.61	1.00	170.61	0.542	No	No	1.06
184	15.09	133.01	1.27	0.10	0.35	165.95	1.00	165.95	0.505	No	No	0.99
185	15.17	130.08	1.28	0.10	0.36	162.71	1.00	162.71	0.481	No	No	0.94
186	15.26	128.45	1.30	0.13	0.37	161.68	1.00	161.68	0.473	No	No	0.92
187	15.34	129.50	1.32	0.16	0.38	163.72	1.00	163.72	0.488	No	No	0.95
188	15.42	130.21	1.36	0.21	0.39	166.31	1.00	166.31	0.508	No	No	0.99
189	15.50	128.87	1.39	0.25	0.40	165.90	1.00	165.90	0.505	No	No	0.98
190	15.58	124.78	1.41	0.25	0.41	161.06	1.00	161.06	0.469	No	No	0.91
191	15.67	119.34	1.42	0.25	0.41	154.29	1.00	154.29	0.422	No	No	0.82
192	15.75	113.42	1.43	0.23	0.42	146.64	1.00	146.64	0.373	No	No	0.72

:: Cyclic Resistance Ratio (CRR) calculation data :: (continued)												
Point ID	Depth (ft)	q _c (tsf)	I _c	Fr (%)	n	Q _{tn}	K _c	Q _{tn,cs}	CRR _{7.5}	Belongs to trans. layer	Clay-like behaviour	FS
193	15.83	109.42	1.47	0.27	0.43	142.77	1.00	142.77	0.351	No	No	0.68
194	15.91	107.96	1.48	0.28	0.44	141.06	1.00	141.06	0.341	No	No	0.66
195	15.99	110.80	1.45	0.25	0.43	143.49	1.00	143.49	0.355	No	No	0.69
196	16.08	116.89	1.40	0.20	0.40	148.73	1.00	148.73	0.386	No	No	0.75
197	16.16	128.19	1.33	0.15	0.38	159.68	1.00	159.68	0.459	No	No	0.88
198	16.24	145.29	1.25	0.12	0.35	177.27	1.00	177.27	0.598	No	No	1.15
199	16.32	164.17	1.19	0.09	0.33	196.71	1.00	196.71	0.788	No	No	1.52
200	16.40	177.76	1.15	0.07	0.31	210.53	1.00	210.53	4.000	No	No	2.00
201	16.49	187.19	1.13	0.08	0.31	220.35	1.00	220.35	4.000	No	No	2.00
202	16.57	190.04	1.13	0.09	0.31	223.60	1.00	223.60	4.000	No	No	2.00
203	16.65	190.52	1.14	0.10	0.31	224.31	1.00	224.31	4.000	No	No	2.00
204	16.73	187.42	1.15	0.11	0.31	220.92	1.00	220.92	4.000	No	No	2.00
205	16.81	188.25	1.20	0.16	0.33	224.34	1.00	224.34	4.000	No	No	2.00
206	16.90	191.63	1.20	0.17	0.33	228.51	1.00	228.51	4.000	No	No	2.00
207	16.98	192.15	1.20	0.18	0.33	228.87	1.00	228.87	4.000	No	No	2.00
208	17.06	189.36	1.17	0.13	0.32	223.21	1.00	223.21	4.000	No	No	2.00
209	17.14	182.22	1.17	0.12	0.32	214.71	1.00	214.71	4.000	No	No	2.00
210	17.22	168.28	1.23	0.15	0.34	200.83	1.00	200.83	4.000	No	No	2.00
211	17.31	144.39	1.35	0.23	0.39	177.82	1.00	177.82	0.603	No	No	1.15
212	17.39	113.53	1.58	0.47	0.48	147.79	1.00	147.79	0.380	No	No	0.72
213	17.47	85.10	1.83	0.93	0.57	117.92	1.19	140.05	0.335	No	No	0.64
214	17.55	59.63	2.09	1.62	0.67	87.67	1.41	123.30	0.254	No	No	0.48
215	17.63	42.45	2.31	2.46	0.76	65.40	1.96	128.21	0.276	No	No	0.52
216	17.72	29.33	2.52	3.48	0.83	47.01	3.15	147.85	0.381	No	No	0.72
217	17.80	22.07	2.67	4.35	0.89	36.21	8.22	297.51	3.600	No	No	2.00
218	17.88	19.97	2.71	4.51	0.91	32.83	4.78	157.00	1.566	No	Yes	2.00
219	17.96	25.28	2.54	3.22	0.84	40.13	3.74	149.96	0.394	No	No	0.75
220	18.04	36.27	2.32	2.14	0.76	54.95	2.01	110.66	0.206	No	No	0.39
221	18.13	58.63	2.06	1.36	0.66	83.74	1.36	113.96	0.218	No	No	0.41
222	18.21	90.22	1.83	0.95	0.57	122.28	1.18	144.76	0.362	No	No	0.69
223	18.29	120.62	1.68	0.74	0.51	157.44	1.00	157.44	0.443	No	No	0.84
224	18.37	134.83	1.60	0.63	0.49	172.52	1.00	172.52	0.558	No	No	1.05
225	18.45	132.86	1.57	0.56	0.48	168.61	1.00	168.61	0.526	No	No	0.99
226	18.54	126.09	1.59	0.54	0.48	160.11	1.00	160.11	0.462	No	No	0.87
227	18.62	120.18	1.62	0.58	0.49	153.43	1.00	153.43	0.416	No	No	0.79
228	18.70	117.24	1.66	0.66	0.51	150.79	1.00	150.79	0.399	No	No	0.75
229	18.78	116.34	1.67	0.68	0.51	149.68	1.00	149.68	0.392	No	No	0.74
230	18.86	114.70	1.67	0.67	0.51	147.30	1.00	147.30	0.377	No	No	0.71
231	18.95	111.45	1.69	0.69	0.52	143.38	1.00	143.38	0.354	No	No	0.67
232	19.03	107.65	1.73	0.79	0.54	139.58	1.06	147.32	0.377	No	No	0.71
233	19.11	103.55	1.78	0.90	0.56	135.39	1.13	153.05	0.413	No	No	0.78
234	19.19	97.49	1.84	1.06	0.58	128.88	1.19	153.96	0.419	No	No	0.79
235	19.27	88.68	1.91	1.22	0.61	118.68	1.24	147.72	0.380	No	No	0.71
236	19.36	77.40	1.96	1.23	0.62	104.18	1.27	132.80	0.298	No	No	0.56
237	19.44	66.76	1.97	1.09	0.63	89.73	1.28	115.29	0.223	No	No	0.42
238	19.52	60.77	1.91	0.75	0.61	80.25	1.24	99.76	0.172	No	No	0.32
239	19.60	55.40	1.92	0.69	0.61	73.08	1.25	91.47	0.151	No	No	0.28
240	19.69	44.91	2.04	0.83	0.65	60.34	1.34	80.89	0.129	No	No	0.24

:: Cyclic Resistance Ratio (CRR) calculation data :: (continued)												
Point ID	Depth (ft)	q _f (tsf)	I _c	Fr (%)	n	Q _{tn}	K _c	Q _{tn,cs}	CRR _{7.5}	Belongs to trans. layer	Clay-like behaviour	FS
241	19.77	30.90	2.28	1.34	0.75	43.16	1.84	79.36	0.126	No	No	0.24
242	19.85	18.95	2.56	2.20	0.85	27.44	4.26	116.91	0.229	No	No	0.43
243	19.93	14.06	2.74	2.93	0.92	20.63	5.10	105.30	0.984	No	Yes	1.84
244	20.01	11.03	2.87	3.50	0.97	16.20	6.74	109.11	0.773	No	Yes	1.45
245	20.10	9.85	2.90	3.41	0.98	14.33	7.24	103.74	0.683	No	Yes	1.28
246	20.18	9.65	2.86	2.77	0.97	13.84	6.66	92.16	0.660	No	Yes	1.23
247	20.26	11.41	2.71	1.91	0.91	16.14	4.87	78.50	0.770	No	Yes	1.44
248	20.34	15.23	2.56	1.55	0.86	21.37	4.28	91.35	0.151	No	No	0.28
249	20.42	17.22	2.52	1.54	0.84	24.08	3.18	76.67	0.122	No	No	0.23
250	20.51	16.55	2.56	1.74	0.85	23.22	4.20	97.49	0.166	No	No	0.31
251	20.59	13.02	2.70	2.15	0.91	18.37	10.05	184.62	0.599	No	No	1.12
252	20.67	10.34	2.84	2.70	0.96	14.59	6.31	92.10	0.696	No	Yes	1.30
253	20.75	8.61	2.95	3.22	1.00	12.07	7.93	95.73	0.576	No	Yes	1.07
254	20.83	7.70	2.99	3.17	1.00	10.56	8.64	91.22	0.503	No	Yes	0.94
255	20.92	7.59	2.93	2.39	1.00	10.32	7.66	79.03	0.492	No	Yes	0.91
256	21.00	7.69	2.84	1.59	0.96	10.26	6.36	65.30	0.489	No	Yes	0.91
257	21.08	7.63	2.80	1.24	0.94	10.05	5.79	58.20	0.479	No	Yes	0.89
258	21.16	7.52	2.79	1.18	0.94	9.85	5.77	56.83	0.470	No	Yes	0.87
259	21.24	7.44	2.80	1.18	0.95	9.72	5.84	56.78	0.464	No	Yes	0.86
260	21.33	7.41	2.80	1.17	0.95	9.65	5.85	56.40	0.460	No	Yes	0.85
261	21.41	7.40	2.80	1.16	0.95	9.60	5.84	56.08	0.458	No	Yes	0.85
262	21.49	7.40	2.80	1.14	0.95	9.58	5.82	55.73	0.457	No	Yes	0.84
263	21.57	7.45	2.79	1.12	0.94	9.61	5.75	55.28	0.458	No	Yes	0.85
264	21.65	7.54	2.79	1.10	0.94	9.71	5.67	55.06	0.463	No	Yes	0.85
265	21.74	7.69	2.77	1.08	0.94	9.90	5.53	54.80	0.472	No	Yes	0.87
266	21.82	7.99	2.75	1.04	0.93	10.28	5.28	54.33	0.491	No	Yes	0.90
267	21.90	8.16	2.74	1.01	0.92	10.49	5.13	53.82	0.500	No	Yes	0.92
268	21.98	8.23	2.74	1.01	0.92	10.55	5.09	53.67	0.503	No	Yes	0.92
269	22.06	8.03	2.75	1.02	0.93	10.26	5.24	53.78	0.489	No	Yes	0.90
270	22.15	7.76	2.77	1.05	0.94	9.87	5.48	54.04	0.471	No	Yes	0.86
271	22.23	7.42	2.79	1.07	0.95	9.37	5.78	54.14	0.447	No	Yes	0.82
272	22.31	7.25	2.81	1.09	0.95	9.11	5.96	54.30	0.435	No	Yes	0.80
273	22.39	7.22	2.81	1.11	0.95	9.06	6.01	54.47	0.432	No	Yes	0.79
274	22.47	7.32	2.81	1.11	0.95	9.18	5.96	54.68	0.438	No	Yes	0.80
275	22.56	7.43	2.80	1.08	0.95	9.30	5.82	54.09	0.443	No	Yes	0.81
276	22.64	7.55	2.81	1.19	0.95	9.47	5.99	56.69	0.452	No	Yes	0.82
277	22.72	7.77	2.83	1.40	0.96	9.81	6.23	61.13	0.468	No	Yes	0.85
278	22.80	8.27	2.83	1.63	0.96	10.55	6.29	66.41	0.503	No	Yes	0.92
279	22.88	8.73	2.82	1.70	0.96	11.18	6.14	68.60	0.533	No	Yes	0.97
280	22.97	9.20	2.80	1.68	0.95	11.80	5.85	68.99	0.563	No	Yes	1.02
281	23.05	9.14	2.81	1.76	0.95	11.71	6.01	70.45	0.559	No	Yes	1.02
282	23.13	9.05	2.81	1.67	0.95	11.53	5.94	68.48	0.550	No	Yes	1.00
283	23.21	8.85	2.79	1.44	0.94	11.17	5.69	63.54	0.533	No	Yes	0.97
284	23.29	8.89	2.73	1.08	0.92	11.08	5.03	55.74	0.529	No	Yes	0.96
285	23.38	8.86	2.70	0.93	0.91	10.96	4.75	52.10	0.523	No	Yes	0.95
286	23.46	8.80	2.70	0.91	0.91	10.85	4.75	51.58	0.518	No	Yes	0.94
287	23.54	8.73	2.71	0.93	0.92	10.74	4.84	51.95	0.512	No	Yes	0.93
288	23.62	8.46	2.73	0.96	0.92	10.37	5.06	52.50	0.494	No	Yes	0.89

:: Cyclic Resistance Ratio (CRR) calculation data :: (continued)												
Point ID	Depth (ft)	q _c (tsf)	I _c	Fr (%)	n	Q _{tn}	K _c	Q _{tn,cs}	CRR _{7.5}	Belongs to trans. layer	Clay-like behaviour	FS
289	23.70	8.24	2.75	0.99	0.93	10.05	5.27	52.98	0.479	No	Yes	0.87
290	23.79	7.95	2.77	1.03	0.94	9.65	5.53	53.36	0.460	No	Yes	0.83
291	23.87	7.94	2.77	1.01	0.94	9.61	5.52	53.05	0.458	No	Yes	0.83
292	23.95	7.80	2.78	1.01	0.94	9.38	5.62	52.70	0.448	No	Yes	0.81
293	24.03	7.66	2.79	1.00	0.94	9.18	5.70	52.30	0.438	No	Yes	0.79
294	24.11	7.57	2.79	0.97	0.94	9.02	5.72	51.58	0.430	No	Yes	0.77
295	24.20	7.58	2.79	0.96	0.94	9.02	5.71	51.44	0.430	No	Yes	0.77
296	24.28	7.64	2.78	0.95	0.94	9.08	5.64	51.19	0.433	No	Yes	0.78
297	24.36	7.75	2.78	0.96	0.94	9.20	5.60	51.53	0.439	No	Yes	0.79
298	24.44	7.92	2.78	0.99	0.94	9.42	5.57	52.50	0.450	No	Yes	0.81
299	24.52	8.28	2.76	1.03	0.94	9.88	5.42	53.59	0.472	No	Yes	0.85
300	24.61	8.69	2.75	1.05	0.93	10.43	5.22	54.46	0.497	No	Yes	0.89
301	24.69	8.87	2.74	1.05	0.93	10.64	5.15	54.78	0.508	No	Yes	0.91
302	24.77	8.93	2.76	1.16	0.93	10.73	5.34	57.29	0.512	No	Yes	0.92
303	24.85	8.91	2.86	1.93	0.97	10.84	6.68	72.39	0.517	No	Yes	0.93
304	24.93	10.00	2.87	2.44	0.98	12.38	6.77	83.84	0.591	No	Yes	1.06
305	25.02	12.51	2.84	3.03	0.96	15.85	6.33	100.30	0.756	No	Yes	1.35
306	25.10	15.89	2.75	3.03	0.93	20.31	5.27	107.09	0.969	No	Yes	1.73
307	25.18	31.27	2.42	2.05	0.80	39.53	2.48	97.94	0.167	No	No	0.30
308	25.26	76.44	1.93	0.95	0.62	91.55	1.25	114.76	0.221	No	No	0.39
309	25.34	147.95	1.56	0.53	0.48	168.57	1.00	168.57	0.525	No	No	0.94
310	25.43	221.18	1.37	0.41	0.40	244.78	1.00	244.78	4.000	No	No	2.00
311	25.51	272.75	1.26	0.36	0.36	296.92	1.00	296.92	4.000	No	No	2.00
312	25.59	303.58	1.28	0.43	0.37	331.08	1.00	331.08	4.000	No	No	2.00
313	25.67	321.41	1.26	0.42	0.36	349.06	1.00	349.06	4.000	No	No	2.00
314	25.75	338.01	1.27	0.47	0.37	367.49	1.00	367.49	4.000	No	No	2.00
315	25.84	347.73	1.30	0.53	0.38	379.17	1.00	379.17	4.000	No	No	2.00
316	25.92	359.17	1.33	0.60	0.39	392.70	1.00	392.70	4.000	No	No	2.00
317	26.00	354.72	1.35	0.63	0.40	388.31	1.00	388.31	4.000	No	No	2.00
318	26.08	347.51	1.31	0.54	0.38	377.64	1.00	377.64	4.000	No	No	2.00
319	26.16	334.14	1.27	0.45	0.37	360.51	1.00	360.51	4.000	No	No	2.00
320	26.25	325.43	1.21	0.36	0.35	347.82	1.00	347.82	4.000	No	No	2.00
321	26.33	317.10	1.13	0.25	0.32	334.90	1.00	334.90	4.000	No	No	2.00
322	26.41	308.39	1.14	0.26	0.32	325.86	1.00	325.86	4.000	No	No	2.00
323	26.49	303.51	1.19	0.31	0.34	322.56	1.00	322.56	4.000	No	No	2.00
324	26.57	301.09	1.29	0.43	0.38	323.64	1.00	323.64	4.000	No	No	2.00
325	26.66	305.45	1.28	0.42	0.37	327.48	1.00	327.48	4.000	No	No	2.00
326	26.74	297.99	1.29	0.42	0.37	319.37	1.00	319.37	4.000	No	No	2.00
327	26.82	295.63	1.28	0.41	0.37	316.23	1.00	316.23	4.000	No	No	2.00
328	26.90	286.58	1.33	0.47	0.39	308.02	1.00	308.02	4.000	No	No	2.00
329	26.98	290.29	1.29	0.42	0.38	310.27	1.00	310.27	4.000	No	No	2.00
330	27.07	288.84	1.24	0.34	0.36	306.07	1.00	306.07	4.000	No	No	2.00
331	27.15	290.63	1.13	0.22	0.32	303.68	1.00	303.68	4.000	No	No	2.00
332	27.23	289.61	1.10	0.18	0.30	300.88	1.00	300.88	4.000	No	No	2.00
333	27.31	284.08	1.09	0.16	0.30	294.62	1.00	294.62	4.000	No	No	2.00
334	27.40	278.93	1.12	0.18	0.31	289.94	1.00	289.94	4.000	No	No	2.00
335	27.48	275.24	1.13	0.20	0.32	286.41	1.00	286.41	4.000	No	No	2.00
336	27.56	276.25	1.17	0.23	0.33	288.40	1.00	288.40	4.000	No	No	2.00

:: Cyclic Resistance Ratio (CRR) calculation data :: (continued)												
Point ID	Depth (ft)	q _c (tsf)	I _c	Fr (%)	n	Q _{tn}	K _c	Q _{tn,cs}	CRR _{7.5}	Belongs to trans. layer	Clay-like behaviour	FS
337	27.64	273.29	1.21	0.28	0.35	286.38	1.00	286.38	4.000	No	No	2.00
338	27.72	273.94	1.22	0.28	0.35	286.95	1.00	286.95	4.000	No	No	2.00
339	27.81	274.81	1.17	0.24	0.33	286.16	1.00	286.16	4.000	No	No	2.00
340	27.89	279.57	1.14	0.21	0.32	289.84	1.00	289.84	4.000	No	No	2.00
341	27.97	279.55	1.13	0.20	0.32	289.15	1.00	289.15	4.000	No	No	2.00
342	28.05	279.48	1.14	0.20	0.32	288.97	1.00	288.97	4.000	No	No	2.00
343	28.13	278.68	1.13	0.19	0.32	287.56	1.00	287.56	4.000	No	No	2.00
344	28.22	275.11	1.11	0.17	0.31	283.18	1.00	283.18	4.000	No	No	2.00
345	28.30	270.40	1.15	0.20	0.33	279.20	1.00	279.20	4.000	No	No	2.00
346	28.38	267.51	1.22	0.27	0.35	277.94	1.00	277.94	4.000	No	No	2.00
347	28.46	269.19	1.31	0.39	0.39	282.07	1.00	282.07	4.000	No	No	2.00
348	28.54	267.45	1.37	0.50	0.41	281.87	1.00	281.87	4.000	No	No	2.00
349	28.63	264.31	1.38	0.51	0.42	278.52	1.00	278.52	4.000	No	No	2.00
350	28.71	259.63	1.36	0.45	0.40	272.38	1.00	272.38	4.000	No	No	2.00
351	28.79	255.57	1.31	0.37	0.39	266.49	1.00	266.49	4.000	No	No	2.00
352	28.87	260.50	1.29	0.36	0.38	270.90	1.00	270.90	4.000	No	No	2.00
353	28.95	261.38	1.38	0.49	0.41	273.84	1.00	273.84	4.000	No	No	2.00
354	29.04	272.23	1.44	0.64	0.44	286.73	1.00	286.73	4.000	No	No	2.00
355	29.12	268.23	1.50	0.75	0.46	283.55	1.00	283.55	4.000	No	No	2.00
356	29.20	262.12	1.46	0.65	0.44	275.59	1.00	275.59	4.000	No	No	2.00
357	29.28	246.20	1.40	0.50	0.42	257.03	1.00	257.03	4.000	No	No	2.00
358	29.36	239.04	1.29	0.30	0.38	246.49	1.00	246.49	4.000	No	No	2.00
359	29.45	239.44	1.25	0.26	0.36	245.78	1.00	245.78	4.000	No	No	2.00
360	29.53	253.30	1.19	0.21	0.34	258.42	1.00	258.42	4.000	No	No	2.00
361	29.61	271.51	1.24	0.30	0.36	278.14	1.00	278.14	4.000	No	No	2.00
362	29.69	294.18	1.29	0.40	0.38	302.44	1.00	302.44	4.000	No	No	2.00
363	29.77	312.56	1.34	0.52	0.40	322.58	1.00	322.58	4.000	No	No	2.00
364	29.86	331.69	1.37	0.60	0.41	342.85	1.00	342.85	4.000	No	No	2.00
365	29.94	346.14	1.38	0.64	0.41	357.61	1.00	357.61	4.000	No	No	2.00
366	30.02	365.08	1.38	0.68	0.42	376.88	1.00	376.88	4.000	No	No	2.00
367	30.10	381.24	1.37	0.69	0.41	392.88	1.00	392.88	4.000	No	No	2.00
368	30.18	391.80	1.35	0.65	0.40	402.44	1.00	402.44	4.000	No	No	2.00
369	30.27	398.98	1.32	0.60	0.39	408.27	1.00	408.27	4.000	No	No	2.00
370	30.35	401.66	1.26	0.51	0.37	408.68	1.00	408.68	4.000	No	No	2.00
371	30.43	414.40	1.21	0.44	0.35	419.33	1.00	419.33	4.000	No	No	2.00
372	30.51	426.09	1.22	0.46	0.35	431.02	1.00	431.02	4.000	No	No	2.00
373	30.59	436.33	1.31	0.64	0.39	444.27	1.00	444.27	4.000	No	No	2.00
374	30.68	462.98	1.38	0.82	0.42	473.33	1.00	473.33	4.000	No	No	2.00
375	30.76	485.08	1.42	0.94	0.43	496.67	1.00	496.67	4.000	No	No	2.00
376	30.84	496.55	1.39	0.88	0.42	506.72	1.00	506.72	4.000	No	No	2.00
377	30.92	486.98	1.39	0.86	0.42	496.11	1.00	496.11	4.000	No	No	2.00
378	31.00	483.72	1.36	0.78	0.41	490.89	1.00	490.89	4.000	No	No	2.00
379	31.09	489.21	1.32	0.71	0.40	494.59	1.00	494.59	4.000	No	No	2.00
380	31.17	512.03	1.21	0.53	0.35	513.19	1.00	513.19	4.000	No	No	2.00
381	31.25	527.67	1.14	0.44	0.33	525.94	1.00	525.94	4.000	No	No	2.00
382	31.33	547.71	1.12	0.43	0.32	544.85	1.00	544.85	4.000	No	No	2.00
383	31.41	554.37	1.10	0.40	0.31	550.07	1.00	550.07	4.000	No	No	2.00
384	31.50	542.38	1.10	0.39	0.31	537.70	1.00	537.70	4.000	No	No	2.00

:: Cyclic Resistance Ratio (CRR) calculation data :: (continued)												
Point ID	Depth (ft)	q _c (tsf)	I _c	Fr (%)	n	Q _{tn}	K _c	Q _{tn,cs}	CRR _{7.5}	Belongs to trans. layer	Clay-like behaviour	FS
385	31.58	530.13	1.13	0.43	0.32	526.00	1.00	526.00	4.000	No	No	2.00
386	31.66	533.19	1.20	0.52	0.35	530.55	1.00	530.55	4.000	No	No	2.00
387	31.74	509.71	1.23	0.56	0.36	507.55	1.00	507.55	4.000	No	No	2.00
388	31.82	489.37	1.16	0.43	0.33	484.66	1.00	484.66	4.000	No	No	2.00
389	31.91	441.30	1.35	0.70	0.41	441.08	1.00	441.08	4.000	No	No	2.00
390	31.99	453.05	1.40	0.84	0.43	453.68	1.00	453.68	4.000	No	No	2.00
391	32.07	475.30	1.46	1.00	0.45	476.72	1.00	476.72	4.000	No	No	2.00
392	32.15	520.78	1.37	0.84	0.42	519.38	1.00	519.38	4.000	No	No	2.00
393	32.23	546.69	1.35	0.83	0.41	544.13	1.00	544.13	4.000	No	No	2.00
394	32.32	577.36	1.32	0.77	0.40	572.96	1.00	572.96	4.000	No	No	2.00
395	32.40	557.93	1.30	0.73	0.39	552.57	1.00	552.57	4.000	No	No	2.00
396	32.48	518.03	1.37	0.83	0.42	513.85	1.00	513.85	4.000	No	No	2.00
397	32.56	440.67	1.45	0.93	0.45	437.89	1.00	437.89	4.000	No	No	2.00
398	32.64	395.68	1.49	0.96	0.46	393.13	1.00	393.13	4.000	No	No	2.00
399	32.73	373.89	1.35	0.62	0.41	368.70	1.00	368.70	4.000	No	No	2.00
400	32.81	393.80	1.22	0.42	0.36	385.79	1.00	385.79	4.000	No	No	2.00
401	32.89	410.46	1.15	0.34	0.33	400.50	1.00	400.50	4.000	No	No	2.00
402	32.97	423.75	1.22	0.45	0.36	414.41	1.00	414.41	4.000	No	No	2.00
403	33.05	447.80	1.31	0.63	0.39	439.08	1.00	439.08	4.000	No	No	2.00
404	33.14	490.69	1.39	0.84	0.42	482.16	1.00	482.16	4.000	No	No	2.00
405	33.22	539.15	1.40	0.93	0.43	529.49	1.00	529.49	4.000	No	No	2.00
406	33.30	550.82	1.45	1.07	0.45	541.18	1.00	541.18	4.000	No	No	2.00
407	33.38	547.41	1.49	1.19	0.46	537.81	1.00	537.81	4.000	No	No	2.00
408	33.46	514.85	1.51	1.22	0.47	505.37	1.00	505.37	4.000	No	No	2.00
409	33.55	466.95	1.56	1.31	0.49	458.21	1.00	458.21	4.000	No	No	2.00
410	33.63	432.70	1.55	1.19	0.49	423.59	1.00	423.59	4.000	No	No	2.00
411	33.71	405.29	1.57	1.21	0.49	396.27	1.00	396.27	4.000	No	No	2.00
412	33.79	397.55	1.52	1.05	0.48	387.61	1.00	387.61	4.000	No	No	2.00
413	33.87	382.48	1.55	1.11	0.49	372.62	1.00	372.62	4.000	No	No	2.00
414	33.96	386.38	1.57	1.19	0.50	376.06	1.00	376.06	4.000	No	No	2.00
415	34.04	397.16	1.55	1.12	0.49	385.75	1.00	385.75	4.000	No	No	2.00
416	34.12	410.46	1.49	0.97	0.46	397.60	1.00	397.60	4.000	No	No	2.00
417	34.20	440.27	1.38	0.74	0.42	424.96	1.00	424.96	4.000	No	No	2.00
418	34.28	461.91	1.29	0.60	0.39	444.55	1.00	444.55	4.000	No	No	2.00
419	34.37	457.97	1.25	0.52	0.37	439.88	1.00	439.88	4.000	No	No	2.00
420	34.45	410.83	1.34	0.62	0.41	394.66	1.00	394.66	4.000	No	No	2.00
421	34.53	362.28	1.48	0.85	0.46	348.28	1.00	348.28	4.000	No	No	2.00
422	34.61	322.49	1.60	1.10	0.51	310.05	1.00	310.05	4.000	No	No	2.00
423	34.69	303.32	1.65	1.21	0.52	291.32	1.00	291.32	4.000	No	No	2.00
424	34.78	284.42	1.67	1.23	0.53	272.74	1.00	272.74	4.000	No	No	2.00
425	34.86	274.78	1.62	1.03	0.52	262.85	1.00	262.85	4.000	No	No	2.00
426	34.94	278.06	1.56	0.88	0.49	265.44	1.00	265.44	4.000	No	No	2.00
427	35.02	277.18	1.54	0.82	0.49	264.16	1.00	264.16	4.000	No	No	2.00
428	35.10	277.04	1.56	0.85	0.49	263.72	1.00	263.72	4.000	No	No	2.00
429	35.19	271.79	1.50	0.69	0.47	258.18	1.00	258.18	4.000	No	No	2.00
430	35.27	271.98	1.34	0.40	0.41	257.68	1.00	257.68	4.000	No	No	2.00
431	35.35	273.99	1.22	0.25	0.37	259.10	1.00	259.10	4.000	No	No	2.00
432	35.43	283.73	1.25	0.29	0.37	268.20	1.00	268.20	4.000	No	No	2.00

:: Cyclic Resistance Ratio (CRR) calculation data :: (continued)												
Point ID	Depth (ft)	q _c (tsf)	I _c	Fr (%)	n	Q _{tn}	K _c	Q _{tn,cs}	CRR _{7.5}	Belongs to trans. layer	Clay-like behaviour	FS
433	35.52	287.59	1.32	0.40	0.40	271.74	1.00	271.74	4.000	No	No	2.00
434	35.60	285.68	1.39	0.50	0.43	269.74	1.00	269.74	4.000	No	No	2.00
435	35.68	286.47	1.41	0.55	0.44	270.23	1.00	270.23	4.000	No	No	2.00
436	35.76	308.09	1.47	0.72	0.46	290.49	1.00	290.49	4.000	No	No	2.00
437	35.84	340.67	1.49	0.83	0.47	321.02	1.00	321.02	4.000	No	No	2.00
438	35.93	379.43	1.48	0.88	0.46	357.29	1.00	357.29	4.000	No	No	2.00
439	36.01	408.13	1.44	0.81	0.45	383.96	1.00	383.96	4.000	No	No	2.00
440	36.09	421.42	1.48	0.94	0.46	396.01	1.00	396.01	4.000	No	No	2.00
441	36.17	409.34	1.49	0.94	0.47	384.09	1.00	384.09	4.000	No	No	2.00
442	36.25	395.37	1.57	1.15	0.50	370.34	1.00	370.34	4.000	No	No	2.00
443	36.34	389.54	1.50	0.94	0.47	364.44	1.00	364.44	4.000	No	No	2.00
444	36.42	378.60	1.51	0.95	0.48	353.66	1.00	353.66	4.000	No	No	2.00
445	36.50	363.00	1.46	0.78	0.46	338.69	1.00	338.69	4.000	No	No	2.00
446	36.58	335.19	1.55	0.98	0.49	311.98	1.00	311.98	4.000	No	No	2.00
447	36.66	338.85	1.62	1.20	0.52	314.81	1.00	314.81	4.000	No	No	2.00
448	36.75	344.05	1.65	1.32	0.53	319.11	1.00	319.11	4.000	No	No	2.00
449	36.83	380.68	1.59	1.18	0.51	353.00	1.00	353.00	4.000	No	No	2.00
450	36.91	394.90	1.51	0.97	0.48	366.08	1.00	366.08	4.000	No	No	2.00
451	36.99	366.64	1.51	0.90	0.48	339.31	1.00	339.31	4.000	No	No	2.00
452	37.07	360.64	1.50	0.87	0.47	333.35	1.00	333.35	4.000	No	No	2.00
453	37.16	366.79	1.54	1.00	0.49	338.42	1.00	338.42	4.000	No	No	2.00
454	37.24	437.35	1.47	0.93	0.46	403.79	1.00	403.79	4.000	No	No	2.00
455	37.32	416.12	1.52	1.03	0.48	383.31	1.00	383.31	4.000	No	No	2.00
456	37.40	383.12	1.54	1.03	0.49	352.15	1.00	352.15	4.000	No	No	2.00
457	37.48	317.72	1.72	1.48	0.56	290.37	1.02	296.23	4.000	No	No	2.00
458	37.57	318.89	1.78	1.78	0.58	290.62	1.13	328.50	4.000	No	No	2.00
459	37.65	344.64	1.81	2.01	0.59	313.57	1.16	364.11	4.000	No	No	2.00
460	37.73	366.21	1.80	2.06	0.59	332.80	1.16	384.53	4.000	No	No	2.00
461	37.81	393.61	1.79	2.10	0.59	357.33	1.15	409.61	4.000	No	No	2.00
462	37.89	405.97	1.81	2.22	0.59	367.89	1.16	427.88	4.000	No	No	2.00
463	37.98	460.10	1.71	1.85	0.56	417.51	1.01	423.75	4.000	No	No	2.00
464	38.06	398.67	1.76	1.92	0.57	360.52	1.10	395.93	4.000	No	No	2.00
465	38.14	340.53	1.78	1.84	0.58	306.99	1.13	346.71	4.000	No	No	2.00
466	38.22	263.09	1.93	2.35	0.64	235.36	1.26	296.22	4.000	No	No	2.00
467	38.30	250.57	1.96	2.43	0.65	223.50	1.28	285.04	4.000	No	No	2.00
468	38.39	221.28	2.04	2.79	0.68	196.33	1.34	263.73	4.000	No	No	2.00
469	38.47	170.86	2.19	3.51	0.74	150.17	1.59	238.04	4.000	No	No	2.00
470	38.55	145.32	2.27	3.96	0.77	126.83	1.83	232.23	4.000	No	No	2.00
471	38.63	125.32	2.34	4.26	0.80	108.65	2.09	226.81	4.000	No	No	2.00
472	38.71	117.25	2.34	4.05	0.80	101.31	2.09	212.08	4.000	No	No	2.00
473	38.80	109.77	2.34	3.86	0.80	94.52	2.11	199.21	0.815	No	No	1.60
474	38.88	104.97	2.34	3.62	0.80	90.14	2.07	186.71	0.685	No	No	1.35
475	38.96	100.07	2.34	3.52	0.80	85.66	2.09	179.28	0.616	No	No	1.21
476	39.04	97.58	2.34	3.40	0.80	83.32	2.08	173.36	0.565	No	No	1.11
477	39.12	96.80	2.33	3.32	0.79	82.50	2.06	169.78	0.535	No	No	1.05
478	39.21	95.23	2.34	3.35	0.80	80.94	2.10	169.67	0.534	No	No	1.05
479	39.29	94.41	2.38	3.68	0.81	79.96	2.25	180.09	0.623	No	No	1.23
480	39.37	94.78	2.39	3.89	0.82	80.07	2.34	187.55	0.694	No	No	1.37

:: Cyclic Resistance Ratio (CRR) calculation data :: (continued)												
Point ID	Depth (ft)	q_t (tsf)	I_c	Fr (%)	n	Q_{tn}	K_c	$Q_{tn,cs}$	CRR _{7.5}	Belongs to trans. layer	Clay-like behaviour	FS
481	39.45	103.02	2.36	3.73	0.80	87.16	2.16	188.03	0.698	No	No	1.38
482	39.53	127.96	2.21	2.91	0.75	109.20	1.64	179.07	0.614	No	No	1.22
483	39.62	165.69	2.03	2.15	0.68	142.81	1.34	191.20	0.730	No	No	1.45
484	39.70	197.23	1.90	1.68	0.63	171.11	1.24	211.86	4.000	No	No	2.00
485	39.78	205.23	1.86	1.53	0.61	178.20	1.21	215.24	4.000	No	No	2.00
486	39.86	188.91	1.92	1.71	0.64	163.15	1.25	204.17	4.000	No	No	2.00
487	39.94	164.19	2.02	2.04	0.68	140.65	1.33	186.52	0.683	No	No	1.36
488	40.03	142.03	2.13	2.46	0.72	120.58	1.46	176.23	0.589	No	No	1.17
489	40.11	123.98	2.22	2.84	0.75	104.36	1.65	172.65	0.559	No	No	1.11
490	40.19	112.12	2.29	3.26	0.78	93.66	1.89	177.34	0.599	No	No	1.19
491	40.27	105.38	2.33	3.51	0.80	87.55	2.06	180.76	0.629	No	No	1.26
492	40.35	107.61	2.31	3.29	0.79	89.40	1.95	174.50	0.574	No	No	1.15
493	40.44	116.06	2.24	2.88	0.76	96.73	1.73	167.16	0.514	No	No	1.03
494	40.52	122.36	2.19	2.60	0.74	102.18	1.60	163.06	0.483	No	No	0.97
495	40.60	121.38	2.20	2.63	0.75	101.13	1.61	162.98	0.483	No	No	0.97
496	40.68	110.70	2.27	2.96	0.77	91.54	1.81	165.25	0.500	No	No	1.00
497	40.76	100.73	2.34	3.36	0.80	82.65	2.07	171.26	0.547	No	No	1.10
498	40.85	95.90	2.37	3.50	0.81	78.31	2.20	172.51	0.557	No	No	1.12
499	40.93	97.43	2.34	3.31	0.80	79.55	2.10	166.94	0.513	No	No	1.03
500	41.01	99.31	2.31	3.04	0.79	81.12	1.96	159.10	0.455	No	No	0.91
501	41.09	100.12	2.30	2.93	0.78	81.72	1.91	155.99	0.433	No	No	0.87
502	41.17	96.73	2.32	3.03	0.79	78.63	2.00	156.92	0.439	No	No	0.89
503	41.26	91.97	2.35	3.21	0.81	74.38	2.14	159.42	0.457	No	No	0.92
504	41.34	88.45	2.37	3.26	0.81	71.24	2.23	158.67	0.451	No	No	0.91
505	41.42	92.99	2.45	4.37	0.84	74.47	2.67	198.85	0.811	No	No	1.64
506	41.50	103.92	2.50	5.50	0.86	83.04	2.97	246.95	4.000	No	No	2.00
507	41.58	116.20	2.54	6.81	0.88	92.61	3.77	349.42	4.000	No	No	2.00
508	41.67	125.32	2.38	4.58	0.82	100.88	2.30	231.58	4.000	No	No	2.00
509	41.75	264.42	1.70	1.16	0.56	224.57	1.00	224.57	4.000	No	No	2.00
510	41.83	406.50	N/A	0.00	1.00	320.45	1.00	320.45	4.000	No	No	2.00
511	41.91	568.35	N/A	0.00	1.00	448.44	1.00	448.44	4.000	No	No	2.00
512	41.99	595.38	N/A	0.00	1.00	469.48	1.00	469.48	4.000	No	No	2.00

Abbreviations

Depth:	Depth from free surface, at which CPT was performed (ft)
q_t :	Total cone resistance
I_c :	Soil behavior type index
Fr:	Normalized friction ratio (%)
n:	Stress exponent
Q_{tn} :	Normalized cone resistance
K_c :	Cone resistance correction factor due to fines
$Q_{tn,cs}$:	Normalized and adjusted cone resistance
CRR _{7.5} :	Cyclic resistance ratio for $M_w=7.5$
FS:	Factor of safety against soil liquefaction

:: Liquefaction Potential Index calculation data ::											
Depth (ft)	FS	F _L	w _z	d _z	LPI	Depth (ft)	FS	F _L	w _z	d _z	LPI
0.08	2.00	0.00	0.00	0.00	0.00	0.16	2.00	0.00	0.00	0.00	0.00
0.25	2.00	0.00	0.00	0.00	0.00	0.33	2.00	0.00	0.00	0.00	0.00
0.41	2.00	0.00	0.00	0.00	0.00	0.49	2.00	0.00	0.00	0.00	0.00
0.57	2.00	0.00	0.00	0.00	0.00	0.66	2.00	0.00	0.00	0.00	0.00
0.74	2.00	0.00	0.00	0.00	0.00	0.82	2.00	0.00	0.00	0.00	0.00
0.90	2.00	0.00	0.00	0.00	0.00	0.98	2.00	0.00	0.00	0.00	0.00
1.07	2.00	0.00	0.00	0.00	0.00	1.15	2.00	0.00	0.00	0.00	0.00
1.23	2.00	0.00	0.00	0.00	0.00	1.31	2.00	0.00	0.00	0.00	0.00
1.39	2.00	0.00	0.00	0.00	0.00	1.48	2.00	0.00	0.00	0.00	0.00
1.56	2.00	0.00	0.00	0.00	0.00	1.64	2.00	0.00	0.00	0.00	0.00
1.72	2.00	0.00	0.00	0.00	0.00	1.80	2.00	0.00	0.00	0.00	0.00
1.89	2.00	0.00	0.00	0.00	0.00	1.97	2.00	0.00	0.00	0.00	0.00
2.05	2.00	0.00	0.00	0.00	0.00	2.13	2.00	0.00	0.00	0.00	0.00
2.21	2.00	0.00	0.00	0.00	0.00	2.30	2.00	0.00	0.00	0.00	0.00
2.38	2.00	0.00	0.00	0.00	0.00	2.46	2.00	0.00	0.00	0.00	0.00
2.54	2.00	0.00	0.00	0.00	0.00	2.62	2.00	0.00	0.00	0.00	0.00
2.71	2.00	0.00	0.00	0.00	0.00	2.79	2.00	0.00	0.00	0.00	0.00
2.87	2.00	0.00	0.00	0.00	0.00	2.95	2.00	0.00	0.00	0.00	0.00
3.03	2.00	0.00	0.00	0.00	0.00	3.12	2.00	0.00	0.00	0.00	0.00
3.20	2.00	0.00	0.00	0.00	0.00	3.28	2.00	0.00	0.00	0.00	0.00
3.36	2.00	0.00	0.00	0.08	0.00	3.44	2.00	0.00	0.00	0.08	0.00
3.53	2.00	0.00	0.00	0.08	0.00	3.61	2.00	0.00	0.00	0.08	0.00
3.69	2.00	0.00	0.00	0.08	0.00	3.77	2.00	0.00	0.00	0.08	0.00
3.85	2.00	0.00	0.00	0.08	0.00	3.94	2.00	0.00	0.00	0.08	0.00
4.02	2.00	0.00	0.00	0.08	0.00	4.10	2.00	0.00	0.00	0.08	0.00
4.18	2.00	0.00	0.00	0.08	0.00	4.27	2.00	0.00	0.00	0.08	0.00
4.35	2.00	0.00	0.00	0.08	0.00	4.43	2.00	0.00	0.00	0.08	0.00
4.51	2.00	0.00	0.00	0.08	0.00	4.59	2.00	0.00	0.00	0.08	0.00
4.68	2.00	0.00	0.00	0.08	0.00	4.76	2.00	0.00	0.00	0.08	0.00
4.84	2.00	0.00	0.00	0.08	0.00	4.92	2.00	0.00	0.00	0.08	0.00
5.00	2.00	0.00	0.00	0.08	0.00	5.09	2.00	0.00	0.00	0.08	0.00
5.17	2.00	0.00	0.00	0.08	0.00	5.25	2.00	0.00	0.00	0.08	0.00
5.33	2.00	0.00	0.00	0.08	0.00	5.41	2.00	0.00	0.00	0.08	0.00
5.50	2.00	0.00	0.00	0.08	0.00	5.58	2.00	0.00	0.00	0.08	0.00
5.66	2.00	0.00	0.00	0.08	0.00	5.74	2.00	0.00	0.00	0.08	0.00
5.82	2.00	0.00	0.00	0.08	0.00	5.91	1.92	0.00	0.00	0.08	0.00
5.99	1.79	0.00	0.00	0.08	0.00	6.07	1.63	0.00	0.00	0.08	0.00
6.15	1.50	0.00	0.00	0.08	0.00	6.23	1.43	0.00	0.00	0.08	0.00
6.32	1.38	0.00	0.00	0.08	0.00	6.40	1.33	0.00	0.00	0.08	0.00
6.48	1.27	0.00	0.00	0.08	0.00	6.56	1.22	0.00	0.00	0.08	0.00
6.64	1.18	0.00	0.00	0.08	0.00	6.73	1.12	0.00	0.00	0.08	0.00
6.81	1.08	0.00	0.00	0.08	0.00	6.89	1.05	0.00	0.00	0.08	0.00
6.97	1.00	0.00	0.00	0.08	0.00	7.05	0.96	0.00	0.00	0.08	0.01
7.14	0.91	0.00	0.00	0.08	0.02	7.22	0.87	0.00	0.00	0.08	0.03
7.30	0.84	0.00	0.00	0.08	0.04	7.38	0.81	0.00	0.00	0.08	0.04
7.46	0.81	0.00	0.00	0.08	0.04	7.55	0.82	0.00	0.00	0.08	0.04
7.63	0.84	0.00	0.00	0.08	0.04	7.71	0.85	0.00	0.00	0.08	0.03
7.79	0.87	0.00	0.00	0.08	0.03	7.87	0.87	0.00	0.00	0.08	0.03

:: Liquefaction Potential Index calculation data :: (continued)											
Depth (ft)	FS	F _L	w _z	d _z	LPI	Depth (ft)	FS	F _L	w _z	d _z	LPI
7.96	0.88	0.00	0.00	0.08	0.03	8.04	0.88	0.00	0.00	0.08	0.03
8.12	0.90	0.00	0.00	0.08	0.02	8.20	0.90	0.00	0.00	0.08	0.02
8.28	0.88	0.00	0.00	0.08	0.03	8.37	0.86	0.00	0.00	0.08	0.03
8.45	0.84	0.00	0.00	0.08	0.03	8.53	0.84	0.00	0.00	0.08	0.04
8.61	0.84	0.00	0.00	0.08	0.04	8.69	0.85	0.00	0.00	0.08	0.03
8.78	0.88	0.00	0.00	0.08	0.03	8.86	0.89	0.00	0.00	0.08	0.02
8.94	0.90	0.00	0.00	0.08	0.02	9.02	0.91	0.00	0.00	0.08	0.02
9.10	0.94	0.00	0.00	0.08	0.01	9.19	0.98	0.00	0.00	0.08	0.00
9.27	1.05	0.00	0.00	0.08	0.00	9.35	1.18	0.00	0.00	0.08	0.00
9.43	1.42	0.00	0.00	0.08	0.00	9.51	1.57	0.00	0.00	0.08	0.00
9.60	1.57	0.00	0.00	0.08	0.00	9.68	1.34	0.00	0.00	0.08	0.00
9.76	1.13	0.00	0.00	0.08	0.00	9.84	0.95	0.00	0.00	0.08	0.01
9.92	0.87	0.00	0.00	0.08	0.03	10.01	0.83	0.00	0.00	0.08	0.04
10.09	0.82	0.00	0.00	0.08	0.04	10.17	0.84	0.00	0.00	0.08	0.03
10.25	0.86	0.00	0.00	0.08	0.03	10.33	0.87	0.00	0.00	0.08	0.03
10.42	0.87	0.00	0.00	0.08	0.03	10.50	0.88	0.00	0.00	0.08	0.03
10.58	0.91	0.00	0.00	0.08	0.02	10.66	1.00	0.00	0.00	0.08	0.00
10.74	1.12	0.00	0.00	0.08	0.00	10.83	1.28	0.00	0.00	0.08	0.00
10.91	1.37	0.00	0.00	0.08	0.00	10.99	1.37	0.00	0.00	0.08	0.00
11.07	1.27	0.00	0.00	0.08	0.00	11.15	1.21	0.00	0.00	0.08	0.00
11.24	1.43	0.00	0.00	0.08	0.00	11.32	1.79	0.00	0.00	0.08	0.00
11.40	2.00	0.00	0.00	0.08	0.00	11.48	0.41	0.00	0.00	0.08	0.12
11.56	0.29	0.00	0.00	0.08	0.15	11.65	0.33	0.00	0.00	0.08	0.14
11.73	0.37	0.00	0.00	0.08	0.13	11.81	0.36	0.00	0.00	0.08	0.13
11.89	0.38	0.00	0.00	0.08	0.13	11.98	0.40	0.00	0.00	0.08	0.12
12.06	0.47	0.00	0.00	0.08	0.11	12.14	0.57	0.00	0.00	0.08	0.09
12.22	0.71	0.00	0.00	0.08	0.06	12.30	0.83	0.00	0.00	0.08	0.04
12.39	0.93	0.00	0.00	0.08	0.01	12.47	1.02	0.00	0.00	0.08	0.00
12.55	1.12	0.00	0.00	0.08	0.00	12.63	1.25	0.00	0.00	0.08	0.00
12.71	1.42	0.00	0.00	0.08	0.00	12.80	1.61	0.00	0.00	0.08	0.00
12.88	2.00	0.00	0.00	0.08	0.00	12.96	2.00	0.00	0.00	0.08	0.00
13.04	2.00	0.00	0.00	0.08	0.00	13.12	2.00	0.00	0.00	0.08	0.00
13.21	2.00	0.00	0.00	0.08	0.00	13.29	2.00	0.00	0.00	0.08	0.00
13.37	2.00	0.00	0.00	0.08	0.00	13.45	2.00	0.00	0.00	0.08	0.00
13.53	2.00	0.00	0.00	0.08	0.00	13.62	2.00	0.00	0.00	0.08	0.00
13.70	2.00	0.00	0.00	0.08	0.00	13.78	2.00	0.00	0.00	0.08	0.00
13.86	2.00	0.00	0.00	0.08	0.00	13.94	2.00	0.00	0.00	0.08	0.00
14.03	2.00	0.00	0.00	0.08	0.00	14.11	2.00	0.00	0.00	0.08	0.00
14.19	1.63	0.00	0.00	0.08	0.00	14.27	1.59	0.00	0.00	0.08	0.00
14.35	1.57	0.00	0.00	0.08	0.00	14.44	1.55	0.00	0.00	0.08	0.00
14.52	1.53	0.00	0.00	0.08	0.00	14.60	1.50	0.00	0.00	0.08	0.00
14.68	1.44	0.00	0.00	0.08	0.00	14.76	1.36	0.00	0.00	0.08	0.00
14.85	1.25	0.00	0.00	0.08	0.00	14.93	1.16	0.00	0.00	0.08	0.00
15.01	1.06	0.00	0.00	0.08	0.00	15.09	0.99	0.00	0.00	0.08	0.00
15.17	0.94	0.00	0.00	0.08	0.01	15.26	0.92	0.00	0.00	0.08	0.01
15.34	0.95	0.00	0.00	0.08	0.01	15.42	0.99	0.00	0.00	0.08	0.00
15.50	0.98	0.00	0.00	0.08	0.00	15.58	0.91	0.00	0.00	0.08	0.02
15.67	0.82	0.00	0.00	0.08	0.03	15.75	0.72	0.00	0.00	0.08	0.05

:: Liquefaction Potential Index calculation data :: (continued)											
Depth (ft)	FS	F _L	w _z	d _z	LPI	Depth (ft)	FS	F _L	w _z	d _z	LPI
15.83	0.68	0.00	0.00	0.08	0.06	15.91	0.66	0.00	0.00	0.08	0.06
15.99	0.69	0.00	0.00	0.08	0.06	16.08	0.75	0.00	0.00	0.08	0.05
16.16	0.88	0.00	0.00	0.08	0.02	16.24	1.15	0.00	0.00	0.08	0.00
16.32	1.52	0.00	0.00	0.08	0.00	16.40	2.00	0.00	0.00	0.08	0.00
16.49	2.00	0.00	0.00	0.08	0.00	16.57	2.00	0.00	0.00	0.08	0.00
16.65	2.00	0.00	0.00	0.08	0.00	16.73	2.00	0.00	0.00	0.08	0.00
16.81	2.00	0.00	0.00	0.08	0.00	16.90	2.00	0.00	0.00	0.08	0.00
16.98	2.00	0.00	0.00	0.08	0.00	17.06	2.00	0.00	0.00	0.08	0.00
17.14	2.00	0.00	0.00	0.08	0.00	17.22	2.00	0.00	0.00	0.08	0.00
17.31	1.15	0.00	0.00	0.08	0.00	17.39	0.72	0.00	0.00	0.08	0.05
17.47	0.64	0.00	0.00	0.08	0.07	17.55	0.48	0.00	0.00	0.08	0.09
17.63	0.52	0.00	0.00	0.08	0.09	17.72	0.72	0.00	0.00	0.08	0.05
17.80	2.00	0.00	0.00	0.08	0.00	17.88	2.00	0.00	0.00	0.08	0.00
17.96	0.75	0.00	0.00	0.08	0.05	18.04	0.39	0.00	0.00	0.08	0.11
18.13	0.41	0.00	0.00	0.08	0.11	18.21	0.69	0.00	0.00	0.08	0.06
18.29	0.84	0.00	0.00	0.08	0.03	18.37	1.05	0.00	0.00	0.08	0.00
18.45	0.99	0.00	0.00	0.08	0.00	18.54	0.87	0.00	0.00	0.08	0.02
18.62	0.79	0.00	0.00	0.08	0.04	18.70	0.75	0.00	0.00	0.08	0.04
18.78	0.74	0.00	0.00	0.08	0.05	18.86	0.71	0.00	0.00	0.08	0.05
18.95	0.67	0.00	0.00	0.08	0.06	19.03	0.71	0.00	0.00	0.08	0.05
19.11	0.78	0.00	0.00	0.08	0.04	19.19	0.79	0.00	0.00	0.08	0.04
19.27	0.71	0.00	0.00	0.08	0.05	19.36	0.56	0.00	0.00	0.08	0.08
19.44	0.42	0.58	0.40	0.08	0.10	19.52	0.32	0.68	0.34	0.08	0.12
19.60	0.28	0.72	0.31	0.08	0.13	19.69	0.24	0.76	0.29	0.08	0.13
19.77	0.24	0.76	0.29	0.08	0.13	19.85	0.43	0.57	0.41	0.08	0.10
19.93	1.84	0.00	0.00	0.08	0.00	20.01	1.45	0.00	0.00	0.08	0.00
20.10	1.28	0.00	0.00	0.08	0.00	20.18	1.23	0.00	0.00	0.08	0.00
20.26	1.44	0.00	0.00	0.08	0.00	20.34	0.28	0.72	0.31	0.08	0.12
20.42	0.23	0.77	0.29	0.08	0.13	20.51	0.31	0.69	0.33	0.08	0.12
20.59	1.12	0.00	0.00	0.08	0.00	20.67	1.30	0.00	0.00	0.08	0.00
20.75	1.07	0.00	0.00	0.08	0.00	20.83	0.94	0.00	0.00	0.08	0.01
20.92	0.91	0.00	0.00	0.08	0.01	21.00	0.91	0.00	0.00	0.08	0.02
21.08	0.89	0.00	0.00	0.08	0.02	21.16	0.87	0.00	0.00	0.08	0.02
21.24	0.86	0.00	0.00	0.08	0.02	21.33	0.85	0.00	0.00	0.08	0.03
21.41	0.85	0.00	0.00	0.08	0.03	21.49	0.84	0.00	0.00	0.08	0.03
21.57	0.85	0.00	0.00	0.08	0.03	21.65	0.85	0.00	0.00	0.08	0.02
21.74	0.87	0.00	0.00	0.08	0.02	21.82	0.90	0.00	0.00	0.08	0.02
21.90	0.92	0.00	0.00	0.08	0.01	21.98	0.92	0.00	0.00	0.08	0.01
22.06	0.90	0.00	0.00	0.08	0.02	22.15	0.86	0.00	0.00	0.08	0.02
22.23	0.82	0.00	0.00	0.08	0.03	22.31	0.80	0.00	0.00	0.08	0.03
22.39	0.79	0.00	0.00	0.08	0.03	22.47	0.80	0.00	0.00	0.08	0.03
22.56	0.81	0.00	0.00	0.08	0.03	22.64	0.82	0.00	0.00	0.08	0.03
22.72	0.85	0.00	0.00	0.08	0.02	22.80	0.92	0.00	0.00	0.08	0.01
22.88	0.97	0.00	0.00	0.08	0.00	22.97	1.02	0.00	0.00	0.08	0.00
23.05	1.02	0.00	0.00	0.08	0.00	23.13	1.00	0.00	0.00	0.08	0.00
23.21	0.97	0.00	0.00	0.08	0.01	23.29	0.96	0.00	0.00	0.08	0.01
23.38	0.95	0.00	0.00	0.08	0.01	23.46	0.94	0.00	0.00	0.08	0.01
23.54	0.93	0.00	0.00	0.08	0.01	23.62	0.89	0.00	0.00	0.08	0.02

:: Liquefaction Potential Index calculation data :: (continued)											
Depth (ft)	FS	F _L	w _z	d _z	LPI	Depth (ft)	FS	F _L	w _z	d _z	LPI
23.70	0.87	0.00	0.00	0.08	0.02	23.79	0.83	0.00	0.00	0.08	0.03
23.87	0.83	0.00	0.00	0.08	0.03	23.95	0.81	0.00	0.00	0.08	0.03
24.03	0.79	0.00	0.00	0.08	0.03	24.11	0.77	0.00	0.00	0.08	0.04
24.20	0.77	0.00	0.00	0.08	0.04	24.28	0.78	0.00	0.00	0.08	0.03
24.36	0.79	0.00	0.00	0.08	0.03	24.44	0.81	0.00	0.00	0.08	0.03
24.52	0.85	0.00	0.00	0.08	0.02	24.61	0.89	0.00	0.00	0.08	0.02
24.69	0.91	0.00	0.00	0.08	0.01	24.77	0.92	0.00	0.00	0.08	0.01
24.85	0.93	0.00	0.00	0.08	0.01	24.93	1.06	0.00	0.00	0.08	0.00
25.02	1.35	0.00	0.00	0.08	0.00	25.10	1.73	0.00	0.00	0.08	0.00
25.18	0.30	0.70	0.32	0.08	0.11	25.26	0.39	0.61	0.38	0.08	0.09
25.34	0.94	0.00	0.00	0.08	0.01	25.43	2.00	0.00	0.00	0.08	0.00
25.51	2.00	0.00	0.00	0.08	0.00	25.59	2.00	0.00	0.00	0.08	0.00
25.67	2.00	0.00	0.00	0.08	0.00	25.75	2.00	0.00	0.00	0.08	0.00
25.84	2.00	0.00	0.00	0.08	0.00	25.92	2.00	0.00	0.00	0.08	0.00
26.00	2.00	0.00	0.00	0.08	0.00	26.08	2.00	0.00	0.00	0.08	0.00
26.16	2.00	0.00	0.00	0.08	0.00	26.25	2.00	0.00	0.00	0.08	0.00
26.33	2.00	0.00	0.00	0.08	0.00	26.41	2.00	0.00	0.00	0.08	0.00
26.49	2.00	0.00	0.00	0.08	0.00	26.57	2.00	0.00	0.00	0.08	0.00
26.66	2.00	0.00	0.00	0.08	0.00	26.74	2.00	0.00	0.00	0.08	0.00
26.82	2.00	0.00	0.00	0.08	0.00	26.90	2.00	0.00	0.00	0.08	0.00
26.98	2.00	0.00	0.00	0.08	0.00	27.07	2.00	0.00	0.00	0.08	0.00
27.15	2.00	0.00	0.00	0.08	0.00	27.23	2.00	0.00	0.00	0.08	0.00
27.31	2.00	0.00	0.00	0.08	0.00	27.40	2.00	0.00	0.00	0.08	0.00
27.48	2.00	0.00	0.00	0.08	0.00	27.56	2.00	0.00	0.00	0.08	0.00
27.64	2.00	0.00	0.00	0.08	0.00	27.72	2.00	0.00	0.00	0.08	0.00
27.81	2.00	0.00	0.00	0.08	0.00	27.89	2.00	0.00	0.00	0.08	0.00
27.97	2.00	0.00	0.00	0.08	0.00	28.05	2.00	0.00	0.00	0.08	0.00
28.13	2.00	0.00	0.00	0.08	0.00	28.22	2.00	0.00	0.00	0.08	0.00
28.30	2.00	0.00	0.00	0.08	0.00	28.38	2.00	0.00	0.00	0.08	0.00
28.46	2.00	0.00	0.00	0.08	0.00	28.54	2.00	0.00	0.00	0.08	0.00
28.63	2.00	0.00	0.00	0.08	0.00	28.71	2.00	0.00	0.00	0.08	0.00
28.79	2.00	0.00	0.00	0.08	0.00	28.87	2.00	0.00	0.00	0.08	0.00
28.95	2.00	0.00	0.00	0.08	0.00	29.04	2.00	0.00	0.00	0.08	0.00
29.12	2.00	0.00	0.00	0.08	0.00	29.20	2.00	0.00	0.00	0.08	0.00
29.28	2.00	0.00	0.00	0.08	0.00	29.36	2.00	0.00	0.00	0.08	0.00
29.45	2.00	0.00	0.00	0.08	0.00	29.53	2.00	0.00	0.00	0.08	0.00
29.61	2.00	0.00	0.00	0.08	0.00	29.69	2.00	0.00	0.00	0.08	0.00
29.77	2.00	0.00	0.00	0.08	0.00	29.86	2.00	0.00	0.00	0.08	0.00
29.94	2.00	0.00	0.00	0.08	0.00	30.02	2.00	0.00	0.00	0.08	0.00
30.10	2.00	0.00	0.00	0.08	0.00	30.18	2.00	0.00	0.00	0.08	0.00
30.27	2.00	0.00	0.00	0.08	0.00	30.35	2.00	0.00	0.00	0.08	0.00
30.43	2.00	0.00	0.00	0.08	0.00	30.51	2.00	0.00	0.00	0.08	0.00
30.59	2.00	0.00	0.00	0.08	0.00	30.68	2.00	0.00	0.00	0.08	0.00
30.76	2.00	0.00	0.00	0.08	0.00	30.84	2.00	0.00	0.00	0.08	0.00
30.92	2.00	0.00	0.00	0.08	0.00	31.00	2.00	0.00	0.00	0.08	0.00
31.09	2.00	0.00	0.00	0.08	0.00	31.17	2.00	0.00	0.00	0.08	0.00
31.25	2.00	0.00	0.00	0.08	0.00	31.33	2.00	0.00	0.00	0.08	0.00
31.41	2.00	0.00	0.00	0.08	0.00	31.50	2.00	0.00	0.00	0.08	0.00

:: Liquefaction Potential Index calculation data :: (continued)											
Depth (ft)	FS	F _L	w _z	d _z	LPI	Depth (ft)	FS	F _L	w _z	d _z	LPI
31.58	2.00	0.00	0.00	0.08	0.00	31.66	2.00	0.00	0.00	0.08	0.00
31.74	2.00	0.00	0.00	0.08	0.00	31.82	2.00	0.00	0.00	0.08	0.00
31.91	2.00	0.00	0.00	0.08	0.00	31.99	2.00	0.00	0.00	0.08	0.00
32.07	2.00	0.00	0.00	0.08	0.00	32.15	2.00	0.00	0.00	0.08	0.00
32.23	2.00	0.00	0.00	0.08	0.00	32.32	2.00	0.00	0.00	0.08	0.00
32.40	2.00	0.00	0.00	0.08	0.00	32.48	2.00	0.00	0.00	0.08	0.00
32.56	2.00	0.00	0.00	0.08	0.00	32.64	2.00	0.00	0.00	0.08	0.00
32.73	2.00	0.00	0.00	0.08	0.00	32.81	2.00	0.00	0.00	0.08	0.00
32.89	2.00	0.00	0.00	0.08	0.00	32.97	2.00	0.00	0.00	0.08	0.00
33.05	2.00	0.00	0.00	0.08	0.00	33.14	2.00	0.00	0.00	0.08	0.00
33.22	2.00	0.00	0.00	0.08	0.00	33.30	2.00	0.00	0.00	0.08	0.00
33.38	2.00	0.00	0.00	0.08	0.00	33.46	2.00	0.00	0.00	0.08	0.00
33.55	2.00	0.00	0.00	0.08	0.00	33.63	2.00	0.00	0.00	0.08	0.00
33.71	2.00	0.00	0.00	0.08	0.00	33.79	2.00	0.00	0.00	0.08	0.00
33.87	2.00	0.00	0.00	0.08	0.00	33.96	2.00	0.00	0.00	0.08	0.00
34.04	2.00	0.00	0.00	0.08	0.00	34.12	2.00	0.00	0.00	0.08	0.00
34.20	2.00	0.00	0.00	0.08	0.00	34.28	2.00	0.00	0.00	0.08	0.00
34.37	2.00	0.00	0.00	0.08	0.00	34.45	2.00	0.00	0.00	0.08	0.00
34.53	2.00	0.00	0.00	0.08	0.00	34.61	2.00	0.00	0.00	0.08	0.00
34.69	2.00	0.00	0.00	0.08	0.00	34.78	2.00	0.00	0.00	0.08	0.00
34.86	2.00	0.00	0.00	0.08	0.00	34.94	2.00	0.00	0.00	0.08	0.00
35.02	2.00	0.00	0.00	0.08	0.00	35.10	2.00	0.00	0.00	0.08	0.00
35.19	2.00	0.00	0.00	0.08	0.00	35.27	2.00	0.00	0.00	0.08	0.00
35.35	2.00	0.00	0.00	0.08	0.00	35.43	2.00	0.00	0.00	0.08	0.00
35.52	2.00	0.00	0.00	0.08	0.00	35.60	2.00	0.00	0.00	0.08	0.00
35.68	2.00	0.00	0.00	0.08	0.00	35.76	2.00	0.00	0.00	0.08	0.00
35.84	2.00	0.00	0.00	0.08	0.00	35.93	2.00	0.00	0.00	0.08	0.00
36.01	2.00	0.00	0.00	0.08	0.00	36.09	2.00	0.00	0.00	0.08	0.00
36.17	2.00	0.00	0.00	0.08	0.00	36.25	2.00	0.00	0.00	0.08	0.00
36.34	2.00	0.00	0.00	0.08	0.00	36.42	2.00	0.00	0.00	0.08	0.00
36.50	2.00	0.00	0.00	0.08	0.00	36.58	2.00	0.00	0.00	0.08	0.00
36.66	2.00	0.00	0.00	0.08	0.00	36.75	2.00	0.00	0.00	0.08	0.00
36.83	2.00	0.00	0.00	0.08	0.00	36.91	2.00	0.00	0.00	0.08	0.00
36.99	2.00	0.00	0.00	0.08	0.00	37.07	2.00	0.00	0.00	0.08	0.00
37.16	2.00	0.00	0.00	0.08	0.00	37.24	2.00	0.00	0.00	0.08	0.00
37.32	2.00	0.00	0.00	0.08	0.00	37.40	2.00	0.00	0.00	0.08	0.00
37.48	2.00	0.00	0.00	0.08	0.00	37.57	2.00	0.00	0.00	0.08	0.00
37.65	2.00	0.00	0.00	0.08	0.00	37.73	2.00	0.00	0.00	0.08	0.00
37.81	2.00	0.00	0.00	0.08	0.00	37.89	2.00	0.00	0.00	0.08	0.00
37.98	2.00	0.00	0.00	0.08	0.00	38.06	2.00	0.00	0.00	0.08	0.00
38.14	2.00	0.00	0.00	0.08	0.00	38.22	2.00	0.00	0.00	0.08	0.00
38.30	2.00	0.00	0.00	0.08	0.00	38.39	2.00	0.00	0.00	0.08	0.00
38.47	2.00	0.00	0.00	0.08	0.00	38.55	2.00	0.00	0.00	0.08	0.00
38.63	2.00	0.00	0.00	0.08	0.00	38.71	2.00	0.00	0.00	0.08	0.00
38.80	1.60	0.00	0.00	0.08	0.00	38.88	1.35	0.00	0.00	0.08	0.00
38.96	1.21	0.00	0.00	0.08	0.00	39.04	1.11	0.00	0.00	0.08	0.00
39.12	1.05	0.00	0.00	0.08	0.00	39.21	1.05	0.00	0.00	0.08	0.00
39.29	1.23	0.00	0.00	0.08	0.00	39.37	1.37	0.00	0.00	0.08	0.00

:: Liquefaction Potential Index calculation data :: (continued)											
Depth (ft)	FS	F _L	w _z	d _z	LPI	Depth (ft)	FS	F _L	w _z	d _z	LPI
39.45	1.38	0.00	0.00	0.08	0.00	39.53	1.22	0.00	0.00	0.08	0.00
39.62	1.45	0.00	0.00	0.08	0.00	39.70	2.00	0.00	0.00	0.08	0.00
39.78	2.00	0.00	0.00	0.08	0.00	39.86	2.00	0.00	0.00	0.08	0.00
39.94	1.36	0.00	0.00	0.08	0.00	40.03	1.17	0.00	0.00	0.08	0.00
40.11	1.11	0.00	0.00	0.08	0.00	40.19	1.19	0.00	0.00	0.08	0.00
40.27	1.26	0.00	0.00	0.08	0.00	40.35	1.15	0.00	0.00	0.08	0.00
40.44	1.03	0.00	0.00	0.08	0.00	40.52	0.97	0.00	0.00	0.08	0.00
40.60	0.97	0.00	0.00	0.08	0.00	40.68	1.00	0.00	0.00	0.08	0.00
40.76	1.10	0.00	0.00	0.08	0.00	40.85	1.12	0.00	0.00	0.08	0.00
40.93	1.03	0.00	0.00	0.08	0.00	41.01	0.91	0.00	0.00	0.08	0.01
41.09	0.87	0.00	0.00	0.08	0.01	41.17	0.89	0.00	0.00	0.08	0.01
41.26	0.92	0.00	0.00	0.08	0.01	41.34	0.91	0.00	0.00	0.08	0.01
41.42	1.64	0.00	0.00	0.08	0.00	41.50	2.00	0.00	0.00	0.08	0.00
41.58	2.00	0.00	0.00	0.08	0.00	41.67	2.00	0.00	0.00	0.08	0.00
41.75	2.00	0.00	0.00	0.08	0.00	41.83	2.00	0.00	0.00	0.08	0.00
41.91	2.00	0.00	0.00	0.08	0.00	41.99	2.00	0.00	0.00	0.08	0.00


Overall liquefaction potential: 6.23

LPI = 0.00 - Liquefaction risk very low
 LPI between 0.00 and 5.00 - Liquefaction risk low
 LPI between 5.00 and 15.00 - Liquefaction risk high
 LPI > 15.00 - Liquefaction risk very high

Abbreviations

FS: Calculated factor of safety for test point
 F_L: 1 - FS
 w_z: Function value of the extend of soil liquefaction according to depth
 d_z: Layer thickness (ft)
 LPI: Liquefaction potential index value for test point

Estimation of post-earthquake settlements

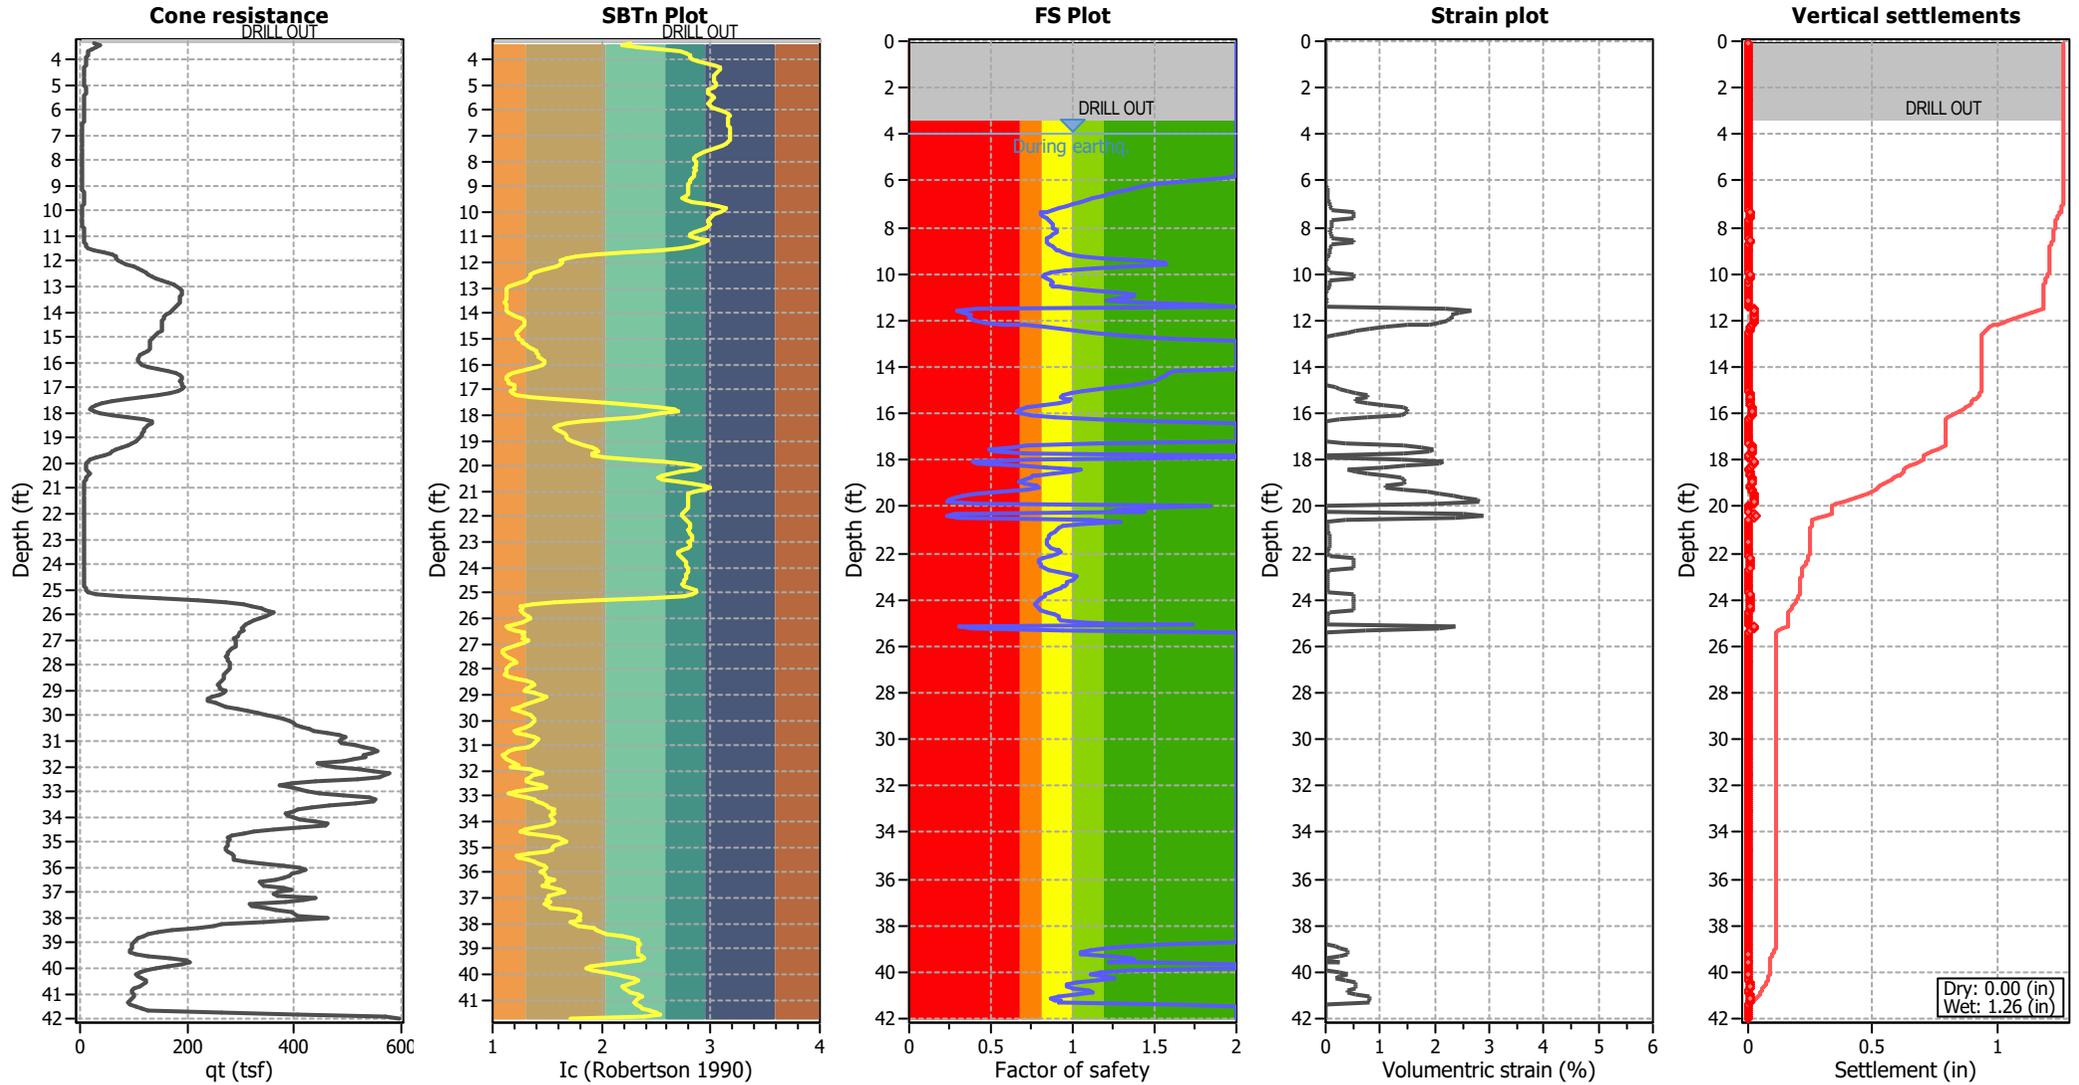

Abbreviations

- q_t : Total cone resistance (cone resistance q_c corrected for pore water effects)
- I_c : Soil Behaviour Type Index
- FS: Calculated Factor of Safety against liquefaction
- Volumetric strain: Post-liquefaction volumetric strain

:: Post-earthquake settlement due to soil liquefaction ::											
Depth (ft)	Q _{tn,cs}	FS	e _v (%)	DF	Settlement (in)	Depth (ft)	Q _{tn,cs}	FS	e _v (%)	DF	Settlement (in)
4.02	145.60	2.00	0.00	1.00	0.00	4.10	151.08	2.00	0.00	1.00	0.00
4.18	157.64	2.00	0.00	1.00	0.00	4.27	162.32	2.00	0.00	1.00	0.00
4.35	163.41	2.00	0.00	1.00	0.00	4.43	159.37	2.00	0.00	1.00	0.00
4.51	153.47	2.00	0.00	1.00	0.00	4.59	149.78	2.00	0.00	1.00	0.00
4.68	151.18	2.00	0.00	1.00	0.00	4.76	153.92	2.00	0.00	1.00	0.00
4.84	156.97	2.00	0.00	1.00	0.00	4.92	159.83	2.00	0.00	1.00	0.00
5.00	161.53	2.00	0.00	1.00	0.00	5.09	160.47	2.00	0.00	1.00	0.00
5.17	155.70	2.00	0.00	1.00	0.00	5.25	151.27	2.00	0.00	1.00	0.00
5.33	148.19	2.00	0.00	1.00	0.00	5.41	145.52	2.00	0.00	1.00	0.00
5.50	141.54	2.00	0.00	1.00	0.00	5.58	136.40	2.00	0.00	1.00	0.00
5.66	131.35	2.00	0.00	1.00	0.00	5.74	129.27	2.00	0.00	1.00	0.00
5.82	130.22	2.00	0.00	1.00	0.00	5.91	132.98	1.92	0.00	1.00	0.00
5.99	135.66	1.79	0.00	1.00	0.00	6.07	138.26	1.63	0.01	1.00	0.00
6.15	139.93	1.50	0.01	1.00	0.00	6.23	136.46	1.43	0.02	1.00	0.00
6.32	130.06	1.38	0.02	1.00	0.00	6.40	122.40	1.33	0.02	1.00	0.00
6.48	117.67	1.27	0.03	1.00	0.00	6.56	113.82	1.22	0.03	1.00	0.00
6.64	111.06	1.18	0.04	1.00	0.00	6.73	108.64	1.12	0.05	1.00	0.00
6.81	106.03	1.08	0.05	1.00	0.00	6.89	103.44	1.05	0.06	1.00	0.00
6.97	100.54	1.00	0.07	1.00	0.00	7.05	96.87	0.96	0.08	1.00	0.00
7.14	91.72	0.91	0.10	1.00	0.00	7.22	86.28	0.87	0.11	1.00	0.00
7.30	79.89	0.84	0.50	1.00	0.00	7.38	73.07	0.81	0.50	1.00	0.00
7.46	65.65	0.81	0.50	1.00	0.00	7.55	59.83	0.82	0.50	1.00	0.00
7.63	55.77	0.84	0.50	1.00	0.00	7.71	53.31	0.85	0.12	1.00	0.00
7.79	50.89	0.87	0.11	1.00	0.00	7.87	49.67	0.87	0.10	1.00	0.00
7.96	49.60	0.88	0.10	1.00	0.00	8.04	51.73	0.88	0.10	1.00	0.00
8.12	52.88	0.90	0.09	1.00	0.00	8.20	52.94	0.90	0.09	1.00	0.00
8.28	51.42	0.88	0.10	1.00	0.00	8.37	50.52	0.86	0.10	1.00	0.00
8.45	49.55	0.84	0.11	1.00	0.00	8.53	48.75	0.84	0.50	1.00	0.00
8.61	48.02	0.84	0.50	1.00	0.00	8.69	47.97	0.85	0.10	1.00	0.00
8.78	48.18	0.88	0.09	1.00	0.00	8.86	48.11	0.89	0.09	1.00	0.00
8.94	48.25	0.90	0.08	1.00	0.00	9.02	48.61	0.91	0.08	1.00	0.00
9.10	50.34	0.94	0.07	1.00	0.00	9.19	52.65	0.98	0.06	1.00	0.00
9.27	55.68	1.05	0.04	1.00	0.00	9.35	61.10	1.18	0.03	1.00	0.00
9.43	67.44	1.42	0.01	1.00	0.00	9.51	81.31	1.57	0.01	1.00	0.00
9.60	93.72	1.57	0.01	1.00	0.00	9.68	105.29	1.34	0.02	1.00	0.00
9.76	106.64	1.13	0.03	1.00	0.00	9.84	101.79	0.95	0.06	1.00	0.00
9.92	91.80	0.87	0.08	1.00	0.00	10.01	80.97	0.83	0.50	1.00	0.00
10.09	74.00	0.82	0.50	1.00	0.00	10.17	71.61	0.84	0.50	1.00	0.00
10.25	71.70	0.86	0.08	1.00	0.00	10.33	71.43	0.87	0.08	1.00	0.00
10.42	71.54	0.87	0.08	1.00	0.00	10.50	73.14	0.88	0.08	1.00	0.00
10.58	75.73	0.91	0.07	1.00	0.00	10.66	78.55	1.00	0.05	1.00	0.00
10.74	80.91	1.12	0.03	1.00	0.00	10.83	82.14	1.28	0.02	1.00	0.00
10.91	81.11	1.37	0.01	1.00	0.00	10.99	81.56	1.37	0.01	1.00	0.00
11.07	84.30	1.27	0.02	1.00	0.00	11.15	99.20	1.21	0.02	1.00	0.00
11.24	109.73	1.43	0.01	1.00	0.00	11.32	112.44	1.79	0.00	1.00	0.00
11.40	108.35	2.00	0.00	1.00	0.00	11.48	107.56	0.41	2.20	1.00	0.02
11.56	85.11	0.29	2.67	1.00	0.03	11.65	93.93	0.33	2.46	1.00	0.02
11.73	102.13	0.37	2.30	1.00	0.02	11.81	100.19	0.36	2.33	1.00	0.02

:: Post-earthquake settlement due to soil liquefaction :: (continued)											
Depth (ft)	Q _{tn,cs}	FS	e _v (%)	DF	Settlement (in)	Depth (ft)	Q _{tn,cs}	FS	e _v (%)	DF	Settlement (in)
11.89	103.14	0.38	2.28	1.00	0.02	11.98	106.73	0.40	2.22	1.00	0.02
12.06	116.01	0.47	2.07	1.00	0.02	12.14	128.57	0.57	1.90	1.00	0.02
12.22	141.87	0.71	1.50	1.00	0.01	12.30	151.27	0.83	1.11	1.00	0.01
12.39	159.01	0.93	0.79	1.00	0.01	12.47	165.09	1.02	0.55	1.00	0.01
12.55	171.52	1.12	0.39	1.00	0.00	12.63	179.00	1.25	0.19	1.00	0.00
12.71	187.70	1.42	0.00	1.00	0.00	12.80	197.15	1.61	0.00	1.00	0.00
12.88	207.91	2.00	0.00	1.00	0.00	12.96	218.70	2.00	0.00	1.00	0.00
13.04	229.56	2.00	0.00	1.00	0.00	13.12	235.26	2.00	0.00	1.00	0.00
13.21	235.78	2.00	0.00	1.00	0.00	13.29	232.97	2.00	0.00	1.00	0.00
13.37	230.24	2.00	0.00	1.00	0.00	13.45	228.82	2.00	0.00	1.00	0.00
13.53	227.89	2.00	0.00	1.00	0.00	13.62	226.23	2.00	0.00	1.00	0.00
13.70	224.57	2.00	0.00	1.00	0.00	13.78	220.64	2.00	0.00	1.00	0.00
13.86	216.46	2.00	0.00	1.00	0.00	13.94	210.96	2.00	0.00	1.00	0.00
14.03	206.74	2.00	0.00	1.00	0.00	14.11	202.33	2.00	0.00	1.00	0.00
14.19	199.66	1.63	0.00	1.00	0.00	14.27	198.03	1.59	0.00	1.00	0.00
14.35	197.25	1.57	0.00	1.00	0.00	14.44	196.49	1.55	0.00	1.00	0.00
14.52	195.46	1.53	0.00	1.00	0.00	14.60	194.18	1.50	0.00	1.00	0.00
14.68	191.20	1.44	0.00	1.00	0.00	14.76	187.40	1.36	0.00	1.00	0.00
14.85	181.57	1.25	0.19	1.00	0.00	14.93	176.30	1.16	0.27	1.00	0.00
15.01	170.61	1.06	0.39	1.00	0.00	15.09	165.95	0.99	0.55	1.00	0.01
15.17	162.71	0.94	0.76	1.00	0.01	15.26	161.68	0.92	0.77	1.00	0.01
15.34	163.72	0.95	0.56	1.00	0.01	15.42	166.31	0.99	0.55	1.00	0.01
15.50	165.90	0.98	0.55	1.00	0.01	15.58	161.06	0.91	0.77	1.00	0.01
15.67	154.29	0.82	1.08	1.00	0.01	15.75	146.64	0.72	1.43	1.00	0.01
15.83	142.77	0.68	1.48	1.00	0.01	15.91	141.06	0.66	1.51	1.00	0.01
15.99	143.49	0.69	1.47	1.00	0.01	16.08	148.73	0.75	1.40	1.00	0.01
16.16	159.68	0.88	0.78	1.00	0.01	16.24	177.27	1.15	0.27	1.00	0.00
16.32	196.71	1.52	0.00	1.00	0.00	16.40	210.53	2.00	0.00	1.00	0.00
16.49	220.35	2.00	0.00	1.00	0.00	16.57	223.60	2.00	0.00	1.00	0.00
16.65	224.31	2.00	0.00	1.00	0.00	16.73	220.92	2.00	0.00	1.00	0.00
16.81	224.34	2.00	0.00	1.00	0.00	16.90	228.51	2.00	0.00	1.00	0.00
16.98	228.87	2.00	0.00	1.00	0.00	17.06	223.21	2.00	0.00	1.00	0.00
17.14	214.71	2.00	0.00	1.00	0.00	17.22	200.83	2.00	0.00	1.00	0.00
17.31	177.82	1.15	0.38	1.00	0.00	17.39	147.79	0.72	1.41	1.00	0.01
17.47	140.05	0.64	1.77	1.00	0.02	17.55	123.30	0.48	1.97	1.00	0.02
17.63	128.21	0.52	1.91	1.00	0.02	17.72	147.85	0.72	1.41	1.00	0.01
17.80	297.51	2.00	0.00	1.00	0.00	17.88	157.00	2.00	0.00	1.00	0.00
17.96	149.96	0.75	1.38	1.00	0.01	18.04	110.66	0.39	2.15	1.00	0.02
18.13	113.96	0.41	2.10	1.00	0.02	18.21	144.76	0.69	1.45	1.00	0.01
18.29	157.44	0.84	1.05	1.00	0.01	18.37	172.52	1.05	0.39	1.00	0.00
18.45	168.61	0.99	0.54	1.00	0.01	18.54	160.11	0.87	0.78	1.00	0.01
18.62	153.43	0.79	1.09	1.00	0.01	18.70	150.79	0.75	1.12	1.00	0.01
18.78	149.68	0.74	1.39	1.00	0.01	18.86	147.30	0.71	1.42	1.00	0.01
18.95	143.38	0.67	1.47	1.00	0.01	19.03	147.32	0.71	1.42	1.00	0.01
19.11	153.05	0.78	1.09	1.00	0.01	19.19	153.96	0.79	1.08	1.00	0.01
19.27	147.72	0.71	1.41	1.00	0.01	19.36	132.80	0.56	1.85	1.00	0.02
19.44	115.29	0.42	2.08	1.00	0.02	19.52	99.76	0.32	2.34	1.00	0.02
19.60	91.47	0.28	2.51	1.00	0.02	19.69	80.89	0.24	2.78	1.00	0.03

:: Post-earthquake settlement due to soil liquefaction :: (continued)											
Depth (ft)	Q _{tn,cs}	FS	e _v (%)	DF	Settlement (in)	Depth (ft)	Q _{tn,cs}	FS	e _v (%)	DF	Settlement (in)
19.77	79.36	0.24	2.82	1.00	0.03	19.85	116.91	0.43	2.06	1.00	0.02
19.93	105.30	1.84	0.00	1.00	0.00	20.01	109.11	1.45	0.01	1.00	0.00
20.10	103.74	1.28	0.01	1.00	0.00	20.18	92.16	1.23	0.02	1.00	0.00
20.26	78.50	1.44	0.01	1.00	0.00	20.34	91.35	0.28	2.52	1.00	0.02
20.42	76.67	0.23	2.91	1.00	0.03	20.51	97.49	0.31	2.39	1.00	0.02
20.59	184.62	1.12	0.37	1.00	0.00	20.67	92.10	1.30	0.01	1.00	0.00
20.75	95.73	1.07	0.03	1.00	0.00	20.83	91.22	0.94	0.04	1.00	0.00
20.92	79.03	0.91	0.05	1.00	0.00	21.00	65.30	0.91	0.05	1.00	0.00
21.08	58.20	0.89	0.05	1.00	0.00	21.16	56.83	0.87	0.06	1.00	0.00
21.24	56.78	0.86	0.06	1.00	0.00	21.33	56.40	0.85	0.06	1.00	0.00
21.41	56.08	0.85	0.06	1.00	0.00	21.49	55.73	0.84	0.06	1.00	0.00
21.57	55.28	0.85	0.06	1.00	0.00	21.65	55.06	0.85	0.06	1.00	0.00
21.74	54.80	0.87	0.06	1.00	0.00	21.82	54.33	0.90	0.05	1.00	0.00
21.90	53.82	0.92	0.05	1.00	0.00	21.98	53.67	0.92	0.04	1.00	0.00
22.06	53.78	0.90	0.05	1.00	0.00	22.15	54.04	0.86	0.06	1.00	0.00
22.23	54.14	0.82	0.50	1.00	0.00	22.31	54.30	0.80	0.50	1.00	0.00
22.39	54.47	0.79	0.50	1.00	0.00	22.47	54.68	0.80	0.50	1.00	0.00
22.56	54.09	0.81	0.50	1.00	0.00	22.64	56.69	0.82	0.50	1.00	0.00
22.72	61.13	0.85	0.06	1.00	0.00	22.80	66.41	0.92	0.05	1.00	0.00
22.88	68.60	0.97	0.04	1.00	0.00	22.97	68.99	1.02	0.03	1.00	0.00
23.05	70.45	1.02	0.03	1.00	0.00	23.13	68.48	1.00	0.03	1.00	0.00
23.21	63.54	0.97	0.04	1.00	0.00	23.29	55.74	0.96	0.04	1.00	0.00
23.38	52.10	0.95	0.04	1.00	0.00	23.46	51.58	0.94	0.04	1.00	0.00
23.54	51.95	0.93	0.04	1.00	0.00	23.62	52.50	0.89	0.05	1.00	0.00
23.70	52.98	0.87	0.05	1.00	0.00	23.79	53.36	0.83	0.50	1.00	0.00
23.87	53.05	0.83	0.50	1.00	0.00	23.95	52.70	0.81	0.50	1.00	0.00
24.03	52.30	0.79	0.50	1.00	0.00	24.11	51.58	0.77	0.50	1.00	0.00
24.20	51.44	0.77	0.50	1.00	0.00	24.28	51.19	0.78	0.50	1.00	0.00
24.36	51.53	0.79	0.50	1.00	0.00	24.44	52.50	0.81	0.50	1.00	0.00
24.52	53.59	0.85	0.06	1.00	0.00	24.61	54.46	0.89	0.05	1.00	0.00
24.69	54.78	0.91	0.04	1.00	0.00	24.77	57.29	0.92	0.04	1.00	0.00
24.85	72.39	0.93	0.04	1.00	0.00	24.93	83.84	1.06	0.03	1.00	0.00
25.02	100.30	1.35	0.01	1.00	0.00	25.10	107.09	1.73	0.00	1.00	0.00
25.18	97.94	0.30	2.38	1.00	0.02	25.26	114.76	0.39	2.09	1.00	0.02
25.34	168.57	0.94	0.72	1.00	0.01	25.43	244.78	2.00	0.00	1.00	0.00
25.51	296.92	2.00	0.00	1.00	0.00	25.59	331.08	2.00	0.00	1.00	0.00
25.67	349.06	2.00	0.00	1.00	0.00	25.75	367.49	2.00	0.00	1.00	0.00
25.84	379.17	2.00	0.00	1.00	0.00	25.92	392.70	2.00	0.00	1.00	0.00
26.00	388.31	2.00	0.00	1.00	0.00	26.08	377.64	2.00	0.00	1.00	0.00
26.16	360.51	2.00	0.00	1.00	0.00	26.25	347.82	2.00	0.00	1.00	0.00
26.33	334.90	2.00	0.00	1.00	0.00	26.41	325.86	2.00	0.00	1.00	0.00
26.49	322.56	2.00	0.00	1.00	0.00	26.57	323.64	2.00	0.00	1.00	0.00
26.66	327.48	2.00	0.00	1.00	0.00	26.74	319.37	2.00	0.00	1.00	0.00
26.82	316.23	2.00	0.00	1.00	0.00	26.90	308.02	2.00	0.00	1.00	0.00
26.98	310.27	2.00	0.00	1.00	0.00	27.07	306.07	2.00	0.00	1.00	0.00
27.15	303.68	2.00	0.00	1.00	0.00	27.23	300.88	2.00	0.00	1.00	0.00
27.31	294.62	2.00	0.00	1.00	0.00	27.40	289.94	2.00	0.00	1.00	0.00
27.48	286.41	2.00	0.00	1.00	0.00	27.56	288.40	2.00	0.00	1.00	0.00

:: Post-earthquake settlement due to soil liquefaction :: (continued)											
Depth (ft)	Q _{tn,cs}	FS	e _v (%)	DF	Settlement (in)	Depth (ft)	Q _{tn,cs}	FS	e _v (%)	DF	Settlement (in)
27.64	286.38	2.00	0.00	1.00	0.00	27.72	286.95	2.00	0.00	1.00	0.00
27.81	286.16	2.00	0.00	1.00	0.00	27.89	289.84	2.00	0.00	1.00	0.00
27.97	289.15	2.00	0.00	1.00	0.00	28.05	288.97	2.00	0.00	1.00	0.00
28.13	287.56	2.00	0.00	1.00	0.00	28.22	283.18	2.00	0.00	1.00	0.00
28.30	279.20	2.00	0.00	1.00	0.00	28.38	277.94	2.00	0.00	1.00	0.00
28.46	282.07	2.00	0.00	1.00	0.00	28.54	281.87	2.00	0.00	1.00	0.00
28.63	278.52	2.00	0.00	1.00	0.00	28.71	272.38	2.00	0.00	1.00	0.00
28.79	266.49	2.00	0.00	1.00	0.00	28.87	270.90	2.00	0.00	1.00	0.00
28.95	273.84	2.00	0.00	1.00	0.00	29.04	286.73	2.00	0.00	1.00	0.00
29.12	283.55	2.00	0.00	1.00	0.00	29.20	275.59	2.00	0.00	1.00	0.00
29.28	257.03	2.00	0.00	1.00	0.00	29.36	246.49	2.00	0.00	1.00	0.00
29.45	245.78	2.00	0.00	1.00	0.00	29.53	258.42	2.00	0.00	1.00	0.00
29.61	278.14	2.00	0.00	1.00	0.00	29.69	302.44	2.00	0.00	1.00	0.00
29.77	322.58	2.00	0.00	1.00	0.00	29.86	342.85	2.00	0.00	1.00	0.00
29.94	357.61	2.00	0.00	1.00	0.00	30.02	376.88	2.00	0.00	1.00	0.00
30.10	392.88	2.00	0.00	1.00	0.00	30.18	402.44	2.00	0.00	1.00	0.00
30.27	408.27	2.00	0.00	1.00	0.00	30.35	408.68	2.00	0.00	1.00	0.00
30.43	419.33	2.00	0.00	1.00	0.00	30.51	431.02	2.00	0.00	1.00	0.00
30.59	444.27	2.00	0.00	1.00	0.00	30.68	473.33	2.00	0.00	1.00	0.00
30.76	496.67	2.00	0.00	1.00	0.00	30.84	506.72	2.00	0.00	1.00	0.00
30.92	496.11	2.00	0.00	1.00	0.00	31.00	490.89	2.00	0.00	1.00	0.00
31.09	494.59	2.00	0.00	1.00	0.00	31.17	513.19	2.00	0.00	1.00	0.00
31.25	525.94	2.00	0.00	1.00	0.00	31.33	544.85	2.00	0.00	1.00	0.00
31.41	550.07	2.00	0.00	1.00	0.00	31.50	537.70	2.00	0.00	1.00	0.00
31.58	526.00	2.00	0.00	1.00	0.00	31.66	530.55	2.00	0.00	1.00	0.00
31.74	507.55	2.00	0.00	1.00	0.00	31.82	484.66	2.00	0.00	1.00	0.00
31.91	441.08	2.00	0.00	1.00	0.00	31.99	453.68	2.00	0.00	1.00	0.00
32.07	476.72	2.00	0.00	1.00	0.00	32.15	519.38	2.00	0.00	1.00	0.00
32.23	544.13	2.00	0.00	1.00	0.00	32.32	572.96	2.00	0.00	1.00	0.00
32.40	552.57	2.00	0.00	1.00	0.00	32.48	513.85	2.00	0.00	1.00	0.00
32.56	437.89	2.00	0.00	1.00	0.00	32.64	393.13	2.00	0.00	1.00	0.00
32.73	368.70	2.00	0.00	1.00	0.00	32.81	385.79	2.00	0.00	1.00	0.00
32.89	400.50	2.00	0.00	1.00	0.00	32.97	414.41	2.00	0.00	1.00	0.00
33.05	439.08	2.00	0.00	1.00	0.00	33.14	482.16	2.00	0.00	1.00	0.00
33.22	529.49	2.00	0.00	1.00	0.00	33.30	541.18	2.00	0.00	1.00	0.00
33.38	537.81	2.00	0.00	1.00	0.00	33.46	505.37	2.00	0.00	1.00	0.00
33.55	458.21	2.00	0.00	1.00	0.00	33.63	423.59	2.00	0.00	1.00	0.00
33.71	396.27	2.00	0.00	1.00	0.00	33.79	387.61	2.00	0.00	1.00	0.00
33.87	372.62	2.00	0.00	1.00	0.00	33.96	376.06	2.00	0.00	1.00	0.00
34.04	385.75	2.00	0.00	1.00	0.00	34.12	397.60	2.00	0.00	1.00	0.00
34.20	424.96	2.00	0.00	1.00	0.00	34.28	444.55	2.00	0.00	1.00	0.00
34.37	439.88	2.00	0.00	1.00	0.00	34.45	394.66	2.00	0.00	1.00	0.00
34.53	348.28	2.00	0.00	1.00	0.00	34.61	310.05	2.00	0.00	1.00	0.00
34.69	291.32	2.00	0.00	1.00	0.00	34.78	272.74	2.00	0.00	1.00	0.00
34.86	262.85	2.00	0.00	1.00	0.00	34.94	265.44	2.00	0.00	1.00	0.00
35.02	264.16	2.00	0.00	1.00	0.00	35.10	263.72	2.00	0.00	1.00	0.00
35.19	258.18	2.00	0.00	1.00	0.00	35.27	257.68	2.00	0.00	1.00	0.00
35.35	259.10	2.00	0.00	1.00	0.00	35.43	268.20	2.00	0.00	1.00	0.00

:: Post-earthquake settlement due to soil liquefaction :: (continued)											
Depth (ft)	Q _{tn,cs}	FS	e _v (%)	DF	Settlement (in)	Depth (ft)	Q _{tn,cs}	FS	e _v (%)	DF	Settlement (in)
35.52	271.74	2.00	0.00	1.00	0.00	35.60	269.74	2.00	0.00	1.00	0.00
35.68	270.23	2.00	0.00	1.00	0.00	35.76	290.49	2.00	0.00	1.00	0.00
35.84	321.02	2.00	0.00	1.00	0.00	35.93	357.29	2.00	0.00	1.00	0.00
36.01	383.96	2.00	0.00	1.00	0.00	36.09	396.01	2.00	0.00	1.00	0.00
36.17	384.09	2.00	0.00	1.00	0.00	36.25	370.34	2.00	0.00	1.00	0.00
36.34	364.44	2.00	0.00	1.00	0.00	36.42	353.66	2.00	0.00	1.00	0.00
36.50	338.69	2.00	0.00	1.00	0.00	36.58	311.98	2.00	0.00	1.00	0.00
36.66	314.81	2.00	0.00	1.00	0.00	36.75	319.11	2.00	0.00	1.00	0.00
36.83	353.00	2.00	0.00	1.00	0.00	36.91	366.08	2.00	0.00	1.00	0.00
36.99	339.31	2.00	0.00	1.00	0.00	37.07	333.35	2.00	0.00	1.00	0.00
37.16	338.42	2.00	0.00	1.00	0.00	37.24	403.79	2.00	0.00	1.00	0.00
37.32	383.31	2.00	0.00	1.00	0.00	37.40	352.15	2.00	0.00	1.00	0.00
37.48	296.23	2.00	0.00	1.00	0.00	37.57	328.50	2.00	0.00	1.00	0.00
37.65	364.11	2.00	0.00	1.00	0.00	37.73	384.53	2.00	0.00	1.00	0.00
37.81	409.61	2.00	0.00	1.00	0.00	37.89	427.88	2.00	0.00	1.00	0.00
37.98	423.75	2.00	0.00	1.00	0.00	38.06	395.93	2.00	0.00	1.00	0.00
38.14	346.71	2.00	0.00	1.00	0.00	38.22	296.22	2.00	0.00	1.00	0.00
38.30	285.04	2.00	0.00	1.00	0.00	38.39	263.73	2.00	0.00	1.00	0.00
38.47	238.04	2.00	0.00	1.00	0.00	38.55	232.23	2.00	0.00	1.00	0.00
38.63	226.81	2.00	0.00	1.00	0.00	38.71	212.08	2.00	0.00	1.00	0.00
38.80	199.21	1.60	0.00	1.00	0.00	38.88	186.71	1.35	0.19	1.00	0.00
38.96	179.28	1.21	0.27	1.00	0.00	39.04	173.36	1.11	0.39	1.00	0.00
39.12	169.78	1.05	0.39	1.00	0.00	39.21	169.67	1.05	0.39	1.00	0.00
39.29	180.09	1.23	0.27	1.00	0.00	39.37	187.55	1.37	0.00	1.00	0.00
39.45	188.03	1.38	0.00	1.00	0.00	39.53	179.07	1.22	0.27	1.00	0.00
39.62	191.20	1.45	0.00	1.00	0.00	39.70	211.86	2.00	0.00	1.00	0.00
39.78	215.24	2.00	0.00	1.00	0.00	39.86	204.17	2.00	0.00	1.00	0.00
39.94	186.52	1.36	0.00	1.00	0.00	40.03	176.23	1.17	0.27	1.00	0.00
40.11	172.65	1.11	0.39	1.00	0.00	40.19	177.34	1.19	0.27	1.00	0.00
40.27	180.76	1.26	0.19	1.00	0.00	40.35	174.50	1.15	0.38	1.00	0.00
40.44	167.16	1.03	0.55	1.00	0.01	40.52	163.06	0.97	0.56	1.00	0.01
40.60	162.98	0.97	0.56	1.00	0.01	40.68	165.25	1.00	0.55	1.00	0.01
40.76	171.26	1.10	0.39	1.00	0.00	40.85	172.51	1.12	0.39	1.00	0.00
40.93	166.94	1.03	0.55	1.00	0.01	41.01	159.10	0.91	0.79	1.00	0.01
41.09	155.99	0.87	0.81	1.00	0.01	41.17	156.92	0.89	0.80	1.00	0.01
41.26	159.42	0.92	0.79	1.00	0.01	41.34	158.67	0.91	0.79	1.00	0.01
41.42	198.85	1.64	0.00	1.00	0.00	41.50	246.95	2.00	0.00	1.00	0.00
41.58	349.42	2.00	0.00	1.00	0.00	41.67	231.58	2.00	0.00	1.00	0.00
41.75	224.57	2.00	0.00	1.00	0.00	41.83	320.45	2.00	0.00	1.00	0.00
41.91	448.44	2.00	0.00	1.00	0.00	41.99	469.48	2.00	0.00	1.00	0.00


Total estimated settlement: 1.26

Abbreviations

- Q_{tn,cs}: Equivalent clean sand normalized cone resistance
- FS: Factor of safety against liquefaction
- e_v (%): Post-liquefaction volumetric strain
- DF: e_v depth weighting factor
- Settlement: Calculated settlement

Estimation of post-earthquake lateral Displacements

Geometric parameters: Level ground (or gently sloping) with free face (L: 70.00 ft - H: 5.00 ft)

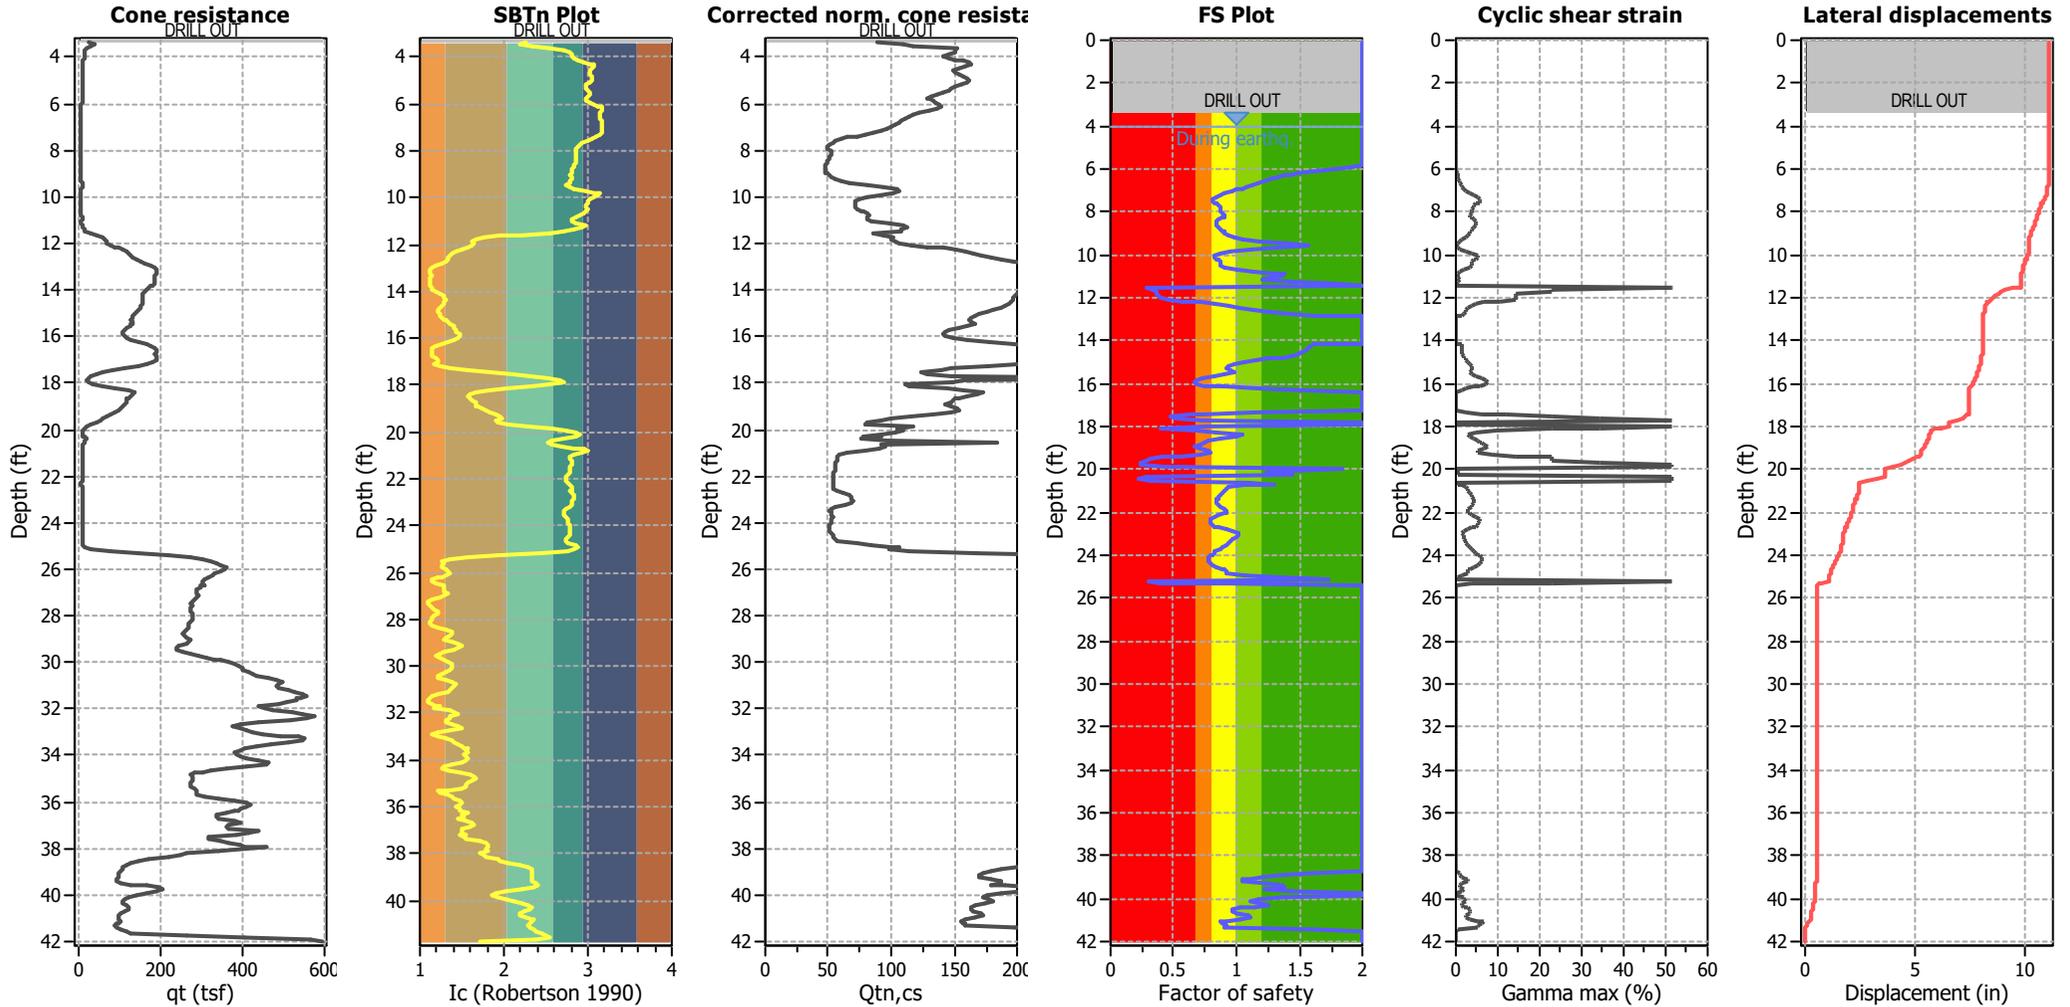


Abbreviations

q_t: Total cone resistance (cone resistance q_c corrected for pore water effects)
 I_c: Soil Behaviour Type Index
 Q_{tn,cs}: Equivalent clean sand normalized CPT total cone resistance

F.S.: Factor of safety
 γ_{max}: Maximum cyclic shear strain
 LDI: Lateral displacement index

Surface condition



:: Lateral displacement index calculation ::								
Depth (ft)	q _t (tsf)	Q _{tn}	R _f (%)	Q _{tn,cs}	FS	D _r	Gamma _{max} (%)	Lat. disp. (in)
4.02	12.58	23.32	4.65	145.60	2.00	18.95	0.05	0.00
4.10	11.87	21.98	5.09	151.08	2.00	16.99	0.06	0.00
4.18	10.69	19.73	5.82	157.64	2.00	13.43	0.06	0.00
4.27	9.49	17.46	6.62	162.32	2.00	9.40	0.07	0.00
4.35	8.71	15.98	7.12	163.41	2.00	6.47	0.07	0.00
4.43	8.54	15.65	6.90	159.37	2.00	5.78	0.07	0.00
4.51	8.61	15.77	6.40	153.47	2.00	6.05	0.07	0.00
4.59	8.75	16.03	6.05	149.78	2.00	6.58	0.07	0.00
4.68	8.83	16.16	6.12	151.18	2.00	6.85	0.07	0.00
4.76	8.99	16.46	6.24	153.92	2.00	7.45	0.07	0.00
4.84	9.07	16.60	6.43	156.97	2.00	7.72	0.07	0.00
4.92	9.16	16.76	6.60	159.83	2.00	8.04	0.07	0.00
5.00	9.26	16.95	6.67	161.53	2.00	8.42	0.07	0.00
5.09	9.57	17.53	6.44	160.47	2.00	9.52	0.07	0.00
5.17	9.97	18.27	5.95	155.70	2.00	10.89	0.06	0.00
5.25	10.00	18.32	5.64	151.27	2.00	10.99	0.06	0.00
5.33	9.57	17.49	5.59	148.19	2.00	9.45	0.07	0.00
5.41	8.91	16.23	5.67	145.52	2.00	6.99	0.07	0.00
5.50	8.48	15.43	5.57	141.54	2.00	5.31	0.07	0.00
5.58	8.32	15.11	5.27	136.40	2.00	4.63	0.07	0.00
5.66	8.35	15.16	4.90	131.35	2.00	4.74	0.07	0.00
5.74	8.40	15.25	4.74	129.27	2.00	4.93	0.07	0.00
5.82	8.37	15.17	4.82	130.22	2.00	4.76	0.07	0.00
5.91	8.12	14.69	5.11	132.98	1.92	3.69	0.09	0.00
5.99	7.63	13.77	5.52	135.66	1.79	1.56	0.12	0.00
6.07	7.02	12.61	6.08	138.26	1.63	0.00	0.20	0.00
6.15	6.52	11.65	6.58	139.93	1.50	0.00	0.30	0.00
6.23	6.26	11.15	6.47	136.46	1.43	0.00	0.38	0.00
6.32	6.10	10.84	6.00	130.06	1.38	0.00	0.45	0.00
6.40	5.93	10.51	5.43	122.40	1.33	0.00	0.54	0.00
6.48	5.72	10.10	5.15	117.67	1.27	0.00	0.67	0.00
6.56	5.55	9.77	4.92	113.82	1.22	0.00	0.81	0.01
6.64	5.39	9.47	4.78	111.06	1.18	0.00	0.97	0.01
6.73	5.17	9.04	4.72	108.64	1.12	0.00	1.24	0.01
6.81	5.03	8.76	4.58	106.03	1.08	0.00	1.48	0.01
6.89	4.91	8.53	4.43	103.44	1.05	0.00	1.73	0.01
6.97	4.75	8.22	4.27	100.54	1.00	0.00	2.12	0.02
7.05	4.61	7.94	4.04	96.87	0.96	0.00	2.56	0.02
7.14	4.41	7.56	3.71	91.72	0.91	0.00	3.33	0.02
7.22	4.26	7.26	3.32	86.28	0.87	0.00	4.12	0.03
7.30	4.12	6.99	2.86	79.89	0.84	0.00	5.07	0.04
7.38	4.02	6.81	2.36	73.07	0.81	0.00	5.90	0.04
7.46	4.05	6.84	1.82	65.65	0.81	0.00	5.88	0.04
7.55	4.11	6.96	1.44	59.83	0.82	0.00	5.54	0.04
7.63	4.22	7.15	1.19	55.77	0.84	0.00	4.95	0.04
7.71	4.31	7.32	1.04	53.31	0.85	0.00	4.52	0.03
7.79	4.40	7.49	0.92	50.89	0.87	0.00	4.12	0.03
7.87	4.44	7.55	0.86	49.67	0.87	0.00	4.04	0.03

:: Estimation of post-earthquake lateral Displacements :: (continued)								
Depth (ft)	q _t (tsf)	Q _{tn}	R _f (%)	Q _{tn,cs}	FS	D _r	Gamma _{max} (%)	Lat. disp. (in)
7.96	4.47	7.60	0.85	49.60	0.88	0.00	3.99	0.03
8.04	4.52	7.70	0.94	51.73	0.88	0.00	3.84	0.03
8.12	4.62	7.87	0.99	52.88	0.90	0.00	3.50	0.03
8.20	4.66	7.95	0.99	52.94	0.90	0.00	3.41	0.02
8.28	4.59	7.81	0.92	51.42	0.88	0.00	3.79	0.03
8.37	4.51	7.65	0.89	50.52	0.86	0.00	4.28	0.03
8.45	4.45	7.52	0.85	49.55	0.84	0.00	4.74	0.03
8.53	4.43	7.49	0.81	48.75	0.84	0.00	4.92	0.04
8.61	4.46	7.53	0.78	48.02	0.84	0.00	4.88	0.03
8.69	4.56	7.70	0.77	47.97	0.85	0.00	4.44	0.03
8.78	4.68	7.93	0.77	48.18	0.88	0.00	3.92	0.03
8.86	4.78	8.12	0.76	48.11	0.89	0.00	3.57	0.03
8.94	4.86	8.26	0.76	48.25	0.90	0.00	3.34	0.02
9.02	4.92	8.36	0.77	48.61	0.91	0.00	3.20	0.02
9.10	5.06	8.62	0.84	50.34	0.94	0.00	2.80	0.02
9.19	5.28	9.03	0.92	52.65	0.98	0.00	2.27	0.02
9.27	5.67	9.77	1.03	55.68	1.05	0.00	1.57	0.01
9.35	6.32	10.99	1.22	61.10	1.18	0.00	0.89	0.01
9.43	7.52	13.25	1.42	67.44	1.42	0.28	0.36	0.00
9.51	8.28	14.68	1.99	81.31	1.57	3.66	0.22	0.00
9.60	8.34	14.77	2.59	93.72	1.57	3.87	0.21	0.00
9.68	7.24	12.68	3.49	105.29	1.34	0.00	0.46	0.00
9.76	6.17	10.66	3.96	106.64	1.13	0.00	1.11	0.01
9.84	5.31	9.02	4.00	101.79	0.95	0.00	2.56	0.02
9.92	4.92	8.28	3.39	91.80	0.87	0.00	3.96	0.03
10.01	4.72	7.88	2.65	80.97	0.83	0.00	5.08	0.04
10.09	4.72	7.88	2.16	74.00	0.82	0.00	5.16	0.04
10.17	4.82	8.06	1.98	71.61	0.84	0.00	4.69	0.03
10.25	4.96	8.31	1.95	71.70	0.86	0.00	4.09	0.03
10.33	5.02	8.43	1.92	71.43	0.87	0.00	3.87	0.03
10.42	5.02	8.42	1.92	71.54	0.87	0.00	3.94	0.03
10.50	5.07	8.51	2.01	73.14	0.88	0.00	3.79	0.03
10.58	5.28	8.89	2.12	75.73	0.91	0.00	3.10	0.02
10.66	5.74	9.75	2.19	78.55	1.00	0.00	2.00	0.01
10.74	6.40	10.99	2.20	80.91	1.12	0.00	1.12	0.01
10.83	7.25	12.59	2.13	82.14	1.28	0.00	0.58	0.00
10.91	7.75	13.54	2.02	81.11	1.37	1.00	0.41	0.00
10.99	7.75	13.53	2.04	81.56	1.37	0.98	0.41	0.00
11.07	7.24	12.56	2.25	84.30	1.27	0.00	0.61	0.00
11.15	6.94	11.97	3.17	99.20	1.21	0.00	0.78	0.01
11.24	8.15	14.26	3.51	109.73	1.43	2.71	0.33	0.00
11.32	10.06	17.86	3.29	112.44	1.79	10.15	0.11	0.00
11.40	12.30	22.09	2.83	108.35	2.00	17.16	0.05	0.00
11.48	16.41	29.85	2.15	107.56	0.41	27.10	51.20	0.37
11.56	27.66	51.10	1.32	85.11	0.29	44.84	51.20	0.37
11.65	42.95	73.73	0.79	93.93	0.33	56.94	22.70	0.16
11.73	57.70	92.19	0.50	102.13	0.37	64.32	22.70	0.16
11.81	65.13	100.19	0.37	100.19	0.36	67.06	14.50	0.10

:: Estimation of post-earthquake lateral Displacements :: (continued)								
Depth (ft)	q _t (tsf)	Q _{tn}	R _f (%)	Q _{tn,cs}	FS	D _r	Gamma _{max} (%)	Lat. disp. (in)
11.89	68.14	103.14	0.32	103.14	0.38	68.02	14.50	0.10
11.98	70.56	106.73	0.35	106.73	0.40	69.15	14.50	0.10
12.06	77.24	116.01	0.38	116.01	0.47	71.90	14.50	0.10
12.14	87.06	128.57	0.38	128.57	0.57	75.29	10.28	0.07
12.22	98.79	141.87	0.32	141.87	0.71	78.54	6.54	0.05
12.30	108.42	151.27	0.25	151.27	0.83	80.66	4.80	0.03
12.39	116.33	159.01	0.21	159.01	0.93	82.31	3.74	0.03
12.47	122.33	165.09	0.19	165.09	1.02	83.55	3.09	0.02
12.55	127.66	171.52	0.20	171.52	1.12	84.81	2.53	0.02
12.63	134.08	179.00	0.20	179.00	1.25	86.22	2.18	0.02
12.71	141.80	187.70	0.20	187.70	1.42	87.78	1.74	0.01
12.80	151.92	197.15	0.17	197.15	1.61	89.40	1.38	0.01
12.88	163.38	207.91	0.13	207.91	2.00	91.16	0.00	0.00
12.96	175.02	218.70	0.10	218.70	2.00	92.83	0.00	0.00
13.04	185.29	229.56	0.10	229.56	2.00	94.43	0.00	0.00
13.12	190.46	235.26	0.10	235.26	2.00	95.24	0.00	0.00
13.21	190.85	235.78	0.11	235.78	2.00	95.31	0.00	0.00
13.29	188.49	232.97	0.11	232.97	2.00	94.91	0.00	0.00
13.37	187.10	230.24	0.10	230.24	2.00	94.53	0.00	0.00
13.45	186.37	228.82	0.09	228.82	2.00	94.32	0.00	0.00
13.53	186.12	227.89	0.08	227.89	2.00	94.19	0.00	0.00
13.62	184.93	226.23	0.07	226.23	2.00	93.95	0.00	0.00
13.70	183.80	224.57	0.07	224.57	2.00	93.70	0.00	0.00
13.78	180.39	220.64	0.06	220.64	2.00	93.12	0.00	0.00
13.86	176.69	216.46	0.06	216.46	2.00	92.49	0.00	0.00
13.94	171.69	210.96	0.07	210.96	2.00	91.64	0.00	0.00
14.03	166.60	206.74	0.11	206.74	2.00	90.97	0.00	0.00
14.11	161.20	202.33	0.15	202.33	2.00	90.26	0.00	0.00
14.19	156.72	199.66	0.20	199.66	1.63	89.82	1.36	0.01
14.27	154.79	198.03	0.21	198.03	1.59	89.55	1.42	0.01
14.35	154.22	197.25	0.22	197.25	1.57	89.42	1.45	0.01
14.44	154.29	196.49	0.20	196.49	1.55	89.29	1.48	0.01
14.52	154.24	195.46	0.19	195.46	1.53	89.12	1.52	0.01
14.60	154.34	194.18	0.17	194.18	1.50	88.90	1.57	0.01
14.68	153.36	191.20	0.13	191.20	1.44	88.39	1.70	0.01
14.76	151.08	187.40	0.11	187.40	1.36	87.73	1.87	0.01
14.85	146.61	181.57	0.09	181.57	1.25	86.69	2.18	0.02
14.93	142.13	176.30	0.08	176.30	1.16	85.72	2.51	0.02
15.01	137.22	170.61	0.08	170.61	1.06	84.63	2.85	0.02
15.09	133.01	165.95	0.09	165.95	0.99	83.72	3.31	0.02
15.17	130.08	162.71	0.10	162.71	0.94	83.07	3.67	0.03
15.26	128.45	161.68	0.13	161.68	0.92	82.86	3.81	0.03
15.34	129.50	163.72	0.16	163.72	0.95	83.27	3.57	0.03
15.42	130.21	166.31	0.21	166.31	0.99	83.79	3.30	0.02
15.50	128.87	165.90	0.25	165.90	0.98	83.71	3.35	0.02
15.58	124.78	161.06	0.25	161.06	0.91	82.73	3.92	0.03
15.67	119.34	154.29	0.25	154.29	0.82	81.31	4.89	0.03
15.75	113.42	146.64	0.23	146.64	0.72	79.64	6.31	0.05

:: Estimation of post-earthquake lateral Displacements :: (continued)								
Depth (ft)	q _t (tsf)	Q _{tn}	R _f (%)	Q _{tn,cs}	FS	D _r	Gamma _{max} (%)	Lat. disp. (in)
15.83	109.42	142.77	0.27	142.77	0.68	78.75	7.20	0.05
15.91	107.96	141.06	0.28	141.06	0.66	78.35	7.65	0.05
15.99	110.80	143.49	0.25	143.49	0.69	78.92	7.06	0.05
16.08	116.89	148.73	0.20	148.73	0.75	80.10	5.94	0.04
16.16	128.19	159.68	0.15	159.68	0.88	82.45	4.16	0.03
16.24	145.29	177.27	0.12	177.27	1.15	85.90	2.53	0.02
16.32	164.17	196.71	0.09	196.71	1.52	89.33	1.54	0.01
16.40	177.76	210.53	0.07	210.53	2.00	91.57	0.00	0.00
16.49	187.19	220.35	0.08	220.35	2.00	93.08	0.00	0.00
16.57	190.04	223.60	0.09	223.60	2.00	93.56	0.00	0.00
16.65	190.52	224.31	0.10	224.31	2.00	93.66	0.00	0.00
16.73	187.42	220.92	0.11	220.92	2.00	93.16	0.00	0.00
16.81	188.25	224.34	0.16	224.34	2.00	93.67	0.00	0.00
16.90	191.63	228.51	0.17	228.51	2.00	94.28	0.00	0.00
16.98	192.15	228.87	0.18	228.87	2.00	94.33	0.00	0.00
17.06	189.36	223.21	0.13	223.21	2.00	93.50	0.00	0.00
17.14	182.22	214.71	0.12	214.71	2.00	92.22	0.00	0.00
17.22	168.28	200.83	0.14	200.83	2.00	90.01	0.00	0.00
17.31	144.39	177.82	0.23	177.82	1.15	86.00	2.54	0.02
17.39	113.53	147.79	0.47	147.79	0.72	79.89	6.31	0.05
17.47	85.10	117.92	0.92	140.05	0.64	72.44	11.72	0.08
17.55	59.63	87.67	1.59	123.30	0.48	62.66	22.70	0.16
17.63	42.45	65.40	2.41	128.21	0.52	52.98	34.10	0.24
17.72	29.33	47.01	3.37	147.85	0.72	42.08	51.20	0.37
17.80	22.07	36.21	4.16	297.51	2.00	33.47	0.00	0.00
17.88	19.97	32.83	4.29	157.00	2.00	30.24	0.04	0.00
17.96	25.28	40.13	3.09	149.96	0.75	36.86	51.20	0.37
18.04	36.27	54.95	2.08	110.66	0.39	47.24	34.10	0.24
18.13	58.63	83.74	1.34	113.96	0.41	61.14	22.70	0.16
18.21	90.22	122.28	0.94	144.76	0.69	73.64	9.54	0.07
18.29	120.62	157.44	0.73	157.44	0.84	81.98	4.65	0.03
18.37	134.83	172.52	0.62	172.52	1.05	85.00	2.89	0.02
18.45	132.86	168.61	0.55	168.61	0.99	84.24	3.26	0.02
18.54	126.09	160.11	0.54	160.11	0.87	82.53	4.28	0.03
18.62	120.18	153.43	0.58	153.43	0.79	81.13	5.32	0.04
18.70	117.24	150.79	0.66	150.79	0.75	80.56	5.81	0.04
18.78	116.34	149.68	0.68	149.68	0.74	80.31	6.04	0.04
18.86	114.70	147.30	0.67	147.30	0.71	79.78	6.54	0.05
18.95	111.45	143.38	0.69	143.38	0.67	78.89	7.46	0.05
19.03	107.65	139.58	0.78	147.32	0.71	78.01	6.54	0.05
19.11	103.55	135.39	0.89	153.05	0.78	77.00	5.42	0.04
19.19	97.49	128.88	1.04	153.96	0.79	75.37	5.26	0.04
19.27	88.68	118.68	1.21	147.72	0.71	72.65	8.44	0.06
19.36	77.40	104.18	1.22	132.80	0.56	68.35	14.50	0.10
19.44	66.76	89.73	1.07	115.29	0.42	63.42	22.70	0.16
19.52	60.77	80.25	0.73	99.76	0.32	59.74	22.70	0.16
19.60	55.40	73.08	0.67	91.47	0.28	56.65	22.70	0.16
19.69	44.91	60.34	0.81	80.89	0.24	50.33	34.10	0.24

:: Estimation of post-earthquake lateral Displacements :: (continued)								
Depth (ft)	q _t (tsf)	Q _{tn}	R _f (%)	Q _{tn,cs}	FS	D _r	Gamma _{max} (%)	Lat. disp. (in)
19.77	30.90	43.16	1.29	79.36	0.24	39.26	51.20	0.37
19.85	18.95	27.44	2.08	116.91	0.43	24.32	51.20	0.37
19.93	14.06	20.63	2.70	105.30	1.84	14.91	0.08	0.00
20.01	11.03	16.20	3.15	109.11	1.45	6.91	0.29	0.00
20.10	9.85	14.33	3.02	103.74	1.28	2.87	0.54	0.00
20.18	9.65	13.84	2.45	92.16	1.23	1.72	0.64	0.00
20.26	11.41	16.14	1.72	78.50	1.44	6.79	0.30	0.00
20.34	15.23	21.37	1.44	91.35	0.28	16.06	51.20	0.37
20.42	17.22	24.08	1.44	76.67	0.23	20.01	51.20	0.37
20.51	16.55	23.22	1.62	97.49	0.31	18.81	51.20	0.37
20.59	13.02	18.37	1.97	184.62	1.12	11.06	0.00	0.00
20.67	10.34	14.59	2.40	92.10	1.30	3.46	0.50	0.00
20.75	8.61	12.07	2.79	95.73	1.07	0.00	1.30	0.01
20.83	7.70	10.56	2.70	91.22	0.94	0.00	2.54	0.02
20.92	7.59	10.32	2.02	79.03	0.91	0.00	2.84	0.02
21.00	7.69	10.26	1.35	65.30	0.91	0.00	2.94	0.02
21.08	7.63	10.05	1.05	58.20	0.89	0.00	3.27	0.02
21.16	7.52	9.85	1.00	56.83	0.87	0.00	3.63	0.03
21.24	7.44	9.72	1.00	56.78	0.86	0.00	3.89	0.03
21.33	7.41	9.65	0.99	56.40	0.85	0.00	4.06	0.03
21.41	7.40	9.60	0.97	56.08	0.85	0.00	4.16	0.03
21.49	7.40	9.58	0.96	55.73	0.84	0.00	4.23	0.03
21.57	7.45	9.61	0.94	55.28	0.85	0.00	4.18	0.03
21.65	7.54	9.71	0.93	55.06	0.85	0.00	3.99	0.03
21.74	7.69	9.90	0.91	54.80	0.87	0.00	3.64	0.03
21.82	7.99	10.28	0.89	54.33	0.90	0.00	3.03	0.02
21.90	8.16	10.49	0.87	53.82	0.92	0.00	2.76	0.02
21.98	8.23	10.55	0.86	53.67	0.92	0.00	2.69	0.02
22.06	8.03	10.26	0.87	53.78	0.90	0.00	3.10	0.02
22.15	7.76	9.87	0.88	54.04	0.86	0.00	3.77	0.03
22.23	7.42	9.37	0.90	54.14	0.82	0.00	4.88	0.03
22.31	7.25	9.11	0.91	54.30	0.80	0.00	5.61	0.04
22.39	7.22	9.06	0.92	54.47	0.79	0.00	5.82	0.04
22.47	7.32	9.18	0.92	54.68	0.80	0.00	5.46	0.04
22.56	7.43	9.30	0.90	54.09	0.81	0.00	5.15	0.04
22.64	7.55	9.47	1.00	56.69	0.82	0.00	4.72	0.03
22.72	7.77	9.81	1.18	61.13	0.85	0.00	3.98	0.03
22.80	8.27	10.55	1.38	66.41	0.92	0.00	2.79	0.02
22.88	8.73	11.18	1.45	68.60	0.97	0.00	2.11	0.02
22.97	9.20	11.80	1.45	68.99	1.02	0.00	1.61	0.01
23.05	9.14	11.71	1.52	70.45	1.02	0.00	1.68	0.01
23.13	9.05	11.53	1.44	68.48	1.00	0.00	1.82	0.01
23.21	8.85	11.17	1.24	63.54	0.97	0.00	2.14	0.02
23.29	8.89	11.08	0.93	55.74	0.96	0.00	2.23	0.02
23.38	8.86	10.96	0.79	52.10	0.95	0.00	2.36	0.02
23.46	8.80	10.85	0.78	51.58	0.94	0.00	2.49	0.02
23.54	8.73	10.74	0.79	51.95	0.93	0.00	2.64	0.02
23.62	8.46	10.37	0.82	52.50	0.89	0.00	3.14	0.02

:: Estimation of post-earthquake lateral Displacements :: (continued)								
Depth (ft)	q _t (tsf)	Q _{tn}	R _f (%)	Q _{tn,cs}	FS	D _r	Gamma _{max} (%)	Lat. disp. (in)
23.70	8.24	10.05	0.84	52.98	0.87	0.00	3.68	0.03
23.79	7.95	9.65	0.86	53.36	0.83	0.00	4.50	0.03
23.87	7.94	9.61	0.85	53.05	0.83	0.00	4.61	0.03
23.95	7.80	9.38	0.84	52.70	0.81	0.00	5.19	0.04
24.03	7.66	9.18	0.83	52.30	0.79	0.00	5.81	0.04
24.11	7.57	9.02	0.80	51.58	0.77	0.00	6.34	0.05
24.20	7.58	9.02	0.80	51.44	0.77	0.00	6.38	0.05
24.28	7.64	9.08	0.79	51.19	0.78	0.00	6.20	0.04
24.36	7.75	9.20	0.80	51.53	0.79	0.00	5.81	0.04
24.44	7.92	9.42	0.83	52.50	0.81	0.00	5.18	0.04
24.52	8.28	9.88	0.86	53.59	0.85	0.00	4.11	0.03
24.61	8.69	10.43	0.89	54.46	0.89	0.00	3.17	0.02
24.69	8.87	10.64	0.89	54.78	0.91	0.00	2.88	0.02
24.77	8.93	10.73	0.99	57.29	0.92	0.00	2.77	0.02
24.85	8.91	10.84	1.64	72.39	0.93	0.00	2.63	0.02
24.93	10.00	12.38	2.11	83.84	1.06	0.00	1.36	0.01
25.02	12.51	15.85	2.70	100.30	1.35	6.21	0.40	0.00
25.10	15.89	20.31	2.77	107.09	1.73	14.39	0.11	0.00
25.18	31.27	39.53	1.96	97.94	0.30	36.37	51.20	0.37
25.26	76.44	91.55	0.93	114.76	0.39	64.09	22.70	0.16
25.34	147.95	168.57	0.53	168.57	0.94	84.24	3.67	0.03
25.43	221.18	244.78	0.41	244.78	2.00	96.55	0.00	0.00
25.51	272.75	296.92	0.35	296.92	2.00	100.00	0.00	0.00
25.59	303.58	331.08	0.43	331.08	2.00	100.00	0.00	0.00
25.67	321.41	349.06	0.42	349.06	2.00	100.00	0.00	0.00
25.75	338.01	367.49	0.47	367.49	2.00	100.00	0.00	0.00
25.84	347.73	379.17	0.53	379.17	2.00	100.00	0.00	0.00
25.92	359.17	392.70	0.60	392.70	2.00	100.00	0.00	0.00
26.00	354.72	388.31	0.63	388.31	2.00	100.00	0.00	0.00
26.08	347.51	377.64	0.54	377.64	2.00	100.00	0.00	0.00
26.16	334.14	360.51	0.45	360.51	2.00	100.00	0.00	0.00
26.25	325.43	347.82	0.36	347.82	2.00	100.00	0.00	0.00
26.33	317.10	334.90	0.25	334.90	2.00	100.00	0.00	0.00
26.41	308.39	325.86	0.25	325.86	2.00	100.00	0.00	0.00
26.49	303.51	322.56	0.31	322.56	2.00	100.00	0.00	0.00
26.57	301.09	323.64	0.43	323.64	2.00	100.00	0.00	0.00
26.66	305.45	327.48	0.42	327.48	2.00	100.00	0.00	0.00
26.74	297.99	319.37	0.42	319.37	2.00	100.00	0.00	0.00
26.82	295.63	316.23	0.41	316.23	2.00	100.00	0.00	0.00
26.90	286.58	308.02	0.47	308.02	2.00	100.00	0.00	0.00
26.98	290.29	310.27	0.42	310.27	2.00	100.00	0.00	0.00
27.07	288.84	306.07	0.34	306.07	2.00	100.00	0.00	0.00
27.15	290.63	303.68	0.22	303.68	2.00	100.00	0.00	0.00
27.23	289.61	300.88	0.18	300.88	2.00	100.00	0.00	0.00
27.31	284.08	294.62	0.16	294.62	2.00	100.00	0.00	0.00
27.40	278.93	289.94	0.18	289.94	2.00	100.00	0.00	0.00
27.48	275.24	286.41	0.19	286.41	2.00	100.00	0.00	0.00
27.56	276.25	288.40	0.23	288.40	2.00	100.00	0.00	0.00

:: Estimation of post-earthquake lateral Displacements :: (continued)								
Depth (ft)	q _t (tsf)	Q _{tn}	R _f (%)	Q _{tn,cs}	FS	D _r	Gamma _{max} (%)	Lat. disp. (in)
27.64	273.29	286.38	0.27	286.38	2.00	100.00	0.00	0.00
27.72	273.94	286.95	0.28	286.95	2.00	100.00	0.00	0.00
27.81	274.81	286.16	0.23	286.16	2.00	100.00	0.00	0.00
27.89	279.57	289.84	0.21	289.84	2.00	100.00	0.00	0.00
27.97	279.55	289.15	0.19	289.15	2.00	100.00	0.00	0.00
28.05	279.48	288.97	0.20	288.97	2.00	100.00	0.00	0.00
28.13	278.68	287.56	0.19	287.56	2.00	100.00	0.00	0.00
28.22	275.11	283.18	0.17	283.18	2.00	100.00	0.00	0.00
28.30	270.40	279.20	0.20	279.20	2.00	100.00	0.00	0.00
28.38	267.51	277.94	0.27	277.94	2.00	100.00	0.00	0.00
28.46	269.19	282.07	0.39	282.07	2.00	100.00	0.00	0.00
28.54	267.45	281.87	0.50	281.87	2.00	100.00	0.00	0.00
28.63	264.31	278.52	0.51	278.52	2.00	100.00	0.00	0.00
28.71	259.63	272.38	0.45	272.38	2.00	100.00	0.00	0.00
28.79	255.57	266.49	0.37	266.49	2.00	99.35	0.00	0.00
28.87	260.50	270.90	0.35	270.90	2.00	99.89	0.00	0.00
28.95	261.38	273.84	0.49	273.84	2.00	100.00	0.00	0.00
29.04	272.23	286.73	0.64	286.73	2.00	100.00	0.00	0.00
29.12	268.23	283.55	0.75	283.55	2.00	100.00	0.00	0.00
29.20	262.12	275.59	0.64	275.59	2.00	100.00	0.00	0.00
29.28	246.20	257.03	0.49	257.03	2.00	98.16	0.00	0.00
29.36	239.04	246.49	0.30	246.49	2.00	96.78	0.00	0.00
29.45	239.44	245.78	0.25	245.78	2.00	96.68	0.00	0.00
29.53	253.30	258.42	0.21	258.42	2.00	98.34	0.00	0.00
29.61	271.51	278.14	0.30	278.14	2.00	100.00	0.00	0.00
29.69	294.18	302.44	0.40	302.44	2.00	100.00	0.00	0.00
29.77	312.56	322.58	0.52	322.58	2.00	100.00	0.00	0.00
29.86	331.69	342.85	0.60	342.85	2.00	100.00	0.00	0.00
29.94	346.14	357.61	0.64	357.61	2.00	100.00	0.00	0.00
30.02	365.08	376.88	0.68	376.88	2.00	100.00	0.00	0.00
30.10	381.24	392.88	0.69	392.88	2.00	100.00	0.00	0.00
30.18	391.80	402.44	0.65	402.44	2.00	100.00	0.00	0.00
30.27	398.98	408.27	0.60	408.27	2.00	100.00	0.00	0.00
30.35	401.66	408.68	0.51	408.68	2.00	100.00	0.00	0.00
30.43	414.40	419.33	0.43	419.33	2.00	100.00	0.00	0.00
30.51	426.09	431.02	0.46	431.02	2.00	100.00	0.00	0.00
30.59	436.33	444.27	0.64	444.27	2.00	100.00	0.00	0.00
30.68	462.98	473.33	0.82	473.33	2.00	100.00	0.00	0.00
30.76	485.08	496.67	0.93	496.67	2.00	100.00	0.00	0.00
30.84	496.55	506.72	0.88	506.72	2.00	100.00	0.00	0.00
30.92	486.98	496.11	0.86	496.11	2.00	100.00	0.00	0.00
31.00	483.72	490.89	0.78	490.89	2.00	100.00	0.00	0.00
31.09	489.21	494.59	0.71	494.59	2.00	100.00	0.00	0.00
31.17	512.03	513.19	0.52	513.19	2.00	100.00	0.00	0.00
31.25	527.67	525.94	0.43	525.94	2.00	100.00	0.00	0.00
31.33	547.71	544.85	0.43	544.85	2.00	100.00	0.00	0.00
31.41	554.37	550.07	0.40	550.07	2.00	100.00	0.00	0.00
31.50	542.38	537.70	0.39	537.70	2.00	100.00	0.00	0.00

:: Estimation of post-earthquake lateral Displacements :: (continued)								
Depth (ft)	q _t (tsf)	Q _{tn}	R _f (%)	Q _{tn,cs}	FS	D _r	Gamma _{max} (%)	Lat. disp. (in)
31.58	530.13	526.00	0.42	526.00	2.00	100.00	0.00	0.00
31.66	533.19	530.55	0.52	530.55	2.00	100.00	0.00	0.00
31.74	509.71	507.55	0.55	507.55	2.00	100.00	0.00	0.00
31.82	489.37	484.66	0.43	484.66	2.00	100.00	0.00	0.00
31.91	441.30	441.08	0.70	441.08	2.00	100.00	0.00	0.00
31.99	453.05	453.68	0.83	453.68	2.00	100.00	0.00	0.00
32.07	475.30	476.72	1.00	476.72	2.00	100.00	0.00	0.00
32.15	520.78	519.38	0.83	519.38	2.00	100.00	0.00	0.00
32.23	546.69	544.13	0.82	544.13	2.00	100.00	0.00	0.00
32.32	577.36	572.96	0.77	572.96	2.00	100.00	0.00	0.00
32.40	557.93	552.57	0.73	552.57	2.00	100.00	0.00	0.00
32.48	518.03	513.85	0.83	513.85	2.00	100.00	0.00	0.00
32.56	440.67	437.89	0.93	437.89	2.00	100.00	0.00	0.00
32.64	395.68	393.13	0.96	393.13	2.00	100.00	0.00	0.00
32.73	373.89	368.70	0.61	368.70	2.00	100.00	0.00	0.00
32.81	393.80	385.79	0.42	385.79	2.00	100.00	0.00	0.00
32.89	410.46	400.50	0.34	400.50	2.00	100.00	0.00	0.00
32.97	423.75	414.41	0.45	414.41	2.00	100.00	0.00	0.00
33.05	447.80	439.08	0.62	439.08	2.00	100.00	0.00	0.00
33.14	490.69	482.16	0.84	482.16	2.00	100.00	0.00	0.00
33.22	539.15	529.49	0.92	529.49	2.00	100.00	0.00	0.00
33.30	550.82	541.18	1.07	541.18	2.00	100.00	0.00	0.00
33.38	547.41	537.81	1.18	537.81	2.00	100.00	0.00	0.00
33.46	514.85	505.37	1.22	505.37	2.00	100.00	0.00	0.00
33.55	466.95	458.21	1.31	458.21	2.00	100.00	0.00	0.00
33.63	432.70	423.59	1.19	423.59	2.00	100.00	0.00	0.00
33.71	405.29	396.27	1.20	396.27	2.00	100.00	0.00	0.00
33.79	397.55	387.61	1.05	387.61	2.00	100.00	0.00	0.00
33.87	382.48	372.62	1.11	372.62	2.00	100.00	0.00	0.00
33.96	386.38	376.06	1.18	376.06	2.00	100.00	0.00	0.00
34.04	397.16	385.75	1.11	385.75	2.00	100.00	0.00	0.00
34.12	410.46	397.60	0.97	397.60	2.00	100.00	0.00	0.00
34.20	440.27	424.96	0.74	424.96	2.00	100.00	0.00	0.00
34.28	461.91	444.55	0.60	444.55	2.00	100.00	0.00	0.00
34.37	457.97	439.88	0.52	439.88	2.00	100.00	0.00	0.00
34.45	410.83	394.66	0.62	394.66	2.00	100.00	0.00	0.00
34.53	362.28	348.28	0.84	348.28	2.00	100.00	0.00	0.00
34.61	322.49	310.05	1.09	310.05	2.00	100.00	0.00	0.00
34.69	303.32	291.32	1.20	291.32	2.00	100.00	0.00	0.00
34.78	284.42	272.74	1.22	272.74	2.00	100.00	0.00	0.00
34.86	274.78	262.85	1.02	262.85	2.00	98.90	0.00	0.00
34.94	278.06	265.44	0.87	265.44	2.00	99.22	0.00	0.00
35.02	277.18	264.16	0.81	264.16	2.00	99.06	0.00	0.00
35.10	277.04	263.72	0.85	263.72	2.00	99.01	0.00	0.00
35.19	271.79	258.18	0.68	258.18	2.00	98.31	0.00	0.00
35.27	271.98	257.68	0.39	257.68	2.00	98.24	0.00	0.00
35.35	273.99	259.10	0.25	259.10	2.00	98.42	0.00	0.00
35.43	283.73	268.20	0.29	268.20	2.00	99.56	0.00	0.00

:: Estimation of post-earthquake lateral Displacements :: (continued)								
Depth (ft)	q _t (tsf)	Q _{tn}	R _f (%)	Q _{tn,cs}	FS	D _r	Gamma _{max} (%)	Lat. disp. (in)
35.52	287.59	271.74	0.40	271.74	2.00	100.00	0.00	0.00
35.60	285.68	269.74	0.49	269.74	2.00	99.75	0.00	0.00
35.68	286.47	270.23	0.54	270.23	2.00	99.81	0.00	0.00
35.76	308.09	290.49	0.71	290.49	2.00	100.00	0.00	0.00
35.84	340.67	321.02	0.82	321.02	2.00	100.00	0.00	0.00
35.93	379.43	357.29	0.87	357.29	2.00	100.00	0.00	0.00
36.01	408.13	383.96	0.81	383.96	2.00	100.00	0.00	0.00
36.09	421.42	396.01	0.93	396.01	2.00	100.00	0.00	0.00
36.17	409.34	384.09	0.94	384.09	2.00	100.00	0.00	0.00
36.25	395.37	370.34	1.14	370.34	2.00	100.00	0.00	0.00
36.34	389.54	364.44	0.93	364.44	2.00	100.00	0.00	0.00
36.42	378.60	353.66	0.95	353.66	2.00	100.00	0.00	0.00
36.50	363.00	338.69	0.77	338.69	2.00	100.00	0.00	0.00
36.58	335.19	311.98	0.97	311.98	2.00	100.00	0.00	0.00
36.66	338.85	314.81	1.19	314.81	2.00	100.00	0.00	0.00
36.75	344.05	319.11	1.31	319.11	2.00	100.00	0.00	0.00
36.83	380.68	353.00	1.17	353.00	2.00	100.00	0.00	0.00
36.91	394.90	366.08	0.97	366.08	2.00	100.00	0.00	0.00
36.99	366.64	339.31	0.90	339.31	2.00	100.00	0.00	0.00
37.07	360.64	333.35	0.86	333.35	2.00	100.00	0.00	0.00
37.16	366.79	338.42	0.99	338.42	2.00	100.00	0.00	0.00
37.24	437.35	403.79	0.93	403.79	2.00	100.00	0.00	0.00
37.32	416.12	383.31	1.02	383.31	2.00	100.00	0.00	0.00
37.40	383.12	352.15	1.02	352.15	2.00	100.00	0.00	0.00
37.48	317.72	290.37	1.47	296.23	2.00	100.00	0.00	0.00
37.57	318.89	290.62	1.76	328.50	2.00	100.00	0.00	0.00
37.65	344.64	313.57	2.00	364.11	2.00	100.00	0.00	0.00
37.73	366.21	332.80	2.04	384.53	2.00	100.00	0.00	0.00
37.81	393.61	357.33	2.09	409.61	2.00	100.00	0.00	0.00
37.89	405.97	367.89	2.21	427.88	2.00	100.00	0.00	0.00
37.98	460.10	417.51	1.84	423.75	2.00	100.00	0.00	0.00
38.06	398.67	360.52	1.91	395.93	2.00	100.00	0.00	0.00
38.14	340.53	306.99	1.83	346.71	2.00	100.00	0.00	0.00
38.22	263.09	235.36	2.33	296.22	2.00	95.25	0.00	0.00
38.30	250.57	223.50	2.41	285.04	2.00	93.55	0.00	0.00
38.39	221.28	196.33	2.76	263.73	2.00	89.27	0.00	0.00
38.47	170.86	150.17	3.46	238.04	2.00	80.42	0.00	0.00
38.55	145.32	126.83	3.90	232.23	2.00	74.84	0.00	0.00
38.63	125.32	108.65	4.18	226.81	2.00	69.74	0.00	0.00
38.71	117.25	101.31	3.97	212.08	2.00	67.43	0.00	0.00
38.80	109.77	94.52	3.78	199.21	1.60	65.14	0.82	0.01
38.88	104.97	90.14	3.54	186.71	1.35	63.58	0.96	0.01
38.96	100.07	85.66	3.44	179.28	1.21	61.89	1.53	0.01
39.04	97.58	83.32	3.32	173.36	1.11	60.98	2.24	0.02
39.12	96.80	82.50	3.24	169.78	1.05	60.65	2.83	0.02
39.21	95.23	80.94	3.27	169.67	1.05	60.02	2.84	0.02
39.29	94.41	79.96	3.59	180.09	1.23	59.62	1.43	0.01
39.37	94.78	80.07	3.80	187.55	1.37	59.66	0.89	0.01

:: Estimation of post-earthquake lateral Displacements :: (continued)								
Depth (ft)	q _t (tsf)	Q _{tn}	R _f (%)	Q _{tn,cs}	FS	D _r	Gamma _{max} (%)	Lat. disp. (in)
39.45	103.02	87.16	3.65	188.03	1.38	62.46	0.86	0.01
39.53	127.96	109.20	2.86	179.07	1.22	69.91	1.82	0.01
39.62	165.69	142.81	2.12	191.20	1.45	78.76	1.50	0.01
39.70	197.23	171.11	1.66	211.86	2.00	84.73	0.00	0.00
39.78	205.23	178.20	1.51	215.24	2.00	86.07	0.00	0.00
39.86	188.91	163.15	1.69	204.17	2.00	83.16	0.00	0.00
39.94	164.19	140.65	2.01	186.52	1.36	78.26	1.70	0.01
40.03	142.03	120.58	2.42	176.23	1.17	73.18	2.02	0.01
40.11	123.98	104.36	2.79	172.65	1.11	68.41	2.35	0.02
40.19	112.12	93.66	3.20	177.34	1.19	64.84	1.64	0.01
40.27	105.38	87.55	3.44	180.76	1.26	62.61	1.31	0.01
40.35	107.61	89.40	3.22	174.50	1.15	63.30	1.96	0.01
40.44	116.06	96.73	2.82	167.16	1.03	65.90	2.96	0.02
40.52	122.36	102.18	2.55	163.06	0.97	67.71	3.53	0.03
40.60	121.38	101.13	2.58	162.98	0.97	67.37	3.53	0.03
40.68	110.70	91.54	2.90	165.25	1.00	64.08	3.56	0.03
40.76	100.73	82.65	3.28	171.26	1.10	60.71	2.38	0.02
40.85	95.90	78.31	3.41	172.51	1.12	58.93	2.18	0.02
40.93	97.43	79.55	3.23	166.94	1.03	59.45	3.14	0.02
41.01	99.31	81.12	2.96	159.10	0.91	60.10	5.33	0.04
41.09	100.12	81.72	2.86	155.99	0.87	60.34	6.58	0.05
41.17	96.73	78.63	2.96	156.92	0.89	59.07	6.14	0.04
41.26	91.97	74.38	3.13	159.42	0.92	57.23	5.15	0.04
41.34	88.45	71.24	3.17	158.67	0.91	55.81	5.40	0.04
41.42	92.99	74.47	4.25	198.85	1.64	57.27	0.40	0.00
41.50	103.92	83.04	5.37	246.95	2.00	60.87	0.00	0.00
41.58	116.20	92.61	6.67	349.42	2.00	64.46	0.00	0.00
41.67	125.32	100.88	4.49	231.58	2.00	67.29	0.00	0.00
41.75	264.42	224.57	1.15	224.57	2.00	93.70	0.00	0.00
41.83	406.50	320.45	0.00	320.45	2.00	100.00	0.00	0.00
41.91	568.35	448.44	0.00	448.44	2.00	100.00	0.00	0.00
41.99	595.38	469.48	0.00	469.48	2.00	100.00	0.00	0.00
Total estimated displacement: 11.09								

Abbreviations

- q_t: Total cone resistance
- Q_{tn}: Adjusted cone resistance to an effective overburden stress of 1 atm
- R_f: Friction ration
- Q_{tn,cs}: Adjusted and corrected cone resistance due to fines
- FS: Calculated factor of safety against liquefaction
- D_r: Calculated relative density
- Gamma_{max}: Calculated maximum cyclic shear strain
- Lat. disp.: Lateral displacement

:: Strength loss calculation (Robertson (2009)) ::							
Depth (ft)	q _t (tsf)	Q _{tn}	K _c	Q _{tn,cs}	I _c	S _{u(liq)} /σ' _v	S _{u(peak)} /σ' _v
0.08	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
0.16	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
0.25	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
0.33	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
0.41	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
0.49	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
0.57	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
0.66	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
0.74	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
0.82	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
0.90	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
0.98	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
1.07	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
1.15	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
1.23	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
1.31	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
1.39	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
1.48	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
1.56	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
1.64	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
1.72	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
1.80	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
1.89	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
1.97	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
2.05	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
2.13	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
2.21	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
2.30	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
2.38	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
2.46	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
2.54	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
2.62	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
2.71	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
2.79	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
2.87	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
2.95	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
3.03	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
3.12	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
3.20	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
3.28	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
3.36	26.72	50.13	1.78	89.32	2.26	0.73	0.73
3.44	36.78	69.13	1.59	109.81	2.19	0.77	0.77
3.53	29.77	55.87	2.09	116.82	2.34	0.78	0.78
3.61	21.75	40.70	3.30	134.19	2.54	0.83	0.83
3.69	16.35	30.49	4.93	150.38	2.72	3.27	5.19
3.77	14.45	26.89	5.59	150.26	2.78	3.08	4.49
3.85	13.28	24.67	5.93	146.25	2.81	2.40	4.03
3.94	12.87	23.89	5.93	141.63	2.81	2.39	3.83

:: Strength loss calculation (Robertson (2009)) :: (continued)							
Depth (ft)	q _t (tsf)	Q _{tn}	K _c	Q _{tn,cs}	I _c	S _{u(liq)} /σ' _v	S _{u(peak)} /σ' _v
4.02	12.58	23.32	6.24	145.60	2.83	2.41	3.68
4.10	11.87	21.98	6.87	151.08	2.88	2.53	3.43
4.18	10.69	19.73	7.99	157.64	2.95	2.56	3.06
4.27	9.49	17.46	9.30	162.32	3.03	2.57	2.68
4.35	8.71	15.98	10.23	163.41	3.08	2.54	2.44
4.43	8.54	15.65	10.19	159.37	3.08	2.40	2.37
4.51	8.61	15.77	9.73	153.47	3.05	2.14	2.37
4.59	8.75	16.03	9.34	149.78	3.03	2.04	2.39
4.68	8.83	16.16	9.35	151.18	3.03	2.09	2.39
4.76	8.99	16.46	9.35	153.92	3.03	2.21	2.41
4.84	9.07	16.60	9.46	156.97	3.04	2.23	2.41
4.92	9.16	16.76	9.54	159.83	3.04	2.29	2.42
5.00	9.26	16.95	9.53	161.53	3.04	2.39	2.43
5.09	9.57	17.53	9.16	160.47	3.02	2.33	2.49
5.17	9.97	18.27	8.52	155.70	2.98	2.23	2.57
5.25	10.00	18.32	8.26	151.27	2.97	2.07	2.56
5.33	9.57	17.49	8.47	148.19	2.98	1.97	2.43
5.41	8.91	16.23	8.96	145.52	3.01	1.86	2.24
5.50	8.48	15.43	9.17	141.54	3.02	1.70	2.11
5.58	8.32	15.11	9.02	136.40	3.01	1.57	2.05
5.66	8.35	15.16	8.66	131.35	2.99	1.46	2.05
5.74	8.40	15.25	8.48	129.27	2.98	1.36	2.04
5.82	8.37	15.17	8.58	130.22	2.99	1.42	2.02
5.91	8.12	14.69	9.05	132.98	3.02	1.48	1.94
5.99	7.63	13.77	9.85	135.66	3.06	1.45	1.81
6.07	7.02	12.61	10.97	138.26	3.12	1.47	1.65
6.15	6.52	11.65	12.01	139.93	3.17	1.50	1.51
6.23	6.26	11.15	12.24	136.46	3.18	1.45	1.44
6.32	6.10	10.84	12.00	130.06	3.17	1.20	1.39
6.40	5.93	10.51	11.64	122.40	3.15	1.08	1.34
6.48	5.72	10.10	11.65	117.67	3.15	0.98	1.28
6.56	5.55	9.77	11.65	113.82	3.15	0.90	1.23
6.64	5.39	9.47	11.73	111.06	3.15	0.85	1.18
6.73	5.17	9.04	12.02	108.64	3.17	0.81	1.12
6.81	5.03	8.76	12.10	106.03	3.17	0.75	1.08
6.89	4.91	8.53	12.13	103.44	3.17	0.70	1.05
6.97	4.75	8.22	12.23	100.54	3.18	0.67	1.01
7.05	4.61	7.94	12.20	96.87	3.18	0.60	0.97
7.14	4.41	7.56	12.14	91.72	3.17	0.53	0.92
7.22	4.26	7.26	11.88	86.28	3.16	0.44	0.88
7.30	4.12	6.99	11.43	79.89	3.14	0.38	0.84
7.38	4.02	6.81	10.73	73.07	3.11	0.30	0.81
7.46	4.05	6.84	9.60	65.65	3.05	0.22	0.81
7.55	4.11	6.96	8.60	59.83	2.99	0.18	0.82
7.63	4.22	7.15	7.80	55.77	2.94	0.16	0.84
7.71	4.31	7.32	7.29	53.31	2.91	0.14	0.86
7.79	4.40	7.49	6.79	50.89	2.87	0.13	0.88
7.87	4.44	7.55	6.58	49.67	2.86	0.11	0.88

:: Strength loss calculation (Robertson (2009)) :: (continued)							
Depth (ft)	q _t (tsf)	Q _{tn}	K _c	Q _{tn,cs}	I _c	S _{u(liq)} /σ' _v	S _{u(peak)} /σ' _v
7.96	4.47	7.60	6.52	49.60	2.85	0.11	0.88
8.04	4.52	7.70	6.72	51.73	2.87	0.13	0.89
8.12	4.62	7.87	6.72	52.88	2.87	0.15	0.91
8.20	4.66	7.95	6.66	52.94	2.86	0.14	0.91
8.28	4.59	7.81	6.59	51.42	2.86	0.13	0.90
8.37	4.51	7.65	6.61	50.52	2.86	0.12	0.87
8.45	4.45	7.52	6.59	49.55	2.86	0.12	0.86
8.53	4.43	7.49	6.51	48.75	2.85	0.11	0.85
8.61	4.46	7.53	6.38	48.02	2.84	0.10	0.85
8.69	4.56	7.70	6.23	47.97	2.83	0.10	0.87
8.78	4.68	7.93	6.07	48.18	2.82	0.11	0.89
8.86	4.78	8.12	5.93	48.11	2.81	0.11	0.91
8.94	4.86	8.26	5.84	48.25	2.80	0.11	0.92
9.02	4.92	8.36	5.81	48.61	2.80	0.11	0.93
9.10	5.06	8.62	5.84	50.34	2.80	0.12	0.96
9.19	5.28	9.03	5.83	52.65	2.80	0.14	1.00
9.27	5.67	9.77	5.70	55.68	2.79	0.17	1.08
9.35	6.32	10.99	5.56	61.10	2.78	0.20	1.20
9.43	7.52	13.25	5.09	67.44	2.74	0.31	1.45
9.51	8.28	14.68	5.54	81.31	2.77	0.42	1.59
9.60	8.34	14.77	6.35	93.72	2.84	0.69	1.60
9.68	7.24	12.68	8.30	105.29	2.97	0.74	1.36
9.76	6.17	10.66	10.00	106.64	3.07	0.72	1.14
9.84	5.31	9.02	11.28	101.79	3.13	0.61	0.96
9.92	4.92	8.28	11.09	91.80	3.12	0.46	0.88
10.01	4.72	7.88	10.27	80.97	3.08	0.33	0.83
10.09	4.72	7.88	9.39	74.00	3.03	0.26	0.83
10.17	4.82	8.06	8.88	71.61	3.01	0.27	0.84
10.25	4.96	8.31	8.62	71.70	2.99	0.27	0.87
10.33	5.02	8.43	8.47	71.43	2.98	0.26	0.88
10.42	5.02	8.42	8.49	71.54	2.98	0.26	0.87
10.50	5.07	8.51	8.59	73.14	2.99	0.27	0.88
10.58	5.28	8.89	8.51	75.73	2.98	0.30	0.91
10.66	5.74	9.75	8.05	78.55	2.96	0.34	1.00
10.74	6.40	10.99	7.36	80.91	2.91	0.38	1.12
10.83	7.25	12.59	6.52	82.14	2.85	0.42	1.28
10.91	7.75	13.54	5.99	81.11	2.81	0.45	1.37
10.99	7.75	13.53	6.03	81.56	2.81	0.39	1.36
11.07	7.24	12.56	6.71	84.30	2.87	0.43	1.26
11.15	6.94	11.97	8.29	99.20	2.97	0.47	1.19
11.24	8.15	14.26	7.69	109.73	2.93	0.84	1.42
11.32	10.06	17.86	6.29	112.44	2.83	0.94	1.76
11.40	12.30	22.09	4.90	108.35	2.72	0.82	2.17
11.48	16.41	29.85	3.25	97.03	2.54	0.76	0.76
11.56	27.66	51.10	1.67	85.11	2.22	0.72	0.72
11.65	42.95	73.73	1.27	93.93	1.96	0.74	0.74
11.73	57.70	92.19	1.11	102.13	1.76	0.75	0.75
11.81	65.13	100.19	1.00	100.19	1.67	0.75	0.75

:: Strength loss calculation (Robertson (2009)) :: (continued)							
Depth (ft)	q _t (tsf)	Q _{tn}	K _c	Q _{tn,cs}	I _c	S _{u(liq)} /σ' _v	S _{u(peak)} /σ' _v
11.89	68.14	103.14	1.00	103.14	1.63	0.75	0.75
11.98	70.56	106.73	1.00	106.73	1.63	0.76	0.76
12.06	77.24	116.01	1.00	116.01	1.62	0.78	0.78
12.14	87.06	128.57	1.00	128.57	1.58	0.80	0.80
12.22	98.79	141.87	1.00	141.87	1.51	0.82	0.82
12.30	108.42	151.27	1.00	151.27	1.43	0.83	0.83
12.39	116.33	159.01	1.00	159.01	1.38	0.84	0.84
12.47	122.33	165.09	1.00	165.09	1.35	0.85	0.85
12.55	127.66	171.52	1.00	171.52	1.34	0.85	0.85
12.63	134.08	179.00	1.00	179.00	1.33	0.86	0.86
12.71	141.80	187.70	1.00	187.70	1.31	0.87	0.87
12.80	151.92	197.15	1.00	197.15	1.26	0.88	0.88
12.88	163.38	207.91	1.00	207.91	1.20	0.90	0.90
12.96	175.02	218.70	1.00	218.70	1.15	0.91	0.91
13.04	185.29	229.56	1.00	229.56	1.13	0.92	0.92
13.12	190.46	235.26	1.00	235.26	1.12	0.92	0.92
13.21	190.85	235.78	1.00	235.78	1.13	0.92	0.92
13.29	188.49	232.97	1.00	232.97	1.13	0.92	0.92
13.37	187.10	230.24	1.00	230.24	1.13	0.92	0.92
13.45	186.37	228.82	1.00	228.82	1.12	0.92	0.92
13.53	186.12	227.89	1.00	227.89	1.12	0.92	0.92
13.62	184.93	226.23	1.00	226.23	1.12	0.91	0.91
13.70	183.80	224.57	1.00	224.57	1.12	0.91	0.91
13.78	180.39	220.64	1.00	220.64	1.13	0.91	0.91
13.86	176.69	216.46	1.00	216.46	1.13	0.90	0.90
13.94	171.69	210.96	1.00	210.96	1.15	0.90	0.90
14.03	166.60	206.74	1.00	206.74	1.18	0.89	0.89
14.11	161.20	202.33	1.00	202.33	1.23	0.89	0.89
14.19	156.72	199.66	1.00	199.66	1.28	0.89	0.89
14.27	154.79	198.03	1.00	198.03	1.30	0.88	0.88
14.35	154.22	197.25	1.00	197.25	1.30	0.88	0.88
14.44	154.29	196.49	1.00	196.49	1.29	0.88	0.88
14.52	154.24	195.46	1.00	195.46	1.28	0.88	0.88
14.60	154.34	194.18	1.00	194.18	1.26	0.88	0.88
14.68	153.36	191.20	1.00	191.20	1.24	0.88	0.88
14.76	151.08	187.40	1.00	187.40	1.22	0.87	0.87
14.85	146.61	181.57	1.00	181.57	1.22	0.87	0.87
14.93	142.13	176.30	1.00	176.30	1.23	0.86	0.86
15.01	137.22	170.61	1.00	170.61	1.25	0.85	0.85
15.09	133.01	165.95	1.00	165.95	1.27	0.85	0.85
15.17	130.08	162.71	1.00	162.71	1.28	0.84	0.84
15.26	128.45	161.68	1.00	161.68	1.30	0.84	0.84
15.34	129.50	163.72	1.00	163.72	1.32	0.84	0.84
15.42	130.21	166.31	1.00	166.31	1.36	0.85	0.85
15.50	128.87	165.90	1.00	165.90	1.39	0.85	0.85
15.58	124.78	161.06	1.00	161.06	1.41	0.84	0.84
15.67	119.34	154.29	1.00	154.29	1.42	0.83	0.83
15.75	113.42	146.64	1.00	146.64	1.43	0.82	0.82

:: Strength loss calculation (Robertson (2009)) :: (continued)							
Depth (ft)	q _t (tsf)	Q _{tn}	K _c	Q _{tn,cs}	I _c	S _{u(liq)} /σ' _v	S _{u(peak)} /σ' _v
15.83	109.42	142.77	1.00	142.77	1.47	0.82	0.82
15.91	107.96	141.06	1.00	141.06	1.48	0.81	0.81
15.99	110.80	143.49	1.00	143.49	1.45	0.82	0.82
16.08	116.89	148.73	1.00	148.73	1.40	0.83	0.83
16.16	128.19	159.68	1.00	159.68	1.33	0.84	0.84
16.24	145.29	177.27	1.00	177.27	1.25	0.86	0.86
16.32	164.17	196.71	1.00	196.71	1.19	0.88	0.88
16.40	177.76	210.53	1.00	210.53	1.15	0.90	0.90
16.49	187.19	220.35	1.00	220.35	1.13	0.91	0.91
16.57	190.04	223.60	1.00	223.60	1.13	0.91	0.91
16.65	190.52	224.31	1.00	224.31	1.14	0.91	0.91
16.73	187.42	220.92	1.00	220.92	1.15	0.91	0.91
16.81	188.25	224.34	1.00	224.34	1.20	0.91	0.91
16.90	191.63	228.51	1.00	228.51	1.20	0.92	0.92
16.98	192.15	228.87	1.00	228.87	1.20	0.92	0.92
17.06	189.36	223.21	1.00	223.21	1.17	0.91	0.91
17.14	182.22	214.71	1.00	214.71	1.17	0.90	0.90
17.22	168.28	200.83	1.00	200.83	1.23	0.89	0.89
17.31	144.39	177.82	1.00	177.82	1.35	0.86	0.86
17.39	113.53	147.79	1.00	147.79	1.58	0.82	0.82
17.47	85.10	117.92	1.19	140.05	1.83	0.81	0.81
17.55	59.63	87.67	1.41	123.30	2.09	0.79	0.79
17.63	42.45	65.40	1.96	128.21	2.31	0.80	0.80
17.72	29.33	47.01	3.10	145.70	2.52	0.82	0.82
17.80	22.07	36.21	4.36	157.81	2.67	1.75	2.78
17.88	19.97	32.83	4.78	157.00	2.71	1.51	2.49
17.96	25.28	40.13	3.29	132.10	2.54	0.83	0.83
18.04	36.27	54.95	2.01	110.66	2.32	0.77	0.77
18.13	58.63	83.74	1.36	113.96	2.06	0.77	0.77
18.21	90.22	122.28	1.18	144.76	1.83	0.82	0.82
18.29	120.62	157.44	1.00	157.44	1.68	0.84	0.84
18.37	134.83	172.52	1.00	172.52	1.60	0.86	0.86
18.45	132.86	168.61	1.00	168.61	1.57	0.85	0.85
18.54	126.09	160.11	1.00	160.11	1.59	0.84	0.84
18.62	120.18	153.43	1.00	153.43	1.62	0.83	0.83
18.70	117.24	150.79	1.00	150.79	1.66	0.83	0.83
18.78	116.34	149.68	1.00	149.68	1.67	0.83	0.83
18.86	114.70	147.30	1.00	147.30	1.67	0.82	0.82
18.95	111.45	143.38	1.00	143.38	1.69	0.82	0.82
19.03	107.65	139.58	1.06	147.32	1.73	0.82	0.82
19.11	103.55	135.39	1.13	153.05	1.78	0.83	0.83
19.19	97.49	128.88	1.19	153.96	1.84	0.83	0.83
19.27	88.68	118.68	1.24	147.72	1.91	0.82	0.82
19.36	77.40	104.18	1.27	132.80	1.96	0.80	0.80
19.44	66.76	89.73	1.28	115.29	1.97	0.78	0.78
19.52	60.77	80.25	1.24	99.76	1.91	0.75	0.75
19.60	55.40	73.08	1.25	91.47	1.92	0.73	0.73
19.69	44.91	60.34	1.34	80.89	2.04	0.63	0.71

:: Strength loss calculation (Robertson (2009)) :: (continued)							
Depth (ft)	q _t (tsf)	Q _{tn}	K _c	Q _{tn,cs}	I _c	S _{u(liq)} /σ' _v	S _{u(peak)} /σ' _v
19.77	30.90	43.16	1.84	79.36	2.28	0.55	0.71
19.85	18.95	27.44	3.45	94.61	2.56	0.78	0.78
19.93	14.06	20.63	5.10	105.30	2.74	0.60	1.54
20.01	11.03	16.20	6.74	109.11	2.87	0.62	1.18
20.10	9.85	14.33	7.24	103.74	2.90	0.51	1.03
20.18	9.65	13.84	6.66	92.16	2.86	0.35	1.01
20.26	11.41	16.14	4.87	78.50	2.71	0.31	1.21
20.34	15.23	21.37	3.45	73.75	2.56	0.73	0.73
20.42	17.22	24.08	3.11	74.97	2.52	0.44	0.70
20.51	16.55	23.22	3.43	79.64	2.56	0.74	0.74
20.59	13.02	18.37	4.69	86.04	2.70	0.40	1.38
20.67	10.34	14.59	6.31	92.10	2.84	0.40	1.06
20.75	8.61	12.07	7.93	95.73	2.95	0.41	0.86
20.83	7.70	10.56	8.64	91.22	2.99	0.36	0.75
20.92	7.59	10.32	7.66	79.03	2.93	0.24	0.74
21.00	7.69	10.26	6.36	65.30	2.84	0.14	0.75
21.08	7.63	10.05	5.79	58.20	2.80	0.12	0.74
21.16	7.52	9.85	5.77	56.83	2.79	0.12	0.72
21.24	7.44	9.72	5.84	56.78	2.80	0.12	0.71
21.33	7.41	9.65	5.85	56.40	2.80	0.12	0.71
21.41	7.40	9.60	5.84	56.08	2.80	0.11	0.71
21.49	7.40	9.58	5.82	55.73	2.80	0.11	0.70
21.57	7.45	9.61	5.75	55.28	2.79	0.11	0.71
21.65	7.54	9.71	5.67	55.06	2.79	0.11	0.71
21.74	7.69	9.90	5.53	54.80	2.77	0.11	0.73
21.82	7.99	10.28	5.28	54.33	2.75	0.11	0.76
21.90	8.16	10.49	5.13	53.82	2.74	0.11	0.78
21.98	8.23	10.55	5.09	53.67	2.74	0.11	0.78
22.06	8.03	10.26	5.24	53.78	2.75	0.11	0.76
22.15	7.76	9.87	5.48	54.04	2.77	0.11	0.73
22.23	7.42	9.37	5.78	54.14	2.79	0.10	0.69
22.31	7.25	9.11	5.96	54.30	2.81	0.10	0.67
22.39	7.22	9.06	6.01	54.47	2.81	0.10	0.66
22.47	7.32	9.18	5.96	54.68	2.81	0.10	0.67
22.56	7.43	9.30	5.82	54.09	2.80	0.11	0.68
22.64	7.55	9.47	5.99	56.69	2.81	0.10	0.69
22.72	7.77	9.81	6.23	61.13	2.83	0.14	0.71
22.80	8.27	10.55	6.29	66.41	2.83	0.18	0.77
22.88	8.73	11.18	6.14	68.60	2.82	0.20	0.82
22.97	9.20	11.80	5.85	68.99	2.80	0.20	0.86
23.05	9.14	11.71	6.01	70.45	2.81	0.21	0.86
23.13	9.05	11.53	5.94	68.48	2.81	0.22	0.84
23.21	8.85	11.17	5.69	63.54	2.79	0.16	0.82
23.29	8.89	11.08	5.03	55.74	2.73	0.11	0.82
23.38	8.86	10.96	4.75	52.10	2.70	0.10	0.82
23.46	8.80	10.85	4.75	51.58	2.70	0.11	0.81
23.54	8.73	10.74	4.84	51.95	2.71	0.10	0.80
23.62	8.46	10.37	5.06	52.50	2.73	0.10	0.77

:: Strength loss calculation (Robertson (2009)) :: (continued)							
Depth (ft)	q _t (tsf)	Q _{tn}	K _c	Q _{tn,cs}	I _c	S _{u(liq)} /σ' _v	S _{u(peak)} /σ' _v
23.70	8.24	10.05	5.27	52.98	2.75	0.10	0.74
23.79	7.95	9.65	5.53	53.36	2.77	0.10	0.71
23.87	7.94	9.61	5.52	53.05	2.77	0.10	0.71
23.95	7.80	9.38	5.62	52.70	2.78	0.10	0.69
24.03	7.66	9.18	5.70	52.30	2.79	0.09	0.67
24.11	7.57	9.02	5.72	51.58	2.79	0.09	0.66
24.20	7.58	9.02	5.71	51.44	2.79	0.09	0.66
24.28	7.64	9.08	5.64	51.19	2.78	0.09	0.66
24.36	7.75	9.20	5.60	51.53	2.78	0.09	0.67
24.44	7.92	9.42	5.57	52.50	2.78	0.09	0.69
24.52	8.28	9.88	5.42	53.59	2.76	0.11	0.73
24.61	8.69	10.43	5.22	54.46	2.75	0.11	0.77
24.69	8.87	10.64	5.15	54.78	2.74	0.12	0.78
24.77	8.93	10.73	5.34	57.29	2.76	0.12	0.79
24.85	8.91	10.84	6.68	72.39	2.86	0.15	0.78
24.93	10.00	12.38	6.77	83.84	2.87	0.37	0.89
25.02	12.51	15.85	6.33	100.30	2.84	0.40	1.15
25.10	15.89	20.31	5.27	107.09	2.75	0.70	1.49
25.18	31.27	39.53	2.48	97.94	2.42	0.74	0.74
25.26	76.44	91.55	1.25	114.76	1.93	0.77	0.77
25.34	147.95	168.57	1.00	168.57	1.56	0.85	0.85
25.43	221.18	244.78	1.00	244.78	1.37	0.93	0.93
25.51	272.75	296.92	1.00	296.92	1.26	0.98	0.98
25.59	303.58	331.08	1.00	331.08	1.28	1.00	1.00
25.67	321.41	349.06	1.00	349.06	1.26	1.01	1.01
25.75	338.01	367.49	1.00	367.49	1.27	1.03	1.03
25.84	347.73	379.17	1.00	379.17	1.30	1.03	1.03
25.92	359.17	392.70	1.00	392.70	1.33	1.04	1.04
26.00	354.72	388.31	1.00	388.31	1.35	1.04	1.04
26.08	347.51	377.64	1.00	377.64	1.31	1.03	1.03
26.16	334.14	360.51	1.00	360.51	1.27	1.02	1.02
26.25	325.43	347.82	1.00	347.82	1.21	1.01	1.01
26.33	317.10	334.90	1.00	334.90	1.13	1.00	1.00
26.41	308.39	325.86	1.00	325.86	1.14	1.00	1.00
26.49	303.51	322.56	1.00	322.56	1.19	1.00	1.00
26.57	301.09	323.64	1.00	323.64	1.29	1.00	1.00
26.66	305.45	327.48	1.00	327.48	1.28	1.00	1.00
26.74	297.99	319.37	1.00	319.37	1.29	0.99	0.99
26.82	295.63	316.23	1.00	316.23	1.28	0.99	0.99
26.90	286.58	308.02	1.00	308.02	1.33	0.98	0.98
26.98	290.29	310.27	1.00	310.27	1.29	0.99	0.99
27.07	288.84	306.07	1.00	306.07	1.24	0.98	0.98
27.15	290.63	303.68	1.00	303.68	1.13	0.98	0.98
27.23	289.61	300.88	1.00	300.88	1.10	0.98	0.98
27.31	284.08	294.62	1.00	294.62	1.09	0.97	0.97
27.40	278.93	289.94	1.00	289.94	1.12	0.97	0.97
27.48	275.24	286.41	1.00	286.41	1.13	0.97	0.97
27.56	276.25	288.40	1.00	288.40	1.17	0.97	0.97

:: Strength loss calculation (Robertson (2009)) :: (continued)							
Depth (ft)	q _t (tsf)	Q _{tn}	K _c	Q _{tn,cs}	I _c	S _{u(liq)} /σ' _v	S _{u(peak)} /σ' _v
27.64	273.29	286.38	1.00	286.38	1.21	0.97	0.97
27.72	273.94	286.95	1.00	286.95	1.22	0.97	0.97
27.81	274.81	286.16	1.00	286.16	1.17	0.97	0.97
27.89	279.57	289.84	1.00	289.84	1.14	0.97	0.97
27.97	279.55	289.15	1.00	289.15	1.13	0.97	0.97
28.05	279.48	288.97	1.00	288.97	1.14	0.97	0.97
28.13	278.68	287.56	1.00	287.56	1.13	0.97	0.97
28.22	275.11	283.18	1.00	283.18	1.11	0.96	0.96
28.30	270.40	279.20	1.00	279.20	1.15	0.96	0.96
28.38	267.51	277.94	1.00	277.94	1.22	0.96	0.96
28.46	269.19	282.07	1.00	282.07	1.31	0.96	0.96
28.54	267.45	281.87	1.00	281.87	1.37	0.96	0.96
28.63	264.31	278.52	1.00	278.52	1.38	0.96	0.96
28.71	259.63	272.38	1.00	272.38	1.36	0.96	0.96
28.79	255.57	266.49	1.00	266.49	1.31	0.95	0.95
28.87	260.50	270.90	1.00	270.90	1.29	0.95	0.95
28.95	261.38	273.84	1.00	273.84	1.38	0.96	0.96
29.04	272.23	286.73	1.00	286.73	1.44	0.97	0.97
29.12	268.23	283.55	1.00	283.55	1.50	0.96	0.96
29.20	262.12	275.59	1.00	275.59	1.46	0.96	0.96
29.28	246.20	257.03	1.00	257.03	1.40	0.94	0.94
29.36	239.04	246.49	1.00	246.49	1.29	0.93	0.93
29.45	239.44	245.78	1.00	245.78	1.25	0.93	0.93
29.53	253.30	258.42	1.00	258.42	1.19	0.94	0.94
29.61	271.51	278.14	1.00	278.14	1.24	0.96	0.96
29.69	294.18	302.44	1.00	302.44	1.29	0.98	0.98
29.77	312.56	322.58	1.00	322.58	1.34	1.00	1.00
29.86	331.69	342.85	1.00	342.85	1.37	1.01	1.01
29.94	346.14	357.61	1.00	357.61	1.38	1.02	1.02
30.02	365.08	376.88	1.00	376.88	1.38	1.03	1.03
30.10	381.24	392.88	1.00	392.88	1.37	1.04	1.04
30.18	391.80	402.44	1.00	402.44	1.35	1.05	1.05
30.27	398.98	408.27	1.00	408.27	1.32	1.05	1.05
30.35	401.66	408.68	1.00	408.68	1.26	1.05	1.05
30.43	414.40	419.33	1.00	419.33	1.21	1.06	1.06
30.51	426.09	431.02	1.00	431.02	1.22	1.07	1.07
30.59	436.33	444.27	1.00	444.27	1.31	1.07	1.07
30.68	462.98	473.33	1.00	473.33	1.38	1.09	1.09
30.76	485.08	496.67	1.00	496.67	1.42	1.10	1.10
30.84	496.55	506.72	1.00	506.72	1.39	1.11	1.11
30.92	486.98	496.11	1.00	496.11	1.39	1.10	1.10
31.00	483.72	490.89	1.00	490.89	1.36	1.10	1.10
31.09	489.21	494.59	1.00	494.59	1.32	1.10	1.10
31.17	512.03	513.19	1.00	513.19	1.21	1.11	1.11
31.25	527.67	525.94	1.00	525.94	1.14	1.12	1.12
31.33	547.71	544.85	1.00	544.85	1.12	1.13	1.13
31.41	554.37	550.07	1.00	550.07	1.10	1.13	1.13
31.50	542.38	537.70	1.00	537.70	1.10	1.13	1.13

:: Strength loss calculation (Robertson (2009)) :: (continued)							
Depth (ft)	q _t (tsf)	Q _{tn}	K _c	Q _{tn,cs}	I _c	S _{u(liq)} /σ' _v	S _{u(peak)} /σ' _v
31.58	530.13	526.00	1.00	526.00	1.13	1.12	1.12
31.66	533.19	530.55	1.00	530.55	1.20	1.12	1.12
31.74	509.71	507.55	1.00	507.55	1.23	1.11	1.11
31.82	489.37	484.66	1.00	484.66	1.16	1.10	1.10
31.91	441.30	441.08	1.00	441.08	1.35	1.07	1.07
31.99	453.05	453.68	1.00	453.68	1.40	1.08	1.08
32.07	475.30	476.72	1.00	476.72	1.46	1.09	1.09
32.15	520.78	519.38	1.00	519.38	1.37	1.12	1.12
32.23	546.69	544.13	1.00	544.13	1.35	1.13	1.13
32.32	577.36	572.96	1.00	572.96	1.32	1.14	1.14
32.40	557.93	552.57	1.00	552.57	1.30	1.13	1.13
32.48	518.03	513.85	1.00	513.85	1.37	1.11	1.11
32.56	440.67	437.89	1.00	437.89	1.45	1.07	1.07
32.64	395.68	393.13	1.00	393.13	1.49	1.04	1.04
32.73	373.89	368.70	1.00	368.70	1.35	1.03	1.03
32.81	393.80	385.79	1.00	385.79	1.22	1.04	1.04
32.89	410.46	400.50	1.00	400.50	1.15	1.05	1.05
32.97	423.75	414.41	1.00	414.41	1.22	1.06	1.06
33.05	447.80	439.08	1.00	439.08	1.31	1.07	1.07
33.14	490.69	482.16	1.00	482.16	1.39	1.10	1.10
33.22	539.15	529.49	1.00	529.49	1.40	1.12	1.12
33.30	550.82	541.18	1.00	541.18	1.45	1.13	1.13
33.38	547.41	537.81	1.00	537.81	1.49	1.13	1.13
33.46	514.85	505.37	1.00	505.37	1.51	1.11	1.11
33.55	466.95	458.21	1.00	458.21	1.56	1.08	1.08
33.63	432.70	423.59	1.00	423.59	1.55	1.06	1.06
33.71	405.29	396.27	1.00	396.27	1.57	1.05	1.05
33.79	397.55	387.61	1.00	387.61	1.52	1.04	1.04
33.87	382.48	372.62	1.00	372.62	1.55	1.03	1.03
33.96	386.38	376.06	1.00	376.06	1.57	1.03	1.03
34.04	397.16	385.75	1.00	385.75	1.55	1.04	1.04
34.12	410.46	397.60	1.00	397.60	1.49	1.05	1.05
34.20	440.27	424.96	1.00	424.96	1.38	1.06	1.06
34.28	461.91	444.55	1.00	444.55	1.29	1.07	1.07
34.37	457.97	439.88	1.00	439.88	1.25	1.07	1.07
34.45	410.83	394.66	1.00	394.66	1.34	1.04	1.04
34.53	362.28	348.28	1.00	348.28	1.48	1.01	1.01
34.61	322.49	310.05	1.00	310.05	1.60	0.99	0.99
34.69	303.32	291.32	1.00	291.32	1.65	0.97	0.97
34.78	284.42	272.74	1.00	272.74	1.67	0.96	0.96
34.86	274.78	262.85	1.00	262.85	1.62	0.95	0.95
34.94	278.06	265.44	1.00	265.44	1.56	0.95	0.95
35.02	277.18	264.16	1.00	264.16	1.54	0.95	0.95
35.10	277.04	263.72	1.00	263.72	1.56	0.95	0.95
35.19	271.79	258.18	1.00	258.18	1.50	0.94	0.94
35.27	271.98	257.68	1.00	257.68	1.34	0.94	0.94
35.35	273.99	259.10	1.00	259.10	1.22	0.94	0.94
35.43	283.73	268.20	1.00	268.20	1.25	0.95	0.95

:: Strength loss calculation (Robertson (2009)) :: (continued)							
Depth (ft)	q _t (tsf)	Q _{tn}	K _c	Q _{tn,cs}	I _c	S _{u(liq)} /σ' _v	S _{u(peak)} /σ' _v
35.52	287.59	271.74	1.00	271.74	1.32	0.95	0.95
35.60	285.68	269.74	1.00	269.74	1.39	0.95	0.95
35.68	286.47	270.23	1.00	270.23	1.41	0.95	0.95
35.76	308.09	290.49	1.00	290.49	1.47	0.97	0.97
35.84	340.67	321.02	1.00	321.02	1.49	0.99	0.99
35.93	379.43	357.29	1.00	357.29	1.48	1.02	1.02
36.01	408.13	383.96	1.00	383.96	1.44	1.04	1.04
36.09	421.42	396.01	1.00	396.01	1.48	1.05	1.05
36.17	409.34	384.09	1.00	384.09	1.49	1.04	1.04
36.25	395.37	370.34	1.00	370.34	1.57	1.03	1.03
36.34	389.54	364.44	1.00	364.44	1.50	1.02	1.02
36.42	378.60	353.66	1.00	353.66	1.51	1.02	1.02
36.50	363.00	338.69	1.00	338.69	1.46	1.01	1.01
36.58	335.19	311.98	1.00	311.98	1.55	0.99	0.99
36.66	338.85	314.81	1.00	314.81	1.62	0.99	0.99
36.75	344.05	319.11	1.00	319.11	1.65	0.99	0.99
36.83	380.68	353.00	1.00	353.00	1.59	1.02	1.02
36.91	394.90	366.08	1.00	366.08	1.51	1.03	1.03
36.99	366.64	339.31	1.00	339.31	1.51	1.01	1.01
37.07	360.64	333.35	1.00	333.35	1.50	1.00	1.00
37.16	366.79	338.42	1.00	338.42	1.54	1.01	1.01
37.24	437.35	403.79	1.00	403.79	1.47	1.05	1.05
37.32	416.12	383.31	1.00	383.31	1.52	1.04	1.04
37.40	383.12	352.15	1.00	352.15	1.54	1.02	1.02
37.48	317.72	290.37	1.02	296.23	1.72	0.97	0.97
37.57	318.89	290.62	1.13	328.50	1.78	1.00	1.00
37.65	344.64	313.57	1.16	364.11	1.81	1.02	1.02
37.73	366.21	332.80	1.16	384.53	1.80	1.04	1.04
37.81	393.61	357.33	1.15	409.61	1.79	1.05	1.05
37.89	405.97	367.89	1.16	427.88	1.81	1.06	1.06
37.98	460.10	417.51	1.01	423.75	1.71	1.06	1.06
38.06	398.67	360.52	1.10	395.93	1.76	1.05	1.05
38.14	340.53	306.99	1.13	346.71	1.78	1.01	1.01
38.22	263.09	235.36	1.26	296.22	1.93	0.97	0.97
38.30	250.57	223.50	1.28	285.04	1.96	0.97	0.97
38.39	221.28	196.33	1.34	263.73	2.04	0.95	0.95
38.47	170.86	150.17	1.59	238.04	2.19	0.92	0.92
38.55	145.32	126.83	1.83	232.23	2.27	0.92	0.92
38.63	125.32	108.65	2.09	226.81	2.34	0.91	0.91
38.71	117.25	101.31	2.09	212.08	2.34	0.90	0.90
38.80	109.77	94.52	2.11	199.21	2.34	0.89	0.89
38.88	104.97	90.14	2.07	186.71	2.34	0.87	0.87
38.96	100.07	85.66	2.09	179.28	2.34	0.86	0.86
39.04	97.58	83.32	2.08	173.36	2.34	0.86	0.86
39.12	96.80	82.50	2.06	169.78	2.33	0.85	0.85
39.21	95.23	80.94	2.10	169.67	2.34	0.85	0.85
39.29	94.41	79.96	2.25	180.09	2.38	0.86	0.86
39.37	94.78	80.07	2.34	187.55	2.39	0.87	0.87


:: Strength loss calculation (Robertson (2009)) :: (continued)

Depth (ft)	q_t (tsf)	Q_{tn}	K_c	$Q_{tn,cs}$	I_c	$S_{u(liq)}/\sigma'_v$	$S_{u(peak)}/\sigma'_v$
39.45	103.02	87.16	2.16	188.03	2.36	0.87	0.87
39.53	127.96	109.20	1.64	179.07	2.21	0.86	0.86
39.62	165.69	142.81	1.34	191.20	2.03	0.88	0.88
39.70	197.23	171.11	1.24	211.86	1.90	0.90	0.90
39.78	205.23	178.20	1.21	215.24	1.86	0.90	0.90
39.86	188.91	163.15	1.25	204.17	1.92	0.89	0.89
39.94	164.19	140.65	1.33	186.52	2.02	0.87	0.87
40.03	142.03	120.58	1.46	176.23	2.13	0.86	0.86
40.11	123.98	104.36	1.65	172.65	2.22	0.86	0.86
40.19	112.12	93.66	1.89	177.34	2.29	0.86	0.86
40.27	105.38	87.55	2.06	180.76	2.33	0.87	0.87
40.35	107.61	89.40	1.95	174.50	2.31	0.86	0.86
40.44	116.06	96.73	1.73	167.16	2.24	0.85	0.85
40.52	122.36	102.18	1.60	163.06	2.19	0.84	0.84
40.60	121.38	101.13	1.61	162.98	2.20	0.84	0.84
40.68	110.70	91.54	1.81	165.25	2.27	0.85	0.85
40.76	100.73	82.65	2.07	171.26	2.34	0.85	0.85
40.85	95.90	78.31	2.20	172.51	2.37	0.86	0.86
40.93	97.43	79.55	2.10	166.94	2.34	0.85	0.85
41.01	99.31	81.12	1.96	159.10	2.31	0.84	0.84
41.09	100.12	81.72	1.91	155.99	2.30	0.83	0.83
41.17	96.73	78.63	2.00	156.92	2.32	0.84	0.84
41.26	91.97	74.38	2.14	159.42	2.35	0.84	0.84
41.34	88.45	71.24	2.23	158.67	2.37	0.84	0.84
41.42	92.99	74.47	2.67	198.85	2.45	0.89	0.89
41.50	103.92	83.04	2.97	246.95	2.50	0.93	0.93
41.58	116.20	92.61	3.30	305.89	2.54	1.01	1.01
41.67	125.32	100.88	2.30	231.58	2.38	0.92	0.92
41.75	264.42	224.57	1.00	224.57	1.70	0.91	0.91
41.83	406.50	320.45	1.00	320.45	-1.00	0.99	0.99
41.91	568.35	448.44	1.00	448.44	-1.00	1.08	1.08
41.99	595.38	469.48	1.00	469.48	-1.00	1.09	1.09


Abbreviations

- q_t : Total cone resistance
- K_c : Cone resistance correction factor due to fines
- $Q_{tn,cs}$: Adjusted and corrected cone resistance due to fines
- I_c : Soil behavior type index
- $S_{u(liq)}/\sigma'_v$: Calculated liquefied undrained strength ratio
- $S_{u(peak)}/\sigma'_v$: Calculated peak undrained strength ratio

Aging Calculation Estimation

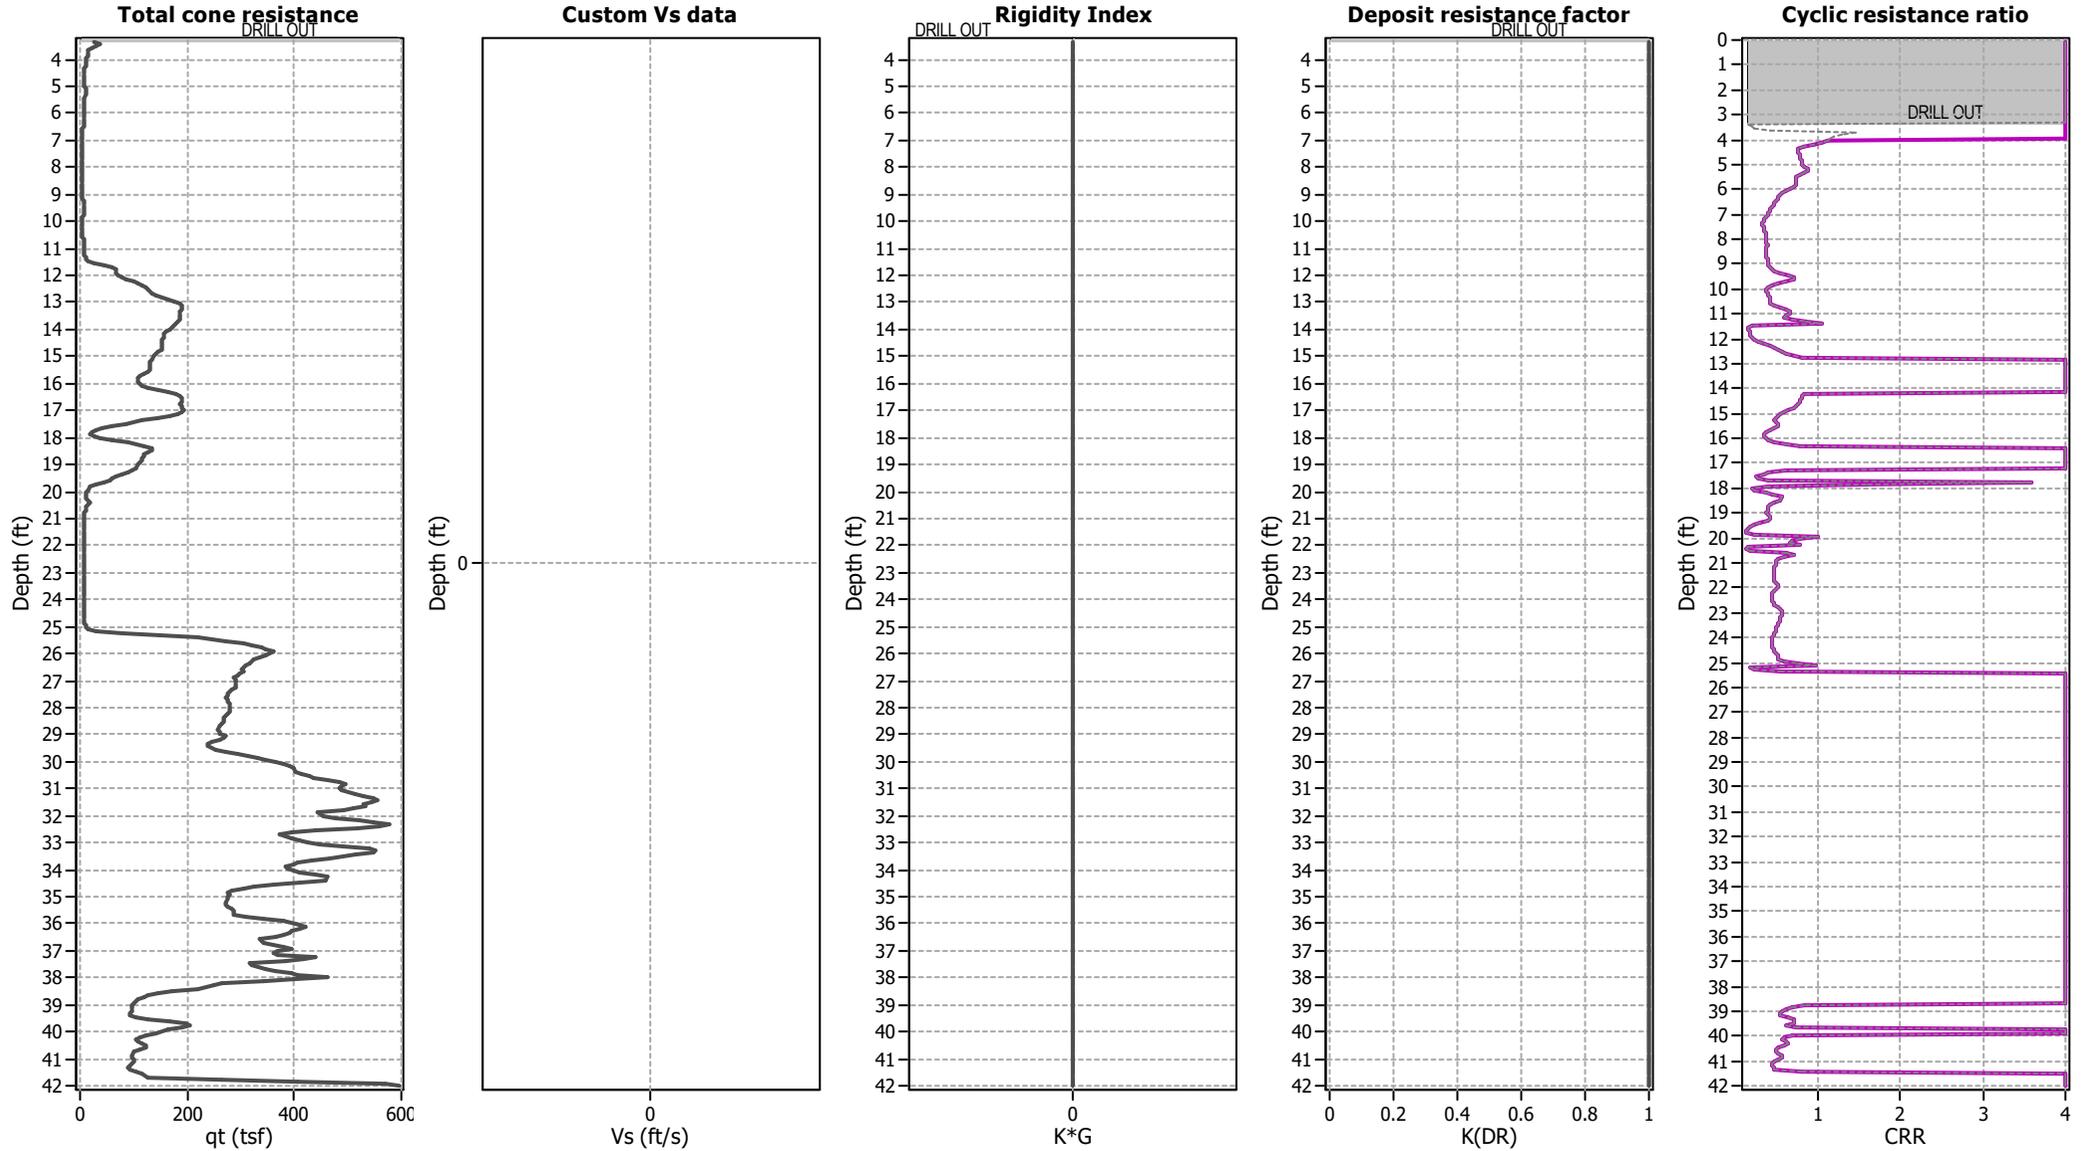

Ejecta Severity Estimation

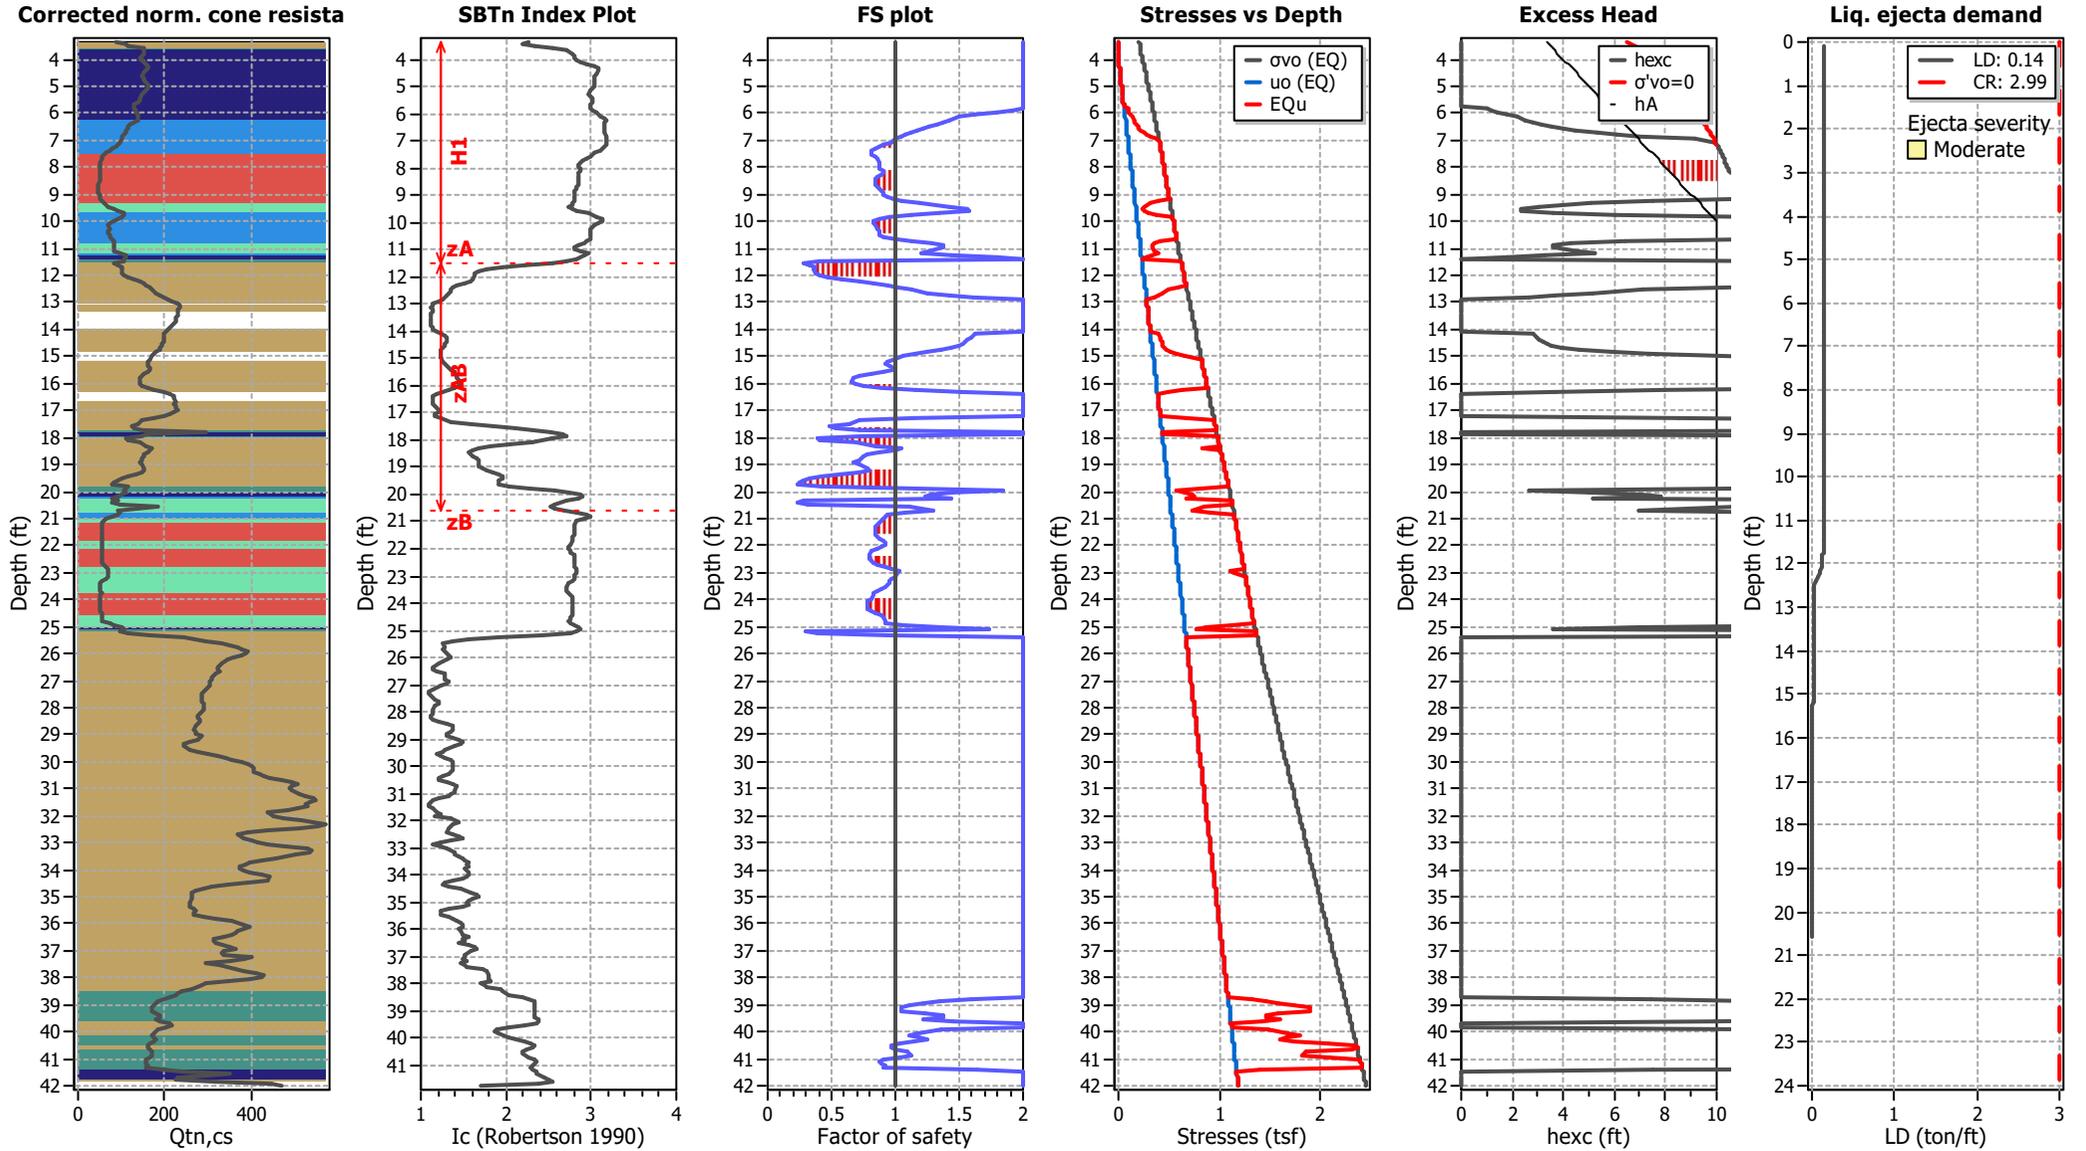




LIQUEFACTION ANALYSIS REPORT

Project title : Fire Station #32 - Site Evaluation
CPT file : CPT-2


Location : 19959 Oaks St, Monroe, WA

Input parameters and analysis data

Analysis method:	Robertson (2009)	G.W.T. (in-situ):	4.00 ft	Use fill:	No	Clay like behavior applied:	All soils
Fines correction method:	Robertson (2009)	G.W.T. (earthq.):	4.00 ft	Fill height:	N/A	Limit depth applied:	No
Points to test:	Based on Ic value	Average results interval:	3	Fill weight:	N/A	Limit depth:	N/A
Earthquake magnitude M_w :	7.10	Ic cut-off value:	2.60	Trans. detect. applied:	No	MSF method:	Method based
Peak ground acceleration:	0.54	Unit weight calculation:	Based on SBT	K_o applied:	No		

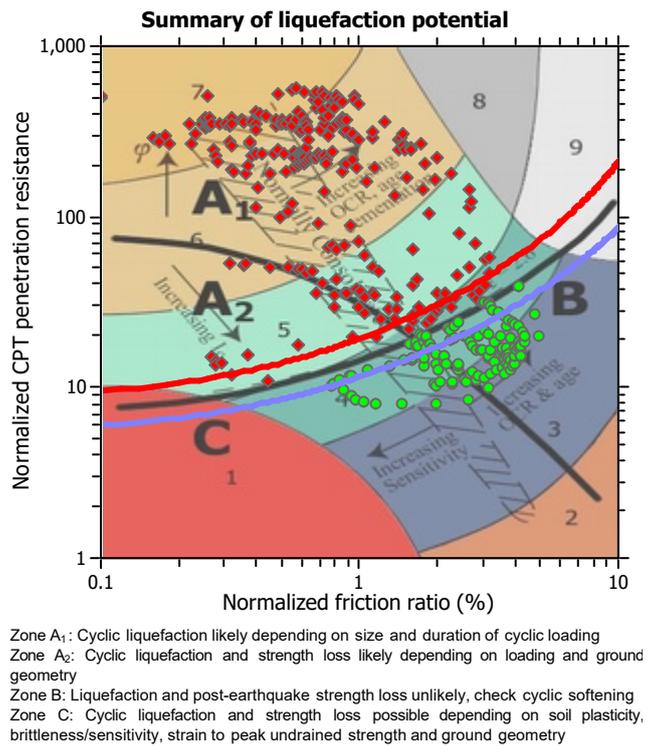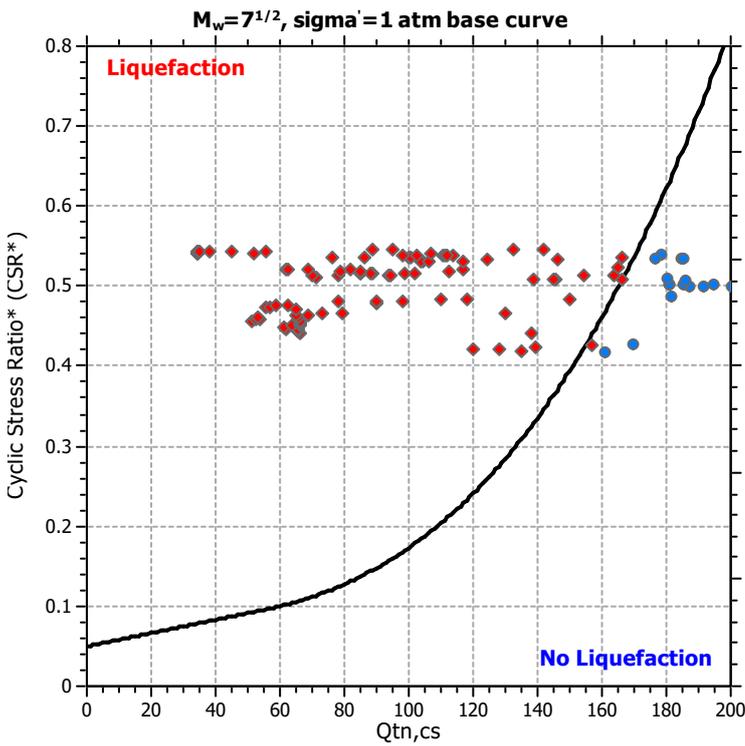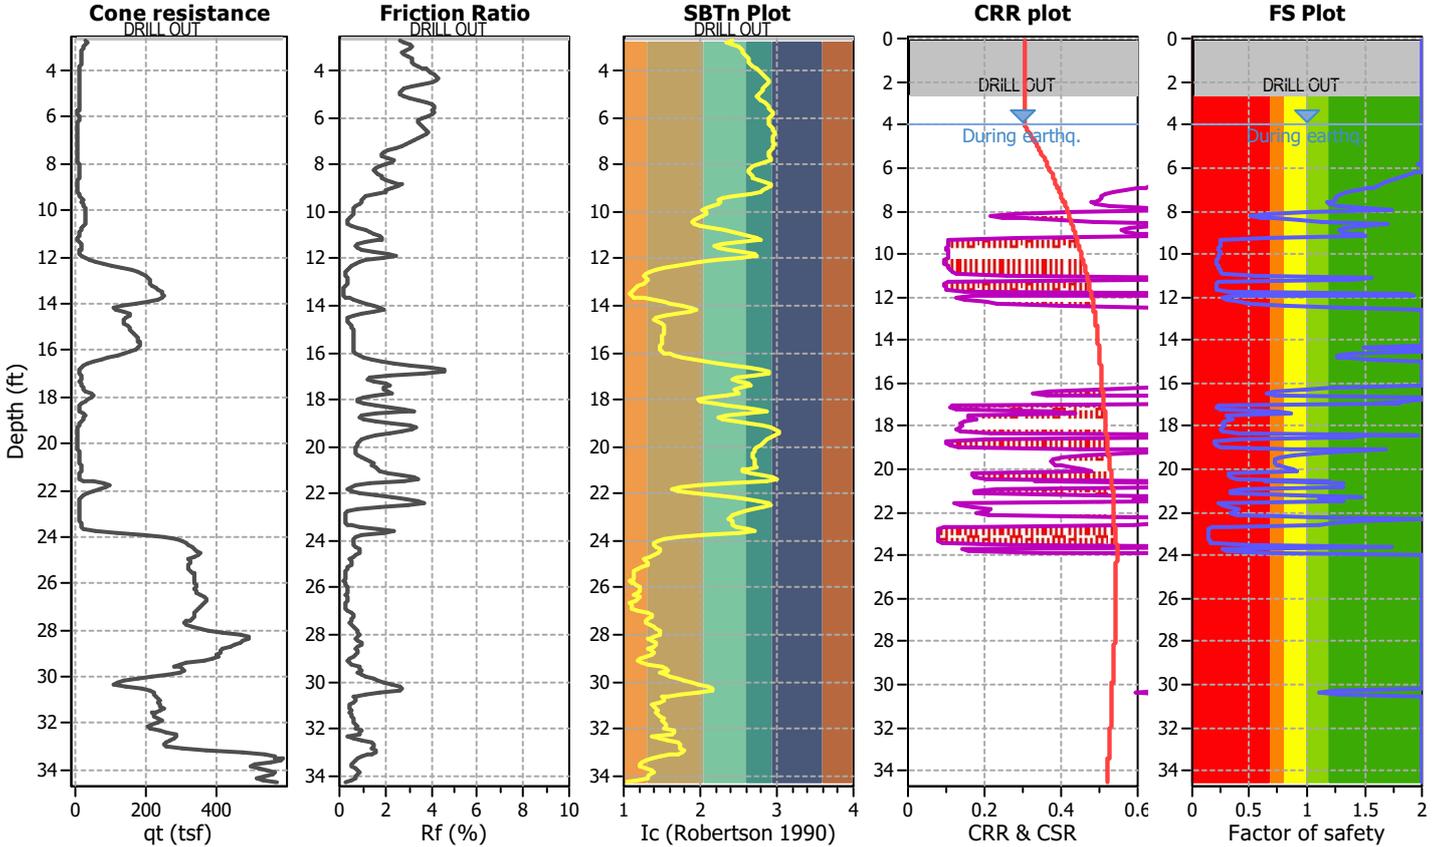

CPT basic interpretation plots

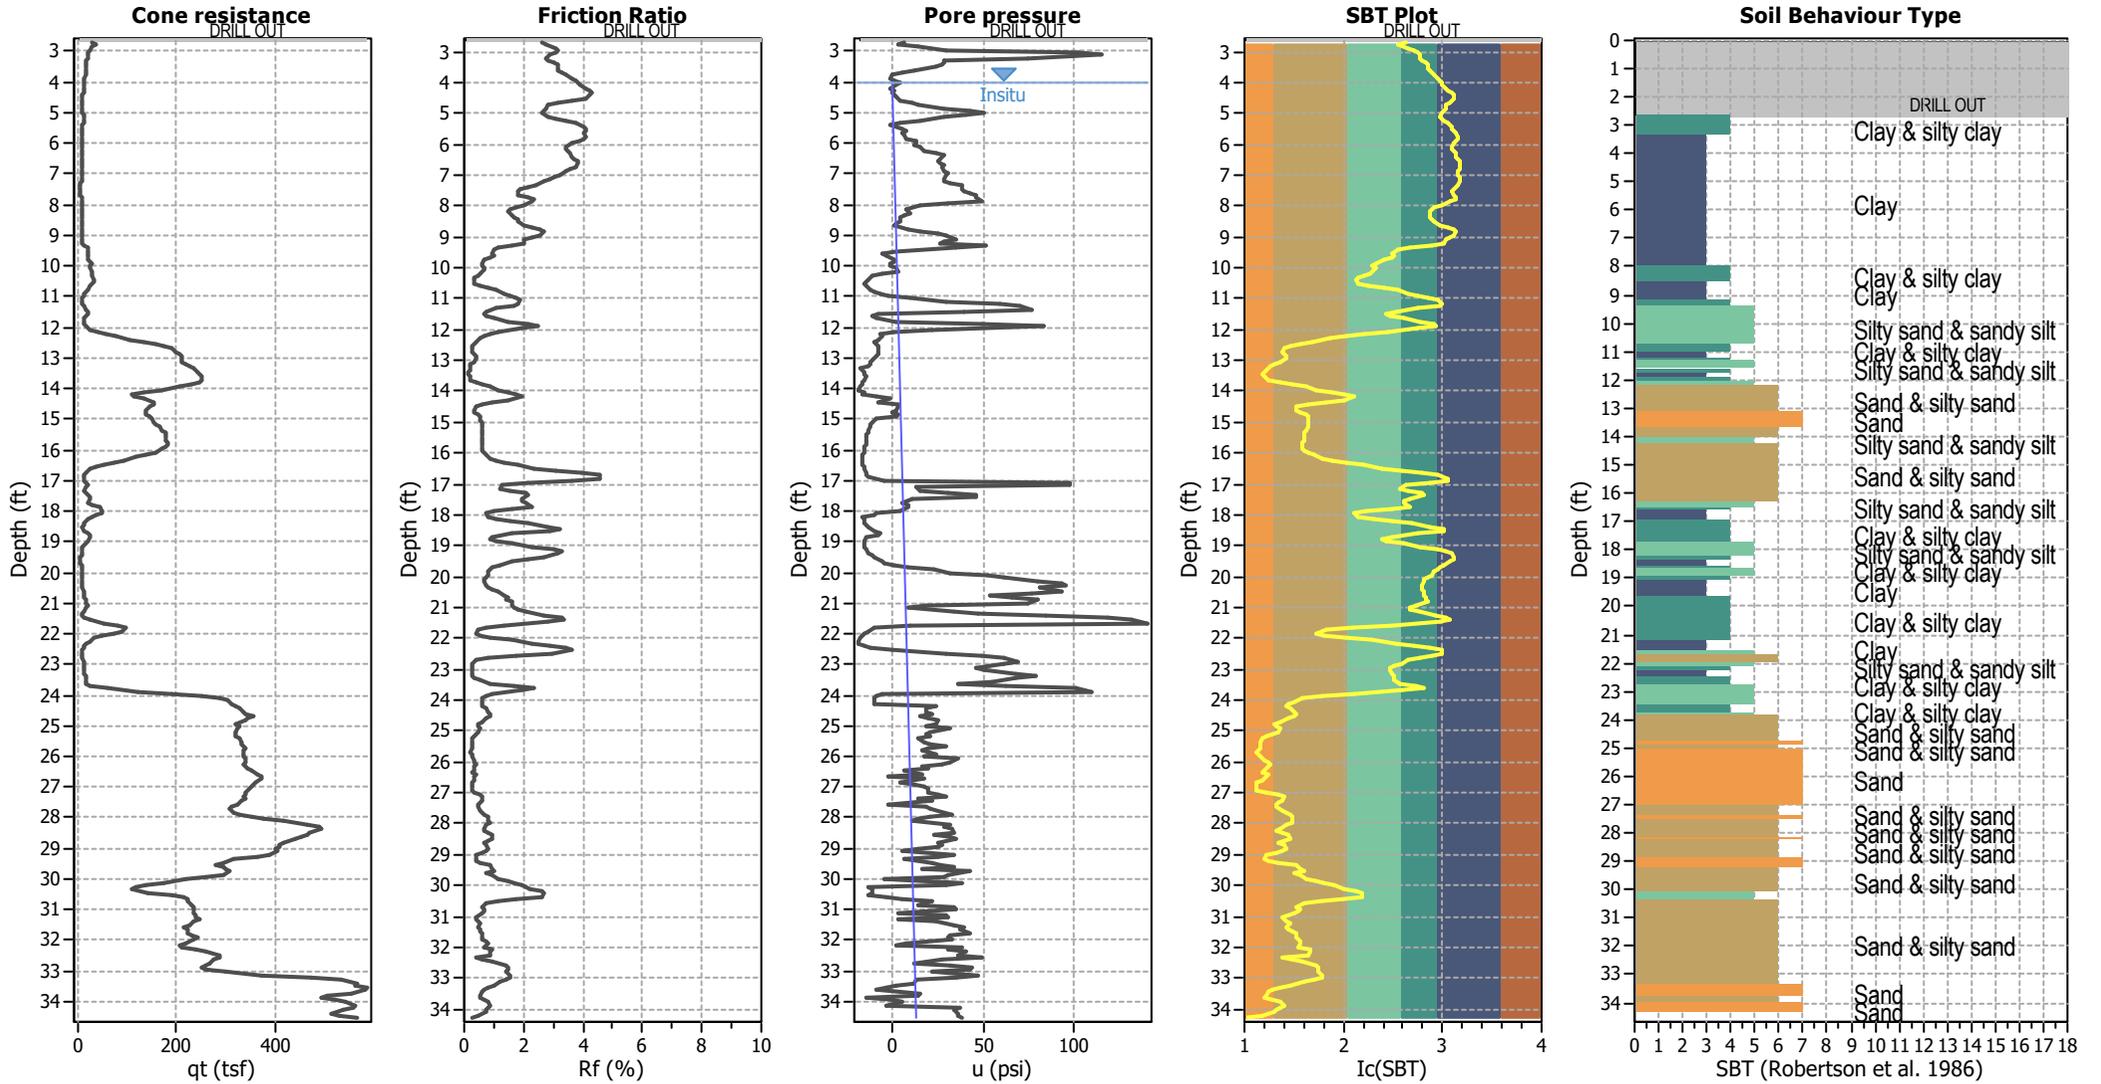


Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	4.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	3	Transition detect. applied:	No
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K _o applied:	No
Earthquake magnitude M _w :	7.10	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.54	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	4.00 ft	Fill height:	N/A	Limit depth:	N/A

SBT legend

1. Sensitive fine grained	4. Clayey silt to silty	7. Gravely sand to sand
2. Organic material	5. Silty sand to sandy silt	8. Very stiff sand to
3. Clay to silty clay	6. Clean sand to silty sand	9. Very stiff fine grained

CPT basic interpretation plots (normalized)

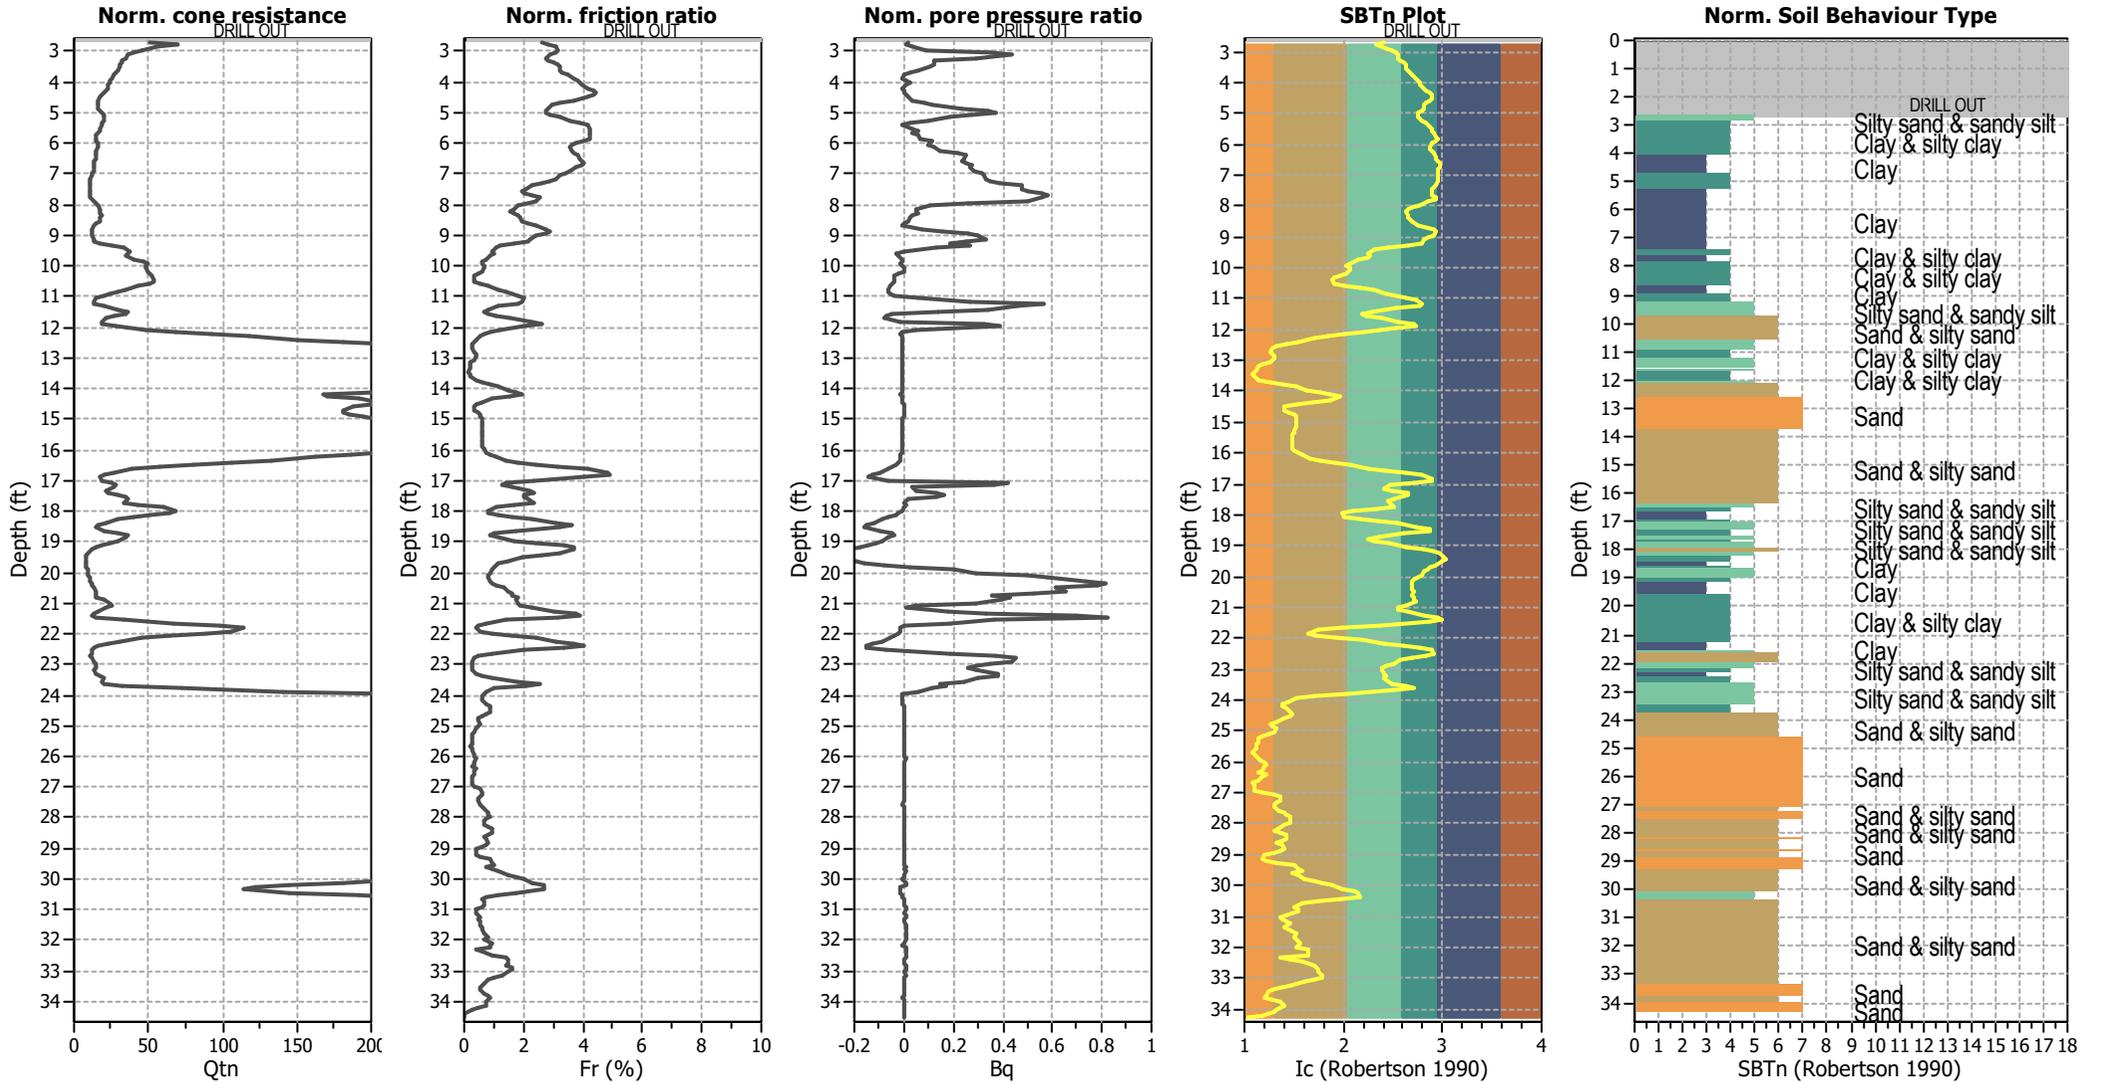


Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	4.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	3	Transition detect. applied:	No
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K _o applied:	No
Earthquake magnitude M _w :	7.10	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.54	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	4.00 ft	Fill height:	N/A	Limit depth:	N/A

SBTn legend

1. Sensitive fine grained	4. Clayey silt to silty	7. Gravely sand to sand
2. Organic material	5. Silty sand to sandy silt	8. Very stiff sand to
3. Clay to silty clay	6. Clean sand to silty sand	9. Very stiff fine grained


Liquefaction analysis overall plots (intermediate results)

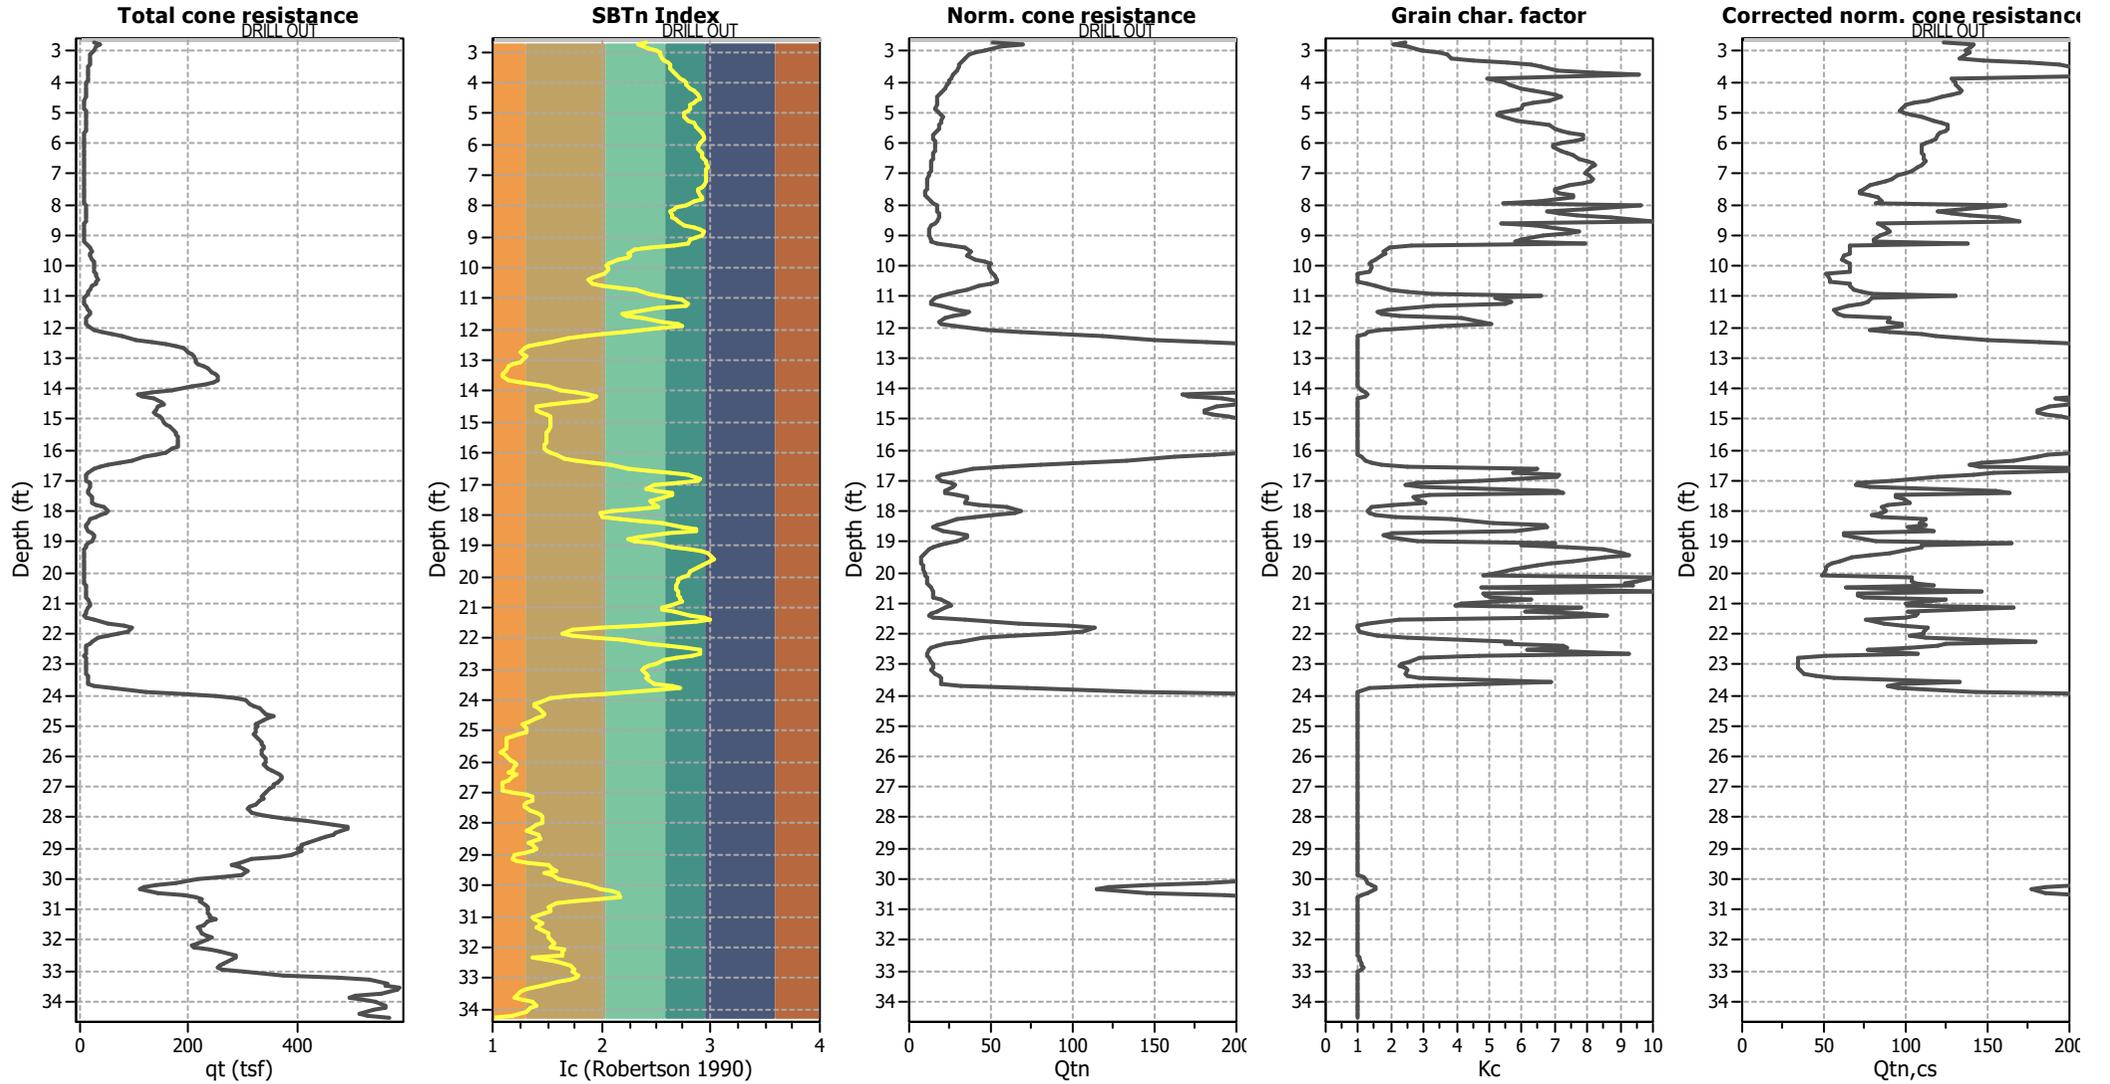

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	4.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	3	Transition detect. applied:	No
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K _o applied:	No
Earthquake magnitude M _w :	7.10	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.54	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	4.00 ft	Fill height:	N/A	Limit depth:	N/A

Liquefaction analysis overall plots

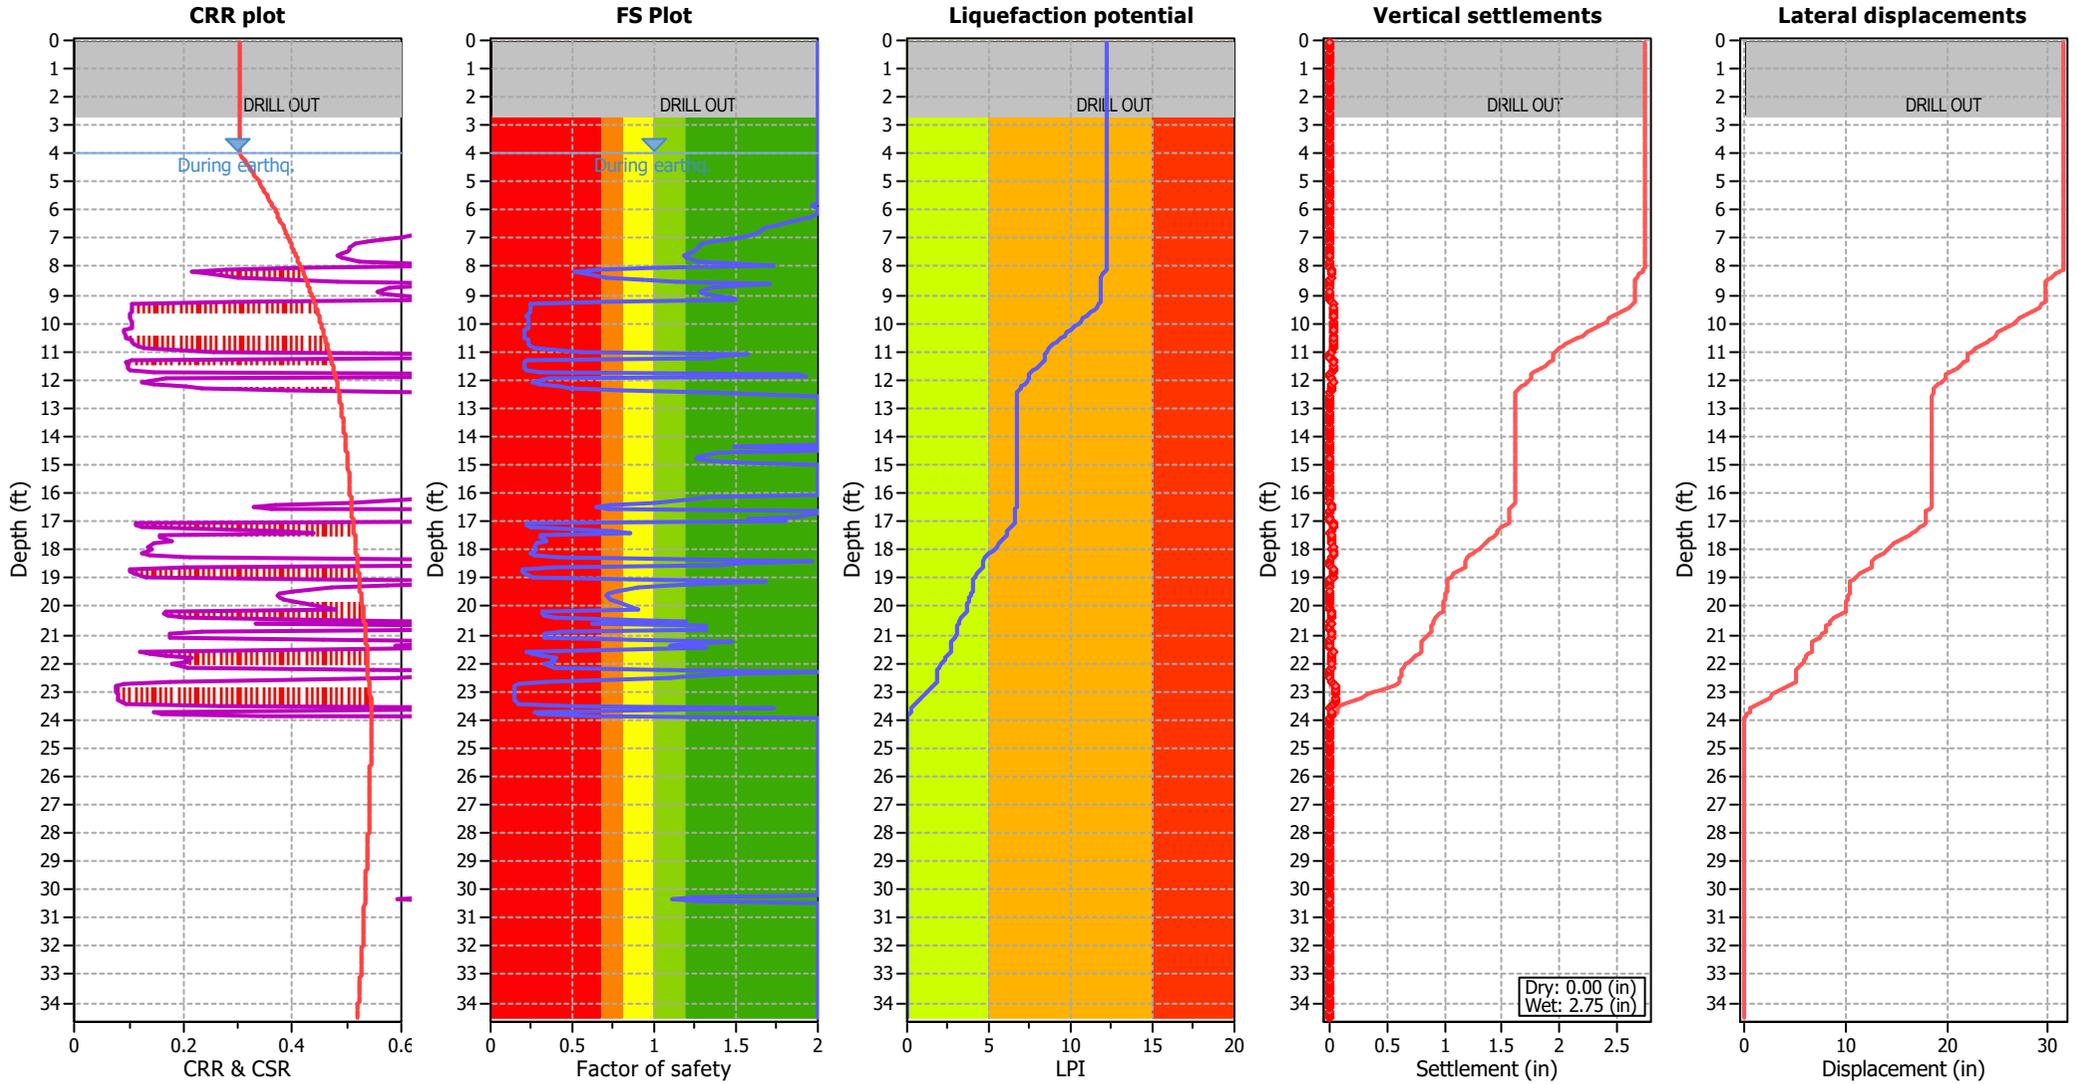

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (earthq.):	4.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	3	Transition detect. applied:	No
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_0 applied:	No
Earthquake magnitude M_w :	7.10	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.54	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	4.00 ft	Fill height:	N/A	Limit depth:	N/A




F.S. color scheme

- Almost certain it will liquefy
- Very likely to liquefy
- Liquefaction and no liq. are equally likely
- Unlike to liquefy
- Almost certain it will not liquefy

LPI color scheme

- Very high risk
- High risk
- Low risk


Liquefaction analysis summary plots

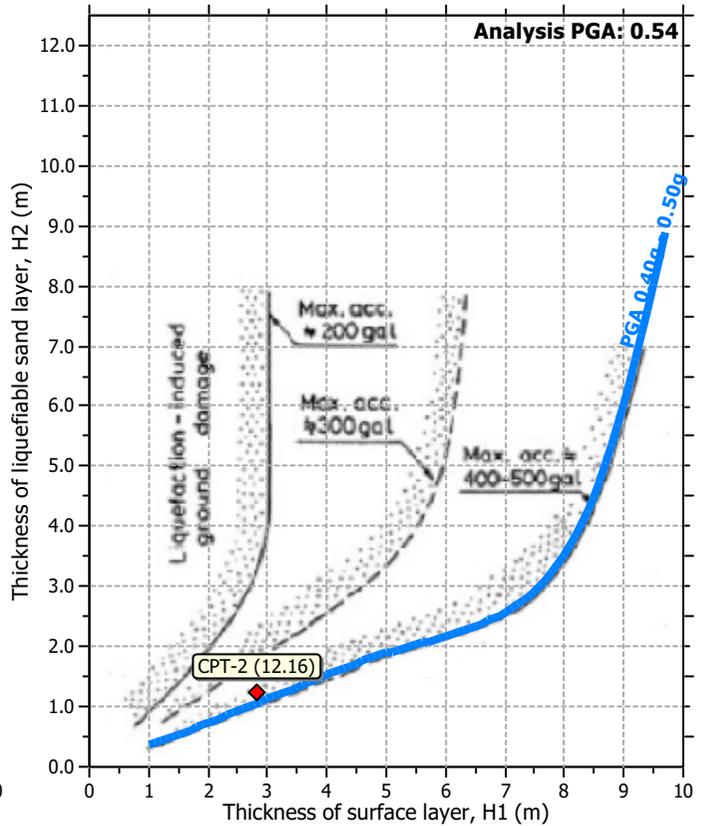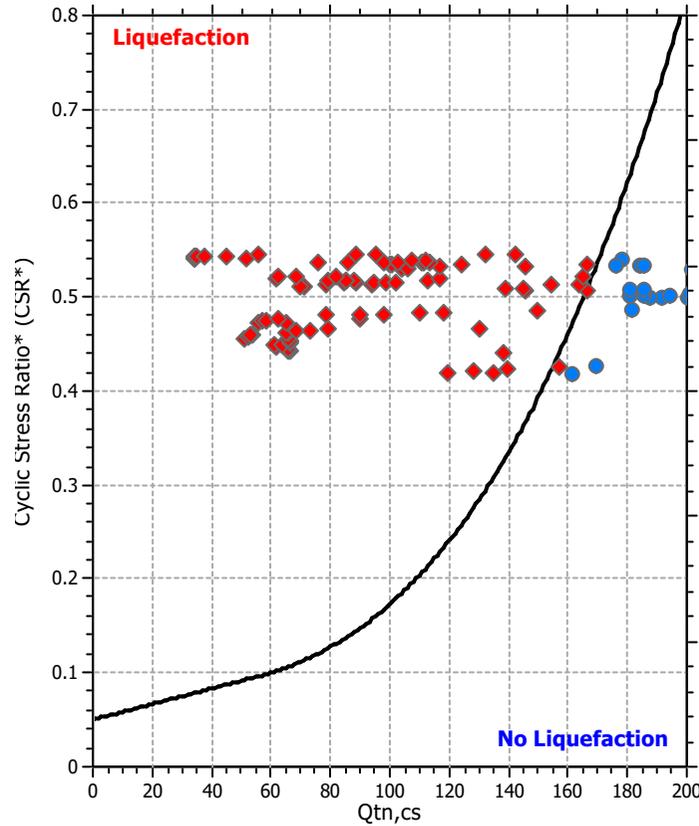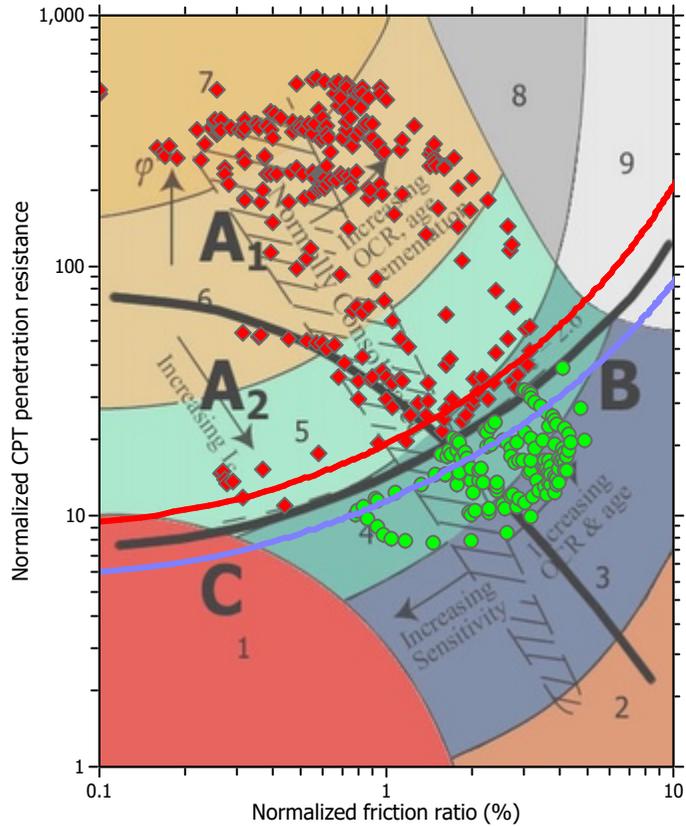

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	4.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	3	Transition detect. applied:	No
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K_v applied:	No
Earthquake magnitude M_w :	7.10	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.54	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	4.00 ft	Fill height:	N/A	Limit depth:	N/A

Check for strength loss plots (Robertson (2010))

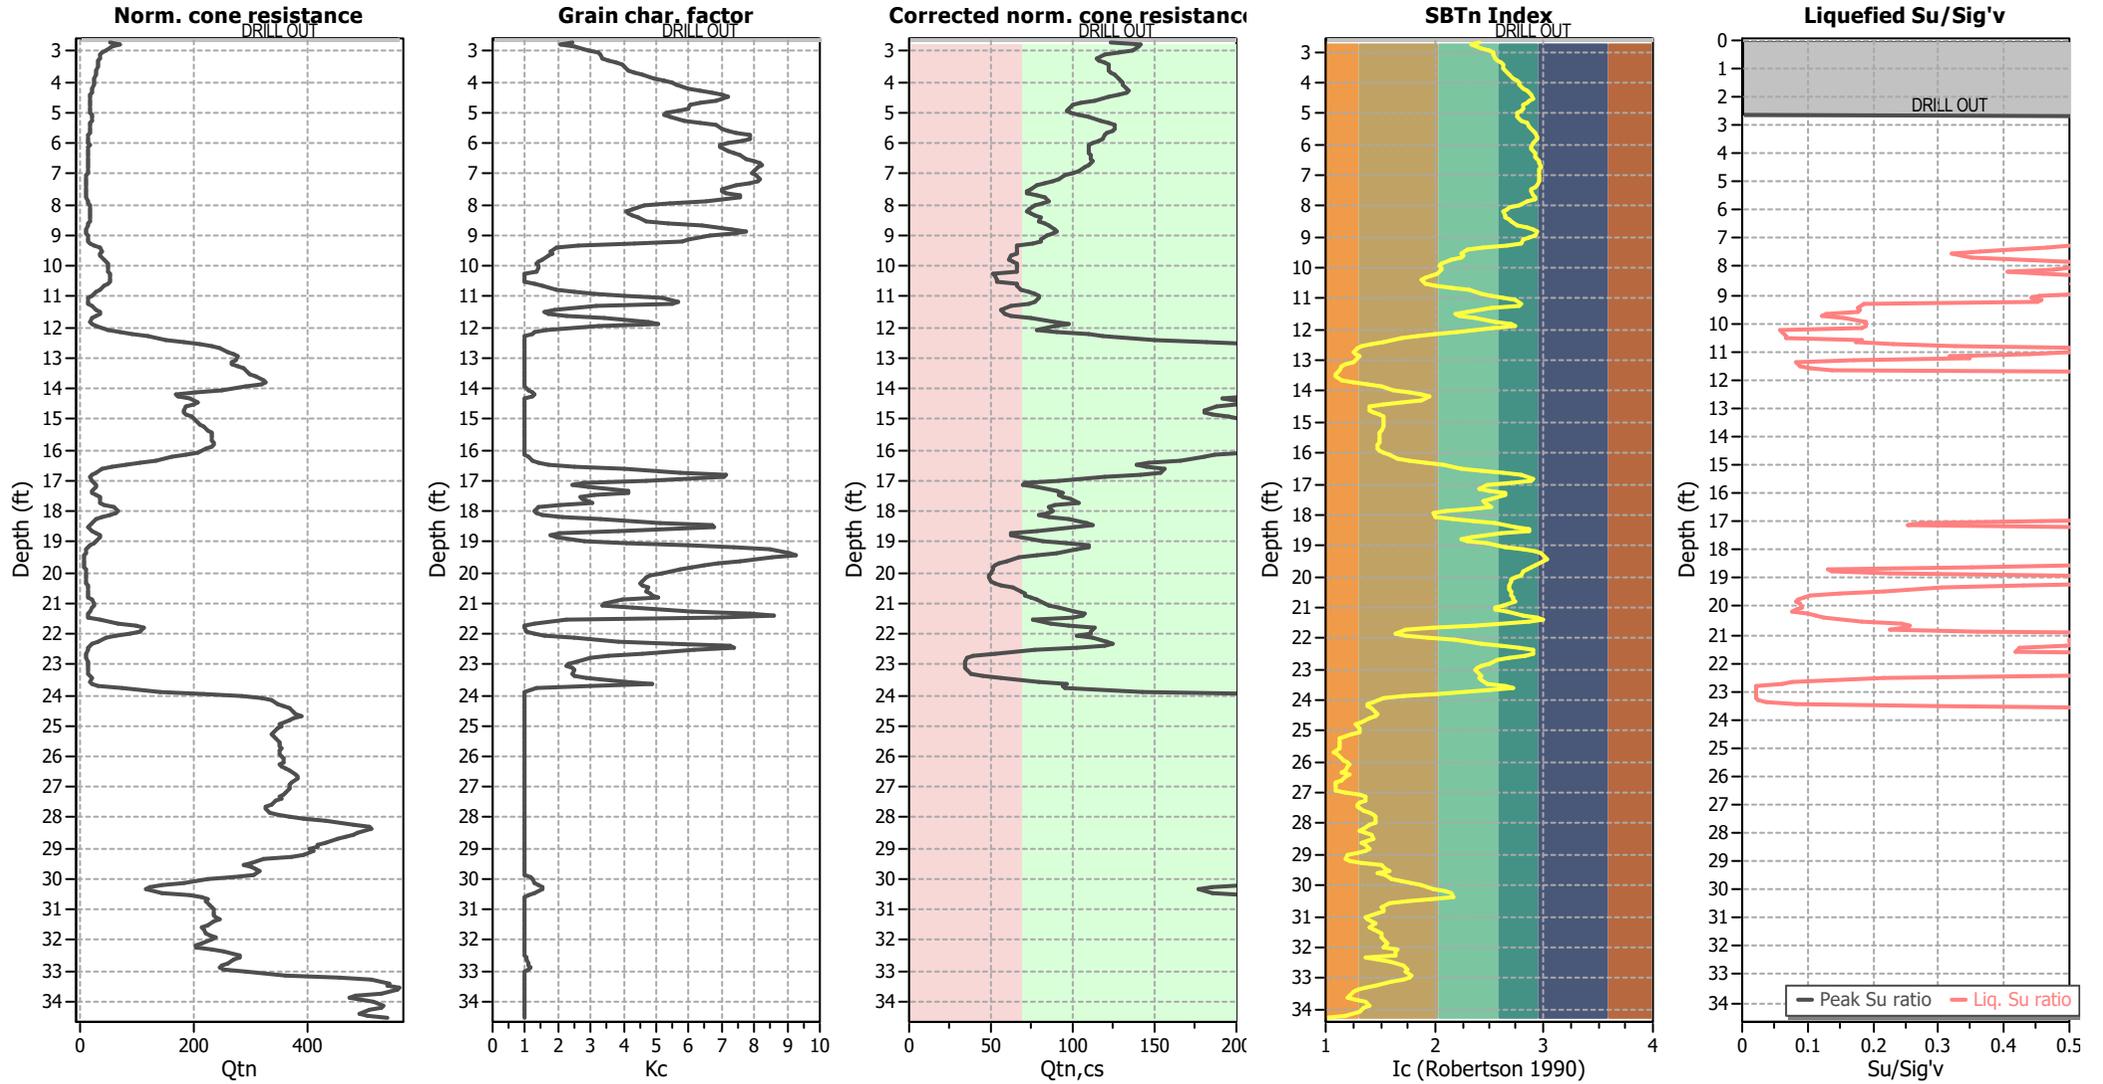

Input parameters and analysis data

Analysis method:	Robertson (2009)	Depth to water table (erthq.):	4.00 ft	Fill weight:	N/A
Fines correction method:	Robertson (2009)	Average results interval:	3	Transition detect. applied:	No
Points to test:	Based on Ic value	Ic cut-off value:	2.60	K _o applied:	No
Earthquake magnitude M _w :	7.10	Unit weight calculation:	Based on SBT	Clay like behavior applied:	All soils
Peak ground acceleration:	0.54	Use fill:	No	Limit depth applied:	No
Depth to water table (insitu):	4.00 ft	Fill height:	N/A	Limit depth:	N/A

:: Field input data ::						
Point ID	Depth (ft)	q _c (tsf)	f _s (tsf)	u (tsf)	Fines content (%)	Unit weight (pcf)
1	0.08	-8888.00	-8888.00	-8888.00	N/A	120.90
2	0.16	-8888.00	-8888.00	-8888.00	N/A	120.90
3	0.25	-8888.00	-8888.00	-8888.00	N/A	120.90
4	0.33	-8888.00	-8888.00	-8888.00	N/A	120.90
5	0.41	-8888.00	-8888.00	-8888.00	N/A	120.90
6	0.49	-8888.00	-8888.00	-8888.00	N/A	120.90
7	0.57	-8888.00	-8888.00	-8888.00	N/A	120.90
8	0.66	-8888.00	-8888.00	-8888.00	N/A	120.90
9	0.74	-8888.00	-8888.00	-8888.00	N/A	120.90
10	0.82	-8888.00	-8888.00	-8888.00	N/A	120.90
11	0.90	-8888.00	-8888.00	-8888.00	N/A	120.90
12	0.98	-8888.00	-8888.00	-8888.00	N/A	120.90
13	1.07	-8888.00	-8888.00	-8888.00	N/A	120.90
14	1.15	-8888.00	-8888.00	-8888.00	N/A	120.90
15	1.23	-8888.00	-8888.00	-8888.00	N/A	120.90
16	1.31	-8888.00	-8888.00	-8888.00	N/A	120.90
17	1.39	-8888.00	-8888.00	-8888.00	N/A	120.90
18	1.48	-8888.00	-8888.00	-8888.00	N/A	120.90
19	1.56	-8888.00	-8888.00	-8888.00	N/A	120.90
20	1.64	-8888.00	-8888.00	-8888.00	N/A	120.90
21	1.72	-8888.00	-8888.00	-8888.00	N/A	120.90
22	1.80	-8888.00	-8888.00	-8888.00	N/A	120.90
23	1.89	-8888.00	-8888.00	-8888.00	N/A	120.90
24	1.97	-8888.00	-8888.00	-8888.00	N/A	120.90
25	2.05	-8888.00	-8888.00	-8888.00	N/A	120.90
26	2.13	-8888.00	-8888.00	-8888.00	N/A	120.90
27	2.21	-8888.00	-8888.00	-8888.00	N/A	120.90
28	2.30	-8888.00	-8888.00	-8888.00	N/A	120.90
29	2.38	-8888.00	-8888.00	-8888.00	N/A	120.90
30	2.46	-8888.00	-8888.00	-8888.00	N/A	120.90
31	2.54	-8888.00	-8888.00	-8888.00	N/A	120.90
32	2.62	-8888.00	-8888.00	-8888.00	N/A	120.90
33	2.71	45.01	1.09	6.67	26.82	115.86
34	2.79	36.22	1.05	2.76	23.65	119.21
35	2.87	28.77	0.92	14.31	27.45	117.87
36	2.95	23.74	0.77	29.26	30.47	116.23
37	3.03	19.17	0.64	102.47	32.15	114.62
38	3.12	17.53	0.55	115.86	32.67	113.23
39	3.20	17.44	0.48	74.65	32.86	112.33
40	3.28	17.13	0.48	28.53	34.00	112.05
41	3.36	16.16	0.52	28.19	35.55	112.18
42	3.44	16.17	0.53	27.36	36.49	112.30
43	3.53	16.20	0.51	24.49	36.84	112.21
44	3.61	15.68	0.50	11.87	37.45	112.01
45	3.69	15.13	0.50	5.19	38.61	111.81
46	3.77	14.58	0.49	0.26	39.93	111.71
47	3.85	14.07	0.50	-0.93	41.73	111.64
48	3.94	13.04	0.51	1.02	43.11	111.52

:: Field input data :: (continued)						
Point ID	Depth (ft)	q _c (tsf)	f _s (tsf)	u (tsf)	Fines content (%)	Unit weight (pcf)
49	4.02	12.83	0.49	4.57	44.21	111.34
50	4.10	12.57	0.48	2.27	44.90	111.24
51	4.18	12.22	0.50	-0.99	46.52	111.19
52	4.27	11.36	0.50	0.54	48.27	110.89
53	4.35	10.60	0.45	-0.04	49.94	110.37
54	4.43	10.00	0.43	1.31	51.21	109.54
55	4.51	9.11	0.38	2.01	51.99	108.53
56	4.59	8.52	0.32	4.41	50.39	107.47
57	4.68	9.36	0.28	10.38	48.34	106.35
58	4.76	8.68	0.25	13.91	46.84	105.69
59	4.84	8.26	0.24	28.15	46.55	105.32
60	4.92	8.58	0.25	43.27	45.15	105.49
61	5.00	9.33	0.25	50.74	43.49	106.20
62	5.09	10.33	0.30	40.17	43.09	107.24
63	5.17	10.74	0.35	28.55	44.09	108.26
64	5.25	10.73	0.38	15.19	46.06	108.91
65	5.33	10.39	0.40	4.02	48.26	109.16
66	5.41	9.93	0.40	-0.83	50.27	109.28
67	5.50	9.67	0.41	5.45	51.14	109.16
68	5.58	9.57	0.39	8.08	52.02	108.79
69	5.66	8.74	0.36	4.90	53.06	108.13
70	5.74	8.09	0.33	6.88	54.65	107.62
71	5.82	8.01	0.34	8.04	54.79	107.39
72	5.91	8.26	0.33	13.17	53.64	107.26
73	5.99	8.47	0.31	12.90	51.86	107.04
74	6.07	8.68	0.30	12.31	50.91	106.76
75	6.15	8.43	0.29	14.72	50.91	106.63
76	6.23	8.24	0.30	17.80	51.96	106.55
77	6.32	7.81	0.30	24.56	52.76	106.46
78	6.40	7.70	0.29	28.20	53.56	106.39
79	6.48	7.60	0.29	26.43	54.28	106.34
80	6.56	7.38	0.30	25.50	55.37	106.32
81	6.64	7.17	0.29	26.46	56.11	106.15
82	6.73	7.03	0.28	28.16	56.27	105.84
83	6.81	6.95	0.27	27.51	55.66	105.39
84	6.89	6.94	0.25	28.21	55.22	104.85
85	6.97	6.63	0.23	30.20	55.07	104.14
86	7.05	6.25	0.20	29.62	55.44	103.29
87	7.14	5.95	0.18	28.94	55.90	102.40
88	7.22	5.64	0.17	28.80	55.70	101.48
89	7.30	5.51	0.14	31.74	54.67	100.59
90	7.38	5.48	0.13	38.38	52.88	99.66
91	7.46	5.46	0.11	38.55	51.30	98.77
92	7.55	5.33	0.10	39.09	51.25	98.23
93	7.63	5.03	0.11	43.03	51.74	98.12
94	7.71	5.10	0.11	45.59	53.55	99.37
95	7.79	5.50	0.16	46.39	53.53	100.79
96	7.87	6.11	0.18	49.53	48.91	102.12

:: Field input data :: (continued)						
Point ID	Depth (ft)	q _c (tsf)	f _s (tsf)	u (tsf)	Fines content (%)	Unit weight (pcf)
97	7.96	8.66	0.17	30.34	44.13	102.50
98	8.04	9.08	0.16	14.85	39.98	102.43
99	8.12	9.48	0.15	7.55	38.29	101.89
100	8.20	9.59	0.13	8.14	37.11	101.78
101	8.28	9.96	0.15	9.65	37.48	102.45
102	8.37	10.11	0.19	6.00	38.10	103.00
103	8.45	9.90	0.17	4.76	39.17	103.34
104	8.53	9.66	0.18	4.12	40.30	102.87
105	8.61	8.65	0.17	2.38	43.81	102.67
106	8.69	7.28	0.17	1.40	48.38	102.44
107	8.78	6.69	0.18	8.72	52.52	102.34
108	8.86	6.36	0.18	15.61	54.15	102.34
109	8.94	6.24	0.18	24.87	52.74	102.01
110	9.02	6.71	0.16	29.65	49.66	101.78
111	9.10	7.29	0.15	35.05	46.64	101.64
112	9.19	7.63	0.16	28.05	45.80	101.71
113	9.27	7.30	0.16	26.61	38.36	102.31
114	9.35	12.76	0.16	52.03	28.20	103.39
115	9.43	20.05	0.17	35.31	22.56	105.14
116	9.51	21.36	0.23	1.91	20.56	105.65
117	9.60	19.65	0.18	-5.48	21.35	105.45
118	9.68	18.13	0.17	-3.48	20.53	104.28
119	9.76	20.22	0.15	0.51	17.34	104.11
120	9.84	27.74	0.14	0.92	14.92	104.39
121	9.92	27.24	0.16	-1.73	13.91	104.73
122	10.01	25.64	0.16	-0.94	14.83	105.22
123	10.09	25.46	0.18	1.78	14.80	105.17
124	10.17	27.13	0.16	2.79	13.71	104.61
125	10.25	29.02	0.12	-5.14	5.00	103.40
126	10.33	30.24	0.10	-11.58	5.00	102.15
127	10.42	31.53	0.10	-13.90	5.00	101.63
128	10.50	32.86	0.09	-14.88	5.00	102.56
129	10.58	29.20	0.15	-15.13	13.02	104.33
130	10.66	23.46	0.20	-14.61	17.64	105.64
131	10.74	17.84	0.21	-12.68	23.02	106.05
132	10.83	16.24	0.22	-10.39	27.55	105.69
133	10.91	14.03	0.21	-6.54	31.67	105.06
134	10.99	10.56	0.19	-2.52	36.89	103.96
135	11.07	8.50	0.17	9.40	42.68	102.25
136	11.15	6.68	0.12	30.08	45.05	101.06
137	11.24	6.93	0.14	58.76	44.17	100.13
138	11.32	7.17	0.12	70.64	31.73	100.80
139	11.40	16.40	0.11	76.54	22.36	101.69
140	11.48	22.02	0.14	39.15	18.50	102.63
141	11.56	19.11	0.14	-7.84	20.18	103.28
142	11.65	15.07	0.15	-10.85	25.64	103.11
143	11.73	11.63	0.16	-9.14	33.35	103.82
144	11.81	10.05	0.23	1.56	40.66	105.14

:: Field input data :: (continued)						
Point ID	Depth (ft)	q _c (tsf)	f _s (tsf)	u (tsf)	Fines content (%)	Unit weight (pcf)
145	11.89	9.46	0.29	49.08	42.09	106.53
146	11.98	11.29	0.29	83.23	32.27	107.96
147	12.06	22.97	0.30	21.72	19.35	109.56
148	12.14	43.05	0.33	1.34	13.01	111.56
149	12.22	55.43	0.42	-6.98	8.96	113.33
150	12.30	75.15	0.44	-6.10	6.02	114.61
151	12.39	103.25	0.42	-7.86	3.34	115.19
152	12.47	134.98	0.39	-9.82	1.69	115.95
153	12.55	159.18	0.47	-8.61	0.72	116.75
154	12.63	180.58	0.48	-7.58	0.29	117.57
155	12.71	189.23	0.50	-7.37	0.05	118.28
156	12.80	199.64	0.57	-7.72	0.21	119.86
157	12.88	209.49	0.83	-8.41	0.46	121.38
158	12.96	211.97	0.91	-9.35	0.41	121.61
159	13.04	212.03	0.63	-10.91	0.00	120.32
160	13.12	211.80	0.45	-12.35	0.00	117.95
161	13.21	214.85	0.36	-12.65	0.00	116.72
162	13.29	225.70	0.40	-13.63	0.00	116.44
163	13.37	239.41	0.38	-17.43	0.00	116.79
164	13.45	243.29	0.40	-16.08	0.00	116.74
165	13.53	248.45	0.38	-15.26	0.00	117.65
166	13.62	253.94	0.53	-14.88	0.00	119.87
167	13.70	256.50	0.85	-15.48	0.06	123.82
168	13.78	249.59	1.64	-16.21	1.31	126.55
169	13.86	236.33	1.93	-16.96	3.04	128.74
170	13.94	209.93	2.52	-17.77	4.66	129.41
171	14.03	175.83	2.48	-18.87	7.29	129.56
172	14.11	123.19	2.56	-15.08	9.79	128.47
173	14.19	101.46	2.02	-16.13	11.88	127.10
174	14.27	99.21	1.70	-8.99	9.67	125.67
175	14.35	138.77	1.37	-1.59	5.98	124.15
176	14.44	166.90	0.83	-7.78	3.18	121.73
177	14.52	151.64	0.49	2.92	1.66	118.46
178	14.60	143.51	0.39	2.66	1.51	116.73
179	14.68	139.85	0.50	2.55	2.04	117.21
180	14.76	131.82	0.61	0.16	2.78	118.70
181	14.85	137.52	0.74	2.83	3.16	119.87
182	14.93	147.85	0.81	1.73	3.18	120.87
183	15.01	153.54	0.88	-8.85	3.22	121.57
184	15.09	153.40	0.95	-10.98	3.28	122.08
185	15.17	158.22	0.98	-11.94	3.26	122.48
186	15.26	165.59	1.01	-12.28	3.01	122.73
187	15.34	173.55	1.02	-13.04	2.80	123.01
188	15.42	177.89	1.05	-13.53	2.70	123.26
189	15.50	178.79	1.09	-14.07	2.73	123.46
190	15.58	178.78	1.09	-14.48	2.72	123.49
191	15.67	179.86	1.06	-14.62	2.63	123.42
192	15.75	182.45	1.05	-14.73	2.51	123.35

:: Field input data :: (continued)						
Point ID	Depth (ft)	q _c (tsf)	f _s (tsf)	u (tsf)	Fines content (%)	Unit weight (pcf)
193	15.83	183.92	1.05	-14.82	2.52	123.35
194	15.91	179.92	1.06	-15.22	2.78	123.49
195	15.99	171.90	1.13	-15.55	3.40	123.63
196	16.08	154.94	1.17	-16.04	4.24	123.71
197	16.16	142.65	1.19	-16.29	5.50	123.60
198	16.24	120.12	1.22	-16.49	7.52	123.48
199	16.32	92.04	1.31	-16.63	10.68	123.19
200	16.40	71.20	1.32	-16.46	15.02	122.65
201	16.49	52.89	1.28	-16.25	20.43	121.60
202	16.57	34.61	1.16	-15.99	27.51	119.92
203	16.65	22.54	0.94	-15.76	36.70	117.65
204	16.73	15.27	0.75	-14.97	45.44	114.79
205	16.81	11.30	0.50	-14.27	51.60	111.86
206	16.90	9.94	0.37	-13.12	51.43	108.80
207	16.98	10.17	0.25	-4.05	40.54	106.66
208	17.06	15.48	0.17	97.28	29.60	105.90
209	17.14	21.38	0.23	97.23	27.01	106.78
210	17.22	17.09	0.30	13.59	30.35	107.67
211	17.31	12.53	0.28	14.84	37.41	107.70
212	17.39	11.98	0.29	30.95	37.66	108.33
213	17.47	17.66	0.37	46.09	31.57	110.24
214	17.55	26.28	0.45	45.71	28.59	112.13
215	17.63	24.78	0.53	11.25	29.17	112.78
216	17.72	19.28	0.49	5.68	31.19	112.77
217	17.80	22.23	0.48	8.71	23.94	112.98
218	17.88	45.53	0.44	8.43	15.69	113.38
219	17.96	60.62	0.39	3.74	12.38	112.84
220	18.04	44.21	0.33	-9.50	13.24	112.56
221	18.13	36.80	0.42	-10.61	18.09	112.22
222	18.21	28.10	0.44	-16.17	24.37	112.15
223	18.29	18.73	0.43	-16.02	32.83	111.30
224	18.37	13.20	0.41	-15.82	42.43	109.99
225	18.45	10.99	0.36	-14.68	49.87	108.55
226	18.54	9.28	0.30	-13.89	50.02	106.77
227	18.62	10.42	0.21	-10.18	35.90	105.64
228	18.70	22.24	0.16	-7.04	24.16	105.86
229	18.78	30.51	0.23	-7.57	20.61	107.18
230	18.86	25.02	0.28	-14.98	22.61	108.65
231	18.95	21.04	0.31	-16.09	29.56	109.49
232	19.03	15.73	0.40	-16.08	37.36	109.64
233	19.11	12.24	0.38	-15.87	46.62	109.29
234	19.19	9.97	0.35	-15.54	52.74	107.80
235	19.27	8.61	0.26	-14.81	57.31	105.73
236	19.36	7.05	0.18	-13.62	59.67	102.94
237	19.44	6.10	0.13	-11.34	60.30	100.09
238	19.52	6.00	0.09	-9.54	57.58	97.37
239	19.60	5.96	0.06	-6.10	53.61	95.17
240	19.69	5.98	0.06	-4.07	50.52	93.72

:: Field input data :: (continued)						
Point ID	Depth (ft)	q _c (tsf)	f _s (tsf)	u (tsf)	Fines content (%)	Unit weight (pcf)
241	19.77	6.18	0.05	1.20	48.84	93.20
242	19.85	6.17	0.05	8.62	46.99	93.17
243	19.93	6.44	0.05	22.90	45.30	93.49
244	20.01	6.80	0.06	32.17	42.75	93.72
245	20.10	7.12	0.05	52.21	40.89	93.50
246	20.18	6.87	0.05	61.81	40.33	93.90
247	20.26	6.82	0.06	79.81	39.90	94.83
248	20.34	7.62	0.07	93.25	39.57	96.13
249	20.42	7.83	0.08	95.42	39.79	97.89
250	20.51	8.41	0.12	81.80	40.59	100.05
251	20.59	9.43	0.15	93.16	40.37	101.79
252	20.67	10.50	0.16	77.12	41.06	102.47
253	20.75	9.16	0.15	54.09	41.18	102.29
254	20.83	9.53	0.14	65.44	42.25	103.34
255	20.92	11.01	0.23	80.57	36.52	106.22
256	21.00	19.69	0.34	74.40	33.41	108.49
257	21.08	19.78	0.34	18.79	33.07	109.33
258	21.16	14.85	0.32	8.73	38.22	108.77
259	21.24	11.21	0.32	34.38	47.10	108.12
260	21.33	8.72	0.34	47.58	54.82	107.65
261	21.41	7.40	0.32	84.59	57.72	107.08
262	21.49	7.70	0.27	118.17	50.30	107.40
263	21.57	12.62	0.32	131.38	25.33	110.36
264	21.65	50.95	0.43	140.67	12.45	113.12
265	21.74	90.96	0.42	9.89	5.00	114.12
266	21.82	98.84	0.32	-10.51	4.95	114.21
267	21.90	96.77	0.39	-13.31	6.56	115.54
268	21.98	70.28	0.68	-15.40	11.10	117.45
269	22.06	47.14	0.86	-16.67	18.74	118.02
270	22.15	32.37	0.81	-17.88	27.17	117.11
271	22.23	23.54	0.69	-18.39	35.71	115.16
272	22.31	15.29	0.55	-18.76	44.41	113.07
273	22.39	12.03	0.48	-15.95	52.10	110.56
274	22.47	10.35	0.32	-11.72	52.71	107.57
275	22.56	9.77	0.15	-0.62	47.34	102.92
276	22.64	8.91	0.05	29.07	39.66	96.84
277	22.72	8.35	0.03	49.29	34.29	91.22
278	22.80	8.28	0.03	61.94	30.90	89.51
279	22.88	10.33	0.03	68.87	27.67	89.93
280	22.97	12.40	0.03	61.35	25.85	90.67
281	23.05	11.72	0.03	54.19	25.60	90.87
282	23.13	11.28	0.03	46.28	26.88	90.39
283	23.21	10.22	0.03	50.31	27.55	90.58
284	23.29	10.80	0.03	68.33	27.08	93.40
285	23.38	14.35	0.07	79.04	27.46	98.05
286	23.46	15.58	0.13	67.70	29.91	102.32
287	23.54	14.38	0.21	54.97	37.21	106.83
288	23.62	13.43	0.42	36.48	41.45	109.55

:: Field input data :: (continued)

Point ID	Depth (ft)	q _c (tsf)	f _s (tsf)	u (tsf)	Fines content (%)	Unit weight (pcf)
289	23.70	16.21	0.47	62.94	30.69	112.84
290	23.79	41.66	0.58	100.79	13.43	116.09
291	23.87	115.78	0.66	109.83	6.27	121.03
292	23.95	203.14	1.40	-6.20	3.22	124.53
293	24.03	255.72	1.59	-8.85	2.08	127.16
294	24.11	296.41	1.79	-9.59	1.34	127.89
295	24.20	307.86	1.67	-10.40	1.34	128.86
296	24.28	307.43	2.20	-9.89	1.83	130.22
297	24.36	320.33	2.89	24.02	2.35	131.55
298	24.44	333.24	2.95	18.51	2.55	132.33
299	24.52	335.22	3.01	18.12	2.25	132.13
300	24.61	340.21	2.60	21.77	1.55	131.15
301	24.69	350.85	1.83	15.19	0.72	130.07
302	24.77	374.64	1.91	20.02	0.09	128.14
303	24.85	312.96	1.17	25.49	0.31	128.33
304	24.93	328.55	1.99	24.04	0.57	128.09
305	25.02	324.81	1.84	18.61	0.44	127.99
306	25.10	325.74	1.08	31.33	0.00	126.16
307	25.18	322.38	0.91	20.98	0.00	124.40
308	25.26	317.29	1.03	18.82	0.00	122.81
309	25.34	317.29	0.50	21.25	0.00	122.95
310	25.43	332.04	0.95	13.99	0.00	123.24
311	25.51	334.73	1.11	17.38	0.00	123.57
312	25.59	333.56	0.60	21.08	0.00	123.47
313	25.67	333.83	0.91	30.00	0.00	122.19
314	25.75	341.03	0.69	19.70	0.00	123.04
315	25.84	340.73	0.87	15.87	0.00	123.48
316	25.92	321.40	1.07	24.48	0.00	124.63
317	26.00	344.73	1.13	17.53	0.00	125.86
318	26.08	346.89	1.42	36.53	0.00	126.45
319	26.16	331.46	1.37	31.84	0.00	125.90
320	26.25	341.99	0.84	26.94	0.00	125.06
321	26.33	336.99	1.04	16.82	0.00	124.31
322	26.41	342.19	1.04	19.59	0.00	126.50
323	26.49	354.40	1.85	6.24	0.00	126.08
324	26.57	361.86	0.79	16.31	0.00	125.82
325	26.66	383.94	0.87	-2.35	0.00	124.30
326	26.74	372.56	1.18	17.83	0.00	124.55
327	26.82	357.96	0.89	3.74	0.00	123.97
328	26.90	357.58	0.66	11.45	0.00	123.78
329	26.98	355.36	1.12	17.07	0.00	126.18
330	27.07	350.74	1.94	19.44	0.53	129.13
331	27.15	343.08	2.54	19.53	1.09	130.00
332	27.23	333.47	1.87	25.21	1.06	129.75
333	27.31	339.12	1.75	30.06	0.59	128.53
334	27.40	332.27	1.62	14.31	0.35	128.15
335	27.48	345.23	1.58	21.62	0.33	127.66
336	27.56	314.40	1.47	-2.56	0.88	128.58

:: Field input data :: (continued)						
Point ID	Depth (ft)	q _c (tsf)	f _s (tsf)	u (tsf)	Fines content (%)	Unit weight (pcf)
337	27.64	312.03	2.28	18.98	1.51	129.20
338	27.72	307.33	2.13	20.49	1.93	129.86
339	27.81	307.25	2.04	27.97	2.33	130.94
340	27.89	333.86	3.25	33.31	2.33	131.60
341	27.97	348.39	2.72	20.57	2.33	132.57
342	28.05	371.88	2.99	13.62	1.56	132.34
343	28.13	410.65	2.77	10.65	0.90	132.65
344	28.22	467.26	2.79	31.58	0.47	133.55
345	28.30	525.30	3.74	27.94	1.08	135.47
346	28.38	481.06	5.36	32.63	1.79	136.72
347	28.46	471.14	5.00	33.44	1.93	136.29
348	28.54	460.64	3.14	22.40	1.32	135.13
349	28.63	469.10	3.41	31.94	0.71	133.52
350	28.71	430.02	2.81	35.28	1.20	134.00
351	28.79	420.48	3.87	24.83	1.55	133.88
352	28.87	405.78	3.41	27.33	1.17	132.81
353	28.95	400.46	1.51	24.80	0.41	131.23
354	29.04	419.58	2.17	14.58	0.00	128.48
355	29.12	380.63	1.22	5.86	0.00	128.39
356	29.20	419.71	1.43	34.13	0.00	128.55
357	29.28	364.01	2.36	25.24	0.66	129.94
358	29.36	313.71	2.39	6.03	3.01	131.82
359	29.45	268.94	3.64	21.83	3.45	131.36
360	29.53	300.26	2.03	26.23	4.04	131.33
361	29.61	265.73	2.51	33.93	2.56	130.01
362	29.69	320.34	2.15	16.31	3.51	131.77
363	29.77	315.40	3.80	42.81	4.37	133.39
364	29.86	291.62	4.51	31.17	6.12	134.87
365	29.94	282.25	4.66	28.51	7.89	134.79
366	30.02	208.49	4.22	-4.46	10.05	134.03
367	30.10	159.77	3.96	38.38	12.59	132.85
368	30.18	155.33	3.56	29.33	15.88	131.80
369	30.27	101.95	3.46	-13.90	17.58	130.28
370	30.35	94.96	2.42	-11.11	17.98	129.58
371	30.43	135.60	2.87	-11.43	12.07	128.99
372	30.51	194.78	2.15	-13.05	6.91	128.62
373	30.59	240.09	1.39	-3.62	4.01	126.74
374	30.68	207.32	1.22	5.37	2.90	125.74
375	30.76	226.57	1.47	21.73	3.40	126.32
376	30.84	229.22	1.75	13.69	3.39	126.99
377	30.92	233.79	1.59	34.48	2.57	125.85
378	31.00	238.36	0.75	34.79	1.20	123.14
379	31.09	238.12	0.48	3.51	1.34	123.45
380	31.17	232.79	1.71	29.52	1.68	124.28
381	31.25	240.92	1.10	30.23	2.26	125.72
382	31.33	247.56	1.17	2.72	1.64	125.03
383	31.41	256.56	1.31	23.72	2.01	124.91
384	31.50	206.08	1.10	34.31	2.57	125.17

:: Field input data :: (continued)						
Point ID	Depth (ft)	q _c (tsf)	f _s (tsf)	u (tsf)	Fines content (%)	Unit weight (pcf)
385	31.58	216.08	1.36	39.07	3.11	125.24
386	31.66	222.89	1.41	36.83	2.91	125.36
387	31.74	223.36	1.13	42.55	3.20	126.06
388	31.82	223.66	1.73	32.00	3.60	127.41
389	31.91	249.97	2.21	30.31	3.76	128.39
390	31.99	254.17	1.77	33.36	3.29	127.16
391	32.07	204.93	0.89	7.13	5.26	128.64
392	32.15	193.61	3.48	2.40	5.18	127.61
393	32.23	219.76	1.06	38.29	5.00	127.62
394	32.32	214.85	0.88	30.27	1.13	122.84
395	32.40	277.15	0.77	40.20	2.45	127.25
396	32.48	283.88	3.15	36.64	4.06	131.50
397	32.56	298.17	4.37	49.49	6.31	134.31
398	32.64	278.81	4.63	27.67	6.68	134.18
399	32.73	255.32	3.08	12.14	7.00	133.86
400	32.81	262.88	4.01	31.67	6.90	133.24
401	32.89	253.42	3.79	43.59	7.79	133.82
402	32.97	237.93	4.07	43.17	7.62	134.10
403	33.05	285.82	4.35	21.82	6.26	134.91
404	33.14	378.41	4.57	47.09	4.38	135.92
405	33.22	454.56	4.96	35.48	2.32	136.63
406	33.30	590.72	4.59	12.69	1.11	136.38
407	33.38	557.88	3.56	11.97	0.26	135.62
408	33.46	552.73	3.44	2.57	0.00	134.76
409	33.55	580.60	3.33	-3.90	0.00	134.62
410	33.63	631.41	3.21	-8.81	0.00	134.35
411	33.71	540.88	3.10	15.54	0.23	135.22
412	33.79	494.08	4.73	13.90	1.15	135.68
413	33.87	491.44	4.27	-14.62	1.57	136.04
414	33.96	503.67	3.82	-0.54	0.97	135.74
415	34.04	572.12	4.01	4.79	0.62	135.68
416	34.12	556.86	4.01	-3.27	0.51	135.98
417	34.20	560.37	4.17	37.60	0.00	133.05
418	34.28	563.88	0.00	34.30	0.00	128.02
419	34.37	491.01	0.00	35.85	N/A	87.36
420	34.45	491.01	0.00	35.85	N/A	87.36
421	34.53	607.27	0.00	38.32	N/A	87.36

Abbreviations

Depth:	Depth from free surface, at which CPT was performed (ft)
q _c :	Measured cone resistance (tsf)
f _s :	Sleeve friction resistance (tsf)
u:	Pore pressure (tsf)
Fines content:	Percentage of fines in soil (%)
Unit weight:	Bulk soil unit weight (pcf)

:: Cyclic Stress Ratio fully adjusted (CSR*) calculation data ::												
Point ID	Depth (ft)	σ_v (tsf)	u_0 (tsf)	σ'_v (tsf)	r_d	CSR	MSF	CSR_{eq}	K_G	User FS	CSR*	Belongs to transition
1	0.08	0.00	0.00	0.00	1.00	0.351	1.15	0.305	1.00	1.00	2.000	No
2	0.16	0.01	0.00	0.01	1.00	0.351	1.15	0.305	1.00	1.00	2.000	No
3	0.25	0.01	0.00	0.01	1.00	0.351	1.15	0.305	1.00	1.00	2.000	No
4	0.33	0.02	0.00	0.02	1.00	0.351	1.15	0.305	1.00	1.00	2.000	No
5	0.41	0.02	0.00	0.02	1.00	0.351	1.15	0.305	1.00	1.00	2.000	No
6	0.49	0.03	0.00	0.03	1.00	0.351	1.15	0.305	1.00	1.00	2.000	No
7	0.57	0.03	0.00	0.03	1.00	0.351	1.15	0.305	1.00	1.00	2.000	No
8	0.66	0.04	0.00	0.04	1.00	0.351	1.15	0.305	1.00	1.00	2.000	No
9	0.74	0.04	0.00	0.04	1.00	0.351	1.15	0.305	1.00	1.00	2.000	No
10	0.82	0.05	0.00	0.05	1.00	0.351	1.15	0.305	1.00	1.00	2.000	No
11	0.90	0.05	0.00	0.05	1.00	0.351	1.15	0.305	1.00	1.00	2.000	No
12	0.98	0.06	0.00	0.06	1.00	0.351	1.15	0.305	1.00	1.00	2.000	No
13	1.07	0.06	0.00	0.06	1.00	0.351	1.15	0.305	1.00	1.00	2.000	No
14	1.15	0.07	0.00	0.07	1.00	0.351	1.15	0.305	1.00	1.00	2.000	No
15	1.23	0.07	0.00	0.07	1.00	0.351	1.15	0.305	1.00	1.00	2.000	No
16	1.31	0.08	0.00	0.08	1.00	0.351	1.15	0.305	1.00	1.00	2.000	No
17	1.39	0.08	0.00	0.08	1.00	0.351	1.15	0.305	1.00	1.00	2.000	No
18	1.48	0.09	0.00	0.09	1.00	0.350	1.15	0.305	1.00	1.00	2.000	No
19	1.56	0.09	0.00	0.09	1.00	0.350	1.15	0.305	1.00	1.00	2.000	No
20	1.64	0.10	0.00	0.10	1.00	0.350	1.15	0.305	1.00	1.00	2.000	No
21	1.72	0.10	0.00	0.10	1.00	0.350	1.15	0.305	1.00	1.00	2.000	No
22	1.80	0.11	0.00	0.11	1.00	0.350	1.15	0.304	1.00	1.00	2.000	No
23	1.89	0.11	0.00	0.11	1.00	0.350	1.15	0.304	1.00	1.00	2.000	No
24	1.97	0.12	0.00	0.12	1.00	0.350	1.15	0.304	1.00	1.00	2.000	No
25	2.05	0.12	0.00	0.12	1.00	0.350	1.15	0.304	1.00	1.00	2.000	No
26	2.13	0.13	0.00	0.13	1.00	0.350	1.15	0.304	1.00	1.00	2.000	No
27	2.21	0.13	0.00	0.13	1.00	0.350	1.15	0.304	1.00	1.00	2.000	No
28	2.30	0.14	0.00	0.14	1.00	0.350	1.15	0.304	1.00	1.00	2.000	No
29	2.38	0.14	0.00	0.14	1.00	0.350	1.15	0.304	1.00	1.00	2.000	No
30	2.46	0.15	0.00	0.15	1.00	0.350	1.15	0.304	1.00	1.00	2.000	No
31	2.54	0.15	0.00	0.15	1.00	0.350	1.15	0.304	1.00	1.00	2.000	No
32	2.62	0.16	0.00	0.16	1.00	0.350	1.15	0.304	1.00	1.00	2.000	No
33	2.71	0.16	0.00	0.16	1.00	0.349	1.15	0.304	1.00	1.00	2.000	No
34	2.79	0.17	0.00	0.17	1.00	0.349	1.15	0.304	1.00	1.00	2.000	No
35	2.87	0.17	0.00	0.17	1.00	0.349	1.15	0.304	1.00	1.00	2.000	No
36	2.95	0.18	0.00	0.18	1.00	0.349	1.15	0.304	1.00	1.00	2.000	No
37	3.03	0.18	0.00	0.18	0.99	0.349	1.15	0.304	1.00	1.00	2.000	No
38	3.12	0.19	0.00	0.19	0.99	0.349	1.15	0.304	1.00	1.00	2.000	No
39	3.20	0.19	0.00	0.19	0.99	0.349	1.15	0.303	1.00	1.00	2.000	No
40	3.28	0.20	0.00	0.20	0.99	0.349	1.15	0.303	1.00	1.00	2.000	No
41	3.36	0.20	0.00	0.20	0.99	0.349	1.15	0.303	1.00	1.00	2.000	No
42	3.44	0.21	0.00	0.21	0.99	0.349	1.15	0.303	1.00	1.00	2.000	No
43	3.53	0.21	0.00	0.21	0.99	0.349	1.15	0.303	1.00	1.00	2.000	No
44	3.61	0.21	0.00	0.21	0.99	0.349	1.15	0.303	1.00	1.00	2.000	No
45	3.69	0.22	0.00	0.22	0.99	0.349	1.15	0.303	1.00	1.00	2.000	No
46	3.77	0.22	0.00	0.22	0.99	0.349	1.15	0.303	1.00	1.00	2.000	No
47	3.85	0.23	0.00	0.23	0.99	0.349	1.15	0.303	1.00	1.00	2.000	No
48	3.94	0.23	0.00	0.23	0.99	0.348	1.15	0.303	1.00	1.00	2.000	No

:: Cyclic Stress Ratio fully adjusted (CSR*) calculation data :: (continued)												
Point ID	Depth (ft)	σ_v (tsf)	u_0 (tsf)	σ'_v (tsf)	r_d	CSR	MSF	CSR _{eq}	K_G	User FS	CSR*	Belongs to transition
49	4.02	0.24	0.00	0.24	0.99	0.349	1.15	0.304	1.00	1.00	0.304	No
50	4.10	0.24	0.00	0.24	0.99	0.353	1.15	0.307	1.00	1.00	0.307	No
51	4.18	0.25	0.01	0.24	0.99	0.356	1.15	0.310	1.00	1.00	0.310	No
52	4.27	0.25	0.01	0.24	0.99	0.360	1.15	0.313	1.00	1.00	0.313	No
53	4.35	0.26	0.01	0.25	0.99	0.363	1.15	0.316	1.00	1.00	0.316	No
54	4.43	0.26	0.01	0.25	0.99	0.367	1.15	0.319	1.00	1.00	0.319	No
55	4.51	0.26	0.02	0.25	0.99	0.370	1.15	0.322	1.00	1.00	0.322	No
56	4.59	0.27	0.02	0.25	0.99	0.374	1.15	0.325	1.00	1.00	0.325	No
57	4.68	0.27	0.02	0.25	0.99	0.377	1.15	0.328	1.00	1.00	0.328	No
58	4.76	0.28	0.02	0.25	0.99	0.380	1.15	0.330	1.00	1.00	0.330	No
59	4.84	0.28	0.03	0.26	0.99	0.383	1.15	0.333	1.00	1.00	0.333	No
60	4.92	0.29	0.03	0.26	0.99	0.386	1.15	0.336	1.00	1.00	0.336	No
61	5.00	0.29	0.03	0.26	0.99	0.389	1.15	0.339	1.00	1.00	0.339	No
62	5.09	0.30	0.03	0.26	0.99	0.392	1.15	0.341	1.00	1.00	0.341	No
63	5.17	0.30	0.04	0.26	0.99	0.395	1.15	0.344	1.00	1.00	0.344	No
64	5.25	0.30	0.04	0.27	0.99	0.398	1.15	0.346	1.00	1.00	0.346	No
65	5.33	0.31	0.04	0.27	0.99	0.401	1.15	0.349	1.00	1.00	0.349	No
66	5.41	0.31	0.04	0.27	0.99	0.404	1.15	0.351	1.00	1.00	0.351	No
67	5.50	0.32	0.05	0.27	0.99	0.407	1.15	0.354	1.00	1.00	0.354	No
68	5.58	0.32	0.05	0.27	0.99	0.410	1.15	0.356	1.00	1.00	0.356	No
69	5.66	0.33	0.05	0.27	0.99	0.412	1.15	0.359	1.00	1.00	0.359	No
70	5.74	0.33	0.05	0.28	0.99	0.415	1.15	0.361	1.00	1.00	0.361	No
71	5.82	0.34	0.06	0.28	0.99	0.418	1.15	0.363	1.00	1.00	0.363	No
72	5.91	0.34	0.06	0.28	0.99	0.420	1.15	0.365	1.00	1.00	0.365	No
73	5.99	0.34	0.06	0.28	0.99	0.423	1.15	0.368	1.00	1.00	0.368	No
74	6.07	0.35	0.06	0.28	0.99	0.426	1.15	0.370	1.00	1.00	0.370	No
75	6.15	0.35	0.07	0.29	0.99	0.428	1.15	0.372	1.00	1.00	0.372	No
76	6.23	0.36	0.07	0.29	0.99	0.431	1.15	0.374	1.00	1.00	0.374	No
77	6.32	0.36	0.07	0.29	0.99	0.433	1.15	0.376	1.00	1.00	0.376	No
78	6.40	0.37	0.07	0.29	0.99	0.435	1.15	0.379	1.00	1.00	0.379	No
79	6.48	0.37	0.08	0.29	0.99	0.438	1.15	0.381	1.00	1.00	0.381	No
80	6.56	0.37	0.08	0.29	0.99	0.440	1.15	0.383	1.00	1.00	0.383	No
81	6.64	0.38	0.08	0.30	0.99	0.443	1.15	0.385	1.00	1.00	0.385	No
82	6.73	0.38	0.09	0.30	0.99	0.445	1.15	0.387	1.00	1.00	0.387	No
83	6.81	0.39	0.09	0.30	0.99	0.447	1.15	0.389	1.00	1.00	0.389	No
84	6.89	0.39	0.09	0.30	0.99	0.449	1.15	0.391	1.00	1.00	0.391	No
85	6.97	0.40	0.09	0.30	0.99	0.452	1.15	0.393	1.00	1.00	0.393	No
86	7.05	0.40	0.10	0.31	0.99	0.454	1.15	0.395	1.00	1.00	0.395	No
87	7.14	0.40	0.10	0.31	0.99	0.456	1.15	0.397	1.00	1.00	0.397	No
88	7.22	0.41	0.10	0.31	0.99	0.458	1.15	0.398	1.00	1.00	0.398	No
89	7.30	0.41	0.10	0.31	0.99	0.461	1.15	0.400	1.00	1.00	0.400	No
90	7.38	0.42	0.11	0.31	0.98	0.463	1.15	0.402	1.00	1.00	0.402	No
91	7.46	0.42	0.11	0.31	0.98	0.465	1.15	0.404	1.00	1.00	0.404	No
92	7.55	0.43	0.11	0.31	0.98	0.467	1.15	0.406	1.00	1.00	0.406	No
93	7.63	0.43	0.11	0.32	0.98	0.469	1.15	0.408	1.00	1.00	0.408	No
94	7.71	0.43	0.12	0.32	0.98	0.471	1.15	0.410	1.00	1.00	0.410	No
95	7.79	0.44	0.12	0.32	0.98	0.473	1.15	0.412	1.00	1.00	0.412	No
96	7.87	0.44	0.12	0.32	0.98	0.475	1.15	0.413	1.00	1.00	0.413	No

:: Cyclic Stress Ratio fully adjusted (CSR*) calculation data :: (continued)												
Point ID	Depth (ft)	σ_v (tsf)	u_0 (tsf)	σ'_v (tsf)	r_d	CSR	MSF	CSR_{eq}	K_G	User FS	CSR*	Belongs to transition
97	7.96	0.45	0.12	0.32	0.98	0.477	1.15	0.415	1.00	1.00	0.415	No
98	8.04	0.45	0.13	0.32	0.98	0.479	1.15	0.417	1.00	1.00	0.417	No
99	8.12	0.45	0.13	0.33	0.98	0.481	1.15	0.418	1.00	1.00	0.418	No
100	8.20	0.46	0.13	0.33	0.98	0.483	1.15	0.420	1.00	1.00	0.420	No
101	8.28	0.46	0.13	0.33	0.98	0.485	1.15	0.422	1.00	1.00	0.422	No
102	8.37	0.47	0.14	0.33	0.98	0.487	1.15	0.423	1.00	1.00	0.423	No
103	8.45	0.47	0.14	0.33	0.98	0.489	1.15	0.425	1.00	1.00	0.425	No
104	8.53	0.48	0.14	0.33	0.98	0.491	1.15	0.427	1.00	1.00	0.427	No
105	8.61	0.48	0.14	0.34	0.98	0.493	1.15	0.428	1.00	1.00	0.428	No
106	8.69	0.48	0.15	0.34	0.98	0.494	1.15	0.430	1.00	1.00	0.430	No
107	8.78	0.49	0.15	0.34	0.98	0.496	1.15	0.431	1.00	1.00	0.431	No
108	8.86	0.49	0.15	0.34	0.98	0.498	1.15	0.433	1.00	1.00	0.433	No
109	8.94	0.50	0.15	0.34	0.98	0.500	1.15	0.434	1.00	1.00	0.434	No
110	9.02	0.50	0.16	0.34	0.98	0.501	1.15	0.436	1.00	1.00	0.436	No
111	9.10	0.50	0.16	0.35	0.98	0.503	1.15	0.437	1.00	1.00	0.437	No
112	9.19	0.51	0.16	0.35	0.98	0.505	1.15	0.439	1.00	1.00	0.439	No
113	9.27	0.51	0.16	0.35	0.98	0.507	1.15	0.440	1.00	1.00	0.440	No
114	9.35	0.52	0.17	0.35	0.98	0.508	1.15	0.442	1.00	1.00	0.442	No
115	9.43	0.52	0.17	0.35	0.98	0.510	1.15	0.443	1.00	1.00	0.443	No
116	9.51	0.53	0.17	0.35	0.98	0.511	1.15	0.445	1.00	1.00	0.445	No
117	9.60	0.53	0.17	0.36	0.98	0.513	1.15	0.446	1.00	1.00	0.446	No
118	9.68	0.53	0.18	0.36	0.98	0.514	1.15	0.447	1.00	1.00	0.447	No
119	9.76	0.54	0.18	0.36	0.98	0.516	1.15	0.449	1.00	1.00	0.449	No
120	9.84	0.54	0.18	0.36	0.98	0.518	1.15	0.450	1.00	1.00	0.450	No
121	9.92	0.55	0.18	0.36	0.98	0.519	1.15	0.451	1.00	1.00	0.451	No
122	10.01	0.55	0.19	0.36	0.98	0.520	1.15	0.453	1.00	1.00	0.453	No
123	10.09	0.56	0.19	0.37	0.98	0.522	1.15	0.454	1.00	1.00	0.454	No
124	10.17	0.56	0.19	0.37	0.98	0.523	1.15	0.455	1.00	1.00	0.455	No
125	10.25	0.56	0.20	0.37	0.98	0.525	1.15	0.456	1.00	1.00	0.456	No
126	10.33	0.57	0.20	0.37	0.98	0.526	1.15	0.458	1.00	1.00	0.458	No
127	10.42	0.57	0.20	0.37	0.98	0.528	1.15	0.459	1.00	1.00	0.459	No
128	10.50	0.58	0.20	0.37	0.98	0.529	1.15	0.460	1.00	1.00	0.460	No
129	10.58	0.58	0.21	0.38	0.98	0.531	1.15	0.461	1.00	1.00	0.461	No
130	10.66	0.59	0.21	0.38	0.98	0.532	1.15	0.463	1.00	1.00	0.463	No
131	10.74	0.59	0.21	0.38	0.98	0.533	1.15	0.464	1.00	1.00	0.464	No
132	10.83	0.59	0.21	0.38	0.98	0.535	1.15	0.465	1.00	1.00	0.465	No
133	10.91	0.60	0.22	0.38	0.98	0.536	1.15	0.466	1.00	1.00	0.466	No
134	10.99	0.60	0.22	0.38	0.98	0.537	1.15	0.467	1.00	1.00	0.467	No
135	11.07	0.61	0.22	0.39	0.98	0.539	1.15	0.468	1.00	1.00	0.468	No
136	11.15	0.61	0.22	0.39	0.98	0.540	1.15	0.470	1.00	1.00	0.470	No
137	11.24	0.62	0.23	0.39	0.98	0.541	1.15	0.471	1.00	1.00	0.471	No
138	11.32	0.62	0.23	0.39	0.98	0.543	1.15	0.472	1.00	1.00	0.472	No
139	11.40	0.62	0.23	0.39	0.98	0.544	1.15	0.473	1.00	1.00	0.473	No
140	11.48	0.63	0.23	0.39	0.98	0.545	1.15	0.474	1.00	1.00	0.474	No
141	11.56	0.63	0.24	0.40	0.98	0.547	1.15	0.475	1.00	1.00	0.475	No
142	11.65	0.64	0.24	0.40	0.98	0.548	1.15	0.476	1.00	1.00	0.476	No
143	11.73	0.64	0.24	0.40	0.98	0.549	1.15	0.477	1.00	1.00	0.477	No
144	11.81	0.64	0.24	0.40	0.98	0.550	1.15	0.478	1.00	1.00	0.478	No

:: Cyclic Stress Ratio fully adjusted (CSR*) calculation data :: (continued)												
Point ID	Depth (ft)	σ_v (tsf)	u_0 (tsf)	σ'_v (tsf)	r_d	CSR	MSF	CSR_{eq}	K_G	User FS	CSR*	Belongs to transition
145	11.89	0.65	0.25	0.40	0.98	0.551	1.15	0.479	1.00	1.00	0.479	No
146	11.98	0.65	0.25	0.40	0.97	0.553	1.15	0.480	1.00	1.00	0.480	No
147	12.06	0.66	0.25	0.41	0.97	0.554	1.15	0.481	1.00	1.00	0.481	No
148	12.14	0.66	0.25	0.41	0.97	0.555	1.15	0.482	1.00	1.00	0.482	No
149	12.22	0.67	0.26	0.41	0.97	0.556	1.15	0.483	1.00	1.00	0.483	No
150	12.30	0.67	0.26	0.41	0.97	0.556	1.15	0.484	1.00	1.00	0.484	No
151	12.39	0.68	0.26	0.42	0.97	0.557	1.15	0.485	1.00	1.00	0.485	No
152	12.47	0.68	0.26	0.42	0.97	0.558	1.15	0.485	1.00	1.00	0.485	No
153	12.55	0.69	0.27	0.42	0.97	0.559	1.15	0.486	1.00	1.00	0.486	No
154	12.63	0.69	0.27	0.42	0.97	0.560	1.15	0.487	1.00	1.00	0.487	No
155	12.71	0.70	0.27	0.42	0.97	0.561	1.15	0.487	1.00	1.00	0.487	No
156	12.80	0.70	0.27	0.43	0.97	0.561	1.15	0.488	1.00	1.00	0.488	No
157	12.88	0.71	0.28	0.43	0.97	0.562	1.15	0.489	1.00	1.00	0.489	No
158	12.96	0.71	0.28	0.43	0.97	0.563	1.15	0.489	1.00	1.00	0.489	No
159	13.04	0.72	0.28	0.43	0.97	0.563	1.15	0.490	1.00	1.00	0.490	No
160	13.12	0.72	0.28	0.44	0.97	0.564	1.15	0.491	1.00	1.00	0.491	No
161	13.21	0.73	0.29	0.44	0.97	0.565	1.15	0.491	1.00	1.00	0.491	No
162	13.29	0.73	0.29	0.44	0.97	0.566	1.15	0.492	1.00	1.00	0.492	No
163	13.37	0.74	0.29	0.44	0.97	0.566	1.15	0.492	1.00	1.00	0.492	No
164	13.45	0.74	0.29	0.44	0.97	0.567	1.15	0.493	1.00	1.00	0.493	No
165	13.53	0.74	0.30	0.45	0.97	0.568	1.15	0.494	1.00	1.00	0.494	No
166	13.62	0.75	0.30	0.45	0.97	0.569	1.15	0.494	1.00	1.00	0.494	No
167	13.70	0.75	0.30	0.45	0.97	0.569	1.15	0.495	1.00	1.00	0.495	No
168	13.78	0.76	0.31	0.45	0.97	0.570	1.15	0.495	1.00	1.00	0.495	No
169	13.86	0.77	0.31	0.46	0.97	0.570	1.15	0.496	1.00	1.00	0.496	No
170	13.94	0.77	0.31	0.46	0.97	0.570	1.15	0.496	1.00	1.00	0.496	No
171	14.03	0.78	0.31	0.46	0.97	0.571	1.15	0.496	1.00	1.00	0.496	No
172	14.11	0.78	0.32	0.47	0.97	0.571	1.15	0.497	1.00	1.00	0.497	No
173	14.19	0.79	0.32	0.47	0.97	0.572	1.15	0.497	1.00	1.00	0.497	No
174	14.27	0.79	0.32	0.47	0.97	0.572	1.15	0.497	1.00	1.00	0.497	No
175	14.35	0.80	0.32	0.47	0.97	0.573	1.15	0.498	1.00	1.00	0.498	No
176	14.44	0.80	0.33	0.48	0.97	0.573	1.15	0.498	1.00	1.00	0.498	No
177	14.52	0.81	0.33	0.48	0.97	0.574	1.15	0.499	1.00	1.00	0.499	No
178	14.60	0.81	0.33	0.48	0.97	0.574	1.15	0.499	1.00	1.00	0.499	No
179	14.68	0.82	0.33	0.48	0.97	0.575	1.15	0.500	1.00	1.00	0.500	No
180	14.76	0.82	0.34	0.48	0.97	0.576	1.15	0.500	1.00	1.00	0.500	No
181	14.85	0.83	0.34	0.49	0.97	0.576	1.15	0.501	1.00	1.00	0.501	No
182	14.93	0.83	0.34	0.49	0.97	0.577	1.15	0.501	1.00	1.00	0.501	No
183	15.01	0.84	0.34	0.49	0.97	0.577	1.15	0.502	1.00	1.00	0.502	No
184	15.09	0.84	0.35	0.49	0.97	0.578	1.15	0.502	1.00	1.00	0.502	No
185	15.17	0.85	0.35	0.50	0.97	0.578	1.15	0.503	1.00	1.00	0.503	No
186	15.26	0.85	0.35	0.50	0.97	0.579	1.15	0.503	1.00	1.00	0.503	No
187	15.34	0.86	0.35	0.50	0.97	0.579	1.15	0.503	1.00	1.00	0.503	No
188	15.42	0.86	0.36	0.50	0.97	0.579	1.15	0.504	1.00	1.00	0.504	No
189	15.50	0.87	0.36	0.51	0.97	0.580	1.15	0.504	1.00	1.00	0.504	No
190	15.58	0.87	0.36	0.51	0.97	0.580	1.15	0.505	1.00	1.00	0.505	No
191	15.67	0.88	0.36	0.51	0.97	0.581	1.15	0.505	1.00	1.00	0.505	No
192	15.75	0.88	0.37	0.51	0.97	0.581	1.15	0.505	1.00	1.00	0.505	No

:: Cyclic Stress Ratio fully adjusted (CSR*) calculation data :: (continued)												
Point ID	Depth (ft)	σ_v (tsf)	u_0 (tsf)	σ'_v (tsf)	r_d	CSR	MSF	CSR _{eq}	K_G	User FS	CSR*	Belongs to transition
193	15.83	0.89	0.37	0.52	0.97	0.582	1.15	0.506	1.00	1.00	0.506	No
194	15.91	0.89	0.37	0.52	0.97	0.582	1.15	0.506	1.00	1.00	0.506	No
195	15.99	0.90	0.37	0.52	0.97	0.582	1.15	0.506	1.00	1.00	0.506	No
196	16.08	0.90	0.38	0.52	0.97	0.583	1.15	0.507	1.00	1.00	0.507	No
197	16.16	0.91	0.38	0.53	0.97	0.583	1.15	0.507	1.00	1.00	0.507	No
198	16.24	0.91	0.38	0.53	0.97	0.583	1.15	0.507	1.00	1.00	0.507	No
199	16.32	0.92	0.38	0.53	0.97	0.584	1.15	0.508	1.00	1.00	0.508	No
200	16.40	0.92	0.39	0.53	0.97	0.584	1.15	0.508	1.00	1.00	0.508	No
201	16.49	0.93	0.39	0.54	0.97	0.585	1.15	0.508	1.00	1.00	0.508	No
202	16.57	0.93	0.39	0.54	0.97	0.585	1.15	0.509	1.00	1.00	0.509	No
203	16.65	0.94	0.39	0.54	0.96	0.585	1.15	0.509	1.00	1.00	0.509	No
204	16.73	0.94	0.40	0.54	0.96	0.586	1.15	0.509	1.00	1.00	0.509	No
205	16.81	0.95	0.40	0.55	0.96	0.587	1.15	0.510	1.00	1.00	0.510	No
206	16.90	0.95	0.40	0.55	0.96	0.587	1.15	0.510	1.00	1.00	0.510	No
207	16.98	0.95	0.40	0.55	0.96	0.588	1.15	0.511	1.00	1.00	0.511	No
208	17.06	0.96	0.41	0.55	0.96	0.588	1.15	0.512	1.00	1.00	0.512	No
209	17.14	0.96	0.41	0.55	0.96	0.589	1.15	0.512	1.00	1.00	0.512	No
210	17.22	0.97	0.41	0.55	0.96	0.590	1.15	0.513	1.00	1.00	0.513	No
211	17.31	0.97	0.42	0.56	0.96	0.590	1.15	0.513	1.00	1.00	0.513	No
212	17.39	0.98	0.42	0.56	0.96	0.591	1.15	0.514	1.00	1.00	0.514	No
213	17.47	0.98	0.42	0.56	0.96	0.591	1.15	0.514	1.00	1.00	0.514	No
214	17.55	0.99	0.42	0.56	0.96	0.592	1.15	0.515	1.00	1.00	0.515	No
215	17.63	0.99	0.43	0.56	0.96	0.592	1.15	0.515	1.00	1.00	0.515	No
216	17.72	0.99	0.43	0.57	0.96	0.593	1.15	0.515	1.00	1.00	0.515	No
217	17.80	1.00	0.43	0.57	0.96	0.593	1.15	0.516	1.00	1.00	0.516	No
218	17.88	1.00	0.43	0.57	0.96	0.594	1.15	0.516	1.00	1.00	0.516	No
219	17.96	1.01	0.44	0.57	0.96	0.594	1.15	0.517	1.00	1.00	0.517	No
220	18.04	1.01	0.44	0.58	0.96	0.595	1.15	0.517	1.00	1.00	0.517	No
221	18.13	1.02	0.44	0.58	0.96	0.595	1.15	0.517	1.00	1.00	0.517	No
222	18.21	1.02	0.44	0.58	0.96	0.596	1.15	0.518	1.00	1.00	0.518	No
223	18.29	1.03	0.45	0.58	0.96	0.596	1.15	0.518	1.00	1.00	0.518	No
224	18.37	1.03	0.45	0.58	0.96	0.597	1.15	0.519	1.00	1.00	0.519	No
225	18.45	1.04	0.45	0.59	0.96	0.597	1.15	0.519	1.00	1.00	0.519	No
226	18.54	1.04	0.45	0.59	0.96	0.598	1.15	0.520	1.00	1.00	0.520	No
227	18.62	1.04	0.46	0.59	0.96	0.598	1.15	0.520	1.00	1.00	0.520	No
228	18.70	1.05	0.46	0.59	0.96	0.599	1.15	0.521	1.00	1.00	0.521	No
229	18.78	1.05	0.46	0.59	0.96	0.599	1.15	0.521	1.00	1.00	0.521	No
230	18.86	1.06	0.46	0.59	0.96	0.600	1.15	0.521	1.00	1.00	0.521	No
231	18.95	1.06	0.47	0.60	0.96	0.600	1.15	0.522	1.00	1.00	0.522	No
232	19.03	1.07	0.47	0.60	0.96	0.601	1.15	0.522	1.00	1.00	0.522	No
233	19.11	1.07	0.47	0.60	0.96	0.601	1.15	0.523	1.00	1.00	0.523	No
234	19.19	1.08	0.47	0.60	0.96	0.602	1.15	0.523	1.00	1.00	0.523	No
235	19.27	1.08	0.48	0.60	0.96	0.602	1.15	0.524	1.00	1.00	0.524	No
236	19.36	1.08	0.48	0.61	0.96	0.603	1.15	0.524	1.00	1.00	0.524	No
237	19.44	1.09	0.48	0.61	0.96	0.603	1.15	0.525	1.00	1.00	0.525	No
238	19.52	1.09	0.48	0.61	0.96	0.604	1.15	0.525	1.00	1.00	0.525	No
239	19.60	1.10	0.49	0.61	0.96	0.605	1.15	0.526	1.00	1.00	0.526	No
240	19.69	1.10	0.49	0.61	0.96	0.605	1.15	0.526	1.00	1.00	0.526	No

:: Cyclic Stress Ratio fully adjusted (CSR*) calculation data :: (continued)												
Point ID	Depth (ft)	σ_v (tsf)	u_0 (tsf)	σ'_v (tsf)	r_d	CSR	MSF	CSR _{eq}	K_G	User FS	CSR*	Belongs to transition
241	19.77	1.10	0.49	0.61	0.96	0.606	1.15	0.527	1.00	1.00	0.527	No
242	19.85	1.11	0.49	0.61	0.96	0.607	1.15	0.528	1.00	1.00	0.528	No
243	19.93	1.11	0.50	0.61	0.96	0.608	1.15	0.528	1.00	1.00	0.528	No
244	20.01	1.12	0.50	0.62	0.96	0.608	1.15	0.529	1.00	1.00	0.529	No
245	20.10	1.12	0.50	0.62	0.96	0.609	1.15	0.529	1.00	1.00	0.529	No
246	20.18	1.12	0.50	0.62	0.96	0.610	1.15	0.530	1.00	1.00	0.530	No
247	20.26	1.13	0.51	0.62	0.96	0.610	1.15	0.531	1.00	1.00	0.531	No
248	20.34	1.13	0.51	0.62	0.96	0.611	1.15	0.531	1.00	1.00	0.531	No
249	20.42	1.14	0.51	0.62	0.96	0.612	1.15	0.532	1.00	1.00	0.532	No
250	20.51	1.14	0.51	0.62	0.96	0.612	1.15	0.532	1.00	1.00	0.532	No
251	20.59	1.14	0.52	0.63	0.96	0.613	1.15	0.533	1.00	1.00	0.533	No
252	20.67	1.15	0.52	0.63	0.96	0.613	1.15	0.533	1.00	1.00	0.533	No
253	20.75	1.15	0.52	0.63	0.95	0.614	1.15	0.533	1.00	1.00	0.533	No
254	20.83	1.16	0.53	0.63	0.95	0.614	1.15	0.534	1.00	1.00	0.534	No
255	20.92	1.16	0.53	0.63	0.95	0.615	1.15	0.534	1.00	1.00	0.534	No
256	21.00	1.16	0.53	0.63	0.95	0.615	1.15	0.535	1.00	1.00	0.535	No
257	21.08	1.17	0.53	0.64	0.95	0.615	1.15	0.535	1.00	1.00	0.535	No
258	21.16	1.17	0.54	0.64	0.95	0.616	1.15	0.535	1.00	1.00	0.535	No
259	21.24	1.18	0.54	0.64	0.95	0.616	1.15	0.536	1.00	1.00	0.536	No
260	21.33	1.18	0.54	0.64	0.95	0.616	1.15	0.536	1.00	1.00	0.536	No
261	21.41	1.19	0.54	0.64	0.95	0.617	1.15	0.536	1.00	1.00	0.536	No
262	21.49	1.19	0.55	0.65	0.95	0.617	1.15	0.537	1.00	1.00	0.537	No
263	21.57	1.20	0.55	0.65	0.95	0.617	1.15	0.537	1.00	1.00	0.537	No
264	21.65	1.20	0.55	0.65	0.95	0.618	1.15	0.537	1.00	1.00	0.537	No
265	21.74	1.21	0.55	0.65	0.95	0.618	1.15	0.537	1.00	1.00	0.537	No
266	21.82	1.21	0.56	0.65	0.95	0.618	1.15	0.537	1.00	1.00	0.537	No
267	21.90	1.21	0.56	0.66	0.95	0.618	1.15	0.538	1.00	1.00	0.538	No
268	21.98	1.22	0.56	0.66	0.95	0.619	1.15	0.538	1.00	1.00	0.538	No
269	22.06	1.22	0.56	0.66	0.95	0.619	1.15	0.538	1.00	1.00	0.538	No
270	22.15	1.23	0.57	0.66	0.95	0.619	1.15	0.538	1.00	1.00	0.538	No
271	22.23	1.23	0.57	0.67	0.95	0.619	1.15	0.538	1.00	1.00	0.538	No
272	22.31	1.24	0.57	0.67	0.95	0.619	1.15	0.538	1.00	1.00	0.538	No
273	22.39	1.24	0.57	0.67	0.95	0.620	1.15	0.539	1.00	1.00	0.539	No
274	22.47	1.25	0.58	0.67	0.95	0.620	1.15	0.539	1.00	1.00	0.539	No
275	22.56	1.25	0.58	0.67	0.95	0.620	1.15	0.539	1.00	1.00	0.539	No
276	22.64	1.26	0.58	0.67	0.95	0.621	1.15	0.540	1.00	1.00	0.540	No
277	22.72	1.26	0.58	0.68	0.95	0.621	1.15	0.540	1.00	1.00	0.540	No
278	22.80	1.26	0.59	0.68	0.95	0.622	1.15	0.541	1.00	1.00	0.541	No
279	22.88	1.27	0.59	0.68	0.95	0.623	1.15	0.541	1.00	1.00	0.541	No
280	22.97	1.27	0.59	0.68	0.95	0.623	1.15	0.542	1.00	1.00	0.542	No
281	23.05	1.27	0.59	0.68	0.95	0.624	1.15	0.542	1.00	1.00	0.542	No
282	23.13	1.28	0.60	0.68	0.95	0.624	1.15	0.543	1.00	1.00	0.543	No
283	23.21	1.28	0.60	0.68	0.95	0.625	1.15	0.543	1.00	1.00	0.543	No
284	23.29	1.29	0.60	0.68	0.95	0.626	1.15	0.544	1.00	1.00	0.544	No
285	23.38	1.29	0.60	0.68	0.95	0.626	1.15	0.544	1.00	1.00	0.544	No
286	23.46	1.29	0.61	0.69	0.95	0.626	1.15	0.545	1.00	1.00	0.545	No
287	23.54	1.30	0.61	0.69	0.95	0.627	1.15	0.545	1.00	1.00	0.545	No
288	23.62	1.30	0.61	0.69	0.95	0.627	1.15	0.545	1.00	1.00	0.545	No

:: Cyclic Stress Ratio fully adjusted (CSR*) calculation data :: (continued)												
Point ID	Depth (ft)	σ_v (tsf)	u_0 (tsf)	σ_v' (tsf)	r_d	CSR	MSF	CSR _{eq}	K_G	User FS	CSR*	Belongs to transition
289	23.70	1.31	0.61	0.69	0.95	0.627	1.15	0.545	1.00	1.00	0.545	No
290	23.79	1.31	0.62	0.69	0.95	0.627	1.15	0.545	1.00	1.00	0.545	No
291	23.87	1.32	0.62	0.70	0.95	0.627	1.15	0.545	1.00	1.00	0.545	No
292	23.95	1.32	0.62	0.70	0.95	0.627	1.15	0.545	1.00	1.00	0.545	No
293	24.03	1.33	0.63	0.70	0.95	0.627	1.15	0.545	1.00	1.00	0.545	No
294	24.11	1.33	0.63	0.70	0.94	0.627	1.15	0.545	1.00	1.00	0.545	No
295	24.20	1.34	0.63	0.71	0.94	0.627	1.15	0.545	1.00	1.00	0.545	No
296	24.28	1.34	0.63	0.71	0.94	0.627	1.15	0.545	1.00	1.00	0.545	No
297	24.36	1.35	0.64	0.71	0.94	0.626	1.15	0.545	1.00	1.00	0.545	No
298	24.44	1.35	0.64	0.72	0.94	0.626	1.15	0.545	1.00	1.00	0.545	No
299	24.52	1.36	0.64	0.72	0.94	0.626	1.15	0.544	1.00	1.00	0.544	No
300	24.61	1.36	0.64	0.72	0.94	0.626	1.15	0.544	1.00	1.00	0.544	No
301	24.69	1.37	0.65	0.72	0.94	0.626	1.15	0.544	1.00	1.00	0.544	No
302	24.77	1.38	0.65	0.73	0.94	0.626	1.15	0.544	1.00	1.00	0.544	No
303	24.85	1.38	0.65	0.73	0.94	0.626	1.15	0.544	1.00	1.00	0.544	No
304	24.93	1.39	0.65	0.73	0.94	0.625	1.15	0.544	1.00	1.00	0.544	No
305	25.02	1.39	0.66	0.74	0.94	0.625	1.15	0.544	1.00	1.00	0.544	No
306	25.10	1.40	0.66	0.74	0.94	0.625	1.15	0.544	1.00	1.00	0.544	No
307	25.18	1.40	0.66	0.74	0.94	0.625	1.15	0.544	1.00	1.00	0.544	No
308	25.26	1.41	0.66	0.74	0.94	0.625	1.15	0.543	1.00	1.00	0.543	No
309	25.34	1.41	0.67	0.75	0.94	0.625	1.15	0.543	1.00	1.00	0.543	No
310	25.43	1.42	0.67	0.75	0.94	0.625	1.15	0.543	1.00	1.00	0.543	No
311	25.51	1.42	0.67	0.75	0.94	0.625	1.15	0.543	1.00	1.00	0.543	No
312	25.59	1.43	0.67	0.75	0.94	0.625	1.15	0.543	1.00	1.00	0.543	No
313	25.67	1.43	0.68	0.76	0.94	0.625	1.15	0.543	1.00	1.00	0.543	No
314	25.75	1.44	0.68	0.76	0.94	0.625	1.15	0.543	1.00	1.00	0.543	No
315	25.84	1.44	0.68	0.76	0.94	0.625	1.15	0.543	1.00	1.00	0.543	No
316	25.92	1.45	0.68	0.76	0.94	0.625	1.15	0.543	1.00	1.00	0.543	No
317	26.00	1.45	0.69	0.77	0.94	0.625	1.15	0.543	1.00	1.00	0.543	No
318	26.08	1.46	0.69	0.77	0.94	0.624	1.15	0.543	1.00	1.00	0.543	No
319	26.16	1.46	0.69	0.77	0.94	0.624	1.15	0.543	1.00	1.00	0.543	No
320	26.25	1.47	0.69	0.77	0.94	0.624	1.15	0.543	1.00	1.00	0.543	No
321	26.33	1.47	0.70	0.78	0.94	0.624	1.15	0.543	1.00	1.00	0.543	No
322	26.41	1.48	0.70	0.78	0.94	0.624	1.15	0.543	1.00	1.00	0.543	No
323	26.49	1.48	0.70	0.78	0.94	0.624	1.15	0.542	1.00	1.00	0.542	No
324	26.57	1.49	0.70	0.78	0.94	0.624	1.15	0.542	1.00	1.00	0.542	No
325	26.66	1.49	0.71	0.79	0.94	0.624	1.15	0.542	1.00	1.00	0.542	No
326	26.74	1.50	0.71	0.79	0.94	0.624	1.15	0.542	1.00	1.00	0.542	No
327	26.82	1.50	0.71	0.79	0.93	0.623	1.15	0.542	1.00	1.00	0.542	No
328	26.90	1.51	0.71	0.79	0.93	0.623	1.15	0.542	1.00	1.00	0.542	No
329	26.98	1.51	0.72	0.80	0.93	0.623	1.15	0.542	1.00	1.00	0.542	No
330	27.07	1.52	0.72	0.80	0.93	0.623	1.15	0.542	1.00	1.00	0.542	No
331	27.15	1.52	0.72	0.80	0.93	0.623	1.15	0.541	1.00	1.00	0.541	No
332	27.23	1.53	0.72	0.80	0.93	0.623	1.15	0.541	1.00	1.00	0.541	No
333	27.31	1.53	0.73	0.81	0.93	0.622	1.15	0.541	1.00	1.00	0.541	No
334	27.40	1.54	0.73	0.81	0.93	0.622	1.15	0.541	1.00	1.00	0.541	No
335	27.48	1.55	0.73	0.81	0.93	0.622	1.15	0.541	1.00	1.00	0.541	No
336	27.56	1.55	0.74	0.82	0.93	0.622	1.15	0.541	1.00	1.00	0.541	No

:: Cyclic Stress Ratio fully adjusted (CSR*) calculation data :: (continued)												
Point ID	Depth (ft)	σ_v (tsf)	u_0 (tsf)	σ'_v (tsf)	r_d	CSR	MSF	CSR_{eq}	K_G	User FS	CSR*	Belongs to transition
337	27.64	1.56	0.74	0.82	0.93	0.622	1.15	0.541	1.00	1.00	0.541	No
338	27.72	1.56	0.74	0.82	0.93	0.622	1.15	0.540	1.00	1.00	0.540	No
339	27.81	1.57	0.74	0.82	0.93	0.621	1.15	0.540	1.00	1.00	0.540	No
340	27.89	1.57	0.75	0.83	0.93	0.621	1.15	0.540	1.00	1.00	0.540	No
341	27.97	1.58	0.75	0.83	0.93	0.621	1.15	0.540	1.00	1.00	0.540	No
342	28.05	1.58	0.75	0.83	0.93	0.621	1.15	0.539	1.00	1.00	0.539	No
343	28.13	1.59	0.75	0.84	0.93	0.620	1.15	0.539	1.00	1.00	0.539	No
344	28.22	1.59	0.76	0.84	0.93	0.620	1.15	0.539	1.00	1.00	0.539	No
345	28.30	1.60	0.76	0.84	0.93	0.620	1.15	0.539	1.00	1.00	0.539	No
346	28.38	1.60	0.76	0.84	0.93	0.619	1.15	0.539	1.00	1.00	0.539	No
347	28.46	1.61	0.76	0.85	0.93	0.619	1.15	0.538	1.00	1.00	0.538	No
348	28.54	1.62	0.77	0.85	0.93	0.619	1.15	0.538	1.00	1.00	0.538	No
349	28.63	1.62	0.77	0.85	0.93	0.619	1.15	0.538	1.00	1.00	0.538	No
350	28.71	1.63	0.77	0.86	0.93	0.618	1.15	0.537	1.00	1.00	0.537	No
351	28.79	1.63	0.77	0.86	0.93	0.618	1.15	0.537	1.00	1.00	0.537	No
352	28.87	1.64	0.78	0.86	0.93	0.618	1.15	0.537	1.00	1.00	0.537	No
353	28.95	1.64	0.78	0.86	0.93	0.617	1.15	0.537	1.00	1.00	0.537	No
354	29.04	1.65	0.78	0.87	0.93	0.617	1.15	0.537	1.00	1.00	0.537	No
355	29.12	1.65	0.78	0.87	0.92	0.617	1.15	0.536	1.00	1.00	0.536	No
356	29.20	1.66	0.79	0.87	0.92	0.617	1.15	0.536	1.00	1.00	0.536	No
357	29.28	1.66	0.79	0.88	0.92	0.617	1.15	0.536	1.00	1.00	0.536	No
358	29.36	1.67	0.79	0.88	0.92	0.616	1.15	0.536	1.00	1.00	0.536	No
359	29.45	1.68	0.79	0.88	0.92	0.616	1.15	0.536	1.00	1.00	0.536	No
360	29.53	1.68	0.80	0.88	0.92	0.616	1.15	0.535	1.00	1.00	0.535	No
361	29.61	1.69	0.80	0.89	0.92	0.616	1.15	0.535	1.00	1.00	0.535	No
362	29.69	1.69	0.80	0.89	0.92	0.615	1.15	0.535	1.00	1.00	0.535	No
363	29.77	1.70	0.80	0.89	0.92	0.615	1.15	0.535	1.00	1.00	0.535	No
364	29.86	1.70	0.81	0.90	0.92	0.615	1.15	0.534	1.00	1.00	0.534	No
365	29.94	1.71	0.81	0.90	0.92	0.614	1.15	0.534	1.00	1.00	0.534	No
366	30.02	1.71	0.81	0.90	0.92	0.614	1.15	0.534	1.00	1.00	0.534	No
367	30.10	1.72	0.81	0.90	0.92	0.614	1.15	0.534	1.00	1.00	0.534	No
368	30.18	1.72	0.82	0.91	0.92	0.613	1.15	0.533	1.00	1.00	0.533	No
369	30.27	1.73	0.82	0.91	0.92	0.613	1.15	0.533	1.00	1.00	0.533	No
370	30.35	1.73	0.82	0.91	0.92	0.613	1.15	0.533	1.00	1.00	0.533	No
371	30.43	1.74	0.82	0.92	0.92	0.613	1.15	0.533	1.00	1.00	0.533	No
372	30.51	1.75	0.83	0.92	0.92	0.612	1.15	0.532	1.00	1.00	0.532	No
373	30.59	1.75	0.83	0.92	0.92	0.612	1.15	0.532	1.00	1.00	0.532	No
374	30.68	1.76	0.83	0.92	0.92	0.612	1.15	0.532	1.00	1.00	0.532	No
375	30.76	1.76	0.83	0.93	0.92	0.612	1.15	0.532	1.00	1.00	0.532	No
376	30.84	1.77	0.84	0.93	0.92	0.612	1.15	0.532	1.00	1.00	0.532	No
377	30.92	1.77	0.84	0.93	0.92	0.611	1.15	0.531	1.00	1.00	0.531	No
378	31.00	1.78	0.84	0.93	0.92	0.611	1.15	0.531	1.00	1.00	0.531	No
379	31.09	1.78	0.85	0.94	0.91	0.611	1.15	0.531	1.00	1.00	0.531	No
380	31.17	1.79	0.85	0.94	0.91	0.611	1.15	0.531	1.00	1.00	0.531	No
381	31.25	1.79	0.85	0.94	0.91	0.610	1.15	0.531	1.00	1.00	0.531	No
382	31.33	1.80	0.85	0.94	0.91	0.610	1.15	0.531	1.00	1.00	0.531	No
383	31.41	1.80	0.86	0.95	0.91	0.610	1.15	0.530	1.00	1.00	0.530	No
384	31.50	1.81	0.86	0.95	0.91	0.610	1.15	0.530	1.00	1.00	0.530	No

:: Cyclic Stress Ratio fully adjusted (CSR*) calculation data :: (continued)												
Point ID	Depth (ft)	σ_v (tsf)	u_0 (tsf)	σ_v' (tsf)	r_d	CSR	MSF	CSR _{eq}	K_G	User FS	CSR*	Belongs to transition
385	31.58	1.81	0.86	0.95	0.91	0.610	1.15	0.530	1.00	1.00	0.530	No
386	31.66	1.82	0.86	0.95	0.91	0.609	1.15	0.530	1.00	1.00	0.530	No
387	31.74	1.82	0.87	0.96	0.91	0.609	1.15	0.530	1.00	1.00	0.530	No
388	31.82	1.83	0.87	0.96	0.91	0.609	1.15	0.529	1.00	1.00	0.529	No
389	31.91	1.83	0.87	0.96	0.91	0.609	1.15	0.529	1.00	1.00	0.529	No
390	31.99	1.84	0.87	0.97	0.91	0.608	1.15	0.529	1.00	1.00	0.529	No
391	32.07	1.84	0.88	0.97	0.91	0.608	1.15	0.529	1.00	1.00	0.529	No
392	32.15	1.85	0.88	0.97	0.91	0.608	1.15	0.528	1.00	1.00	0.528	No
393	32.23	1.85	0.88	0.97	0.91	0.607	1.15	0.528	1.00	1.00	0.528	No
394	32.32	1.86	0.88	0.98	0.91	0.607	1.15	0.528	1.00	1.00	0.528	No
395	32.40	1.86	0.89	0.98	0.91	0.607	1.15	0.528	1.00	1.00	0.528	No
396	32.48	1.87	0.89	0.98	0.91	0.607	1.15	0.527	1.00	1.00	0.527	No
397	32.56	1.88	0.89	0.98	0.91	0.606	1.15	0.527	1.00	1.00	0.527	No
398	32.64	1.88	0.89	0.99	0.91	0.606	1.15	0.527	1.00	1.00	0.527	No
399	32.73	1.89	0.90	0.99	0.91	0.606	1.15	0.526	1.00	1.00	0.526	No
400	32.81	1.89	0.90	0.99	0.90	0.605	1.15	0.526	1.00	1.00	0.526	No
401	32.89	1.90	0.90	1.00	0.90	0.605	1.15	0.526	1.00	1.00	0.526	No
402	32.97	1.90	0.90	1.00	0.90	0.604	1.15	0.526	1.00	1.00	0.526	No
403	33.05	1.91	0.91	1.00	0.90	0.604	1.15	0.525	1.00	1.00	0.525	No
404	33.14	1.91	0.91	1.00	0.90	0.604	1.15	0.525	1.00	1.00	0.525	No
405	33.22	1.92	0.91	1.01	0.90	0.603	1.15	0.524	1.00	1.00	0.524	No
406	33.30	1.92	0.91	1.01	0.90	0.603	1.15	0.524	1.00	1.00	0.524	No
407	33.38	1.93	0.92	1.01	0.90	0.602	1.15	0.524	1.00	1.00	0.524	No
408	33.46	1.94	0.92	1.02	0.90	0.602	1.15	0.523	1.00	1.00	0.523	No
409	33.55	1.94	0.92	1.02	0.90	0.602	1.15	0.523	1.00	1.00	0.523	No
410	33.63	1.95	0.92	1.02	0.90	0.601	1.15	0.523	1.00	1.00	0.523	No
411	33.71	1.95	0.93	1.03	0.90	0.601	1.15	0.522	1.00	1.00	0.522	No
412	33.79	1.96	0.93	1.03	0.90	0.601	1.15	0.522	1.00	1.00	0.522	No
413	33.87	1.96	0.93	1.03	0.90	0.600	1.15	0.522	1.00	1.00	0.522	No
414	33.96	1.97	0.93	1.03	0.90	0.600	1.15	0.521	1.00	1.00	0.521	No
415	34.04	1.97	0.94	1.04	0.90	0.599	1.15	0.521	1.00	1.00	0.521	No
416	34.12	1.98	0.94	1.04	0.90	0.599	1.15	0.521	1.00	1.00	0.521	No
417	34.20	1.99	0.94	1.04	0.90	0.599	1.15	0.520	1.00	1.00	0.520	No
418	34.28	1.99	0.94	1.05	0.90	0.598	1.15	0.520	1.00	1.00	0.520	No
419	34.37	1.99	0.95	1.05	0.89	0.598	1.15	0.520	1.00	1.00	2.000	No
420	34.45	2.00	0.95	1.05	0.89	0.598	1.15	0.520	1.00	1.00	2.000	No
421	34.53	2.00	0.95	1.05	0.89	0.599	1.15	0.520	1.00	1.00	2.000	No

Abbreviations

- Depth: Depth from free surface, at which CPT was performed (ft)
- σ_v : Total overburden pressure at test point (tsf)
- u_0 : Water pressure at test point (tsf)
- σ_v' : Effective overburden pressure based on GWT during earthquake (tsf)
- r_d : Nonlinear shear mass factor
- CSR: Cyclic Stress Ratio
- MSF: Magnitude Scaling Factor
- CSR_{eq}: CSR adjusted for M=7.5
- K_G : Effective overburden stress factor
- CSR*: CSR fully adjusted

:: Cyclic Resistance Ratio (CRR) calculation data ::												
Point ID	Depth (ft)	q _t (tsf)	I _c	Fr (%)	n	Q _{tn}	K _c	Q _{tn,cs}	CRR _{7.5}	Belongs to trans. layer	Clay-like behaviour	FS
1	0.08	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
2	0.16	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
3	0.25	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
4	0.33	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
5	0.41	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
6	0.49	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
7	0.57	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
8	0.66	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
9	0.74	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
10	0.82	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
11	0.90	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
12	0.98	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
13	1.07	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
14	1.15	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
15	1.23	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
16	1.31	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
17	1.39	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
18	1.48	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
19	1.56	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
20	1.64	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
21	1.72	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
22	1.80	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
23	1.89	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
24	1.97	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
25	2.05	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
26	2.13	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
27	2.21	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
28	2.30	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
29	2.38	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
30	2.46	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
31	2.54	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
32	2.62	0.00	N/A	0.00	1.00	-1.00	1.00	N/A	4.000	No	No	2.00
33	2.71	27.12	2.41	2.65	0.78	50.96	2.43	123.67	4.000	No	No	2.00
34	2.79	36.78	2.33	2.79	0.75	69.21	2.04	141.42	4.000	No	No	2.00
35	2.87	29.80	2.43	3.08	0.78	56.00	2.51	140.63	4.000	No	No	2.00
36	2.95	24.60	2.50	3.18	0.81	46.16	2.95	136.00	4.000	No	No	2.00
37	3.03	21.34	2.53	3.09	0.82	39.99	3.48	139.06	4.000	No	No	2.00
38	3.12	19.45	2.54	2.89	0.83	36.42	3.74	136.38	4.000	No	No	2.00
39	3.20	18.42	2.55	2.75	0.83	34.45	3.85	132.63	4.000	No	No	2.00
40	3.28	17.54	2.57	2.83	0.84	32.79	4.51	147.76	4.000	No	No	2.00
41	3.36	16.89	2.60	3.03	0.85	31.55	5.55	175.07	4.000	No	No	2.00
42	3.44	16.56	2.62	3.17	0.86	30.92	6.27	193.86	4.000	No	No	2.00
43	3.53	16.32	2.63	3.19	0.86	30.46	6.56	199.66	4.000	No	No	2.00
44	3.61	15.87	2.64	3.22	0.87	29.60	7.08	209.62	4.000	No	No	2.00
45	3.69	15.22	2.66	3.32	0.88	28.35	8.17	231.61	4.000	No	No	2.00
46	3.77	14.62	2.69	3.46	0.89	27.21	9.57	260.47	4.000	No	No	2.00
47	3.85	13.90	2.72	3.67	0.90	25.84	4.96	128.20	4.000	No	Yes	2.00
48	3.94	13.34	2.75	3.82	0.91	24.77	5.24	129.87	4.000	No	Yes	2.00

:: Cyclic Resistance Ratio (CRR) calculation data :: (continued)												
Point ID	Depth (ft)	q _c (tsf)	I _c	Fr (%)	n	Q _{tn}	K _c	Q _{tn,cs}	CRR _{7.5}	Belongs to trans. layer	Clay-like behaviour	FS
49	4.02	12.85	2.77	3.92	0.92	23.84	5.47	130.48	1.137	No	Yes	2.00
50	4.10	12.57	2.78	3.98	0.92	23.30	5.62	130.90	1.111	No	Yes	2.00
51	4.18	12.06	2.81	4.18	0.93	22.33	5.97	133.23	1.065	No	Yes	2.00
52	4.27	11.39	2.84	4.34	0.94	21.05	6.35	133.76	1.004	No	Yes	2.00
53	4.35	10.66	2.87	4.42	0.95	19.67	6.73	132.35	0.938	No	Yes	2.00
54	4.43	9.92	2.89	4.36	0.96	18.26	7.02	128.18	0.871	No	Yes	2.00
55	4.51	9.25	2.90	4.18	0.97	16.98	7.20	122.29	0.810	No	Yes	2.00
56	4.59	9.08	2.87	3.71	0.96	16.65	6.83	113.73	0.794	No	Yes	2.00
57	4.68	8.99	2.84	3.23	0.94	16.48	6.37	104.92	0.786	No	Yes	2.00
58	4.76	9.02	2.81	2.94	0.93	16.52	6.04	99.74	0.788	No	Yes	2.00
59	4.84	8.92	2.81	2.84	0.93	16.32	5.97	97.49	0.779	No	Yes	2.00
60	4.92	9.31	2.79	2.74	0.92	17.06	5.67	96.73	0.814	No	Yes	2.00
61	5.00	10.06	2.76	2.72	0.91	18.46	5.32	98.23	0.881	No	Yes	2.00
62	5.09	10.71	2.75	2.88	0.91	19.68	5.24	103.08	0.939	No	Yes	2.00
63	5.17	11.00	2.77	3.19	0.92	20.23	5.45	110.20	0.965	No	Yes	2.00
64	5.25	10.85	2.80	3.56	0.93	19.94	5.87	116.97	0.951	No	Yes	2.00
65	5.33	10.44	2.84	3.88	0.94	19.15	6.35	121.61	0.913	No	Yes	2.00
66	5.41	10.04	2.87	4.16	0.96	18.38	6.81	125.10	0.877	No	Yes	2.00
67	5.50	9.78	2.89	4.24	0.96	17.89	7.01	125.37	0.854	No	Yes	2.00
68	5.58	9.42	2.90	4.25	0.97	17.19	7.21	123.97	0.820	No	Yes	2.00
69	5.66	8.90	2.92	4.20	0.97	16.20	7.46	120.81	0.773	No	Yes	2.00
70	5.74	8.38	2.94	4.26	0.98	15.21	7.84	119.18	0.726	No	Yes	2.00
71	5.82	8.26	2.94	4.21	0.98	14.98	7.87	117.87	0.714	No	Yes	1.97
72	5.91	8.41	2.93	4.03	0.98	15.26	7.59	115.86	0.728	No	Yes	1.99
73	5.99	8.65	2.90	3.77	0.97	15.71	7.17	112.69	0.749	No	Yes	2.00
74	6.07	8.72	2.88	3.59	0.96	15.82	6.95	109.99	0.755	No	Yes	2.00
75	6.15	8.66	2.88	3.56	0.96	15.71	6.95	109.24	0.749	No	Yes	2.00
76	6.23	8.43	2.90	3.66	0.97	15.27	7.20	109.86	0.728	No	Yes	1.95
77	6.32	8.26	2.91	3.72	0.97	14.92	7.38	110.18	0.712	No	Yes	1.89
78	6.40	8.09	2.92	3.80	0.98	14.59	7.58	110.53	0.696	No	Yes	1.84
79	6.48	7.95	2.94	3.86	0.98	14.32	7.75	110.92	0.683	No	Yes	1.79
80	6.56	7.76	2.95	3.98	0.99	13.96	8.01	111.85	0.666	No	Yes	1.74
81	6.64	7.58	2.96	4.02	0.99	13.61	8.19	111.49	0.649	No	Yes	1.69
82	6.73	7.45	2.97	3.96	0.99	13.35	8.23	109.87	0.637	No	Yes	1.65
83	6.81	7.38	2.96	3.77	0.99	13.21	8.08	106.77	0.630	No	Yes	1.62
84	6.89	7.25	2.95	3.59	0.99	12.97	7.98	103.45	0.619	No	Yes	1.58
85	6.97	7.03	2.95	3.40	0.99	12.54	7.94	99.57	0.598	No	Yes	1.52
86	7.05	6.70	2.95	3.24	0.99	11.92	8.03	95.66	0.568	No	Yes	1.44
87	7.14	6.37	2.96	3.09	0.99	11.27	8.14	91.78	0.538	No	Yes	1.36
88	7.22	6.13	2.96	2.87	0.99	10.82	8.09	87.53	0.516	No	Yes	1.29
89	7.30	6.02	2.94	2.61	0.99	10.60	7.84	83.09	0.505	No	Yes	1.26
90	7.38	6.00	2.91	2.31	0.97	10.56	7.41	78.28	0.504	No	Yes	1.25
91	7.46	5.98	2.89	2.06	0.97	10.51	7.04	74.02	0.501	No	Yes	1.24
92	7.55	5.85	2.89	1.97	0.97	10.26	7.03	72.14	0.489	No	Yes	1.21
93	7.63	5.77	2.90	1.99	0.97	10.09	7.15	72.09	0.481	No	Yes	1.18
94	7.71	5.86	2.92	2.31	0.98	10.25	7.57	77.60	0.489	No	Yes	1.19
95	7.79	6.25	2.92	2.56	0.98	10.98	7.57	83.12	0.524	No	Yes	1.27
96	7.87	7.36	2.85	2.44	0.95	13.08	6.50	84.99	0.624	No	Yes	1.51

:: Cyclic Resistance Ratio (CRR) calculation data :: (continued)												
Point ID	Depth (ft)	q _f (tsf)	I _c	Fr (%)	n	Q _{tn}	K _c	Q _{tn,cs}	CRR _{7.5}	Belongs to trans. layer	Clay-like behaviour	FS
97	7.96	8.40	2.77	2.14	0.92	15.04	5.46	82.07	0.717	No	Yes	1.73
98	8.04	9.32	2.69	1.83	0.89	16.77	9.63	161.54	0.425	No	No	1.02
99	8.12	9.53	2.66	1.65	0.88	17.15	7.86	134.70	0.277	No	No	0.66
100	8.20	9.80	2.64	1.57	0.87	17.65	6.78	119.72	0.216	No	No	0.51
101	8.28	10.00	2.64	1.67	0.87	18.03	7.11	128.13	0.248	No	No	0.59
102	8.37	10.09	2.65	1.78	0.88	18.19	7.67	139.52	0.299	No	No	0.71
103	8.45	9.96	2.68	1.90	0.89	17.94	8.74	156.79	0.395	No	No	0.93
104	8.53	9.46	2.70	1.91	0.89	16.98	10.00	169.79	0.482	No	No	1.13
105	8.61	8.57	2.76	2.14	0.92	15.29	5.39	82.41	0.729	No	Yes	1.70
106	8.69	7.60	2.84	2.45	0.95	13.46	6.38	85.81	0.642	No	Yes	1.49
107	8.78	6.90	2.91	2.77	0.97	12.12	7.33	88.85	0.578	No	Yes	1.34
108	8.86	6.67	2.93	2.91	0.98	11.67	7.72	90.07	0.557	No	Yes	1.29
109	8.94	6.77	2.91	2.72	0.98	11.87	7.38	87.58	0.566	No	Yes	1.30
110	9.02	7.18	2.86	2.43	0.96	12.62	6.67	84.11	0.602	No	Yes	1.38
111	9.10	7.65	2.81	2.18	0.94	13.51	5.99	80.97	0.645	No	Yes	1.47
112	9.19	7.84	2.80	2.13	0.93	13.85	5.81	80.50	0.661	No	Yes	1.51
113	9.27	9.74	2.66	1.71	0.88	17.45	7.92	138.24	0.293	No	No	0.67
114	9.35	13.92	2.44	1.21	0.80	25.33	2.61	66.21	0.107	No	No	0.24
115	9.43	18.48	2.30	1.04	0.74	33.95	1.93	65.49	0.106	No	No	0.24
116	9.51	20.50	2.25	0.97	0.72	37.76	1.74	65.69	0.106	No	No	0.24
117	9.60	19.68	2.27	1.00	0.73	36.19	1.81	65.52	0.106	No	No	0.24
118	9.68	19.29	2.24	0.88	0.72	35.45	1.74	61.60	0.102	No	No	0.23
119	9.76	22.02	2.15	0.72	0.69	40.60	1.50	61.00	0.101	No	No	0.23
120	9.84	25.07	2.07	0.62	0.66	46.35	1.38	63.88	0.104	No	No	0.23
121	9.92	26.87	2.03	0.60	0.64	49.51	1.34	66.30	0.107	No	No	0.24
122	10.01	26.11	2.07	0.66	0.65	48.31	1.37	66.40	0.107	No	No	0.24
123	10.09	26.10	2.07	0.66	0.65	48.28	1.37	66.30	0.107	No	No	0.24
124	10.17	27.20	2.03	0.58	0.64	49.54	1.33	65.98	0.107	No	No	0.23
125	10.25	28.73	1.97	0.45	0.62	51.03	1.00	51.03	0.092	No	No	0.20
126	10.33	30.12	1.92	0.36	0.60	52.21	1.00	52.21	0.093	No	No	0.20
127	10.42	31.35	1.88	0.32	0.59	53.56	1.00	53.56	0.094	No	No	0.21
128	10.50	30.99	1.91	0.37	0.60	53.35	1.00	53.35	0.094	No	No	0.20
129	10.58	28.29	2.00	0.53	0.63	50.35	1.31	65.93	0.107	No	No	0.23
130	10.66	23.30	2.16	0.82	0.69	42.93	1.52	65.29	0.106	No	No	0.23
131	10.74	19.00	2.31	1.14	0.75	34.80	1.98	68.77	0.110	No	No	0.24
132	10.83	15.89	2.43	1.39	0.79	28.92	2.52	73.00	0.116	No	No	0.25
133	10.91	13.52	2.52	1.59	0.83	24.42	3.24	79.21	0.126	No	No	0.27
134	10.99	11.03	2.63	1.82	0.87	19.71	6.60	129.99	0.256	No	No	0.55
135	11.07	8.76	2.74	1.99	0.91	15.40	5.16	79.42	0.735	No	Yes	1.57
136	11.15	7.84	2.78	1.98	0.93	13.67	5.65	77.22	0.652	No	Yes	1.39
137	11.24	7.69	2.77	1.79	0.92	13.38	5.46	73.09	0.638	No	Yes	1.36
138	11.32	11.15	2.52	1.16	0.83	19.91	3.27	65.19	0.106	No	No	0.22
139	11.40	16.09	2.30	0.79	0.74	29.23	1.91	55.77	0.096	No	No	0.20
140	11.48	19.69	2.19	0.68	0.70	35.99	1.58	56.82	0.097	No	No	0.20
141	11.56	18.83	2.23	0.79	0.72	34.40	1.71	58.72	0.099	No	No	0.21
142	11.65	15.13	2.38	1.05	0.78	27.40	2.28	62.38	0.103	No	No	0.22
143	11.73	12.16	2.56	1.56	0.84	21.78	4.12	89.75	0.147	No	No	0.31
144	11.81	10.58	2.70	2.28	0.90	18.78	4.75	89.14	0.896	No	Yes	1.87

:: Cyclic Resistance Ratio (CRR) calculation data :: (continued)												
Point ID	Depth (ft)	q _c (tsf)	I _c	Fr (%)	n	Q _{tn}	K _c	Q _{tn,cs}	CRR _{7.5}	Belongs to trans. layer	Clay-like behaviour	FS
145	11.89	10.91	2.73	2.63	0.91	19.39	5.03	97.61	0.925	No	Yes	1.93
146	11.98	15.31	2.54	2.00	0.83	27.71	3.54	98.05	0.168	No	No	0.35
147	12.06	26.28	2.21	1.19	0.71	47.81	1.64	78.43	0.125	No	No	0.26
148	12.14	40.56	2.00	0.87	0.63	68.77	1.31	90.03	0.148	No	No	0.31
149	12.22	57.82	1.84	0.69	0.57	92.55	1.19	110.20	0.204	No	No	0.42
150	12.30	77.84	1.69	0.55	0.51	118.35	1.00	118.35	0.234	No	No	0.48
151	12.39	104.35	1.53	0.40	0.45	149.74	1.00	149.74	0.392	No	No	0.81
152	12.47	132.35	1.41	0.32	0.41	181.77	1.00	181.77	0.639	No	No	1.32
153	12.55	158.12	1.33	0.28	0.38	210.60	1.00	210.60	4.000	No	No	2.00
154	12.63	176.22	1.29	0.28	0.36	230.94	1.00	230.94	4.000	No	No	2.00
155	12.71	189.71	1.26	0.27	0.35	246.14	1.00	246.14	4.000	No	No	2.00
156	12.80	199.34	1.28	0.32	0.36	259.68	1.00	259.68	4.000	No	No	2.00
157	12.88	206.91	1.31	0.37	0.37	271.38	1.00	271.38	4.000	No	No	2.00
158	12.96	211.03	1.30	0.38	0.37	275.83	1.00	275.83	4.000	No	No	2.00
159	13.04	211.78	1.26	0.31	0.35	272.35	1.00	272.35	4.000	No	No	2.00
160	13.12	212.72	1.19	0.23	0.32	266.85	1.00	266.85	4.000	No	No	2.00
161	13.21	217.26	1.15	0.19	0.31	268.39	1.00	268.39	4.000	No	No	2.00
162	13.29	226.44	1.12	0.17	0.30	276.65	1.00	276.65	4.000	No	No	2.00
163	13.37	235.91	1.11	0.17	0.29	286.43	1.00	286.43	4.000	No	No	2.00
164	13.45	243.48	1.09	0.16	0.28	293.47	1.00	293.47	4.000	No	No	2.00
165	13.53	248.34	1.10	0.18	0.29	299.81	1.00	299.81	4.000	No	No	2.00
166	13.62	252.74	1.14	0.23	0.31	309.31	1.00	309.31	4.000	No	No	2.00
167	13.70	253.12	1.26	0.40	0.35	321.90	1.00	321.90	4.000	No	No	2.00
168	13.78	247.24	1.38	0.60	0.40	325.87	1.00	325.87	4.000	No	No	2.00
169	13.86	231.70	1.51	0.88	0.45	317.82	1.00	317.82	4.000	No	No	2.00
170	13.94	207.10	1.62	1.12	0.49	292.75	1.00	292.75	4.000	No	No	2.00
171	14.03	169.40	1.76	1.50	0.54	249.47	1.10	274.44	4.000	No	No	2.00
172	14.11	133.25	1.87	1.78	0.59	202.53	1.22	246.97	4.000	No	No	2.00
173	14.19	107.76	1.96	1.96	0.62	167.37	1.28	213.65	4.000	No	No	2.00
174	14.27	113.02	1.87	1.51	0.58	170.20	1.22	206.89	4.000	No	No	2.00
175	14.35	134.87	1.69	0.97	0.52	192.01	1.00	192.01	0.738	No	No	1.48
176	14.44	152.40	1.52	0.59	0.45	205.70	1.00	205.70	4.000	No	No	2.00
177	14.52	154.01	1.41	0.37	0.41	200.43	1.00	200.43	4.000	No	No	2.00
178	14.60	145.04	1.40	0.32	0.40	187.64	1.00	187.64	0.694	No	No	1.39
179	14.68	138.42	1.44	0.36	0.42	181.01	1.00	181.01	0.632	No	No	1.26
180	14.76	136.42	1.50	0.45	0.44	180.97	1.00	180.97	0.631	No	No	1.26
181	14.85	139.09	1.52	0.52	0.45	185.57	1.00	185.57	0.674	No	No	1.35
182	14.93	146.28	1.52	0.56	0.45	194.92	1.00	194.92	0.769	No	No	1.53
183	15.01	151.51	1.53	0.58	0.45	201.63	1.00	201.63	4.000	No	No	2.00
184	15.09	154.90	1.53	0.61	0.46	205.98	1.00	205.98	4.000	No	No	2.00
185	15.17	158.90	1.53	0.62	0.46	210.75	1.00	210.75	4.000	No	No	2.00
186	15.26	165.61	1.51	0.61	0.45	218.14	1.00	218.14	4.000	No	No	2.00
187	15.34	172.15	1.50	0.60	0.44	225.38	1.00	225.38	4.000	No	No	2.00
188	15.42	176.55	1.49	0.60	0.44	230.23	1.00	230.23	4.000	No	No	2.00
189	15.50	178.28	1.49	0.61	0.44	232.11	1.00	232.11	4.000	No	No	2.00
190	15.58	178.94	1.49	0.61	0.44	232.44	1.00	232.44	4.000	No	No	2.00
191	15.67	180.15	1.49	0.60	0.44	233.13	1.00	233.13	4.000	No	No	2.00
192	15.75	181.86	1.48	0.58	0.44	234.32	1.00	234.32	4.000	No	No	2.00

:: Cyclic Resistance Ratio (CRR) calculation data :: (continued)												
Point ID	Depth (ft)	q _c (tsf)	I _c	Fr (%)	n	Q _{tn}	K _c	Q _{tn,cs}	CRR _{7.5}	Belongs to trans. layer	Clay-like behaviour	FS
193	15.83	181.88	1.48	0.58	0.44	233.90	1.00	233.90	4.000	No	No	2.00
194	15.91	178.36	1.50	0.61	0.44	230.04	1.00	230.04	4.000	No	No	2.00
195	15.99	168.69	1.54	0.67	0.46	219.56	1.00	219.56	4.000	No	No	2.00
196	16.08	156.27	1.59	0.75	0.48	205.80	1.00	205.80	4.000	No	No	2.00
197	16.16	139.00	1.67	0.86	0.51	186.15	1.00	186.15	0.680	No	No	1.34
198	16.24	118.03	1.77	1.06	0.55	161.93	1.12	180.90	0.631	No	No	1.24
199	16.32	94.22	1.91	1.38	0.60	133.49	1.24	166.16	0.507	No	No	1.00
200	16.40	71.81	2.07	1.84	0.67	105.50	1.38	145.88	0.369	No	No	0.73
201	16.49	52.67	2.24	2.42	0.73	80.20	1.73	138.63	0.328	No	No	0.64
202	16.57	36.45	2.43	3.17	0.80	57.55	2.52	144.95	0.363	No	No	0.71
203	16.65	23.92	2.63	4.14	0.88	39.06	6.44	251.60	3.600	No	No	2.00
204	16.73	16.15	2.79	4.82	0.94	26.87	5.73	154.07	1.282	No	Yes	2.00
205	16.81	11.96	2.89	4.93	0.98	19.90	7.11	141.55	0.949	No	Yes	1.86
206	16.90	10.32	2.89	4.01	0.98	16.85	7.07	119.17	0.804	No	Yes	1.57
207	16.98	12.25	2.70	2.35	0.91	19.32	4.72	91.29	0.922	No	Yes	1.80
208	17.06	16.59	2.48	1.38	0.82	25.20	2.82	70.95	0.113	No	No	0.22
209	17.14	18.98	2.41	1.29	0.80	28.54	2.45	69.97	0.112	No	No	0.22
210	17.22	17.60	2.49	1.62	0.83	26.79	2.93	78.43	0.125	No	No	0.24
211	17.31	14.15	2.64	2.21	0.88	21.95	7.04	154.64	0.382	No	No	0.74
212	17.39	14.50	2.65	2.32	0.88	22.48	7.27	163.49	0.438	No	No	0.85
213	17.47	19.23	2.52	2.04	0.84	29.33	3.19	93.70	0.157	No	No	0.30
214	17.55	23.40	2.45	2.01	0.81	35.35	2.67	94.34	0.158	No	No	0.31
215	17.63	23.75	2.47	2.15	0.82	35.89	2.75	98.79	0.170	No	No	0.33
216	17.72	22.22	2.51	2.36	0.83	33.75	3.02	101.96	0.179	No	No	0.35
217	17.80	29.12	2.34	1.67	0.77	42.79	2.08	88.85	0.145	No	No	0.28
218	17.88	42.89	2.10	1.04	0.68	60.05	1.41	84.86	0.137	No	No	0.27
219	17.96	50.13	1.98	0.78	0.63	68.35	1.29	88.20	0.144	No	No	0.28
220	18.04	47.13	2.01	0.82	0.64	64.50	1.32	84.91	0.137	No	No	0.26
221	18.13	36.19	2.17	1.12	0.70	50.96	1.55	79.00	0.126	No	No	0.24
222	18.21	27.67	2.35	1.60	0.77	40.10	2.12	85.19	0.138	No	No	0.27
223	18.29	19.78	2.55	2.27	0.85	29.45	3.83	112.80	0.213	No	No	0.41
224	18.37	14.08	2.74	3.05	0.92	21.35	5.10	108.95	1.018	No	Yes	1.96
225	18.45	10.94	2.87	3.59	0.97	16.63	6.71	111.66	0.793	No	Yes	1.53
226	18.54	10.04	2.87	3.19	0.97	15.07	6.75	101.71	0.719	No	Yes	1.38
227	18.62	13.83	2.61	1.73	0.87	20.15	5.81	116.99	0.206	No	No	0.40
228	18.70	20.93	2.34	1.00	0.77	29.46	2.10	61.88	0.102	No	No	0.20
229	18.78	25.78	2.25	0.90	0.73	35.77	1.74	62.39	0.103	No	No	0.20
230	18.86	25.34	2.30	1.12	0.76	35.48	1.93	68.58	0.110	No	No	0.21
231	18.95	20.37	2.47	1.70	0.82	29.23	2.81	82.11	0.131	No	No	0.25
232	19.03	16.11	2.64	2.42	0.88	23.55	7.00	164.88	0.447	No	No	0.86
233	19.11	12.42	2.81	3.33	0.95	18.38	5.99	110.05	0.877	No	Yes	1.68
234	19.19	10.05	2.91	3.68	0.99	14.81	7.38	109.29	0.706	No	Yes	1.35
235	19.27	8.33	2.98	3.66	1.00	12.01	8.49	101.96	0.573	No	Yes	1.09
236	19.36	7.06	3.02	3.20	1.00	9.87	9.09	89.70	0.471	No	Yes	0.90
237	19.44	6.22	3.03	2.64	1.00	8.45	9.25	78.16	0.403	No	Yes	0.77
238	19.52	5.89	2.99	1.98	1.00	7.89	8.56	67.52	0.376	No	Yes	0.72
239	19.60	5.89	2.93	1.47	0.99	7.83	7.59	59.42	0.374	No	Yes	0.71
240	19.69	6.00	2.88	1.17	0.97	7.91	6.86	54.32	0.377	No	Yes	0.72

:: Cyclic Resistance Ratio (CRR) calculation data :: (continued)												
Point ID	Depth (ft)	q _c (tsf)	I _c	Fr (%)	n	Q _{tn}	K _c	Q _{tn,cs}	CRR _{7.5}	Belongs to trans. layer	Clay-like behaviour	FS
241	19.77	6.14	2.85	1.05	0.96	8.07	6.48	52.28	0.385	No	Yes	0.73
242	19.85	6.42	2.82	0.98	0.95	8.44	6.07	51.22	0.403	No	Yes	0.76
243	19.93	6.77	2.79	0.94	0.94	8.93	5.70	50.91	0.426	No	Yes	0.81
244	20.01	7.30	2.74	0.87	0.92	9.64	5.17	49.84	0.460	No	Yes	0.87
245	20.10	7.63	2.71	0.79	0.91	10.06	4.79	48.23	0.480	No	Yes	0.91
246	20.18	7.87	2.70	0.80	0.91	10.38	10.04	104.16	0.167	No	No	0.31
247	20.26	8.23	2.69	0.84	0.90	10.89	9.54	103.91	0.166	No	No	0.31
248	20.34	8.71	2.68	0.93	0.90	11.58	9.17	106.25	0.172	No	No	0.32
249	20.42	9.25	2.69	1.08	0.90	12.38	9.41	116.58	0.205	No	No	0.38
250	20.51	9.85	2.70	1.32	0.91	13.31	4.73	62.99	0.635	No	Yes	1.19
251	20.59	10.66	2.70	1.50	0.91	14.48	10.08	145.96	0.332	No	No	0.62
252	20.67	10.77	2.71	1.62	0.91	14.66	4.83	70.77	0.699	No	Yes	1.31
253	20.75	10.68	2.71	1.60	0.91	14.48	4.85	70.21	0.691	No	Yes	1.29
254	20.83	10.86	2.73	1.80	0.92	14.78	5.07	74.85	0.705	No	Yes	1.32
255	20.92	14.47	2.62	1.77	0.88	19.78	6.29	124.40	0.233	No	No	0.44
256	21.00	17.66	2.56	1.82	0.86	24.14	4.15	100.30	0.174	No	No	0.33
257	21.08	18.59	2.55	1.90	0.85	25.40	3.96	100.63	0.175	No	No	0.33
258	21.16	15.57	2.66	2.26	0.89	21.37	7.79	166.40	0.458	No	No	0.86
259	21.24	12.02	2.82	3.00	0.95	16.56	6.09	100.90	0.790	No	Yes	1.47
260	21.33	9.91	2.94	3.73	1.00	13.59	7.88	107.07	0.648	No	Yes	1.21
261	21.41	9.14	2.99	3.89	1.00	12.35	8.59	106.13	0.589	No	Yes	1.10
262	21.49	10.84	2.87	3.16	0.98	14.76	6.81	100.56	0.704	No	Yes	1.31
263	21.57	25.63	2.37	1.41	0.78	33.94	2.24	75.96	0.121	No	No	0.22
264	21.65	52.86	1.98	0.76	0.64	66.56	1.29	86.02	0.139	No	No	0.26
265	21.74	80.92	1.74	0.49	0.54	97.97	1.00	97.97	0.167	No	No	0.31
266	21.82	95.46	1.64	0.40	0.50	113.49	1.00	113.49	0.216	No	No	0.40
267	21.90	88.44	1.72	0.53	0.54	106.57	1.04	110.41	0.205	No	No	0.38
268	21.98	71.18	1.93	0.92	0.62	88.55	1.26	111.22	0.208	No	No	0.39
269	22.06	49.69	2.19	1.62	0.72	64.18	1.60	102.39	0.180	No	No	0.33
270	22.15	34.10	2.42	2.39	0.80	45.20	2.47	111.79	0.210	No	No	0.39
271	22.23	23.47	2.61	3.07	0.88	31.54	5.67	178.73	0.550	No	No	1.02
272	22.31	16.70	2.77	3.71	0.94	22.51	5.51	124.16	1.074	No	Yes	1.99
273	22.39	12.34	2.90	4.06	0.99	16.48	7.23	119.14	0.786	No	Yes	1.46
274	22.47	10.58	2.91	3.37	0.99	13.85	7.37	102.13	0.661	No	Yes	1.23
275	22.56	9.76	2.82	2.01	0.96	12.41	6.15	76.25	0.592	No	Yes	1.10
276	22.64	9.38	2.68	0.93	0.91	11.55	9.27	107.08	0.175	No	No	0.32
277	22.72	9.18	2.58	0.45	0.86	11.04	4.69	51.78	0.093	No	No	0.17
278	22.80	9.85	2.50	0.32	0.84	11.80	2.90	34.16	0.078	No	No	0.15
279	22.88	11.26	2.43	0.28	0.81	13.54	2.54	34.40	0.079	No	No	0.15
280	22.97	12.37	2.39	0.27	0.79	14.90	2.30	34.31	0.079	No	No	0.15
281	23.05	12.58	2.38	0.27	0.79	15.14	2.27	34.40	0.079	No	No	0.15
282	23.13	11.80	2.41	0.28	0.80	14.15	2.43	34.45	0.079	No	No	0.14
283	23.21	11.56	2.43	0.29	0.81	13.84	2.52	34.94	0.079	No	No	0.15
284	23.29	12.74	2.42	0.37	0.80	15.38	2.46	37.85	0.082	No	No	0.15
285	23.38	14.61	2.43	0.58	0.81	17.88	2.51	44.90	0.087	No	No	0.16
286	23.46	15.74	2.48	0.93	0.83	19.54	2.86	55.91	0.096	No	No	0.18
287	23.54	15.23	2.64	1.81	0.89	19.28	6.87	132.54	0.267	No	No	0.49
288	23.62	15.41	2.72	2.58	0.92	19.75	4.90	96.83	0.942	No	Yes	1.73

:: Cyclic Resistance Ratio (CRR) calculation data :: (continued)												
Point ID	Depth (ft)	q _c (tsf)	I _c	Fr (%)	n	Q _{tn}	K _c	Q _{tn,cs}	CRR _{7.5}	Belongs to trans. layer	Clay-like behaviour	FS
289	23.70	24.73	2.50	2.08	0.84	31.55	2.81	88.55	0.145	No	No	0.27
290	23.79	59.20	2.02	0.98	0.65	71.97	1.32	95.18	0.160	No	No	0.29
291	23.87	121.18	1.71	0.73	0.53	141.55	1.00	142.08	0.347	No	No	0.64
292	23.95	192.00	1.53	0.64	0.46	218.40	1.00	218.40	4.000	No	No	2.00
293	24.03	251.64	1.44	0.64	0.43	282.57	1.00	282.57	4.000	No	No	2.00
294	24.11	286.52	1.38	0.59	0.41	318.49	1.00	318.49	4.000	No	No	2.00
295	24.20	303.76	1.38	0.62	0.41	337.21	1.00	337.21	4.000	No	No	2.00
296	24.28	311.89	1.42	0.73	0.43	347.84	1.00	347.84	4.000	No	No	2.00
297	24.36	320.49	1.46	0.84	0.44	359.02	1.00	359.02	4.000	No	No	2.00
298	24.44	329.89	1.48	0.90	0.45	369.78	1.00	369.78	4.000	No	No	2.00
299	24.52	336.50	1.46	0.85	0.44	375.34	1.00	375.34	4.000	No	No	2.00
300	24.61	342.35	1.40	0.73	0.42	378.18	1.00	378.18	4.000	No	No	2.00
301	24.69	355.51	1.33	0.60	0.39	388.07	1.00	388.07	4.000	No	No	2.00
302	24.77	346.44	1.27	0.47	0.37	374.29	1.00	374.29	4.000	No	No	2.00
303	24.85	339.05	1.29	0.50	0.38	366.95	1.00	366.95	4.000	No	No	2.00
304	24.93	322.43	1.32	0.52	0.39	349.67	1.00	349.67	4.000	No	No	2.00
305	25.02	326.72	1.30	0.50	0.38	353.24	1.00	353.24	4.000	No	No	2.00
306	25.10	324.65	1.24	0.39	0.36	347.34	1.00	347.34	4.000	No	No	2.00
307	25.18	322.15	1.18	0.31	0.33	341.54	1.00	341.54	4.000	No	No	2.00
308	25.26	319.28	1.13	0.26	0.32	336.01	1.00	336.01	4.000	No	No	2.00
309	25.34	322.46	1.13	0.26	0.32	338.95	1.00	338.95	4.000	No	No	2.00
310	25.43	328.27	1.13	0.26	0.32	344.64	1.00	344.64	4.000	No	No	2.00
311	25.51	333.69	1.13	0.27	0.32	350.00	1.00	350.00	4.000	No	No	2.00
312	25.59	334.37	1.13	0.26	0.31	350.16	1.00	350.16	4.000	No	No	2.00
313	25.67	336.48	1.08	0.22	0.30	350.08	1.00	350.08	4.000	No	No	2.00
314	25.75	338.84	1.10	0.24	0.31	353.18	1.00	353.18	4.000	No	No	2.00
315	25.84	334.67	1.13	0.26	0.31	349.46	1.00	349.46	4.000	No	No	2.00
316	25.92	335.89	1.16	0.31	0.33	351.97	1.00	351.97	4.000	No	No	2.00
317	26.00	338.05	1.20	0.36	0.34	355.59	1.00	355.59	4.000	No	No	2.00
318	26.08	341.44	1.22	0.38	0.35	359.45	1.00	359.45	4.000	No	No	2.00
319	26.16	340.57	1.20	0.36	0.34	357.32	1.00	357.32	4.000	No	No	2.00
320	26.25	337.18	1.18	0.32	0.33	352.37	1.00	352.37	4.000	No	No	2.00
321	26.33	340.69	1.14	0.29	0.32	354.31	1.00	354.31	4.000	No	No	2.00
322	26.41	344.74	1.21	0.38	0.35	361.13	1.00	361.13	4.000	No	No	2.00
323	26.49	353.02	1.18	0.35	0.34	368.08	1.00	368.08	4.000	No	No	2.00
324	26.57	366.83	1.15	0.32	0.32	380.58	1.00	380.58	4.000	No	No	2.00
325	26.66	372.94	1.08	0.25	0.30	383.78	1.00	383.78	4.000	No	No	2.00
326	26.74	371.58	1.10	0.26	0.30	382.50	1.00	382.50	4.000	No	No	2.00
327	26.82	362.86	1.09	0.25	0.30	373.00	1.00	373.00	4.000	No	No	2.00
328	26.90	357.12	1.10	0.25	0.31	366.92	1.00	366.92	4.000	No	No	2.00
329	26.98	354.79	1.19	0.35	0.34	367.64	1.00	367.64	4.000	No	No	2.00
330	27.07	349.99	1.31	0.54	0.39	367.17	1.00	367.17	4.000	No	No	2.00
331	27.15	342.74	1.36	0.62	0.41	361.02	1.00	361.02	4.000	No	No	2.00
332	27.23	338.92	1.36	0.61	0.41	356.39	1.00	356.39	4.000	No	No	2.00
333	27.31	335.29	1.32	0.52	0.39	350.52	1.00	350.52	4.000	No	No	2.00
334	27.40	339.19	1.29	0.49	0.38	353.33	1.00	353.33	4.000	No	No	2.00
335	27.48	330.79	1.29	0.47	0.38	344.05	1.00	344.05	4.000	No	No	2.00
336	27.56	324.07	1.34	0.55	0.40	338.34	1.00	338.34	4.000	No	No	2.00

:: Cyclic Resistance Ratio (CRR) calculation data :: (continued)												
Point ID	Depth (ft)	q _c (tsf)	I _c	Fr (%)	n	Q _{tn}	K _c	Q _{tn,cs}	CRR _{7.5}	Belongs to trans. layer	Clay-like behaviour	FS
337	27.64	311.43	1.40	0.63	0.42	326.38	1.00	326.38	4.000	No	No	2.00
338	27.72	309.19	1.43	0.70	0.43	324.61	1.00	324.61	4.000	No	No	2.00
339	27.81	316.54	1.46	0.79	0.45	332.86	1.00	332.86	4.000	No	No	2.00
340	27.89	330.23	1.46	0.81	0.45	346.79	1.00	346.79	4.000	No	No	2.00
341	27.97	351.70	1.46	0.85	0.45	368.87	1.00	368.87	4.000	No	No	2.00
342	28.05	377.19	1.40	0.75	0.42	392.97	1.00	392.97	4.000	No	No	2.00
343	28.13	416.87	1.35	0.69	0.40	431.65	1.00	431.65	4.000	No	No	2.00
344	28.22	468.07	1.31	0.66	0.39	482.47	1.00	482.47	4.000	No	No	2.00
345	28.30	491.65	1.36	0.81	0.41	508.66	1.00	508.66	4.000	No	No	2.00
346	28.38	492.95	1.42	0.96	0.43	511.87	1.00	511.87	4.000	No	No	2.00
347	28.46	471.37	1.43	0.96	0.44	489.11	1.00	489.11	4.000	No	No	2.00
348	28.54	467.38	1.38	0.83	0.42	482.21	1.00	482.21	4.000	No	No	2.00
349	28.63	453.68	1.33	0.69	0.40	465.30	1.00	465.30	4.000	No	No	2.00
350	28.71	440.31	1.37	0.77	0.41	452.52	1.00	452.52	4.000	No	No	2.00
351	28.79	419.18	1.40	0.81	0.42	431.15	1.00	431.15	4.000	No	No	2.00
352	28.87	409.28	1.37	0.72	0.41	419.28	1.00	419.28	4.000	No	No	2.00
353	28.95	408.93	1.30	0.58	0.39	416.12	1.00	416.12	4.000	No	No	2.00
354	29.04	400.44	1.20	0.41	0.35	403.87	1.00	403.87	4.000	No	No	2.00
355	29.12	406.90	1.19	0.40	0.34	409.53	1.00	409.53	4.000	No	No	2.00
356	29.20	388.43	1.22	0.43	0.36	391.58	1.00	391.58	4.000	No	No	2.00
357	29.28	366.12	1.32	0.56	0.40	371.25	1.00	371.25	4.000	No	No	2.00
358	29.36	315.81	1.51	0.89	0.47	323.87	1.00	323.87	4.000	No	No	2.00
359	29.45	294.56	1.54	0.92	0.48	302.13	1.00	302.13	4.000	No	No	2.00
360	29.53	278.70	1.58	0.98	0.49	286.09	1.00	286.09	4.000	No	No	2.00
361	29.61	295.81	1.48	0.76	0.46	301.25	1.00	301.25	4.000	No	No	2.00
362	29.69	300.94	1.55	0.94	0.48	307.40	1.00	307.40	4.000	No	No	2.00
363	29.77	309.55	1.60	1.13	0.50	316.87	1.00	316.87	4.000	No	No	2.00
364	29.86	296.92	1.70	1.46	0.54	305.28	1.00	305.28	4.000	No	No	2.00
365	29.94	261.05	1.79	1.72	0.57	269.20	1.14	306.85	4.000	No	No	2.00
366	30.02	217.14	1.89	1.99	0.61	224.52	1.23	275.52	4.000	No	No	2.00
367	30.10	174.84	1.99	2.26	0.65	181.16	1.30	234.85	4.000	No	No	2.00
368	30.18	139.27	2.10	2.66	0.69	144.63	1.42	205.72	4.000	No	No	2.00
369	30.27	117.43	2.16	2.72	0.71	121.78	1.52	184.82	0.667	No	No	1.25
370	30.35	110.66	2.17	2.67	0.72	114.48	1.54	176.63	0.592	No	No	1.11
371	30.43	141.61	1.97	1.77	0.64	145.07	1.28	185.93	0.678	No	No	1.27
372	30.51	190.02	1.74	1.13	0.56	192.54	1.07	205.83	4.000	No	No	2.00
373	30.59	214.01	1.58	0.75	0.50	214.87	1.00	214.87	4.000	No	No	2.00
374	30.68	224.77	1.50	0.61	0.47	224.59	1.00	224.59	4.000	No	No	2.00
375	30.76	221.23	1.54	0.68	0.48	221.12	1.00	221.12	4.000	No	No	2.00
376	30.84	230.20	1.54	0.70	0.48	229.82	1.00	229.82	4.000	No	No	2.00
377	30.92	234.19	1.48	0.59	0.46	232.87	1.00	232.87	4.000	No	No	2.00
378	31.00	237.11	1.37	0.40	0.42	234.30	1.00	234.30	4.000	No	No	2.00
379	31.09	236.75	1.38	0.42	0.42	233.82	1.00	233.82	4.000	No	No	2.00
380	31.17	237.58	1.41	0.46	0.43	234.67	1.00	234.67	4.000	No	No	2.00
381	31.25	240.72	1.46	0.56	0.45	237.99	1.00	237.99	4.000	No	No	2.00
382	31.33	248.62	1.41	0.48	0.43	245.03	1.00	245.03	4.000	No	No	2.00
383	31.41	237.02	1.44	0.51	0.44	233.53	1.00	233.53	4.000	No	No	2.00
384	31.50	226.70	1.48	0.56	0.46	223.40	1.00	223.40	4.000	No	No	2.00

:: Cyclic Resistance Ratio (CRR) calculation data :: (continued)												
Point ID	Depth (ft)	q_t (tsf)	I_c	Fr (%)	n	Q_{tn}	K_c	$Q_{tn,cs}$	CRR _{7.5}	Belongs to trans. layer	Clay-like behaviour	FS
385	31.58	215.54	1.52	0.60	0.47	212.38	1.00	212.38	4.000	No	No	2.00
386	31.66	221.35	1.51	0.59	0.47	217.75	1.00	217.75	4.000	No	No	2.00
387	31.74	223.84	1.53	0.64	0.48	220.10	1.00	220.10	4.000	No	No	2.00
388	31.82	232.84	1.55	0.73	0.49	228.94	1.00	228.94	4.000	No	No	2.00
389	31.91	243.06	1.56	0.79	0.49	238.84	1.00	238.84	4.000	No	No	2.00
390	31.99	236.70	1.53	0.69	0.48	231.97	1.00	231.97	4.000	No	No	2.00
391	32.07	217.78	1.65	0.95	0.53	213.87	1.00	213.87	4.000	No	No	2.00
392	32.15	206.33	1.65	0.89	0.52	202.21	1.00	202.21	4.000	No	No	2.00
393	32.23	209.75	1.64	0.87	0.52	205.22	1.00	205.22	4.000	No	No	2.00
394	32.32	237.77	1.37	0.38	0.42	230.63	1.00	230.63	4.000	No	No	2.00
395	32.40	259.14	1.47	0.62	0.46	252.02	1.00	252.02	4.000	No	No	2.00
396	32.48	287.00	1.58	0.97	0.50	279.83	1.00	279.83	4.000	No	No	2.00
397	32.56	287.50	1.71	1.42	0.55	280.89	1.01	283.16	4.000	No	No	2.00
398	32.64	277.86	1.73	1.46	0.56	271.10	1.05	283.97	4.000	No	No	2.00
399	32.73	266.02	1.75	1.48	0.56	259.14	1.08	279.25	4.000	No	No	2.00
400	32.81	257.63	1.74	1.42	0.56	250.47	1.07	267.54	4.000	No	No	2.00
401	32.89	251.98	1.78	1.58	0.58	244.78	1.13	277.58	4.000	No	No	2.00
402	32.97	259.58	1.78	1.58	0.57	251.74	1.12	282.85	4.000	No	No	2.00
403	33.05	301.26	1.71	1.45	0.55	291.53	1.00	292.27	4.000	No	No	2.00
404	33.14	373.43	1.60	1.25	0.51	360.47	1.00	360.47	4.000	No	No	2.00
405	33.22	475.02	1.46	0.99	0.45	457.15	1.00	457.15	4.000	No	No	2.00
406	33.30	534.68	1.36	0.82	0.42	513.21	1.00	513.21	4.000	No	No	2.00
407	33.38	567.24	1.29	0.68	0.39	543.20	1.00	543.20	4.000	No	No	2.00
408	33.46	563.79	1.25	0.61	0.37	538.97	1.00	538.97	4.000	No	No	2.00
409	33.55	588.20	1.21	0.57	0.36	561.48	1.00	561.48	4.000	No	No	2.00
410	33.63	584.31	1.20	0.55	0.36	557.12	1.00	557.12	4.000	No	No	2.00
411	33.71	555.56	1.28	0.67	0.39	529.55	1.00	529.55	4.000	No	No	2.00
412	33.79	508.87	1.37	0.80	0.42	484.79	1.00	484.79	4.000	No	No	2.00
413	33.87	496.39	1.40	0.86	0.43	472.43	1.00	472.43	4.000	No	No	2.00
414	33.96	522.36	1.35	0.78	0.41	496.39	1.00	496.39	4.000	No	No	2.00
415	34.04	544.22	1.32	0.73	0.40	516.50	1.00	516.50	4.000	No	No	2.00
416	34.12	563.30	1.31	0.72	0.40	534.01	1.00	534.01	4.000	No	No	2.00
417	34.20	560.70	1.17	0.49	0.35	530.56	1.00	530.56	4.000	No	No	2.00
418	34.28	538.94	0.99	0.26	0.28	509.04	1.00	509.04	4.000	No	No	2.00
419	34.37	515.81	N/A	0.00	1.00	490.60	1.00	490.60	4.000	No	No	2.00
420	34.45	530.29	N/A	0.00	1.00	503.93	1.00	503.93	4.000	No	No	2.00
421	34.53	569.06	N/A	0.00	1.00	540.38	1.00	540.38	4.000	No	No	2.00

Abbreviations

Depth:	Depth from free surface, at which CPT was performed (ft)
q_t :	Total cone resistance
I_c :	Soil behavior type index
Fr:	Normalized friction ratio (%)
n:	Stress exponent
Q_{tn} :	Normalized cone resistance
K_c :	Cone resistance correction factor due to fines
$Q_{tn,cs}$:	Normalized and adjusted cone resistance
CRR _{7.5} :	Cyclic resistance ratio for $M_w=7.5$
FS:	Factor of safety against soil liquefaction

:: Liquefaction Potential Index calculation data ::											
Depth (ft)	FS	F _L	w _z	d _z	LPI	Depth (ft)	FS	F _L	w _z	d _z	LPI
0.08	2.00	0.00	0.00	0.00	0.00	0.16	2.00	0.00	0.00	0.00	0.00
0.25	2.00	0.00	0.00	0.00	0.00	0.33	2.00	0.00	0.00	0.00	0.00
0.41	2.00	0.00	0.00	0.00	0.00	0.49	2.00	0.00	0.00	0.00	0.00
0.57	2.00	0.00	0.00	0.00	0.00	0.66	2.00	0.00	0.00	0.00	0.00
0.74	2.00	0.00	0.00	0.00	0.00	0.82	2.00	0.00	0.00	0.00	0.00
0.90	2.00	0.00	0.00	0.00	0.00	0.98	2.00	0.00	0.00	0.00	0.00
1.07	2.00	0.00	0.00	0.00	0.00	1.15	2.00	0.00	0.00	0.00	0.00
1.23	2.00	0.00	0.00	0.00	0.00	1.31	2.00	0.00	0.00	0.00	0.00
1.39	2.00	0.00	0.00	0.00	0.00	1.48	2.00	0.00	0.00	0.00	0.00
1.56	2.00	0.00	0.00	0.00	0.00	1.64	2.00	0.00	0.00	0.00	0.00
1.72	2.00	0.00	0.00	0.00	0.00	1.80	2.00	0.00	0.00	0.00	0.00
1.89	2.00	0.00	0.00	0.00	0.00	1.97	2.00	0.00	0.00	0.00	0.00
2.05	2.00	0.00	0.00	0.00	0.00	2.13	2.00	0.00	0.00	0.00	0.00
2.21	2.00	0.00	0.00	0.00	0.00	2.30	2.00	0.00	0.00	0.00	0.00
2.38	2.00	0.00	0.00	0.00	0.00	2.46	2.00	0.00	0.00	0.00	0.00
2.54	2.00	0.00	0.00	0.00	0.00	2.62	2.00	0.00	0.00	0.00	0.00
2.71	2.00	0.00	0.00	0.08	0.00	2.79	2.00	0.00	0.00	0.08	0.00
2.87	2.00	0.00	0.00	0.08	0.00	2.95	2.00	0.00	0.00	0.08	0.00
3.03	2.00	0.00	0.00	0.08	0.00	3.12	2.00	0.00	0.00	0.08	0.00
3.20	2.00	0.00	0.00	0.08	0.00	3.28	2.00	0.00	0.00	0.08	0.00
3.36	2.00	0.00	0.00	0.08	0.00	3.44	2.00	0.00	0.00	0.08	0.00
3.53	2.00	0.00	0.00	0.08	0.00	3.61	2.00	0.00	0.00	0.08	0.00
3.69	2.00	0.00	0.00	0.08	0.00	3.77	2.00	0.00	0.00	0.08	0.00
3.85	2.00	0.00	0.00	0.08	0.00	3.94	2.00	0.00	0.00	0.08	0.00
4.02	2.00	0.00	0.00	0.08	0.00	4.10	2.00	0.00	0.00	0.08	0.00
4.18	2.00	0.00	0.00	0.08	0.00	4.27	2.00	0.00	0.00	0.08	0.00
4.35	2.00	0.00	0.00	0.08	0.00	4.43	2.00	0.00	0.00	0.08	0.00
4.51	2.00	0.00	0.00	0.08	0.00	4.59	2.00	0.00	0.00	0.08	0.00
4.68	2.00	0.00	0.00	0.08	0.00	4.76	2.00	0.00	0.00	0.08	0.00
4.84	2.00	0.00	0.00	0.08	0.00	4.92	2.00	0.00	0.00	0.08	0.00
5.00	2.00	0.00	0.00	0.08	0.00	5.09	2.00	0.00	0.00	0.08	0.00
5.17	2.00	0.00	0.00	0.08	0.00	5.25	2.00	0.00	0.00	0.08	0.00
5.33	2.00	0.00	0.00	0.08	0.00	5.41	2.00	0.00	0.00	0.08	0.00
5.50	2.00	0.00	0.00	0.08	0.00	5.58	2.00	0.00	0.00	0.08	0.00
5.66	2.00	0.00	0.00	0.08	0.00	5.74	2.00	0.00	0.00	0.08	0.00
5.82	1.97	0.00	0.00	0.08	0.00	5.91	1.99	0.00	0.00	0.08	0.00
5.99	2.00	0.00	0.00	0.08	0.00	6.07	2.00	0.00	0.00	0.08	0.00
6.15	2.00	0.00	0.00	0.08	0.00	6.23	1.95	0.00	0.00	0.08	0.00
6.32	1.89	0.00	0.00	0.08	0.00	6.40	1.84	0.00	0.00	0.08	0.00
6.48	1.79	0.00	0.00	0.08	0.00	6.56	1.74	0.00	0.00	0.08	0.00
6.64	1.69	0.00	0.00	0.08	0.00	6.73	1.65	0.00	0.00	0.08	0.00
6.81	1.62	0.00	0.00	0.08	0.00	6.89	1.58	0.00	0.00	0.08	0.00
6.97	1.52	0.00	0.00	0.08	0.00	7.05	1.44	0.00	0.00	0.08	0.00
7.14	1.36	0.00	0.00	0.08	0.00	7.22	1.29	0.00	0.00	0.08	0.00
7.30	1.26	0.00	0.00	0.08	0.00	7.38	1.25	0.00	0.00	0.08	0.00
7.46	1.24	0.00	0.00	0.08	0.00	7.55	1.21	0.00	0.00	0.08	0.00
7.63	1.18	0.00	0.00	0.08	0.00	7.71	1.19	0.00	0.00	0.08	0.00
7.79	1.27	0.00	0.00	0.08	0.00	7.87	1.51	0.00	0.00	0.08	0.00

:: Liquefaction Potential Index calculation data :: (continued)											
Depth (ft)	FS	F _L	w _z	d _z	LPI	Depth (ft)	FS	F _L	w _z	d _z	LPI
7.96	1.73	0.00	0.00	0.08	0.00	8.04	1.02	0.00	0.00	0.08	0.00
8.12	0.66	0.00	0.00	0.08	0.07	8.20	0.51	0.00	0.00	0.08	0.11
8.28	0.59	0.00	0.00	0.08	0.09	8.37	0.71	0.00	0.00	0.08	0.06
8.45	0.93	0.00	0.00	0.08	0.02	8.53	1.13	0.00	0.00	0.08	0.00
8.61	1.70	0.00	0.00	0.08	0.00	8.69	1.49	0.00	0.00	0.08	0.00
8.78	1.34	0.00	0.00	0.08	0.00	8.86	1.29	0.00	0.00	0.08	0.00
8.94	1.30	0.00	0.00	0.08	0.00	9.02	1.38	0.00	0.00	0.08	0.00
9.10	1.47	0.00	0.00	0.08	0.00	9.19	1.51	0.00	0.00	0.08	0.00
9.27	0.67	0.33	0.80	0.08	0.07	9.35	0.24	0.76	0.29	0.08	0.16
9.43	0.24	0.76	0.29	0.08	0.16	9.51	0.24	0.76	0.29	0.08	0.16
9.60	0.24	0.76	0.29	0.08	0.16	9.68	0.23	0.77	0.29	0.08	0.16
9.76	0.23	0.77	0.29	0.08	0.16	9.84	0.23	0.77	0.29	0.08	0.16
9.92	0.24	0.76	0.29	0.08	0.16	10.01	0.24	0.76	0.29	0.08	0.16
10.09	0.24	0.76	0.29	0.08	0.16	10.17	0.23	0.77	0.29	0.08	0.16
10.25	0.20	0.80	0.28	0.08	0.17	10.33	0.20	0.80	0.28	0.08	0.17
10.42	0.21	0.79	0.28	0.08	0.17	10.50	0.20	0.80	0.28	0.08	0.17
10.58	0.23	0.77	0.29	0.08	0.16	10.66	0.23	0.77	0.29	0.08	0.16
10.74	0.24	0.76	0.29	0.08	0.16	10.83	0.25	0.75	0.30	0.08	0.16
10.91	0.27	0.73	0.31	0.08	0.15	10.99	0.55	0.45	0.54	0.08	0.09
11.07	1.57	0.00	0.00	0.08	0.00	11.15	1.39	0.00	0.00	0.08	0.00
11.24	1.36	0.00	0.00	0.08	0.00	11.32	0.22	0.78	0.29	0.08	0.16
11.40	0.20	0.80	0.28	0.08	0.16	11.48	0.20	0.80	0.28	0.08	0.16
11.56	0.21	0.79	0.28	0.08	0.16	11.65	0.22	0.78	0.28	0.08	0.16
11.73	0.31	0.69	0.33	0.08	0.14	11.81	1.87	0.00	0.00	0.08	0.00
11.89	1.93	0.00	0.00	0.08	0.00	11.98	0.35	0.65	0.35	0.08	0.13
12.06	0.26	0.74	0.30	0.08	0.15	12.14	0.31	0.69	0.33	0.08	0.14
12.22	0.42	0.58	0.40	0.08	0.12	12.30	0.48	0.52	0.46	0.08	0.10
12.39	0.81	0.00	0.00	0.08	0.04	12.47	1.32	0.00	0.00	0.08	0.00
12.55	2.00	0.00	0.00	0.08	0.00	12.63	2.00	0.00	0.00	0.08	0.00
12.71	2.00	0.00	0.00	0.08	0.00	12.80	2.00	0.00	0.00	0.08	0.00
12.88	2.00	0.00	0.00	0.08	0.00	12.96	2.00	0.00	0.00	0.08	0.00
13.04	2.00	0.00	0.00	0.08	0.00	13.12	2.00	0.00	0.00	0.08	0.00
13.21	2.00	0.00	0.00	0.08	0.00	13.29	2.00	0.00	0.00	0.08	0.00
13.37	2.00	0.00	0.00	0.08	0.00	13.45	2.00	0.00	0.00	0.08	0.00
13.53	2.00	0.00	0.00	0.08	0.00	13.62	2.00	0.00	0.00	0.08	0.00
13.70	2.00	0.00	0.00	0.08	0.00	13.78	2.00	0.00	0.00	0.08	0.00
13.86	2.00	0.00	0.00	0.08	0.00	13.94	2.00	0.00	0.00	0.08	0.00
14.03	2.00	0.00	0.00	0.08	0.00	14.11	2.00	0.00	0.00	0.08	0.00
14.19	2.00	0.00	0.00	0.08	0.00	14.27	2.00	0.00	0.00	0.08	0.00
14.35	1.48	0.00	0.00	0.08	0.00	14.44	2.00	0.00	0.00	0.08	0.00
14.52	2.00	0.00	0.00	0.08	0.00	14.60	1.39	0.00	0.00	0.08	0.00
14.68	1.26	0.00	0.00	0.08	0.00	14.76	1.26	0.00	0.00	0.08	0.00
14.85	1.35	0.00	0.00	0.08	0.00	14.93	1.53	0.00	0.00	0.08	0.00
15.01	2.00	0.00	0.00	0.08	0.00	15.09	2.00	0.00	0.00	0.08	0.00
15.17	2.00	0.00	0.00	0.08	0.00	15.26	2.00	0.00	0.00	0.08	0.00
15.34	2.00	0.00	0.00	0.08	0.00	15.42	2.00	0.00	0.00	0.08	0.00
15.50	2.00	0.00	0.00	0.08	0.00	15.58	2.00	0.00	0.00	0.08	0.00
15.67	2.00	0.00	0.00	0.08	0.00	15.75	2.00	0.00	0.00	0.08	0.00

:: Liquefaction Potential Index calculation data :: (continued)											
Depth (ft)	FS	F _L	w _z	d _z	LPI	Depth (ft)	FS	F _L	w _z	d _z	LPI
15.83	2.00	0.00	0.00	0.08	0.00	15.91	2.00	0.00	0.00	0.08	0.00
15.99	2.00	0.00	0.00	0.08	0.00	16.08	2.00	0.00	0.00	0.08	0.00
16.16	1.34	0.00	0.00	0.08	0.00	16.24	1.24	0.00	0.00	0.08	0.00
16.32	1.00	0.00	0.00	0.08	0.00	16.40	0.73	0.27	1.04	0.08	0.05
16.49	0.64	0.36	0.73	0.08	0.07	16.57	0.71	0.29	0.98	0.08	0.05
16.65	2.00	0.00	0.00	0.08	0.00	16.73	2.00	0.00	0.00	0.08	0.00
16.81	1.86	0.00	0.00	0.08	0.00	16.90	1.57	0.00	0.00	0.08	0.00
16.98	1.80	0.00	0.00	0.08	0.00	17.06	0.22	0.78	0.29	0.08	0.14
17.14	0.22	0.78	0.28	0.08	0.14	17.22	0.24	0.76	0.30	0.08	0.14
17.31	0.74	0.00	0.00	0.08	0.05	17.39	0.85	0.00	0.00	0.08	0.03
17.47	0.30	0.70	0.32	0.08	0.13	17.55	0.31	0.69	0.33	0.08	0.13
17.63	0.33	0.67	0.34	0.08	0.12	17.72	0.35	0.65	0.35	0.08	0.12
17.80	0.28	0.72	0.31	0.08	0.13	17.88	0.27	0.73	0.30	0.08	0.13
17.96	0.28	0.72	0.31	0.08	0.13	18.04	0.26	0.74	0.30	0.08	0.13
18.13	0.24	0.76	0.29	0.08	0.14	18.21	0.27	0.73	0.31	0.08	0.13
18.29	0.41	0.59	0.39	0.08	0.11	18.37	1.96	0.00	0.00	0.08	0.00
18.45	1.53	0.00	0.00	0.08	0.00	18.54	1.38	0.00	0.00	0.08	0.00
18.62	0.40	0.60	0.38	0.08	0.11	18.70	0.20	0.80	0.28	0.08	0.14
18.78	0.20	0.80	0.28	0.08	0.14	18.86	0.21	0.79	0.28	0.08	0.14
18.95	0.25	0.75	0.30	0.08	0.13	19.03	0.86	0.00	0.00	0.08	0.03
19.11	1.68	0.00	0.00	0.08	0.00	19.19	1.35	0.00	0.00	0.08	0.00
19.27	1.09	0.00	0.00	0.08	0.00	19.36	0.90	0.00	0.00	0.08	0.02
19.44	0.77	0.00	0.00	0.08	0.04	19.52	0.72	0.28	1.00	0.08	0.05
19.60	0.71	0.29	0.97	0.08	0.05	19.69	0.72	0.28	1.00	0.08	0.05
19.77	0.73	0.00	0.00	0.08	0.05	19.85	0.76	0.00	0.00	0.08	0.04
19.93	0.81	0.00	0.00	0.08	0.03	20.01	0.87	0.00	0.00	0.08	0.02
20.10	0.91	0.00	0.00	0.08	0.02	20.18	0.31	0.69	0.33	0.08	0.12
20.26	0.31	0.69	0.33	0.08	0.12	20.34	0.32	0.68	0.34	0.08	0.12
20.42	0.38	0.62	0.37	0.08	0.11	20.51	1.19	0.00	0.00	0.08	0.00
20.59	0.62	0.38	0.68	0.08	0.06	20.67	1.31	0.00	0.00	0.08	0.00
20.75	1.29	0.00	0.00	0.08	0.00	20.83	1.32	0.00	0.00	0.08	0.00
20.92	0.44	0.56	0.41	0.08	0.10	21.00	0.33	0.67	0.34	0.08	0.11
21.08	0.33	0.67	0.34	0.08	0.11	21.16	0.86	0.00	0.00	0.08	0.02
21.24	1.47	0.00	0.00	0.08	0.00	21.33	1.21	0.00	0.00	0.08	0.00
21.41	1.10	0.00	0.00	0.08	0.00	21.49	1.31	0.00	0.00	0.08	0.00
21.57	0.22	0.78	0.29	0.08	0.13	21.65	0.26	0.74	0.30	0.08	0.12
21.74	0.31	0.69	0.33	0.08	0.12	21.82	0.40	0.60	0.39	0.08	0.10
21.90	0.38	0.62	0.37	0.08	0.10	21.98	0.39	0.61	0.38	0.08	0.10
22.06	0.33	0.67	0.34	0.08	0.11	22.15	0.39	0.61	0.38	0.08	0.10
22.23	1.02	0.00	0.00	0.08	0.00	22.31	1.99	0.00	0.00	0.08	0.00
22.39	1.46	0.00	0.00	0.08	0.00	22.47	1.23	0.00	0.00	0.08	0.00
22.56	1.10	0.00	0.00	0.08	0.00	22.64	0.32	0.68	0.34	0.08	0.11
22.72	0.17	0.83	0.27	0.08	0.14	22.80	0.15	0.85	0.26	0.08	0.14
22.88	0.15	0.85	0.26	0.08	0.14	22.97	0.15	0.85	0.26	0.08	0.14
23.05	0.15	0.85	0.26	0.08	0.14	23.13	0.14	0.86	0.26	0.08	0.14
23.21	0.15	0.85	0.26	0.08	0.14	23.29	0.15	0.85	0.26	0.08	0.14
23.38	0.16	0.84	0.26	0.08	0.14	23.46	0.18	0.82	0.27	0.08	0.13
23.54	0.49	0.51	0.47	0.08	0.08	23.62	1.73	0.00	0.00	0.08	0.00

:: Liquefaction Potential Index calculation data :: (continued)											
Depth (ft)	FS	F _L	w _z	d _z	LPI	Depth (ft)	FS	F _L	w _z	d _z	LPI
23.70	0.27	0.73	0.31	0.08	0.12	23.79	0.29	0.71	0.32	0.08	0.11
23.87	0.64	0.36	0.71	0.08	0.06	23.95	2.00	0.00	0.00	0.08	0.00
24.03	2.00	0.00	0.00	0.08	0.00	24.11	2.00	0.00	0.00	0.08	0.00
24.20	2.00	0.00	0.00	0.08	0.00	24.28	2.00	0.00	0.00	0.08	0.00
24.36	2.00	0.00	0.00	0.08	0.00	24.44	2.00	0.00	0.00	0.08	0.00
24.52	2.00	0.00	0.00	0.08	0.00	24.61	2.00	0.00	0.00	0.08	0.00
24.69	2.00	0.00	0.00	0.08	0.00	24.77	2.00	0.00	0.00	0.08	0.00
24.85	2.00	0.00	0.00	0.08	0.00	24.93	2.00	0.00	0.00	0.08	0.00
25.02	2.00	0.00	0.00	0.08	0.00	25.10	2.00	0.00	0.00	0.08	0.00
25.18	2.00	0.00	0.00	0.08	0.00	25.26	2.00	0.00	0.00	0.08	0.00
25.34	2.00	0.00	0.00	0.08	0.00	25.43	2.00	0.00	0.00	0.08	0.00
25.51	2.00	0.00	0.00	0.08	0.00	25.59	2.00	0.00	0.00	0.08	0.00
25.67	2.00	0.00	0.00	0.08	0.00	25.75	2.00	0.00	0.00	0.08	0.00
25.84	2.00	0.00	0.00	0.08	0.00	25.92	2.00	0.00	0.00	0.08	0.00
26.00	2.00	0.00	0.00	0.08	0.00	26.08	2.00	0.00	0.00	0.08	0.00
26.16	2.00	0.00	0.00	0.08	0.00	26.25	2.00	0.00	0.00	0.08	0.00
26.33	2.00	0.00	0.00	0.08	0.00	26.41	2.00	0.00	0.00	0.08	0.00
26.49	2.00	0.00	0.00	0.08	0.00	26.57	2.00	0.00	0.00	0.08	0.00
26.66	2.00	0.00	0.00	0.08	0.00	26.74	2.00	0.00	0.00	0.08	0.00
26.82	2.00	0.00	0.00	0.08	0.00	26.90	2.00	0.00	0.00	0.08	0.00
26.98	2.00	0.00	0.00	0.08	0.00	27.07	2.00	0.00	0.00	0.08	0.00
27.15	2.00	0.00	0.00	0.08	0.00	27.23	2.00	0.00	0.00	0.08	0.00
27.31	2.00	0.00	0.00	0.08	0.00	27.40	2.00	0.00	0.00	0.08	0.00
27.48	2.00	0.00	0.00	0.08	0.00	27.56	2.00	0.00	0.00	0.08	0.00
27.64	2.00	0.00	0.00	0.08	0.00	27.72	2.00	0.00	0.00	0.08	0.00
27.81	2.00	0.00	0.00	0.08	0.00	27.89	2.00	0.00	0.00	0.08	0.00
27.97	2.00	0.00	0.00	0.08	0.00	28.05	2.00	0.00	0.00	0.08	0.00
28.13	2.00	0.00	0.00	0.08	0.00	28.22	2.00	0.00	0.00	0.08	0.00
28.30	2.00	0.00	0.00	0.08	0.00	28.38	2.00	0.00	0.00	0.08	0.00
28.46	2.00	0.00	0.00	0.08	0.00	28.54	2.00	0.00	0.00	0.08	0.00
28.63	2.00	0.00	0.00	0.08	0.00	28.71	2.00	0.00	0.00	0.08	0.00
28.79	2.00	0.00	0.00	0.08	0.00	28.87	2.00	0.00	0.00	0.08	0.00
28.95	2.00	0.00	0.00	0.08	0.00	29.04	2.00	0.00	0.00	0.08	0.00
29.12	2.00	0.00	0.00	0.08	0.00	29.20	2.00	0.00	0.00	0.08	0.00
29.28	2.00	0.00	0.00	0.08	0.00	29.36	2.00	0.00	0.00	0.08	0.00
29.45	2.00	0.00	0.00	0.08	0.00	29.53	2.00	0.00	0.00	0.08	0.00
29.61	2.00	0.00	0.00	0.08	0.00	29.69	2.00	0.00	0.00	0.08	0.00
29.77	2.00	0.00	0.00	0.08	0.00	29.86	2.00	0.00	0.00	0.08	0.00
29.94	2.00	0.00	0.00	0.08	0.00	30.02	2.00	0.00	0.00	0.08	0.00
30.10	2.00	0.00	0.00	0.08	0.00	30.18	2.00	0.00	0.00	0.08	0.00
30.27	1.25	0.00	0.00	0.08	0.00	30.35	1.11	0.00	0.00	0.08	0.00
30.43	1.27	0.00	0.00	0.08	0.00	30.51	2.00	0.00	0.00	0.08	0.00
30.59	2.00	0.00	0.00	0.08	0.00	30.68	2.00	0.00	0.00	0.08	0.00
30.76	2.00	0.00	0.00	0.08	0.00	30.84	2.00	0.00	0.00	0.08	0.00
30.92	2.00	0.00	0.00	0.08	0.00	31.00	2.00	0.00	0.00	0.08	0.00
31.09	2.00	0.00	0.00	0.08	0.00	31.17	2.00	0.00	0.00	0.08	0.00
31.25	2.00	0.00	0.00	0.08	0.00	31.33	2.00	0.00	0.00	0.08	0.00
31.41	2.00	0.00	0.00	0.08	0.00	31.50	2.00	0.00	0.00	0.08	0.00

:: Liquefaction Potential Index calculation data :: (continued)											
Depth (ft)	FS	F _L	w _z	d _z	LPI	Depth (ft)	FS	F _L	w _z	d _z	LPI
31.58	2.00	0.00	0.00	0.08	0.00	31.66	2.00	0.00	0.00	0.08	0.00
31.74	2.00	0.00	0.00	0.08	0.00	31.82	2.00	0.00	0.00	0.08	0.00
31.91	2.00	0.00	0.00	0.08	0.00	31.99	2.00	0.00	0.00	0.08	0.00
32.07	2.00	0.00	0.00	0.08	0.00	32.15	2.00	0.00	0.00	0.08	0.00
32.23	2.00	0.00	0.00	0.08	0.00	32.32	2.00	0.00	0.00	0.08	0.00
32.40	2.00	0.00	0.00	0.08	0.00	32.48	2.00	0.00	0.00	0.08	0.00
32.56	2.00	0.00	0.00	0.08	0.00	32.64	2.00	0.00	0.00	0.08	0.00
32.73	2.00	0.00	0.00	0.08	0.00	32.81	2.00	0.00	0.00	0.08	0.00
32.89	2.00	0.00	0.00	0.08	0.00	32.97	2.00	0.00	0.00	0.08	0.00
33.05	2.00	0.00	0.00	0.08	0.00	33.14	2.00	0.00	0.00	0.08	0.00
33.22	2.00	0.00	0.00	0.08	0.00	33.30	2.00	0.00	0.00	0.08	0.00
33.38	2.00	0.00	0.00	0.08	0.00	33.46	2.00	0.00	0.00	0.08	0.00
33.55	2.00	0.00	0.00	0.08	0.00	33.63	2.00	0.00	0.00	0.08	0.00
33.71	2.00	0.00	0.00	0.08	0.00	33.79	2.00	0.00	0.00	0.08	0.00
33.87	2.00	0.00	0.00	0.08	0.00	33.96	2.00	0.00	0.00	0.08	0.00
34.04	2.00	0.00	0.00	0.08	0.00	34.12	2.00	0.00	0.00	0.08	0.00
34.20	2.00	0.00	0.00	0.08	0.00	34.28	2.00	0.00	0.00	0.08	0.00
34.37	2.00	0.00	0.00	0.08	0.00	34.45	2.00	0.00	0.00	0.08	0.00
34.53	2.00	0.00	0.00	0.08	0.00						


Overall liquefaction potential: 12.16

LPI = 0.00 - Liquefaction risk very low
 LPI between 0.00 and 5.00 - Liquefaction risk low
 LPI between 5.00 and 15.00 - Liquefaction risk high
 LPI > 15.00 - Liquefaction risk very high

Abbreviations

FS: Calculated factor of safety for test point
 F_L: 1 - FS
 w_z: Function value of the extend of soil liquefaction according to depth
 d_z: Layer thickness (ft)
 LPI: Liquefaction potential index value for test point

Estimation of post-earthquake settlements

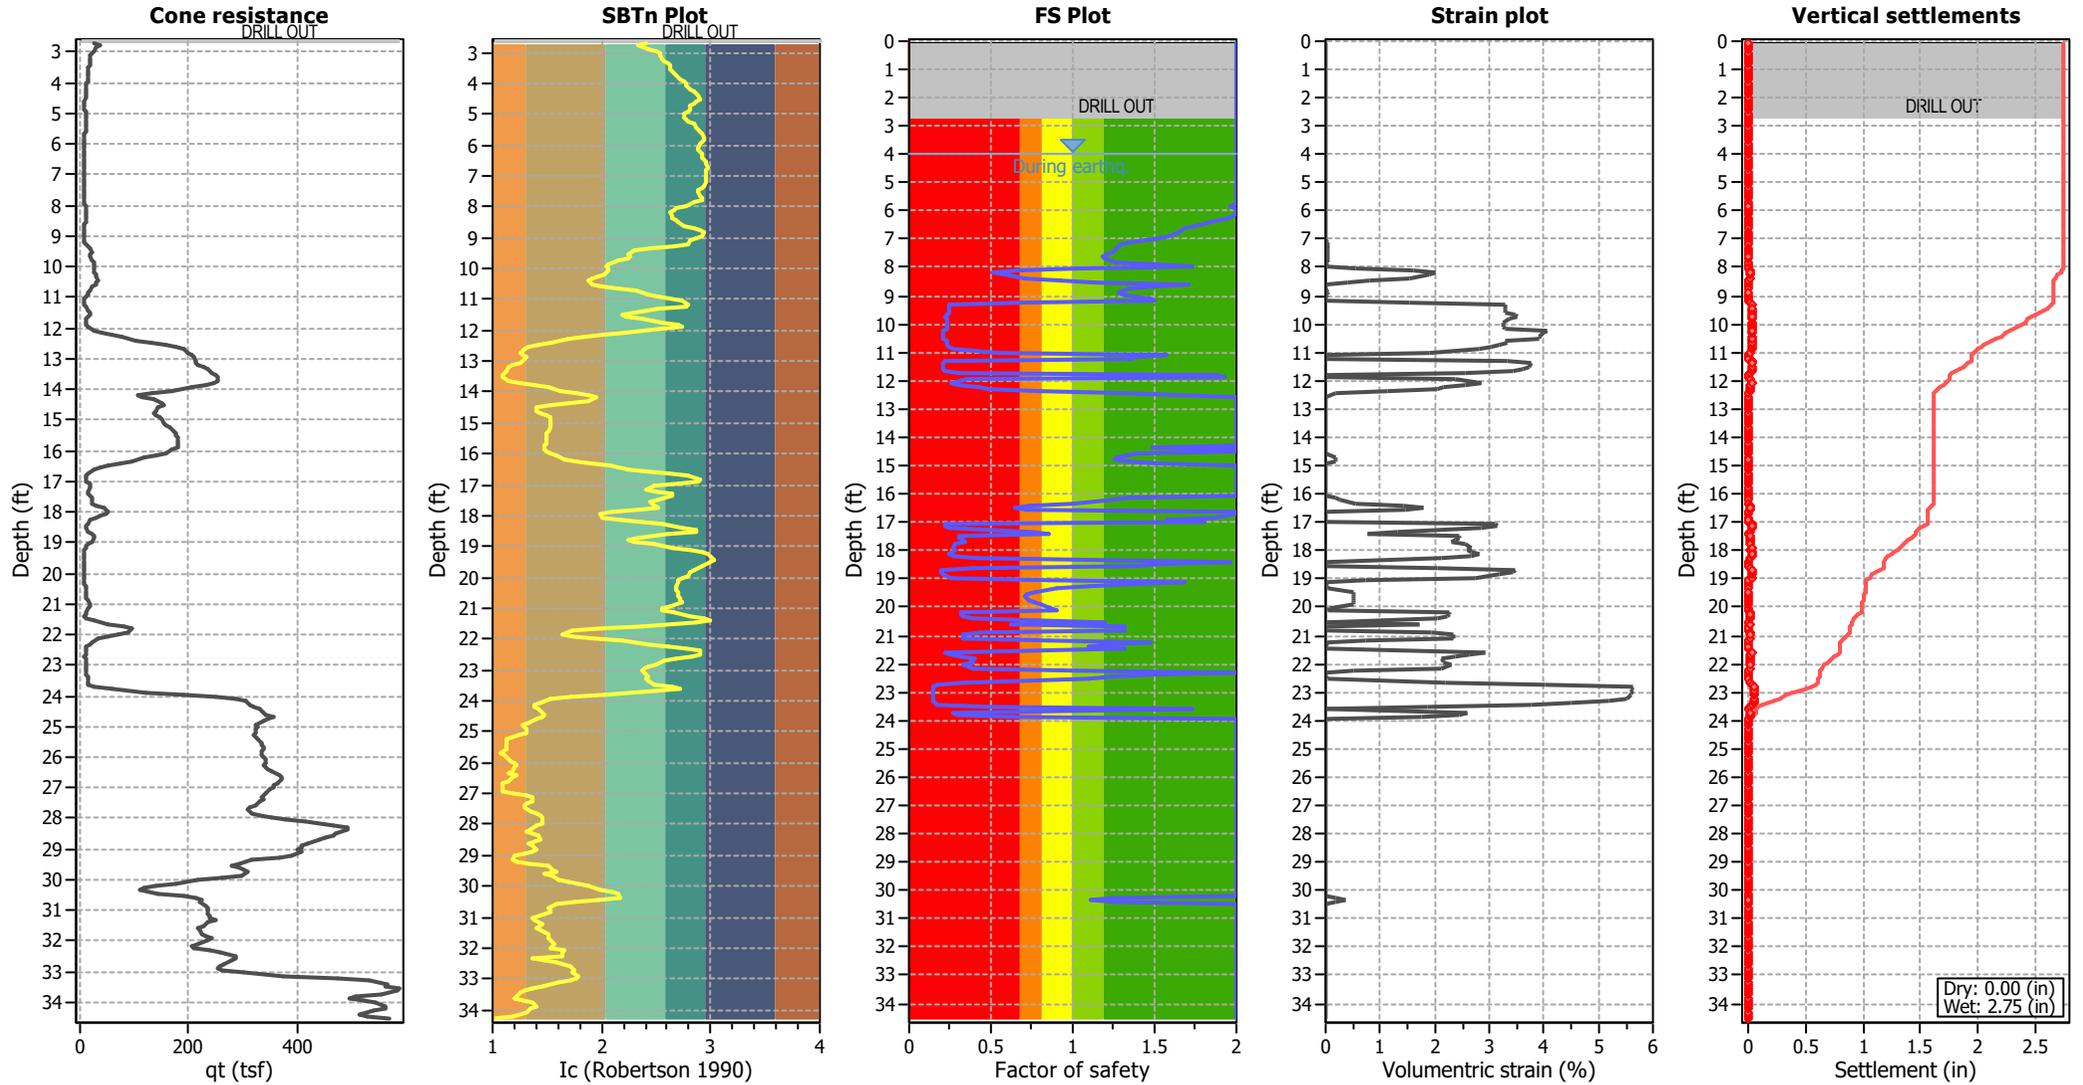

Abbreviations

- q_c: Total cone resistance (cone resistance q_c corrected for pore water effects)
- I_c: Soil Behaviour Type Index
- FS: Calculated Factor of Safety against liquefaction
- Volumetric strain: Post-liquefaction volumetric strain

:: Post-earthquake settlement due to soil liquefaction ::											
Depth (ft)	Q _{tn,cs}	FS	e _v (%)	DF	Settlement (in)	Depth (ft)	Q _{tn,cs}	FS	e _v (%)	DF	Settlement (in)
4.02	130.48	2.00	0.00	1.00	0.00	4.10	130.90	2.00	0.00	1.00	0.00
4.18	133.23	2.00	0.00	1.00	0.00	4.27	133.76	2.00	0.00	1.00	0.00
4.35	132.35	2.00	0.00	1.00	0.00	4.43	128.18	2.00	0.00	1.00	0.00
4.51	122.29	2.00	0.00	1.00	0.00	4.59	113.73	2.00	0.00	1.00	0.00
4.68	104.92	2.00	0.00	1.00	0.00	4.76	99.74	2.00	0.00	1.00	0.00
4.84	97.49	2.00	0.00	1.00	0.00	4.92	96.73	2.00	0.00	1.00	0.00
5.00	98.23	2.00	0.00	1.00	0.00	5.09	103.08	2.00	0.00	1.00	0.00
5.17	110.20	2.00	0.00	1.00	0.00	5.25	116.97	2.00	0.00	1.00	0.00
5.33	121.61	2.00	0.00	1.00	0.00	5.41	125.10	2.00	0.00	1.00	0.00
5.50	125.37	2.00	0.00	1.00	0.00	5.58	123.97	2.00	0.00	1.00	0.00
5.66	120.81	2.00	0.00	1.00	0.00	5.74	119.18	2.00	0.00	1.00	0.00
5.82	117.87	1.97	0.00	1.00	0.00	5.91	115.86	1.99	0.00	1.00	0.00
5.99	112.69	2.00	0.00	1.00	0.00	6.07	109.99	2.00	0.00	1.00	0.00
6.15	109.24	2.00	0.00	1.00	0.00	6.23	109.86	1.95	0.00	1.00	0.00
6.32	110.18	1.89	0.00	1.00	0.00	6.40	110.53	1.84	0.00	1.00	0.00
6.48	110.92	1.79	0.00	1.00	0.00	6.56	111.85	1.74	0.00	1.00	0.00
6.64	111.49	1.69	0.01	1.00	0.00	6.73	109.87	1.65	0.01	1.00	0.00
6.81	106.77	1.62	0.01	1.00	0.00	6.89	103.45	1.58	0.01	1.00	0.00
6.97	99.57	1.52	0.01	1.00	0.00	7.05	95.66	1.44	0.01	1.00	0.00
7.14	91.78	1.36	0.02	1.00	0.00	7.22	87.53	1.29	0.02	1.00	0.00
7.30	83.09	1.26	0.03	1.00	0.00	7.38	78.28	1.25	0.03	1.00	0.00
7.46	74.02	1.24	0.03	1.00	0.00	7.55	72.14	1.21	0.03	1.00	0.00
7.63	72.09	1.18	0.03	1.00	0.00	7.71	77.60	1.19	0.03	1.00	0.00
7.79	83.12	1.27	0.02	1.00	0.00	7.87	84.99	1.51	0.01	1.00	0.00
7.96	82.07	1.73	0.00	1.00	0.00	8.04	161.54	1.02	0.57	1.00	0.01
8.12	134.70	0.66	1.61	1.00	0.02	8.20	119.72	0.51	2.02	1.00	0.02
8.28	128.13	0.59	1.91	1.00	0.02	8.37	139.52	0.71	1.53	1.00	0.02
8.45	156.79	0.93	0.81	1.00	0.01	8.53	169.79	1.13	0.39	1.00	0.00
8.61	82.41	1.70	0.00	1.00	0.00	8.69	85.81	1.49	0.01	1.00	0.00
8.78	88.85	1.34	0.02	1.00	0.00	8.86	90.07	1.29	0.02	1.00	0.00
8.94	87.58	1.30	0.02	1.00	0.00	9.02	84.11	1.38	0.01	1.00	0.00
9.10	80.97	1.47	0.01	1.00	0.00	9.19	80.50	1.51	0.01	1.00	0.00
9.27	138.24	0.67	1.55	1.00	0.02	9.35	66.21	0.24	3.28	1.00	0.03
9.43	65.49	0.24	3.31	1.00	0.03	9.51	65.69	0.24	3.30	1.00	0.03
9.60	65.52	0.24	3.30	1.00	0.03	9.68	61.60	0.23	3.48	1.00	0.03
9.76	61.00	0.23	3.50	1.00	0.03	9.84	63.88	0.23	3.37	1.00	0.03
9.92	66.30	0.24	3.27	1.00	0.03	10.01	66.40	0.24	3.27	1.00	0.03
10.09	66.30	0.24	3.27	1.00	0.03	10.17	65.98	0.23	3.29	1.00	0.03
10.25	51.03	0.20	4.06	1.00	0.04	10.33	52.21	0.20	3.98	1.00	0.04
10.42	53.56	0.21	3.90	1.00	0.04	10.50	53.35	0.20	3.91	1.00	0.04
10.58	65.93	0.23	3.29	1.00	0.03	10.66	65.29	0.23	3.31	1.00	0.03
10.74	68.77	0.24	3.18	1.00	0.03	10.83	73.00	0.25	3.02	1.00	0.03
10.91	79.21	0.27	2.83	1.00	0.03	10.99	129.99	0.55	1.88	1.00	0.02
11.07	79.42	1.57	0.01	1.00	0.00	11.15	77.22	1.39	0.01	1.00	0.00
11.24	73.09	1.36	0.01	1.00	0.00	11.32	65.19	0.22	3.32	1.00	0.03
11.40	55.77	0.20	3.77	1.00	0.04	11.48	56.82	0.20	3.71	1.00	0.04
11.56	58.72	0.21	3.62	1.00	0.04	11.65	62.38	0.22	3.44	1.00	0.03
11.73	89.75	0.31	2.55	1.00	0.03	11.81	89.14	1.87	0.00	1.00	0.00

:: Post-earthquake settlement due to soil liquefaction :: (continued)											
Depth (ft)	Q _{tn,cs}	FS	e _v (%)	DF	Settlement (in)	Depth (ft)	Q _{tn,cs}	FS	e _v (%)	DF	Settlement (in)
11.89	97.61	1.93	0.00	1.00	0.00	11.98	98.05	0.35	2.37	1.00	0.02
12.06	78.43	0.26	2.85	1.00	0.03	12.14	90.03	0.31	2.55	1.00	0.03
12.22	110.20	0.42	2.16	1.00	0.02	12.30	118.35	0.48	2.04	1.00	0.02
12.39	149.74	0.81	1.13	1.00	0.01	12.47	181.77	1.32	0.19	1.00	0.00
12.55	210.60	2.00	0.00	1.00	0.00	12.63	230.94	2.00	0.00	1.00	0.00
12.71	246.14	2.00	0.00	1.00	0.00	12.80	259.68	2.00	0.00	1.00	0.00
12.88	271.38	2.00	0.00	1.00	0.00	12.96	275.83	2.00	0.00	1.00	0.00
13.04	272.35	2.00	0.00	1.00	0.00	13.12	266.85	2.00	0.00	1.00	0.00
13.21	268.39	2.00	0.00	1.00	0.00	13.29	276.65	2.00	0.00	1.00	0.00
13.37	286.43	2.00	0.00	1.00	0.00	13.45	293.47	2.00	0.00	1.00	0.00
13.53	299.81	2.00	0.00	1.00	0.00	13.62	309.31	2.00	0.00	1.00	0.00
13.70	321.90	2.00	0.00	1.00	0.00	13.78	325.87	2.00	0.00	1.00	0.00
13.86	317.82	2.00	0.00	1.00	0.00	13.94	292.75	2.00	0.00	1.00	0.00
14.03	274.44	2.00	0.00	1.00	0.00	14.11	246.97	2.00	0.00	1.00	0.00
14.19	213.65	2.00	0.00	1.00	0.00	14.27	206.89	2.00	0.00	1.00	0.00
14.35	192.01	1.48	0.00	1.00	0.00	14.44	205.70	2.00	0.00	1.00	0.00
14.52	200.43	2.00	0.00	1.00	0.00	14.60	187.64	1.39	0.00	1.00	0.00
14.68	181.01	1.26	0.19	1.00	0.00	14.76	180.97	1.26	0.19	1.00	0.00
14.85	185.57	1.35	0.19	1.00	0.00	14.93	194.92	1.53	0.00	1.00	0.00
15.01	201.63	2.00	0.00	1.00	0.00	15.09	205.98	2.00	0.00	1.00	0.00
15.17	210.75	2.00	0.00	1.00	0.00	15.26	218.14	2.00	0.00	1.00	0.00
15.34	225.38	2.00	0.00	1.00	0.00	15.42	230.23	2.00	0.00	1.00	0.00
15.50	232.11	2.00	0.00	1.00	0.00	15.58	232.44	2.00	0.00	1.00	0.00
15.67	233.13	2.00	0.00	1.00	0.00	15.75	234.32	2.00	0.00	1.00	0.00
15.83	233.90	2.00	0.00	1.00	0.00	15.91	230.04	2.00	0.00	1.00	0.00
15.99	219.56	2.00	0.00	1.00	0.00	16.08	205.80	2.00	0.00	1.00	0.00
16.16	186.15	1.34	0.19	1.00	0.00	16.24	180.90	1.24	0.27	1.00	0.00
16.32	166.16	1.00	0.55	1.00	0.01	16.40	145.88	0.73	1.44	1.00	0.01
16.49	138.63	0.64	1.79	1.00	0.02	16.57	144.95	0.71	1.45	1.00	0.01
16.65	251.60	2.00	0.00	1.00	0.00	16.73	154.07	2.00	0.00	1.00	0.00
16.81	141.55	1.86	0.00	1.00	0.00	16.90	119.17	1.57	0.01	1.00	0.00
16.98	91.29	1.80	0.00	1.00	0.00	17.06	70.95	0.22	3.10	1.00	0.03
17.14	69.97	0.22	3.13	1.00	0.03	17.22	78.43	0.24	2.85	1.00	0.03
17.31	154.64	0.74	1.32	1.00	0.01	17.39	163.49	0.85	0.76	1.00	0.01
17.47	93.70	0.30	2.46	1.00	0.02	17.55	94.34	0.31	2.45	1.00	0.02
17.63	98.79	0.33	2.36	1.00	0.02	17.72	101.96	0.35	2.30	1.00	0.02
17.80	88.85	0.28	2.57	1.00	0.03	17.88	84.86	0.27	2.67	1.00	0.03
17.96	88.20	0.28	2.59	1.00	0.03	18.04	84.91	0.26	2.67	1.00	0.03
18.13	79.00	0.24	2.83	1.00	0.03	18.21	85.19	0.27	2.66	1.00	0.03
18.29	112.80	0.41	2.12	1.00	0.02	18.37	108.95	1.96	0.00	1.00	0.00
18.45	111.66	1.53	0.01	1.00	0.00	18.54	101.71	1.38	0.01	1.00	0.00
18.62	116.99	0.40	2.05	1.00	0.02	18.70	61.88	0.20	3.46	1.00	0.03
18.78	62.39	0.20	3.44	1.00	0.03	18.86	68.58	0.21	3.18	1.00	0.03
18.95	82.11	0.25	2.75	1.00	0.03	19.03	164.88	0.86	0.75	1.00	0.01
19.11	110.05	1.68	0.00	1.00	0.00	19.19	109.29	1.35	0.01	1.00	0.00
19.27	101.96	1.09	0.03	1.00	0.00	19.36	89.70	0.90	0.05	1.00	0.00
19.44	78.16	0.77	0.50	1.00	0.00	19.52	67.52	0.72	0.50	1.00	0.00
19.60	59.42	0.71	0.50	1.00	0.00	19.69	54.32	0.72	0.50	1.00	0.00

:: Post-earthquake settlement due to soil liquefaction :: (continued)											
Depth (ft)	Q _{tn,cs}	FS	e _v (%)	DF	Settlement (in)	Depth (ft)	Q _{tn,cs}	FS	e _v (%)	DF	Settlement (in)
19.77	52.28	0.73	0.50	1.00	0.00	19.85	51.22	0.76	0.50	1.00	0.00
19.93	50.91	0.81	0.50	1.00	0.00	20.01	49.84	0.87	0.06	1.00	0.00
20.10	48.23	0.91	0.05	1.00	0.00	20.18	104.16	0.31	2.26	1.00	0.02
20.26	103.91	0.31	2.26	1.00	0.02	20.34	106.25	0.32	2.22	1.00	0.02
20.42	116.58	0.38	2.06	1.00	0.02	20.51	62.99	1.19	0.02	1.00	0.00
20.59	145.96	0.62	1.71	1.00	0.02	20.67	70.77	1.31	0.01	1.00	0.00
20.75	70.21	1.29	0.01	1.00	0.00	20.83	74.85	1.32	0.01	1.00	0.00
20.92	124.40	0.44	1.95	1.00	0.02	21.00	100.30	0.33	2.33	1.00	0.02
21.08	100.63	0.33	2.32	1.00	0.02	21.16	166.40	0.86	0.74	1.00	0.01
21.24	100.90	1.47	0.01	1.00	0.00	21.33	107.07	1.21	0.02	1.00	0.00
21.41	106.13	1.10	0.02	1.00	0.00	21.49	100.56	1.31	0.01	1.00	0.00
21.57	75.96	0.22	2.93	1.00	0.03	21.65	86.02	0.26	2.64	1.00	0.03
21.74	97.97	0.31	2.38	1.00	0.02	21.82	113.49	0.40	2.11	1.00	0.02
21.90	110.41	0.38	2.15	1.00	0.02	21.98	111.22	0.39	2.14	1.00	0.02
22.06	102.39	0.33	2.29	1.00	0.02	22.15	111.79	0.39	2.13	1.00	0.02
22.23	178.73	1.02	0.51	1.00	0.01	22.31	124.16	1.99	0.00	1.00	0.00
22.39	119.14	1.46	0.01	1.00	0.00	22.47	102.13	1.23	0.02	1.00	0.00
22.56	76.25	1.10	0.02	1.00	0.00	22.64	107.08	0.32	2.21	1.00	0.02
22.72	51.78	0.17	4.01	1.00	0.04	22.80	34.16	0.15	5.64	1.00	0.06
22.88	34.40	0.15	5.61	1.00	0.06	22.97	34.31	0.15	5.62	1.00	0.06
23.05	34.40	0.15	5.61	1.00	0.06	23.13	34.45	0.14	5.60	1.00	0.06
23.21	34.94	0.15	5.53	1.00	0.05	23.29	37.85	0.15	5.18	1.00	0.05
23.38	44.90	0.16	4.51	1.00	0.04	23.46	55.91	0.18	3.76	1.00	0.04
23.54	132.54	0.49	1.85	1.00	0.02	23.62	96.83	1.73	0.00	1.00	0.00
23.70	88.55	0.27	2.58	1.00	0.03	23.79	95.18	0.29	2.43	1.00	0.02
23.87	142.08	0.64	1.75	1.00	0.02	23.95	218.40	2.00	0.00	1.00	0.00
24.03	282.57	2.00	0.00	1.00	0.00	24.11	318.49	2.00	0.00	1.00	0.00
24.20	337.21	2.00	0.00	1.00	0.00	24.28	347.84	2.00	0.00	1.00	0.00
24.36	359.02	2.00	0.00	1.00	0.00	24.44	369.78	2.00	0.00	1.00	0.00
24.52	375.34	2.00	0.00	1.00	0.00	24.61	378.18	2.00	0.00	1.00	0.00
24.69	388.07	2.00	0.00	1.00	0.00	24.77	374.29	2.00	0.00	1.00	0.00
24.85	366.95	2.00	0.00	1.00	0.00	24.93	349.67	2.00	0.00	1.00	0.00
25.02	353.24	2.00	0.00	1.00	0.00	25.10	347.34	2.00	0.00	1.00	0.00
25.18	341.54	2.00	0.00	1.00	0.00	25.26	336.01	2.00	0.00	1.00	0.00
25.34	338.95	2.00	0.00	1.00	0.00	25.43	344.64	2.00	0.00	1.00	0.00
25.51	350.00	2.00	0.00	1.00	0.00	25.59	350.16	2.00	0.00	1.00	0.00
25.67	350.08	2.00	0.00	1.00	0.00	25.75	353.18	2.00	0.00	1.00	0.00
25.84	349.46	2.00	0.00	1.00	0.00	25.92	351.97	2.00	0.00	1.00	0.00
26.00	355.59	2.00	0.00	1.00	0.00	26.08	359.45	2.00	0.00	1.00	0.00
26.16	357.32	2.00	0.00	1.00	0.00	26.25	352.37	2.00	0.00	1.00	0.00
26.33	354.31	2.00	0.00	1.00	0.00	26.41	361.13	2.00	0.00	1.00	0.00
26.49	368.08	2.00	0.00	1.00	0.00	26.57	380.58	2.00	0.00	1.00	0.00
26.66	383.78	2.00	0.00	1.00	0.00	26.74	382.50	2.00	0.00	1.00	0.00
26.82	373.00	2.00	0.00	1.00	0.00	26.90	366.92	2.00	0.00	1.00	0.00
26.98	367.64	2.00	0.00	1.00	0.00	27.07	367.17	2.00	0.00	1.00	0.00
27.15	361.02	2.00	0.00	1.00	0.00	27.23	356.39	2.00	0.00	1.00	0.00
27.31	350.52	2.00	0.00	1.00	0.00	27.40	353.33	2.00	0.00	1.00	0.00
27.48	344.05	2.00	0.00	1.00	0.00	27.56	338.34	2.00	0.00	1.00	0.00

:: Post-earthquake settlement due to soil liquefaction :: (continued)											
Depth (ft)	Q _{tn,cs}	FS	e _v (%)	DF	Settlement (in)	Depth (ft)	Q _{tn,cs}	FS	e _v (%)	DF	Settlement (in)
27.64	326.38	2.00	0.00	1.00	0.00	27.72	324.61	2.00	0.00	1.00	0.00
27.81	332.86	2.00	0.00	1.00	0.00	27.89	346.79	2.00	0.00	1.00	0.00
27.97	368.87	2.00	0.00	1.00	0.00	28.05	392.97	2.00	0.00	1.00	0.00
28.13	431.65	2.00	0.00	1.00	0.00	28.22	482.47	2.00	0.00	1.00	0.00
28.30	508.66	2.00	0.00	1.00	0.00	28.38	511.87	2.00	0.00	1.00	0.00
28.46	489.11	2.00	0.00	1.00	0.00	28.54	482.21	2.00	0.00	1.00	0.00
28.63	465.30	2.00	0.00	1.00	0.00	28.71	452.52	2.00	0.00	1.00	0.00
28.79	431.15	2.00	0.00	1.00	0.00	28.87	419.28	2.00	0.00	1.00	0.00
28.95	416.12	2.00	0.00	1.00	0.00	29.04	403.87	2.00	0.00	1.00	0.00
29.12	409.53	2.00	0.00	1.00	0.00	29.20	391.58	2.00	0.00	1.00	0.00
29.28	371.25	2.00	0.00	1.00	0.00	29.36	323.87	2.00	0.00	1.00	0.00
29.45	302.13	2.00	0.00	1.00	0.00	29.53	286.09	2.00	0.00	1.00	0.00
29.61	301.25	2.00	0.00	1.00	0.00	29.69	307.40	2.00	0.00	1.00	0.00
29.77	316.87	2.00	0.00	1.00	0.00	29.86	305.28	2.00	0.00	1.00	0.00
29.94	306.85	2.00	0.00	1.00	0.00	30.02	275.52	2.00	0.00	1.00	0.00
30.10	234.85	2.00	0.00	1.00	0.00	30.18	205.72	2.00	0.00	1.00	0.00
30.27	184.82	1.25	0.19	1.00	0.00	30.35	176.63	1.11	0.38	1.00	0.00
30.43	185.93	1.27	0.19	1.00	0.00	30.51	205.83	2.00	0.00	1.00	0.00
30.59	214.87	2.00	0.00	1.00	0.00	30.68	224.59	2.00	0.00	1.00	0.00
30.76	221.12	2.00	0.00	1.00	0.00	30.84	229.82	2.00	0.00	1.00	0.00
30.92	232.87	2.00	0.00	1.00	0.00	31.00	234.30	2.00	0.00	1.00	0.00
31.09	233.82	2.00	0.00	1.00	0.00	31.17	234.67	2.00	0.00	1.00	0.00
31.25	237.99	2.00	0.00	1.00	0.00	31.33	245.03	2.00	0.00	1.00	0.00
31.41	233.53	2.00	0.00	1.00	0.00	31.50	223.40	2.00	0.00	1.00	0.00
31.58	212.38	2.00	0.00	1.00	0.00	31.66	217.75	2.00	0.00	1.00	0.00
31.74	220.10	2.00	0.00	1.00	0.00	31.82	228.94	2.00	0.00	1.00	0.00
31.91	238.84	2.00	0.00	1.00	0.00	31.99	231.97	2.00	0.00	1.00	0.00
32.07	213.87	2.00	0.00	1.00	0.00	32.15	202.21	2.00	0.00	1.00	0.00
32.23	205.22	2.00	0.00	1.00	0.00	32.32	230.63	2.00	0.00	1.00	0.00
32.40	252.02	2.00	0.00	1.00	0.00	32.48	279.83	2.00	0.00	1.00	0.00
32.56	283.16	2.00	0.00	1.00	0.00	32.64	283.97	2.00	0.00	1.00	0.00
32.73	279.25	2.00	0.00	1.00	0.00	32.81	267.54	2.00	0.00	1.00	0.00
32.89	277.58	2.00	0.00	1.00	0.00	32.97	282.85	2.00	0.00	1.00	0.00
33.05	292.27	2.00	0.00	1.00	0.00	33.14	360.47	2.00	0.00	1.00	0.00
33.22	457.15	2.00	0.00	1.00	0.00	33.30	513.21	2.00	0.00	1.00	0.00
33.38	543.20	2.00	0.00	1.00	0.00	33.46	538.97	2.00	0.00	1.00	0.00
33.55	561.48	2.00	0.00	1.00	0.00	33.63	557.12	2.00	0.00	1.00	0.00
33.71	529.55	2.00	0.00	1.00	0.00	33.79	484.79	2.00	0.00	1.00	0.00
33.87	472.43	2.00	0.00	1.00	0.00	33.96	496.39	2.00	0.00	1.00	0.00
34.04	516.50	2.00	0.00	1.00	0.00	34.12	534.01	2.00	0.00	1.00	0.00
34.20	530.56	2.00	0.00	1.00	0.00	34.28	509.04	2.00	0.00	1.00	0.00
34.37	490.60	2.00	0.00	1.00	0.00	34.45	503.93	2.00	0.00	1.00	0.00
34.53	540.38	2.00	0.00	1.00	0.00						

:: Post-earthquake settlement due to soil liquefaction :: (continued)											
Depth (ft)	$Q_{tn,cs}$	FS	e_v (%)	DF	Settlement (in)	Depth (ft)	$Q_{tn,cs}$	FS	e_v (%)	DF	Settlement (in)


Total estimated settlement: 2.75

Abbreviations

- $Q_{tn,cs}$: Equivalent clean sand normalized cone resistance
- FS: Factor of safety against liquefaction
- e_v (%): Post-liquefaction volumetric strain
- DF: e_v depth weighting factor
- Settlement: Calculated settlement

Estimation of post-earthquake lateral Displacements

Geometric parameters: Level ground (or gently sloping) with free face (L: 70.00 ft - H: 5.00 ft)

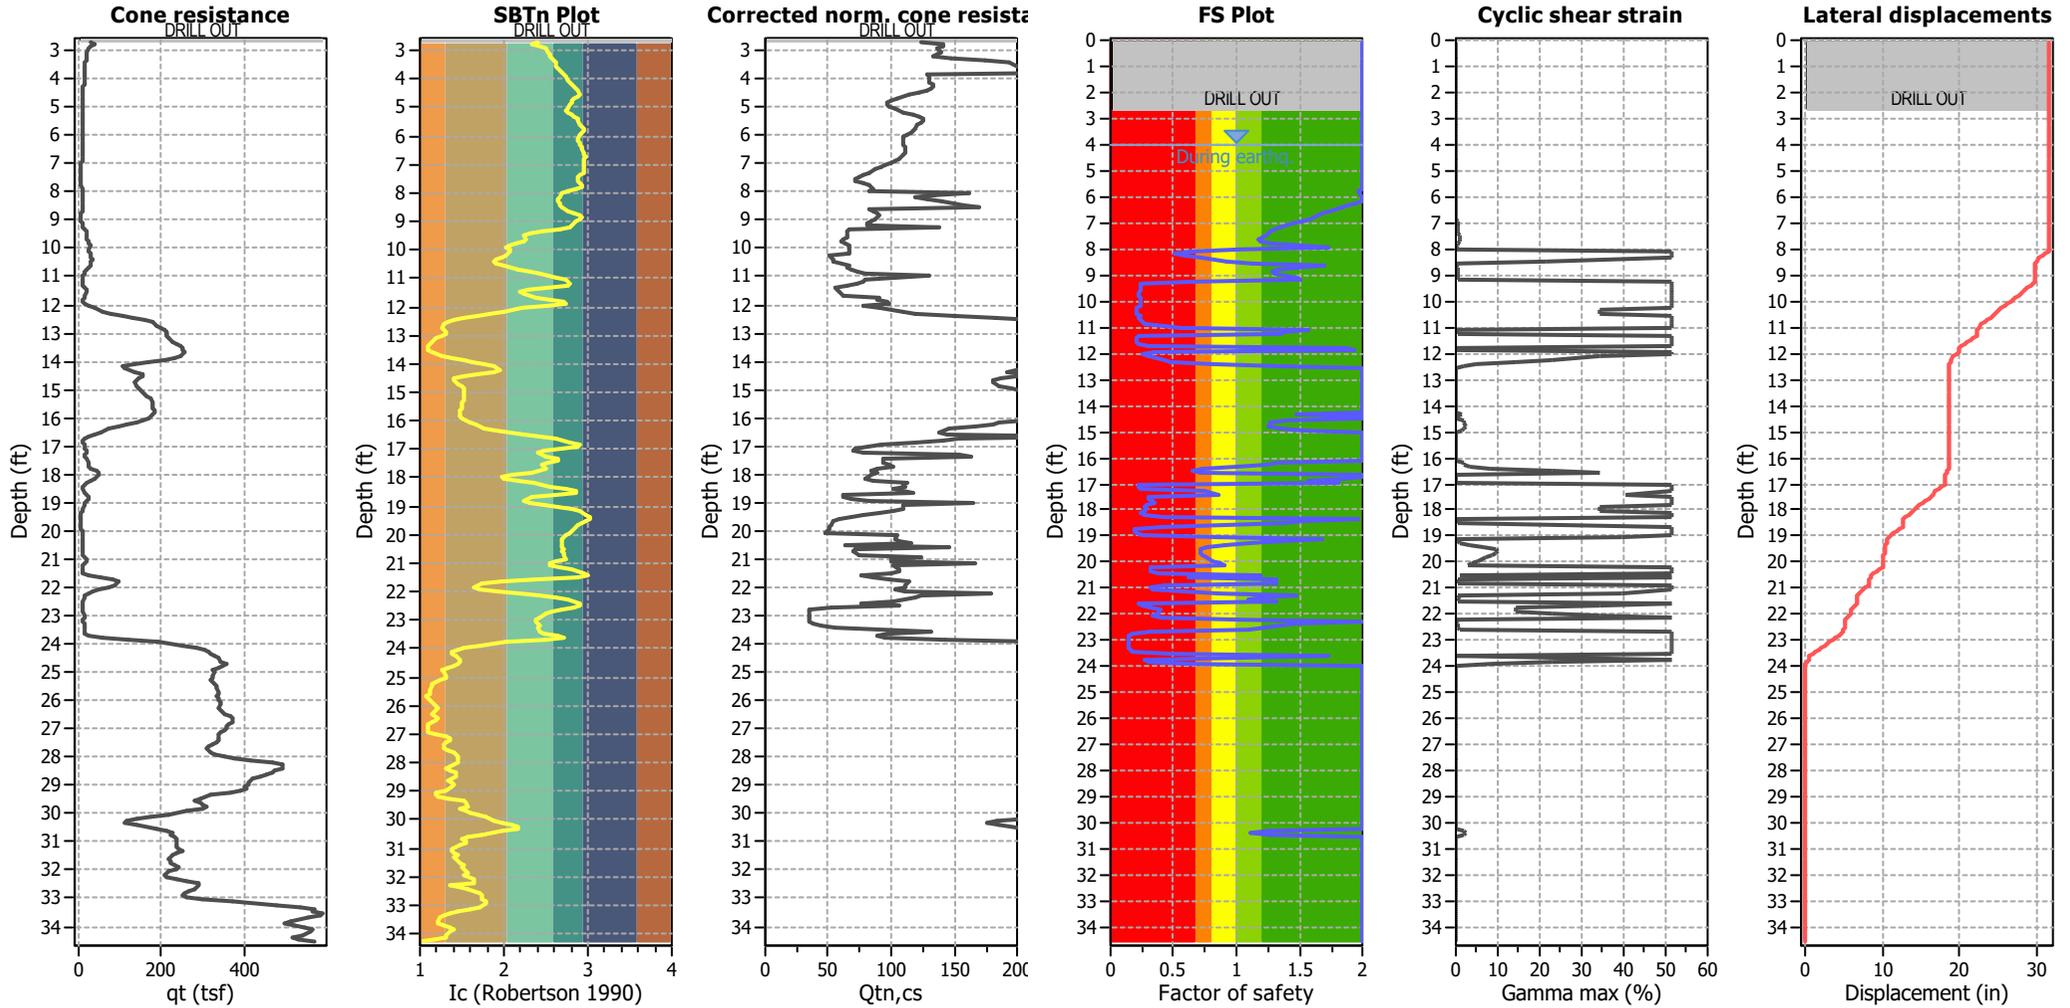


Abbreviations

qt: Total cone resistance (cone resistance q_c corrected for pore water effects)
 Ic: Soil Behaviour Type Index
 $Q_{tn,cs}$: Equivalent clean sand normalized CPT total cone resistance

F.S.: Factor of safety
 γ_{max} : Maximum cyclic shear strain
 LDI: Lateral displacement index

Surface condition



:: Lateral displacement index calculation ::								
Depth (ft)	q _t (tsf)	Q _{tn}	R _f (%)	Q _{tn,cs}	FS	D _r	Gamma _{max} (%)	Lat. disp. (in)
4.02	12.85	23.84	3.84	130.48	2.00	19.68	0.05	0.00
4.10	12.57	23.30	3.90	130.90	2.00	18.92	0.05	0.00
4.18	12.06	22.33	4.10	133.23	2.00	17.51	0.05	0.00
4.27	11.39	21.05	4.25	133.76	2.00	15.57	0.06	0.00
4.35	10.66	19.67	4.32	132.35	2.00	13.33	0.06	0.00
4.43	9.92	18.26	4.25	128.18	2.00	10.87	0.06	0.00
4.51	9.25	16.98	4.06	122.29	2.00	8.47	0.07	0.00
4.59	9.08	16.65	3.60	113.73	2.00	7.82	0.07	0.00
4.68	8.99	16.48	3.13	104.92	2.00	7.48	0.07	0.00
4.76	9.02	16.52	2.85	99.74	2.00	7.57	0.07	0.00
4.84	8.92	16.32	2.75	97.49	2.00	7.17	0.07	0.00
4.92	9.31	17.06	2.66	96.73	2.00	8.63	0.07	0.00
5.00	10.06	18.46	2.64	98.23	2.00	11.23	0.06	0.00
5.09	10.71	19.68	2.80	103.08	2.00	13.34	0.06	0.00
5.17	11.00	20.23	3.10	110.20	2.00	14.26	0.06	0.00
5.25	10.85	19.94	3.46	116.97	2.00	13.77	0.06	0.00
5.33	10.44	19.15	3.76	121.61	2.00	12.44	0.06	0.00
5.41	10.04	18.38	4.03	125.10	2.00	11.09	0.06	0.00
5.50	9.78	17.89	4.11	125.37	2.00	10.20	0.06	0.00
5.58	9.42	17.19	4.11	123.97	2.00	8.88	0.07	0.00
5.66	8.90	16.20	4.05	120.81	2.00	6.92	0.07	0.00
5.74	8.38	15.21	4.09	119.18	2.00	4.84	0.07	0.00
5.82	8.26	14.98	4.04	117.87	1.97	4.33	0.08	0.00
5.91	8.41	15.26	3.87	115.86	1.99	4.95	0.07	0.00
5.99	8.65	15.71	3.62	112.69	2.00	5.91	0.07	0.00
6.07	8.72	15.82	3.45	109.99	2.00	6.13	0.07	0.00
6.15	8.66	15.71	3.42	109.24	2.00	5.91	0.07	0.00
6.23	8.43	15.27	3.50	109.86	1.95	4.96	0.08	0.00
6.32	8.26	14.92	3.56	110.18	1.89	4.21	0.09	0.00
6.40	8.09	14.59	3.62	110.53	1.84	3.47	0.11	0.00
6.48	7.95	14.32	3.68	110.92	1.79	2.85	0.12	0.00
6.56	7.76	13.96	3.79	111.85	1.74	2.02	0.14	0.00
6.64	7.58	13.61	3.82	111.49	1.69	1.17	0.16	0.00
6.73	7.45	13.35	3.76	109.87	1.65	0.53	0.18	0.00
6.81	7.38	13.21	3.57	106.77	1.62	0.19	0.20	0.00
6.89	7.25	12.97	3.40	103.45	1.58	0.00	0.22	0.00
6.97	7.03	12.54	3.21	99.57	1.52	0.00	0.27	0.00
7.05	6.70	11.92	3.05	95.66	1.44	0.00	0.35	0.00
7.14	6.37	11.27	2.89	91.78	1.36	0.00	0.48	0.00
7.22	6.13	10.82	2.68	87.53	1.29	0.00	0.60	0.00
7.30	6.02	10.60	2.43	83.09	1.26	0.00	0.68	0.00
7.38	6.00	10.56	2.15	78.28	1.25	0.00	0.70	0.01
7.46	5.98	10.51	1.91	74.02	1.24	0.00	0.73	0.01
7.55	5.85	10.26	1.83	72.14	1.21	0.00	0.84	0.01
7.63	5.77	10.09	1.84	72.09	1.18	0.00	0.94	0.01
7.71	5.86	10.25	2.13	77.60	1.19	0.00	0.88	0.01
7.79	6.25	10.98	2.38	83.12	1.27	0.00	0.64	0.00
7.87	7.36	13.08	2.29	84.99	1.51	0.00	0.27	0.00

:: Estimation of post-earthquake lateral Displacements :: (continued)								
Depth (ft)	q _t (tsf)	Q _{tn}	R _f (%)	Q _{tn,cs}	FS	D _r	Gamma _{max} (%)	Lat. disp. (in)
7.96	8.40	15.04	2.02	82.07	1.73	4.47	0.14	0.00
8.04	9.32	16.77	1.74	161.54	1.02	8.07	0.00	0.00
8.12	9.53	17.15	1.57	134.70	0.66	8.80	51.20	0.37
8.20	9.80	17.65	1.49	119.72	0.51	9.76	51.20	0.37
8.28	10.00	18.03	1.59	128.13	0.59	10.45	51.20	0.37
8.37	10.09	18.19	1.70	139.52	0.71	10.74	51.20	0.37
8.45	9.96	17.94	1.81	156.79	0.93	10.28	21.40	0.15
8.53	9.46	16.98	1.82	169.79	1.13	8.47	0.00	0.00
8.61	8.57	15.29	2.02	82.41	1.70	5.02	0.15	0.00
8.69	7.60	13.46	2.29	85.81	1.49	0.80	0.28	0.00
8.78	6.90	12.12	2.57	88.85	1.34	0.00	0.48	0.00
8.86	6.67	11.67	2.69	90.07	1.29	0.00	0.59	0.00
8.94	6.77	11.87	2.52	87.58	1.30	0.00	0.55	0.00
9.02	7.18	12.62	2.26	84.11	1.38	0.00	0.41	0.00
9.10	7.65	13.51	2.04	80.97	1.47	0.94	0.30	0.00
9.19	7.84	13.85	1.99	80.50	1.51	1.76	0.27	0.00
9.27	9.74	17.45	1.62	138.24	0.67	9.37	51.20	0.37
9.35	13.92	25.33	1.17	66.21	0.24	21.68	51.20	0.37
9.43	18.48	33.95	1.02	65.49	0.24	31.35	51.20	0.37
9.51	20.50	37.76	0.95	65.69	0.24	34.85	51.20	0.37
9.60	19.68	36.19	0.97	65.52	0.24	33.45	51.20	0.37
9.68	19.29	35.45	0.85	61.60	0.23	32.77	51.20	0.37
9.76	22.02	40.60	0.70	61.00	0.23	37.25	51.20	0.37
9.84	25.07	46.35	0.61	63.88	0.23	41.62	51.20	0.37
9.92	26.87	49.51	0.58	66.30	0.24	43.80	51.20	0.37
10.01	26.11	48.31	0.65	66.40	0.24	42.99	51.20	0.37
10.09	26.10	48.28	0.64	66.30	0.24	42.96	51.20	0.37
10.17	27.20	49.54	0.56	65.98	0.23	43.81	51.20	0.37
10.25	28.73	51.03	0.44	51.03	0.20	44.79	51.20	0.37
10.33	30.12	52.21	0.35	52.21	0.20	45.55	34.10	0.24
10.42	31.35	53.56	0.31	53.56	0.21	46.39	34.10	0.24
10.50	30.99	53.35	0.36	53.35	0.20	46.26	34.10	0.24
10.58	28.29	50.35	0.51	65.93	0.23	44.35	51.20	0.37
10.66	23.30	42.93	0.80	65.29	0.23	39.09	51.20	0.37
10.74	19.00	34.80	1.11	68.77	0.24	32.16	51.20	0.37
10.83	15.89	28.92	1.34	73.00	0.25	26.05	51.20	0.37
10.91	13.52	24.42	1.52	79.21	0.27	20.47	51.20	0.37
10.99	11.03	19.71	1.72	129.99	0.55	13.40	51.20	0.37
11.07	8.76	15.40	1.85	79.42	1.57	5.26	0.21	0.00
11.15	7.84	13.67	1.82	77.22	1.39	1.31	0.39	0.00
11.24	7.69	13.38	1.65	73.09	1.36	0.61	0.43	0.00
11.32	11.15	19.91	1.10	65.19	0.22	13.73	51.20	0.37
11.40	16.09	29.23	0.76	55.77	0.20	26.41	51.20	0.37
11.48	19.69	35.99	0.66	56.82	0.20	33.27	51.20	0.37
11.56	18.83	34.40	0.77	58.72	0.21	31.78	51.20	0.37
11.65	15.13	27.40	1.00	62.38	0.22	24.27	51.20	0.37
11.73	12.16	21.78	1.48	89.75	0.31	16.69	51.20	0.37
11.81	10.58	18.78	2.14	89.14	1.87	11.79	0.08	0.00

:: Estimation of post-earthquake lateral Displacements :: (continued)								
Depth (ft)	q _t (tsf)	Q _{tn}	R _f (%)	Q _{tn,cs}	FS	D _r	Gamma _{max} (%)	Lat. disp. (in)
11.89	10.91	19.39	2.48	97.61	1.93	12.86	0.07	0.00
11.98	15.31	27.71	1.92	98.05	0.35	24.64	51.20	0.37
12.06	26.28	47.81	1.16	78.43	0.26	42.64	51.20	0.37
12.14	40.56	68.77	0.86	90.03	0.31	54.64	34.10	0.24
12.22	57.82	92.55	0.68	110.20	0.42	64.44	22.70	0.16
12.30	77.84	118.35	0.54	118.35	0.48	72.56	14.50	0.10
12.39	104.35	149.74	0.40	149.74	0.81	80.33	5.00	0.04
12.47	132.35	181.77	0.32	181.77	1.32	86.72	1.99	0.01
12.55	158.12	210.60	0.28	210.60	2.00	91.58	0.00	0.00
12.63	176.22	230.94	0.27	230.94	2.00	94.63	0.00	0.00
12.71	189.71	246.14	0.27	246.14	2.00	96.73	0.00	0.00
12.80	199.34	259.68	0.32	259.68	2.00	98.50	0.00	0.00
12.88	206.91	271.38	0.37	271.38	2.00	99.95	0.00	0.00
12.96	211.03	275.83	0.37	275.83	2.00	100.00	0.00	0.00
13.04	211.78	272.35	0.31	272.35	2.00	100.00	0.00	0.00
13.12	212.72	266.85	0.23	266.85	2.00	99.40	0.00	0.00
13.21	217.26	268.39	0.18	268.39	2.00	99.59	0.00	0.00
13.29	226.44	276.65	0.17	276.65	2.00	100.00	0.00	0.00
13.37	235.91	286.43	0.17	286.43	2.00	100.00	0.00	0.00
13.45	243.48	293.47	0.16	293.47	2.00	100.00	0.00	0.00
13.53	248.34	299.81	0.18	299.81	2.00	100.00	0.00	0.00
13.62	252.74	309.31	0.23	309.31	2.00	100.00	0.00	0.00
13.70	253.12	321.90	0.40	321.90	2.00	100.00	0.00	0.00
13.78	247.24	325.87	0.60	325.87	2.00	100.00	0.00	0.00
13.86	231.70	317.82	0.88	317.82	2.00	100.00	0.00	0.00
13.94	207.10	292.75	1.12	292.75	2.00	100.00	0.00	0.00
14.03	169.40	249.47	1.49	274.44	2.00	97.17	0.00	0.00
14.11	133.25	202.53	1.77	246.97	2.00	90.29	0.00	0.00
14.19	107.76	167.37	1.94	213.65	2.00	84.00	0.00	0.00
14.27	113.02	170.20	1.50	206.89	2.00	84.55	0.00	0.00
14.35	134.87	192.01	0.96	192.01	1.48	88.53	1.60	0.01
14.44	152.40	205.70	0.59	205.70	2.00	90.81	0.00	0.00
14.52	154.01	200.43	0.37	200.43	2.00	89.95	0.00	0.00
14.60	145.04	187.64	0.32	187.64	1.39	87.77	1.80	0.01
14.68	138.42	181.01	0.36	181.01	1.26	86.59	2.14	0.02
14.76	136.42	180.97	0.45	180.97	1.26	86.58	2.15	0.02
14.85	139.09	185.57	0.52	185.57	1.35	87.41	1.91	0.01
14.93	146.28	194.92	0.55	194.92	1.53	89.03	1.51	0.01
15.01	151.51	201.63	0.58	201.63	2.00	90.15	0.00	0.00
15.09	154.90	205.98	0.60	205.98	2.00	90.85	0.00	0.00
15.17	158.90	210.75	0.62	210.75	2.00	91.61	0.00	0.00
15.26	165.61	218.14	0.60	218.14	2.00	92.74	0.00	0.00
15.34	172.15	225.38	0.60	225.38	2.00	93.82	0.00	0.00
15.42	176.55	230.23	0.60	230.23	2.00	94.52	0.00	0.00
15.50	178.28	232.11	0.60	232.11	2.00	94.79	0.00	0.00
15.58	178.94	232.44	0.60	232.44	2.00	94.84	0.00	0.00
15.67	180.15	233.13	0.59	233.13	2.00	94.94	0.00	0.00
15.75	181.86	234.32	0.58	234.32	2.00	95.11	0.00	0.00

:: Estimation of post-earthquake lateral Displacements :: (continued)								
Depth (ft)	q _t (tsf)	Q _{tn}	R _f (%)	Q _{tn,cs}	FS	D _r	Gamma _{max} (%)	Lat. disp. (in)
15.83	181.88	233.90	0.58	233.90	2.00	95.05	0.00	0.00
15.91	178.36	230.04	0.61	230.04	2.00	94.50	0.00	0.00
15.99	168.69	219.56	0.67	219.56	2.00	92.96	0.00	0.00
16.08	156.27	205.80	0.75	205.80	2.00	90.82	0.00	0.00
16.16	139.00	186.15	0.86	186.15	1.34	87.51	1.92	0.01
16.24	118.03	161.93	1.05	180.90	1.24	82.91	2.05	0.01
16.32	94.22	133.49	1.36	166.16	1.00	76.53	3.23	0.02
16.40	71.81	105.50	1.82	145.88	0.73	68.77	8.08	0.06
16.49	52.67	80.20	2.38	138.63	0.64	59.72	22.70	0.16
16.57	36.45	57.55	3.09	144.95	0.71	48.76	34.10	0.24
16.65	23.92	39.06	3.98	251.60	2.00	35.97	0.00	0.00
16.73	16.15	26.87	4.54	154.07	2.00	23.62	0.05	0.00
16.81	11.96	19.90	4.54	141.55	1.86	13.72	0.08	0.00
16.90	10.32	16.85	3.64	119.17	1.57	8.22	0.19	0.00
16.98	12.25	19.32	2.16	91.29	1.80	12.74	0.10	0.00
17.06	16.59	25.20	1.30	70.95	0.22	21.50	51.20	0.37
17.14	18.98	28.54	1.23	69.97	0.22	25.61	51.20	0.37
17.22	17.60	26.79	1.53	78.43	0.24	23.52	51.20	0.37
17.31	14.15	21.95	2.06	154.64	0.74	16.95	51.20	0.37
17.39	14.50	22.48	2.17	163.49	0.85	17.74	40.47	0.29
17.47	19.23	29.33	1.93	93.70	0.30	26.52	51.20	0.37
17.55	23.40	35.35	1.93	94.34	0.31	32.67	51.20	0.37
17.63	23.75	35.89	2.06	98.79	0.33	33.18	51.20	0.37
17.72	22.22	33.75	2.25	101.96	0.35	31.15	51.20	0.37
17.80	29.12	42.79	1.62	88.85	0.28	38.98	51.20	0.37
17.88	42.89	60.05	1.02	84.86	0.27	50.17	34.10	0.24
17.96	50.13	68.35	0.77	88.20	0.28	54.44	34.10	0.24
18.04	47.13	64.50	0.80	84.91	0.26	52.53	34.10	0.24
18.13	36.19	50.96	1.09	79.00	0.24	44.75	51.20	0.37
18.21	27.67	40.10	1.54	85.19	0.27	36.84	51.20	0.37
18.29	19.78	29.45	2.15	112.80	0.41	26.65	51.20	0.37
18.37	14.08	21.35	2.83	108.95	1.96	16.03	0.06	0.00
18.45	10.94	16.63	3.25	111.66	1.53	7.79	0.22	0.00
18.54	10.04	15.07	2.86	101.71	1.38	4.54	0.37	0.00
18.62	13.83	20.15	1.60	116.99	0.40	14.13	51.20	0.37
18.70	20.93	29.46	0.95	61.88	0.20	26.66	51.20	0.37
18.78	25.78	35.77	0.86	62.39	0.20	33.07	51.20	0.37
18.86	25.34	35.48	1.08	68.58	0.21	32.80	51.20	0.37
18.95	20.37	29.23	1.62	82.11	0.25	26.40	51.20	0.37
19.03	16.11	23.55	2.26	164.88	0.86	19.27	39.46	0.28
19.11	12.42	18.38	3.04	110.05	1.68	11.09	0.14	0.00
19.19	10.05	14.81	3.29	109.29	1.35	3.96	0.42	0.00
19.27	8.33	12.01	3.19	101.96	1.09	0.00	1.19	0.01
19.36	7.06	9.87	2.71	89.70	0.90	0.00	3.15	0.02
19.44	6.22	8.45	2.18	78.16	0.77	0.00	6.76	0.05
19.52	5.89	7.89	1.61	67.52	0.72	0.00	9.50	0.07
19.60	5.89	7.83	1.19	59.42	0.71	0.00	9.91	0.07
19.69	6.00	7.91	0.96	54.32	0.72	0.00	9.47	0.07

:: Estimation of post-earthquake lateral Displacements :: (continued)								
Depth (ft)	q _t (tsf)	Q _{tn}	R _f (%)	Q _{tn,cs}	FS	D _r	Gamma _{max} (%)	Lat. disp. (in)
19.77	6.14	8.07	0.86	52.28	0.73	0.00	8.67	0.06
19.85	6.42	8.44	0.81	51.22	0.76	0.00	7.00	0.05
19.93	6.77	8.93	0.79	50.91	0.81	0.00	5.35	0.04
20.01	7.30	9.64	0.73	49.84	0.87	0.00	3.68	0.03
20.10	7.63	10.06	0.67	48.23	0.91	0.00	3.00	0.02
20.18	7.87	10.38	0.68	104.16	0.31	0.00	51.20	0.37
20.26	8.23	10.89	0.73	103.91	0.31	0.00	51.20	0.37
20.34	8.71	11.58	0.81	106.25	0.32	0.00	51.20	0.37
20.42	9.25	12.38	0.95	116.58	0.38	0.00	51.20	0.37
20.51	9.85	13.31	1.17	62.99	1.19	0.43	0.77	0.01
20.59	10.66	14.48	1.34	145.96	0.62	3.22	51.20	0.37
20.67	10.77	14.66	1.45	70.77	1.31	3.63	0.47	0.00
20.75	10.68	14.48	1.43	70.21	1.29	3.21	0.51	0.00
20.83	10.86	14.78	1.61	74.85	1.32	3.88	0.46	0.00
20.92	14.47	19.78	1.63	124.40	0.44	13.51	51.20	0.37
21.00	17.66	24.14	1.70	100.30	0.33	20.09	51.20	0.37
21.08	18.59	25.40	1.78	100.63	0.33	21.77	51.20	0.37
21.16	15.57	21.37	2.09	166.40	0.86	16.07	39.73	0.28
21.24	12.02	16.56	2.71	100.90	1.47	7.65	0.26	0.00
21.33	9.91	13.59	3.28	107.07	1.21	1.12	0.71	0.01
21.41	9.14	12.35	3.38	106.13	1.10	0.00	1.15	0.01
21.49	10.84	14.76	2.81	100.56	1.31	3.86	0.47	0.00
21.57	25.63	33.94	1.34	75.96	0.22	31.33	51.20	0.37
21.65	52.86	66.56	0.74	86.02	0.26	53.56	34.10	0.24
21.74	80.92	97.97	0.48	97.97	0.31	66.32	14.50	0.10
21.82	95.46	113.49	0.39	113.49	0.40	71.18	14.50	0.10
21.90	88.44	106.57	0.52	110.41	0.38	69.10	14.50	0.10
21.98	71.18	88.55	0.90	111.22	0.39	62.99	22.70	0.16
22.06	49.69	64.18	1.58	102.39	0.33	52.36	34.10	0.24
22.15	34.10	45.20	2.30	111.79	0.39	40.79	51.20	0.37
22.23	23.47	31.54	2.90	178.73	1.02	28.92	0.00	0.00
22.31	16.70	22.51	3.43	124.16	1.99	17.79	0.05	0.00
22.39	12.34	16.48	3.65	119.14	1.46	7.48	0.28	0.00
22.47	10.58	13.85	2.97	102.13	1.23	1.76	0.66	0.00
22.56	9.76	12.41	1.76	76.25	1.10	0.00	1.15	0.01
22.64	9.38	11.55	0.81	107.08	0.32	0.00	51.20	0.37
22.72	9.18	11.04	0.38	51.78	0.17	0.00	51.20	0.37
22.80	9.85	11.80	0.28	34.16	0.15	0.00	51.20	0.37
22.88	11.26	13.54	0.25	34.40	0.15	0.99	51.20	0.37
22.97	12.37	14.90	0.24	34.31	0.15	4.17	51.20	0.37
23.05	12.58	15.14	0.24	34.40	0.15	4.70	51.20	0.37
23.13	11.80	14.15	0.25	34.45	0.14	2.46	51.20	0.37
23.21	11.56	13.84	0.26	34.94	0.15	1.73	51.20	0.37
23.29	12.74	15.38	0.33	37.85	0.15	5.20	51.20	0.37
23.38	14.61	17.88	0.53	44.90	0.16	10.18	51.20	0.37
23.46	15.74	19.54	0.86	55.91	0.18	13.10	51.20	0.37
23.54	15.23	19.28	1.65	132.54	0.49	12.68	51.20	0.37
23.62	15.41	19.75	2.36	96.83	1.73	13.45	0.11	0.00

:: Estimation of post-earthquake lateral Displacements :: (continued)								
Depth (ft)	q _t (tsf)	Q _{tn}	R _f (%)	Q _{tn,cs}	FS	D _r	Gamma _{max} (%)	Lat. disp. (in)
23.70	24.73	31.55	1.97	88.55	0.27	28.92	51.20	0.37
23.79	59.20	71.97	0.96	95.18	0.29	56.14	22.70	0.16
23.87	121.18	141.55	0.73	142.08	0.64	78.47	8.25	0.06
23.95	192.00	218.40	0.63	218.40	2.00	92.78	0.00	0.00
24.03	251.64	282.57	0.63	282.57	2.00	100.00	0.00	0.00
24.11	286.52	318.49	0.59	318.49	2.00	100.00	0.00	0.00
24.20	303.76	337.21	0.62	337.21	2.00	100.00	0.00	0.00
24.28	311.89	347.84	0.72	347.84	2.00	100.00	0.00	0.00
24.36	320.49	359.02	0.84	359.02	2.00	100.00	0.00	0.00
24.44	329.89	369.78	0.89	369.78	2.00	100.00	0.00	0.00
24.52	336.50	375.34	0.85	375.34	2.00	100.00	0.00	0.00
24.61	342.35	378.18	0.72	378.18	2.00	100.00	0.00	0.00
24.69	355.51	388.07	0.59	388.07	2.00	100.00	0.00	0.00
24.77	346.44	374.29	0.47	374.29	2.00	100.00	0.00	0.00
24.85	339.05	366.95	0.50	366.95	2.00	100.00	0.00	0.00
24.93	322.43	349.67	0.52	349.67	2.00	100.00	0.00	0.00
25.02	326.72	353.24	0.50	353.24	2.00	100.00	0.00	0.00
25.10	324.65	347.34	0.39	347.34	2.00	100.00	0.00	0.00
25.18	322.15	341.54	0.31	341.54	2.00	100.00	0.00	0.00
25.26	319.28	336.01	0.25	336.01	2.00	100.00	0.00	0.00
25.34	322.46	338.95	0.26	338.95	2.00	100.00	0.00	0.00
25.43	328.27	344.64	0.26	344.64	2.00	100.00	0.00	0.00
25.51	333.69	350.00	0.27	350.00	2.00	100.00	0.00	0.00
25.59	334.37	350.16	0.26	350.16	2.00	100.00	0.00	0.00
25.67	336.48	350.08	0.22	350.08	2.00	100.00	0.00	0.00
25.75	338.84	353.18	0.24	353.18	2.00	100.00	0.00	0.00
25.84	334.67	349.46	0.26	349.46	2.00	100.00	0.00	0.00
25.92	335.89	351.97	0.30	351.97	2.00	100.00	0.00	0.00
26.00	338.05	355.59	0.36	355.59	2.00	100.00	0.00	0.00
26.08	341.44	359.45	0.38	359.45	2.00	100.00	0.00	0.00
26.16	340.57	357.32	0.36	357.32	2.00	100.00	0.00	0.00
26.25	337.18	352.37	0.32	352.37	2.00	100.00	0.00	0.00
26.33	340.69	354.31	0.29	354.31	2.00	100.00	0.00	0.00
26.41	344.74	361.13	0.38	361.13	2.00	100.00	0.00	0.00
26.49	353.02	368.08	0.35	368.08	2.00	100.00	0.00	0.00
26.57	366.83	380.58	0.32	380.58	2.00	100.00	0.00	0.00
26.66	372.94	383.78	0.25	383.78	2.00	100.00	0.00	0.00
26.74	371.58	382.50	0.26	382.50	2.00	100.00	0.00	0.00
26.82	362.86	373.00	0.25	373.00	2.00	100.00	0.00	0.00
26.90	357.12	366.92	0.25	366.92	2.00	100.00	0.00	0.00
26.98	354.79	367.64	0.35	367.64	2.00	100.00	0.00	0.00
27.07	349.99	367.17	0.53	367.17	2.00	100.00	0.00	0.00
27.15	342.74	361.02	0.62	361.02	2.00	100.00	0.00	0.00
27.23	338.92	356.39	0.61	356.39	2.00	100.00	0.00	0.00
27.31	335.29	350.52	0.52	350.52	2.00	100.00	0.00	0.00
27.40	339.19	353.33	0.49	353.33	2.00	100.00	0.00	0.00
27.48	330.79	344.05	0.47	344.05	2.00	100.00	0.00	0.00
27.56	324.07	338.34	0.55	338.34	2.00	100.00	0.00	0.00

:: Estimation of post-earthquake lateral Displacements :: (continued)								
Depth (ft)	q _t (tsf)	Q _{tn}	R _f (%)	Q _{tn,cs}	FS	D _r	Gamma _{max} (%)	Lat. disp. (in)
27.64	311.43	326.38	0.63	326.38	2.00	100.00	0.00	0.00
27.72	309.19	324.61	0.70	324.61	2.00	100.00	0.00	0.00
27.81	316.54	332.86	0.78	332.86	2.00	100.00	0.00	0.00
27.89	330.23	346.79	0.81	346.79	2.00	100.00	0.00	0.00
27.97	351.70	368.87	0.85	368.87	2.00	100.00	0.00	0.00
28.05	377.19	392.97	0.75	392.97	2.00	100.00	0.00	0.00
28.13	416.87	431.65	0.68	431.65	2.00	100.00	0.00	0.00
28.22	468.07	482.47	0.66	482.47	2.00	100.00	0.00	0.00
28.30	491.65	508.66	0.81	508.66	2.00	100.00	0.00	0.00
28.38	492.95	511.87	0.95	511.87	2.00	100.00	0.00	0.00
28.46	471.37	489.11	0.95	489.11	2.00	100.00	0.00	0.00
28.54	467.38	482.21	0.82	482.21	2.00	100.00	0.00	0.00
28.63	453.68	465.30	0.69	465.30	2.00	100.00	0.00	0.00
28.71	440.31	452.52	0.76	452.52	2.00	100.00	0.00	0.00
28.79	419.18	431.15	0.80	431.15	2.00	100.00	0.00	0.00
28.87	409.28	419.28	0.72	419.28	2.00	100.00	0.00	0.00
28.95	408.93	416.12	0.58	416.12	2.00	100.00	0.00	0.00
29.04	400.44	403.87	0.41	403.87	2.00	100.00	0.00	0.00
29.12	406.90	409.53	0.39	409.53	2.00	100.00	0.00	0.00
29.20	388.43	391.58	0.43	391.58	2.00	100.00	0.00	0.00
29.28	366.12	371.25	0.56	371.25	2.00	100.00	0.00	0.00
29.36	315.81	323.87	0.88	323.87	2.00	100.00	0.00	0.00
29.45	294.56	302.13	0.91	302.13	2.00	100.00	0.00	0.00
29.53	278.70	286.09	0.98	286.09	2.00	100.00	0.00	0.00
29.61	295.81	301.25	0.75	301.25	2.00	100.00	0.00	0.00
29.69	300.94	307.40	0.94	307.40	2.00	100.00	0.00	0.00
29.77	309.55	316.87	1.13	316.87	2.00	100.00	0.00	0.00
29.86	296.92	305.28	1.46	305.28	2.00	100.00	0.00	0.00
29.94	261.05	269.20	1.71	306.85	2.00	99.69	0.00	0.00
30.02	217.14	224.52	1.97	275.52	2.00	93.69	0.00	0.00
30.10	174.84	181.16	2.24	234.85	2.00	86.61	0.00	0.00
30.18	139.27	144.63	2.63	205.72	2.00	79.18	0.00	0.00
30.27	117.43	121.78	2.68	184.82	1.25	73.50	1.67	0.01
30.35	110.66	114.48	2.63	176.63	1.11	71.46	2.36	0.02
30.43	141.61	145.07	1.75	185.93	1.27	79.28	1.95	0.01
30.51	190.02	192.54	1.12	205.83	2.00	88.62	0.00	0.00
30.59	214.01	214.87	0.74	214.87	2.00	92.25	0.00	0.00
30.68	224.77	224.59	0.61	224.59	2.00	93.71	0.00	0.00
30.76	221.23	221.12	0.67	221.12	2.00	93.19	0.00	0.00
30.84	230.20	229.82	0.70	229.82	2.00	94.47	0.00	0.00
30.92	234.19	232.87	0.58	232.87	2.00	94.90	0.00	0.00
31.00	237.11	234.30	0.40	234.30	2.00	95.10	0.00	0.00
31.09	236.75	233.82	0.41	233.82	2.00	95.03	0.00	0.00
31.17	237.58	234.67	0.46	234.67	2.00	95.16	0.00	0.00
31.25	240.72	237.99	0.55	237.99	2.00	95.62	0.00	0.00
31.33	248.62	245.03	0.48	245.03	2.00	96.58	0.00	0.00
31.41	237.02	233.53	0.50	233.53	2.00	94.99	0.00	0.00
31.50	226.70	223.40	0.55	223.40	2.00	93.53	0.00	0.00

:: Estimation of post-earthquake lateral Displacements :: (continued)								
Depth (ft)	q _t (tsf)	Q _{tn}	R _f (%)	Q _{tn,cs}	FS	D _r	Gamma _{max} (%)	Lat. disp. (in)
31.58	215.54	212.38	0.60	212.38	2.00	91.86	0.00	0.00
31.66	221.35	217.75	0.59	217.75	2.00	92.68	0.00	0.00
31.74	223.84	220.10	0.64	220.10	2.00	93.04	0.00	0.00
31.82	232.84	228.94	0.73	228.94	2.00	94.34	0.00	0.00
31.91	243.06	238.84	0.78	238.84	2.00	95.74	0.00	0.00
31.99	236.70	231.97	0.69	231.97	2.00	94.77	0.00	0.00
32.07	217.78	213.87	0.94	213.87	2.00	92.09	0.00	0.00
32.15	206.33	202.21	0.88	202.21	2.00	90.24	0.00	0.00
32.23	209.75	205.22	0.86	205.22	2.00	90.73	0.00	0.00
32.32	237.77	230.63	0.38	230.63	2.00	94.58	0.00	0.00
32.40	259.14	252.02	0.62	252.02	2.00	97.51	0.00	0.00
32.48	287.00	279.83	0.96	279.83	2.00	100.00	0.00	0.00
32.56	287.50	280.89	1.41	283.16	2.00	100.00	0.00	0.00
32.64	277.86	271.10	1.45	283.97	2.00	99.92	0.00	0.00
32.73	266.02	259.14	1.47	279.25	2.00	98.43	0.00	0.00
32.81	257.63	250.47	1.41	267.54	2.00	97.30	0.00	0.00
32.89	251.98	244.78	1.57	277.58	2.00	96.55	0.00	0.00
32.97	259.58	251.74	1.57	282.85	2.00	97.47	0.00	0.00
33.05	301.26	291.53	1.44	292.27	2.00	100.00	0.00	0.00
33.14	373.43	360.47	1.24	360.47	2.00	100.00	0.00	0.00
33.22	475.02	457.15	0.99	457.15	2.00	100.00	0.00	0.00
33.30	534.68	513.21	0.82	513.21	2.00	100.00	0.00	0.00
33.38	567.24	543.20	0.68	543.20	2.00	100.00	0.00	0.00
33.46	563.79	538.97	0.61	538.97	2.00	100.00	0.00	0.00
33.55	588.20	561.48	0.57	561.48	2.00	100.00	0.00	0.00
33.63	584.31	557.12	0.55	557.12	2.00	100.00	0.00	0.00
33.71	555.56	529.55	0.66	529.55	2.00	100.00	0.00	0.00
33.79	508.87	484.79	0.79	484.79	2.00	100.00	0.00	0.00
33.87	496.39	472.43	0.86	472.43	2.00	100.00	0.00	0.00
33.96	522.36	496.39	0.77	496.39	2.00	100.00	0.00	0.00
34.04	544.22	516.50	0.73	516.50	2.00	100.00	0.00	0.00
34.12	563.30	534.01	0.72	534.01	2.00	100.00	0.00	0.00
34.20	560.70	530.56	0.49	530.56	2.00	100.00	0.00	0.00
34.28	538.94	509.04	0.26	509.04	2.00	100.00	0.00	0.00
34.37	515.81	490.60	0.00	490.60	2.00	100.00	0.00	0.00
34.45	530.29	503.93	0.00	503.93	2.00	100.00	0.00	0.00
34.53	569.06	540.38	0.00	540.38	2.00	100.00	0.00	0.00

Total estimated displacement: 31.50

Abbreviations

- q_t: Total cone resistance
- Q_{tn}: Adjusted cone resistance to an effective overburden stress of 1 atm
- R_f: Friction ration
- Q_{tn,cs}: Adjusted and corrected cone resistance due to fines
- FS: Calculated factor of safety against liquefaction
- D_r: Calculated relative density
- Gamma_{max}: Calculated maximum cyclic shear strain
- Lat. disp.: Lateral displacement

:: Strength loss calculation (Robertson (2009)) ::							
Depth (ft)	q _t (tsf)	Q _{tn}	K _c	Q _{tn,cs}	I _c	S _{u(liq)} /σ' _v	S _{u(peak)} /σ' _v
0.08	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
0.16	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
0.25	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
0.33	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
0.41	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
0.49	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
0.57	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
0.66	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
0.74	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
0.82	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
0.90	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
0.98	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
1.07	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
1.15	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
1.23	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
1.31	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
1.39	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
1.48	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
1.56	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
1.64	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
1.72	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
1.80	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
1.89	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
1.97	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
2.05	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
2.13	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
2.21	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
2.30	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
2.38	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
2.46	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
2.54	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
2.62	0.00	-1.00	1.00	-1.00	-1.00	0.00	0.00
2.71	27.12	50.96	2.43	123.67	2.41	0.79	0.79
2.79	36.78	69.21	2.04	141.42	2.33	0.82	0.82
2.87	29.80	56.00	2.51	140.63	2.43	0.81	0.81
2.95	24.60	46.16	2.95	136.00	2.50	0.81	0.81
3.03	21.34	39.99	3.21	128.36	2.53	0.81	0.81
3.12	19.45	36.42	3.29	119.98	2.54	0.81	0.81
3.20	18.42	34.45	3.33	114.61	2.55	0.80	0.80
3.28	17.54	32.79	3.52	115.31	2.57	0.82	0.82
3.36	16.89	31.55	3.79	119.47	2.60	2.56	5.93
3.44	16.56	30.92	3.96	122.30	2.62	2.56	5.68
3.53	16.32	30.46	4.02	122.41	2.63	2.44	5.47
3.61	15.87	29.60	4.13	122.29	2.64	2.34	5.21
3.69	15.22	28.35	4.35	123.29	2.66	2.26	4.88
3.77	14.62	27.21	4.60	125.26	2.69	2.20	4.59
3.85	13.90	25.84	4.96	128.20	2.72	2.20	4.27
3.94	13.34	24.77	5.24	129.87	2.75	2.18	4.01

:: Strength loss calculation (Robertson (2009)) :: (continued)							
Depth (ft)	q _t (tsf)	Q _{tn}	K _c	Q _{tn,cs}	I _c	S _{u(liq)} /σ' _v	S _{u(peak)} /σ' _v
4.02	12.85	23.84	5.47	130.48	2.77	2.06	3.80
4.10	12.57	23.30	5.62	130.90	2.78	2.03	3.68
4.18	12.06	22.33	5.97	133.23	2.81	2.07	3.50
4.27	11.39	21.05	6.35	133.76	2.84	2.06	3.27
4.35	10.66	19.67	6.73	132.35	2.87	1.85	3.03
4.43	9.92	18.26	7.02	128.18	2.89	1.73	2.79
4.51	9.25	16.98	7.20	122.29	2.90	1.54	2.58
4.59	9.08	16.65	6.83	113.73	2.87	1.26	2.51
4.68	8.99	16.48	6.37	104.92	2.84	1.12	2.47
4.76	9.02	16.52	6.04	99.74	2.81	0.97	2.45
4.84	8.92	16.32	5.97	97.49	2.81	0.95	2.41
4.92	9.31	17.06	5.67	96.73	2.79	0.95	2.50
5.00	10.06	18.46	5.32	98.23	2.76	0.97	2.69
5.09	10.71	19.68	5.24	103.08	2.75	1.14	2.84
5.17	11.00	20.23	5.45	110.20	2.77	1.32	2.90
5.25	10.85	19.94	5.87	116.97	2.80	1.42	2.84
5.33	10.44	19.15	6.35	121.61	2.84	1.49	2.71
5.41	10.04	18.38	6.81	125.10	2.87	1.49	2.58
5.50	9.78	17.89	7.01	125.37	2.89	1.53	2.49
5.58	9.42	17.19	7.21	123.97	2.90	1.43	2.38
5.66	8.90	16.20	7.46	120.81	2.92	1.30	2.23
5.74	8.38	15.21	7.84	119.18	2.94	1.21	2.08
5.82	8.26	14.98	7.87	117.87	2.94	1.21	2.03
5.91	8.41	15.26	7.59	115.86	2.93	1.18	2.06
5.99	8.65	15.71	7.17	112.69	2.90	1.10	2.10
6.07	8.72	15.82	6.95	109.99	2.88	1.05	2.10
6.15	8.66	15.71	6.95	109.24	2.88	1.03	2.08
6.23	8.43	15.27	7.20	109.86	2.90	1.03	2.01
6.32	8.26	14.92	7.38	110.18	2.91	1.03	1.95
6.40	8.09	14.59	7.58	110.53	2.92	0.99	1.89
6.48	7.95	14.32	7.75	110.92	2.94	1.00	1.85
6.56	7.76	13.96	8.01	111.85	2.95	1.00	1.79
6.64	7.58	13.61	8.19	111.49	2.96	0.99	1.73
6.73	7.45	13.35	8.23	109.87	2.97	0.93	1.69
6.81	7.38	13.21	8.08	106.77	2.96	0.89	1.66
6.89	7.25	12.97	7.98	103.45	2.95	0.81	1.62
6.97	7.03	12.54	7.94	99.57	2.95	0.75	1.56
7.05	6.70	11.92	8.03	95.66	2.95	0.67	1.47
7.14	6.37	11.27	8.14	91.78	2.96	0.59	1.39
7.22	6.13	10.82	8.09	87.53	2.96	0.54	1.32
7.30	6.02	10.60	7.84	83.09	2.94	0.47	1.29
7.38	6.00	10.56	7.41	78.28	2.91	0.41	1.28
7.46	5.98	10.51	7.04	74.02	2.89	0.36	1.27
7.55	5.85	10.26	7.03	72.14	2.89	0.32	1.23
7.63	5.77	10.09	7.15	72.09	2.90	0.34	1.21
7.71	5.86	10.25	7.57	77.60	2.92	0.35	1.22
7.79	6.25	10.98	7.57	83.12	2.92	0.50	1.30
7.87	7.36	13.08	6.50	84.99	2.85	0.55	1.54

:: Strength loss calculation (Robertson (2009)) :: (continued)							
Depth (ft)	q _t (tsf)	Q _{tn}	K _c	Q _{tn,cs}	I _c	S _{u(liq)} /σ' _v	S _{u(peak)} /σ' _v
7.96	8.40	15.04	5.46	82.07	2.77	0.53	1.76
8.04	9.32	16.77	4.61	77.38	2.69	0.50	1.96
8.12	9.53	17.15	4.29	73.53	2.66	0.48	1.99
8.20	9.80	17.65	4.07	71.82	2.64	0.41	2.04
8.28	10.00	18.03	4.14	74.58	2.64	0.46	2.07
8.37	10.09	18.19	4.25	77.33	2.65	0.59	2.08
8.45	9.96	17.94	4.46	79.92	2.68	0.51	2.04
8.53	9.46	16.98	4.68	79.40	2.70	0.53	1.92
8.61	8.57	15.29	5.39	82.41	2.76	0.50	1.72
8.69	7.60	13.46	6.38	85.81	2.84	0.51	1.51
8.78	6.90	12.12	7.33	88.85	2.91	0.54	1.35
8.86	6.67	11.67	7.72	90.07	2.93	0.53	1.30
8.94	6.77	11.87	7.38	87.58	2.91	0.52	1.31
9.02	7.18	12.62	6.67	84.11	2.86	0.45	1.39
9.10	7.65	13.51	5.99	80.97	2.81	0.44	1.48
9.19	7.84	13.85	5.81	80.50	2.80	0.46	1.51
9.27	9.74	17.45	4.30	75.05	2.66	0.45	1.89
9.35	13.92	25.33	2.61	66.21	2.44	0.19	0.67
9.43	18.48	33.95	1.93	65.49	2.30	0.18	0.67
9.51	20.50	37.76	1.74	65.69	2.25	0.18	0.67
9.60	19.68	36.19	1.81	65.52	2.27	0.18	0.67
9.68	19.29	35.45	1.74	61.60	2.24	0.13	0.66
9.76	22.02	40.60	1.50	61.00	2.15	0.12	0.66
9.84	25.07	46.35	1.38	63.88	2.07	0.15	0.67
9.92	26.87	49.51	1.34	66.30	2.03	0.19	0.67
10.01	26.11	48.31	1.37	66.40	2.07	0.19	0.67
10.09	26.10	48.28	1.37	66.30	2.07	0.19	0.67
10.17	27.20	49.54	1.33	65.98	2.03	0.18	0.67
10.25	28.73	51.03	1.00	51.03	1.97	0.06	0.63
10.33	30.12	52.21	1.00	52.21	1.92	0.06	0.63
10.42	31.35	53.56	1.00	53.56	1.88	0.07	0.64
10.50	30.99	53.35	1.00	53.35	1.91	0.07	0.64
10.58	28.29	50.35	1.31	65.93	2.00	0.18	0.67
10.66	23.30	42.93	1.52	65.29	2.16	0.17	0.67
10.74	19.00	34.80	1.98	68.77	2.31	0.23	0.68
10.83	15.89	28.92	2.52	73.00	2.43	0.33	0.69
10.91	13.52	24.42	3.13	76.50	2.52	0.55	0.71
10.99	11.03	19.71	4.03	79.39	2.63	0.50	1.94
11.07	8.76	15.40	5.16	79.42	2.74	0.44	1.51
11.15	7.84	13.67	5.65	77.22	2.78	0.32	1.33
11.24	7.69	13.38	5.46	73.09	2.77	0.35	1.30
11.32	11.15	19.91	3.14	62.58	2.52	0.17	0.67
11.40	16.09	29.23	1.91	55.77	2.30	0.08	0.64
11.48	19.69	35.99	1.58	56.82	2.19	0.09	0.65
11.56	18.83	34.40	1.71	58.72	2.23	0.10	0.65
11.65	15.13	27.40	2.28	62.38	2.38	0.14	0.66
11.73	12.16	21.78	3.41	74.20	2.56	0.73	0.73
11.81	10.58	18.78	4.75	89.14	2.70	0.57	1.77

:: Strength loss calculation (Robertson (2009)) :: (continued)							
Depth (ft)	q _t (tsf)	Q _{tn}	K _c	Q _{tn,cs}	I _c	S _{u(liq)} /σ' _v	S _{u(peak)} /σ' _v
11.89	10.91	19.39	5.03	97.61	2.73	0.72	1.82
11.98	15.31	27.71	3.23	89.48	2.54	0.74	0.74
12.06	26.28	47.81	1.64	78.43	2.21	0.51	0.70
12.14	40.56	68.77	1.31	90.03	2.00	0.73	0.73
12.22	57.82	92.55	1.19	110.20	1.84	0.77	0.77
12.30	77.84	118.35	1.00	118.35	1.69	0.78	0.78
12.39	104.35	149.74	1.00	149.74	1.53	0.83	0.83
12.47	132.35	181.77	1.00	181.77	1.41	0.87	0.87
12.55	158.12	210.60	1.00	210.60	1.33	0.90	0.90
12.63	176.22	230.94	1.00	230.94	1.29	0.92	0.92
12.71	189.71	246.14	1.00	246.14	1.26	0.93	0.93
12.80	199.34	259.68	1.00	259.68	1.28	0.94	0.94
12.88	206.91	271.38	1.00	271.38	1.31	0.95	0.95
12.96	211.03	275.83	1.00	275.83	1.30	0.96	0.96
13.04	211.78	272.35	1.00	272.35	1.26	0.96	0.96
13.12	212.72	266.85	1.00	266.85	1.19	0.95	0.95
13.21	217.26	268.39	1.00	268.39	1.15	0.95	0.95
13.29	226.44	276.65	1.00	276.65	1.12	0.96	0.96
13.37	235.91	286.43	1.00	286.43	1.11	0.97	0.97
13.45	243.48	293.47	1.00	293.47	1.09	0.97	0.97
13.53	248.34	299.81	1.00	299.81	1.10	0.98	0.98
13.62	252.74	309.31	1.00	309.31	1.14	0.99	0.99
13.70	253.12	321.90	1.00	321.90	1.26	0.99	0.99
13.78	247.24	325.87	1.00	325.87	1.38	1.00	1.00
13.86	231.70	317.82	1.00	317.82	1.51	0.99	0.99
13.94	207.10	292.75	1.00	292.75	1.62	0.97	0.97
14.03	169.40	249.47	1.10	274.44	1.76	0.96	0.96
14.11	133.25	202.53	1.22	246.97	1.87	0.93	0.93
14.19	107.76	167.37	1.28	213.65	1.96	0.90	0.90
14.27	113.02	170.20	1.22	206.89	1.87	0.89	0.89
14.35	134.87	192.01	1.00	192.01	1.69	0.88	0.88
14.44	152.40	205.70	1.00	205.70	1.52	0.89	0.89
14.52	154.01	200.43	1.00	200.43	1.41	0.89	0.89
14.60	145.04	187.64	1.00	187.64	1.40	0.87	0.87
14.68	138.42	181.01	1.00	181.01	1.44	0.87	0.87
14.76	136.42	180.97	1.00	180.97	1.50	0.87	0.87
14.85	139.09	185.57	1.00	185.57	1.52	0.87	0.87
14.93	146.28	194.92	1.00	194.92	1.52	0.88	0.88
15.01	151.51	201.63	1.00	201.63	1.53	0.89	0.89
15.09	154.90	205.98	1.00	205.98	1.53	0.89	0.89
15.17	158.90	210.75	1.00	210.75	1.53	0.90	0.90
15.26	165.61	218.14	1.00	218.14	1.51	0.91	0.91
15.34	172.15	225.38	1.00	225.38	1.50	0.91	0.91
15.42	176.55	230.23	1.00	230.23	1.49	0.92	0.92
15.50	178.28	232.11	1.00	232.11	1.49	0.92	0.92
15.58	178.94	232.44	1.00	232.44	1.49	0.92	0.92
15.67	180.15	233.13	1.00	233.13	1.49	0.92	0.92
15.75	181.86	234.32	1.00	234.32	1.48	0.92	0.92

:: Strength loss calculation (Robertson (2009)) :: (continued)							
Depth (ft)	q _t (tsf)	Q _{tn}	K _c	Q _{tn,cs}	I _c	S _{u(liq)} /σ' _v	S _{u(peak)} /σ' _v
15.83	181.88	233.90	1.00	233.90	1.48	0.92	0.92
15.91	178.36	230.04	1.00	230.04	1.50	0.92	0.92
15.99	168.69	219.56	1.00	219.56	1.54	0.91	0.91
16.08	156.27	205.80	1.00	205.80	1.59	0.89	0.89
16.16	139.00	186.15	1.00	186.15	1.67	0.87	0.87
16.24	118.03	161.93	1.12	180.90	1.77	0.87	0.87
16.32	94.22	133.49	1.24	166.16	1.91	0.85	0.85
16.40	71.81	105.50	1.38	145.88	2.07	0.82	0.82
16.49	52.67	80.20	1.73	138.63	2.24	0.81	0.81
16.57	36.45	57.55	2.52	144.95	2.43	0.82	0.82
16.65	23.92	39.06	3.99	156.01	2.63	1.74	3.03
16.73	16.15	26.87	5.73	154.07	2.79	1.39	2.00
16.81	11.96	19.90	7.11	141.55	2.89	0.92	1.44
16.90	10.32	16.85	7.07	119.17	2.89	0.68	1.22
16.98	12.25	19.32	4.72	91.29	2.70	0.46	1.47
17.06	16.59	25.20	2.82	70.95	2.48	0.28	0.69
17.14	18.98	28.54	2.45	69.97	2.41	0.25	0.68
17.22	17.60	26.79	2.93	78.43	2.49	0.51	0.70
17.31	14.15	21.95	4.12	90.53	2.64	0.50	1.69
17.39	14.50	22.48	4.17	93.78	2.65	0.52	1.73
17.47	19.23	29.33	3.12	91.41	2.52	0.74	0.74
17.55	23.40	35.35	2.67	94.34	2.45	0.74	0.74
17.63	23.75	35.89	2.75	98.79	2.47	0.75	0.75
17.72	22.22	33.75	3.06	103.16	2.51	0.75	0.75
17.80	29.12	42.79	2.08	88.85	2.34	0.73	0.73
17.88	42.89	60.05	1.41	84.86	2.10	0.72	0.72
17.96	50.13	68.35	1.29	88.20	1.98	0.72	0.72
18.04	47.13	64.50	1.32	84.91	2.01	0.72	0.72
18.13	36.19	50.96	1.55	79.00	2.17	0.54	0.70
18.21	27.67	40.10	2.12	85.19	2.35	0.72	0.72
18.29	19.78	29.45	3.32	97.80	2.55	0.77	0.77
18.37	14.08	21.35	5.10	108.95	2.74	0.71	1.60
18.45	10.94	16.63	6.71	111.66	2.87	0.61	1.21
18.54	10.04	15.07	6.75	101.71	2.87	0.51	1.10
18.62	13.83	20.15	3.85	77.55	2.61	0.35	1.55
18.70	20.93	29.46	2.10	61.88	2.34	0.13	0.66
18.78	25.78	35.77	1.74	62.39	2.25	0.14	0.66
18.86	25.34	35.48	1.93	68.58	2.30	0.23	0.68
18.95	20.37	29.23	2.81	82.11	2.47	0.70	0.71
19.03	16.11	23.55	4.11	96.91	2.64	0.67	1.80
19.11	12.42	18.38	5.99	110.05	2.81	0.63	1.35
19.19	10.05	14.81	7.38	109.29	2.91	0.59	1.07
19.27	8.33	12.01	8.49	101.96	2.98	0.43	0.86
19.36	7.06	9.87	9.09	89.70	3.02	0.30	0.71
19.44	6.22	8.45	9.25	78.16	3.03	0.22	0.60
19.52	5.89	7.89	8.56	67.52	2.99	0.15	0.56
19.60	5.89	7.83	7.59	59.42	2.93	0.10	0.56
19.69	6.00	7.91	6.86	54.32	2.88	0.09	0.57

:: Strength loss calculation (Robertson (2009)) :: (continued)							
Depth (ft)	q _t (tsf)	Q _{tn}	K _c	Q _{tn,cs}	I _c	S _{u(liq)} /σ' _v	S _{u(peak)} /σ' _v
19.77	6.14	8.07	6.48	52.28	2.85	0.08	0.59
19.85	6.42	8.44	6.07	51.22	2.82	0.08	0.62
19.93	6.77	8.93	5.70	50.91	2.79	0.09	0.66
20.01	7.30	9.64	5.17	49.84	2.74	0.09	0.72
20.10	7.63	10.06	4.79	48.23	2.71	0.08	0.75
20.18	7.87	10.38	4.68	48.59	2.70	0.08	0.78
20.26	8.23	10.89	4.60	50.08	2.69	0.10	0.82
20.34	8.71	11.58	4.53	52.51	2.68	0.11	0.87
20.42	9.25	12.38	4.58	56.67	2.69	0.13	0.93
20.51	9.85	13.31	4.73	62.99	2.70	0.18	1.00
20.59	10.66	14.48	4.69	67.91	2.70	0.24	1.09
20.67	10.77	14.66	4.83	70.77	2.71	0.25	1.10
20.75	10.68	14.48	4.85	70.21	2.71	0.25	1.08
20.83	10.86	14.78	5.07	74.85	2.73	0.23	1.10
20.92	14.47	19.78	3.96	78.32	2.62	0.36	1.50
21.00	17.66	24.14	3.42	82.49	2.56	0.75	0.75
21.08	18.59	25.40	3.36	85.35	2.55	0.75	0.75
21.16	15.57	21.37	4.27	91.36	2.66	0.50	1.61
21.24	12.02	16.56	6.09	100.90	2.82	0.50	1.21
21.33	9.91	13.59	7.88	107.07	2.94	0.52	0.97
21.41	9.14	12.35	8.59	106.13	2.99	0.50	0.88
21.49	10.84	14.76	6.81	100.56	2.87	0.42	1.07
21.57	25.63	33.94	2.24	75.96	2.37	0.42	0.70
21.65	52.86	66.56	1.29	86.02	1.98	0.72	0.72
21.74	80.92	97.97	1.00	97.97	1.74	0.74	0.74
21.82	95.46	113.49	1.00	113.49	1.64	0.77	0.77
21.90	88.44	106.57	1.04	110.41	1.72	0.77	0.77
21.98	71.18	88.55	1.26	111.22	1.93	0.77	0.77
22.06	49.69	64.18	1.60	102.39	2.19	0.75	0.75
22.15	34.10	45.20	2.47	111.79	2.42	0.77	0.77
22.23	23.47	31.54	3.82	120.34	2.61	1.03	2.39
22.31	16.70	22.51	5.51	124.16	2.77	0.83	1.65
22.39	12.34	16.48	7.23	119.14	2.90	0.72	1.18
22.47	10.58	13.85	7.37	102.13	2.91	0.47	0.99
22.56	9.76	12.41	6.15	76.25	2.82	0.22	0.90
22.64	9.38	11.55	4.55	52.57	2.68	0.08	0.86
22.72	9.18	11.04	3.57	39.38	2.58	0.06	0.63
22.80	9.85	11.80	3.01	35.53	2.50	0.02	0.62
22.88	11.26	13.54	2.54	34.40	2.43	0.02	0.62
22.97	12.37	14.90	2.30	34.31	2.39	0.02	0.62
23.05	12.58	15.14	2.27	34.40	2.38	0.02	0.62
23.13	11.80	14.15	2.43	34.45	2.41	0.02	0.62
23.21	11.56	13.84	2.52	34.94	2.43	0.02	0.62
23.29	12.74	15.38	2.46	37.85	2.42	0.02	0.62
23.38	14.61	17.88	2.51	44.90	2.43	0.04	0.62
23.46	15.74	19.54	2.86	55.91	2.48	0.08	0.64
23.54	15.23	19.28	4.09	78.83	2.64	0.30	1.45
23.62	15.41	19.75	4.90	96.83	2.72	0.61	1.46

:: Strength loss calculation (Robertson (2009)) :: (continued)							
Depth (ft)	q _t (tsf)	Q _{tn}	K _c	Q _{tn,cs}	I _c	S _{u(liq)} /σ' _v	S _{u(peak)} /σ' _v
23.70	24.73	31.55	2.98	94.02	2.50	0.73	0.73
23.79	59.20	71.97	1.32	95.18	2.02	0.74	0.74
23.87	121.18	141.55	1.00	142.08	1.71	0.82	0.82
23.95	192.00	218.40	1.00	218.40	1.53	0.91	0.91
24.03	251.64	282.57	1.00	282.57	1.44	0.96	0.96
24.11	286.52	318.49	1.00	318.49	1.38	0.99	0.99
24.20	303.76	337.21	1.00	337.21	1.38	1.01	1.01
24.28	311.89	347.84	1.00	347.84	1.42	1.01	1.01
24.36	320.49	359.02	1.00	359.02	1.46	1.02	1.02
24.44	329.89	369.78	1.00	369.78	1.48	1.03	1.03
24.52	336.50	375.34	1.00	375.34	1.46	1.03	1.03
24.61	342.35	378.18	1.00	378.18	1.40	1.03	1.03
24.69	355.51	388.07	1.00	388.07	1.33	1.04	1.04
24.77	346.44	374.29	1.00	374.29	1.27	1.03	1.03
24.85	339.05	366.95	1.00	366.95	1.29	1.03	1.03
24.93	322.43	349.67	1.00	349.67	1.32	1.01	1.01
25.02	326.72	353.24	1.00	353.24	1.30	1.02	1.02
25.10	324.65	347.34	1.00	347.34	1.24	1.01	1.01
25.18	322.15	341.54	1.00	341.54	1.18	1.01	1.01
25.26	319.28	336.01	1.00	336.01	1.13	1.00	1.00
25.34	322.46	338.95	1.00	338.95	1.13	1.01	1.01
25.43	328.27	344.64	1.00	344.64	1.13	1.01	1.01
25.51	333.69	350.00	1.00	350.00	1.13	1.01	1.01
25.59	334.37	350.16	1.00	350.16	1.13	1.01	1.01
25.67	336.48	350.08	1.00	350.08	1.08	1.01	1.01
25.75	338.84	353.18	1.00	353.18	1.10	1.02	1.02
25.84	334.67	349.46	1.00	349.46	1.13	1.01	1.01
25.92	335.89	351.97	1.00	351.97	1.16	1.02	1.02
26.00	338.05	355.59	1.00	355.59	1.20	1.02	1.02
26.08	341.44	359.45	1.00	359.45	1.22	1.02	1.02
26.16	340.57	357.32	1.00	357.32	1.20	1.02	1.02
26.25	337.18	352.37	1.00	352.37	1.18	1.02	1.02
26.33	340.69	354.31	1.00	354.31	1.14	1.02	1.02
26.41	344.74	361.13	1.00	361.13	1.21	1.02	1.02
26.49	353.02	368.08	1.00	368.08	1.18	1.03	1.03
26.57	366.83	380.58	1.00	380.58	1.15	1.04	1.04
26.66	372.94	383.78	1.00	383.78	1.08	1.04	1.04
26.74	371.58	382.50	1.00	382.50	1.10	1.04	1.04
26.82	362.86	373.00	1.00	373.00	1.09	1.03	1.03
26.90	357.12	366.92	1.00	366.92	1.10	1.03	1.03
26.98	354.79	367.64	1.00	367.64	1.19	1.03	1.03
27.07	349.99	367.17	1.00	367.17	1.31	1.03	1.03
27.15	342.74	361.02	1.00	361.02	1.36	1.02	1.02
27.23	338.92	356.39	1.00	356.39	1.36	1.02	1.02
27.31	335.29	350.52	1.00	350.52	1.32	1.02	1.02
27.40	339.19	353.33	1.00	353.33	1.29	1.02	1.02
27.48	330.79	344.05	1.00	344.05	1.29	1.01	1.01
27.56	324.07	338.34	1.00	338.34	1.34	1.01	1.01

:: Strength loss calculation (Robertson (2009)) :: (continued)							
Depth (ft)	q _t (tsf)	Q _{tn}	K _c	Q _{tn,cs}	I _c	S _{u(liq)} /σ' _v	S _{u(peak)} /σ' _v
27.64	311.43	326.38	1.00	326.38	1.40	1.00	1.00
27.72	309.19	324.61	1.00	324.61	1.43	1.00	1.00
27.81	316.54	332.86	1.00	332.86	1.46	1.00	1.00
27.89	330.23	346.79	1.00	346.79	1.46	1.01	1.01
27.97	351.70	368.87	1.00	368.87	1.46	1.03	1.03
28.05	377.19	392.97	1.00	392.97	1.40	1.04	1.04
28.13	416.87	431.65	1.00	431.65	1.35	1.07	1.07
28.22	468.07	482.47	1.00	482.47	1.31	1.10	1.10
28.30	491.65	508.66	1.00	508.66	1.36	1.11	1.11
28.38	492.95	511.87	1.00	511.87	1.42	1.11	1.11
28.46	471.37	489.11	1.00	489.11	1.43	1.10	1.10
28.54	467.38	482.21	1.00	482.21	1.38	1.10	1.10
28.63	453.68	465.30	1.00	465.30	1.33	1.09	1.09
28.71	440.31	452.52	1.00	452.52	1.37	1.08	1.08
28.79	419.18	431.15	1.00	431.15	1.40	1.07	1.07
28.87	409.28	419.28	1.00	419.28	1.37	1.06	1.06
28.95	408.93	416.12	1.00	416.12	1.30	1.06	1.06
29.04	400.44	403.87	1.00	403.87	1.20	1.05	1.05
29.12	406.90	409.53	1.00	409.53	1.19	1.05	1.05
29.20	388.43	391.58	1.00	391.58	1.22	1.04	1.04
29.28	366.12	371.25	1.00	371.25	1.32	1.03	1.03
29.36	315.81	323.87	1.00	323.87	1.51	1.00	1.00
29.45	294.56	302.13	1.00	302.13	1.54	0.98	0.98
29.53	278.70	286.09	1.00	286.09	1.58	0.97	0.97
29.61	295.81	301.25	1.00	301.25	1.48	0.98	0.98
29.69	300.94	307.40	1.00	307.40	1.55	0.98	0.98
29.77	309.55	316.87	1.00	316.87	1.60	0.99	0.99
29.86	296.92	305.28	1.00	305.28	1.70	0.98	0.98
29.94	261.05	269.20	1.14	306.85	1.79	0.98	0.98
30.02	217.14	224.52	1.23	275.52	1.89	0.96	0.96
30.10	174.84	181.16	1.30	234.85	1.99	0.92	0.92
30.18	139.27	144.63	1.42	205.72	2.10	0.89	0.89
30.27	117.43	121.78	1.52	184.82	2.16	0.87	0.87
30.35	110.66	114.48	1.54	176.63	2.17	0.86	0.86
30.43	141.61	145.07	1.28	185.93	1.97	0.87	0.87
30.51	190.02	192.54	1.07	205.83	1.74	0.89	0.89
30.59	214.01	214.87	1.00	214.87	1.58	0.90	0.90
30.68	224.77	224.59	1.00	224.59	1.50	0.91	0.91
30.76	221.23	221.12	1.00	221.12	1.54	0.91	0.91
30.84	230.20	229.82	1.00	229.82	1.54	0.92	0.92
30.92	234.19	232.87	1.00	232.87	1.48	0.92	0.92
31.00	237.11	234.30	1.00	234.30	1.37	0.92	0.92
31.09	236.75	233.82	1.00	233.82	1.38	0.92	0.92
31.17	237.58	234.67	1.00	234.67	1.41	0.92	0.92
31.25	240.72	237.99	1.00	237.99	1.46	0.92	0.92
31.33	248.62	245.03	1.00	245.03	1.41	0.93	0.93
31.41	237.02	233.53	1.00	233.53	1.44	0.92	0.92
31.50	226.70	223.40	1.00	223.40	1.48	0.91	0.91


:: Strength loss calculation (Robertson (2009)) :: (continued)

Depth (ft)	q_t (tsf)	Q_{tn}	K_c	$Q_{tn,cs}$	I_c	$S_{u(liq)}/\sigma'_v$	$S_{u(peak)}/\sigma'_v$
31.58	215.54	212.38	1.00	212.38	1.52	0.90	0.90
31.66	221.35	217.75	1.00	217.75	1.51	0.91	0.91
31.74	223.84	220.10	1.00	220.10	1.53	0.91	0.91
31.82	232.84	228.94	1.00	228.94	1.55	0.92	0.92
31.91	243.06	238.84	1.00	238.84	1.56	0.93	0.93
31.99	236.70	231.97	1.00	231.97	1.53	0.92	0.92
32.07	217.78	213.87	1.00	213.87	1.65	0.90	0.90
32.15	206.33	202.21	1.00	202.21	1.65	0.89	0.89
32.23	209.75	205.22	1.00	205.22	1.64	0.89	0.89
32.32	237.77	230.63	1.00	230.63	1.37	0.92	0.92
32.40	259.14	252.02	1.00	252.02	1.47	0.94	0.94
32.48	287.00	279.83	1.00	279.83	1.58	0.96	0.96
32.56	287.50	280.89	1.01	283.16	1.71	0.96	0.96
32.64	277.86	271.10	1.05	283.97	1.73	0.97	0.97
32.73	266.02	259.14	1.08	279.25	1.75	0.96	0.96
32.81	257.63	250.47	1.07	267.54	1.74	0.95	0.95
32.89	251.98	244.78	1.13	277.58	1.78	0.96	0.96
32.97	259.58	251.74	1.12	282.85	1.78	0.96	0.96
33.05	301.26	291.53	1.00	292.27	1.71	0.97	0.97
33.14	373.43	360.47	1.00	360.47	1.60	1.02	1.02
33.22	475.02	457.15	1.00	457.15	1.46	1.08	1.08
33.30	534.68	513.21	1.00	513.21	1.36	1.11	1.11
33.38	567.24	543.20	1.00	543.20	1.29	1.13	1.13
33.46	563.79	538.97	1.00	538.97	1.25	1.13	1.13
33.55	588.20	561.48	1.00	561.48	1.21	1.14	1.14
33.63	584.31	557.12	1.00	557.12	1.20	1.13	1.13
33.71	555.56	529.55	1.00	529.55	1.28	1.12	1.12
33.79	508.87	484.79	1.00	484.79	1.37	1.10	1.10
33.87	496.39	472.43	1.00	472.43	1.40	1.09	1.09
33.96	522.36	496.39	1.00	496.39	1.35	1.10	1.10
34.04	544.22	516.50	1.00	516.50	1.32	1.11	1.11
34.12	563.30	534.01	1.00	534.01	1.31	1.12	1.12
34.20	560.70	530.56	1.00	530.56	1.17	1.12	1.12
34.28	538.94	509.04	1.00	509.04	0.99	1.11	1.11
34.37	515.81	490.60	1.00	490.60	-1.00	1.10	1.10
34.45	530.29	503.93	1.00	503.93	-1.00	1.11	1.11
34.53	569.06	540.38	1.00	540.38	-1.00	1.13	1.13


Abbreviations

- q_t : Total cone resistance
- K_c : Cone resistance correction factor due to fines
- $Q_{tn,cs}$: Adjusted and corrected cone resistance due to fines
- I_c : Soil behavior type index
- $S_{u(liq)}/\sigma'_v$: Calculated liquefied undrained strength ratio
- $S_{u(peak)}/\sigma'_v$: Calculated peak undrained strength ratio

Aging Calculation Estimation

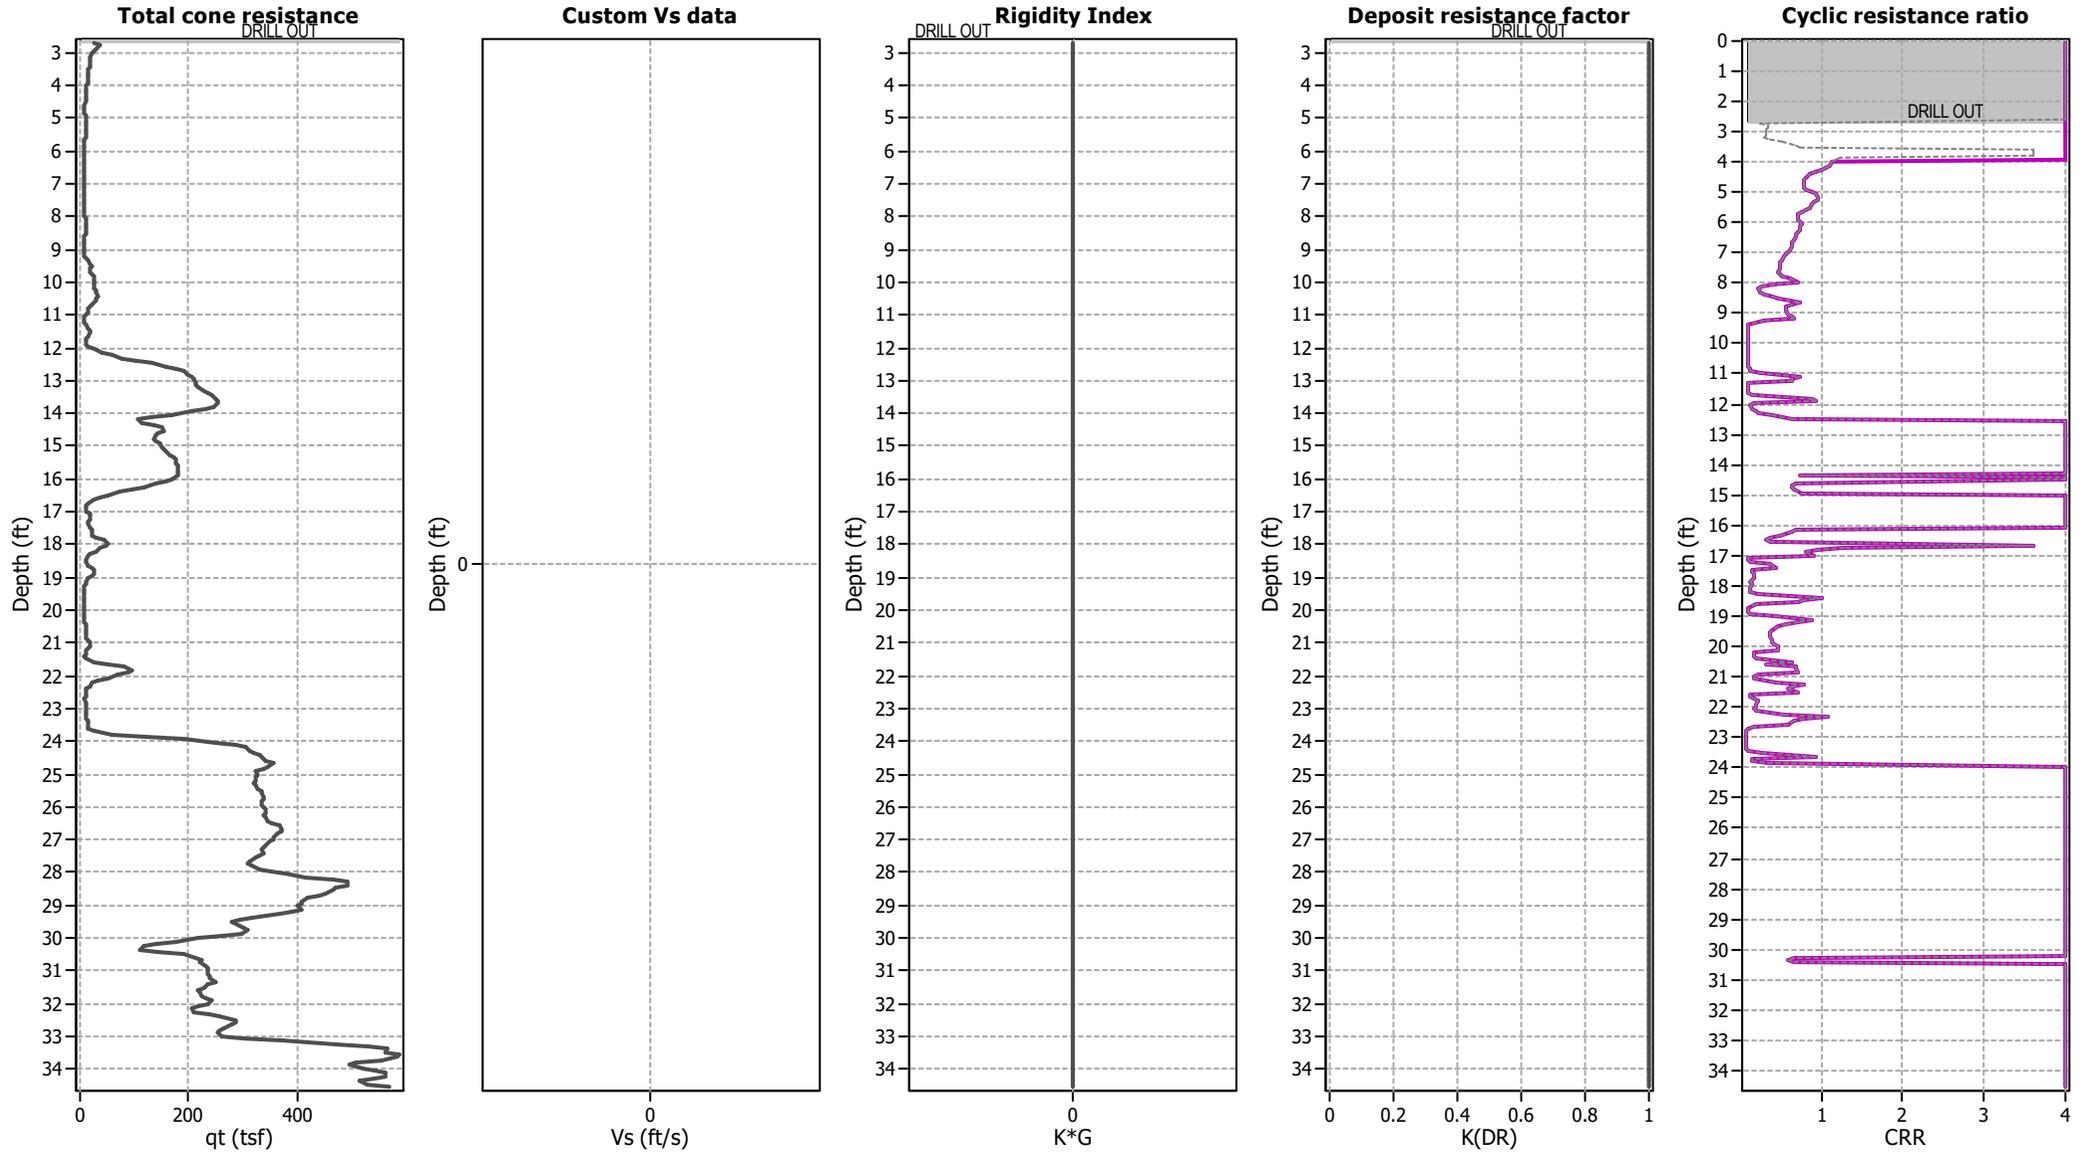


Ejecta Severity Estimation

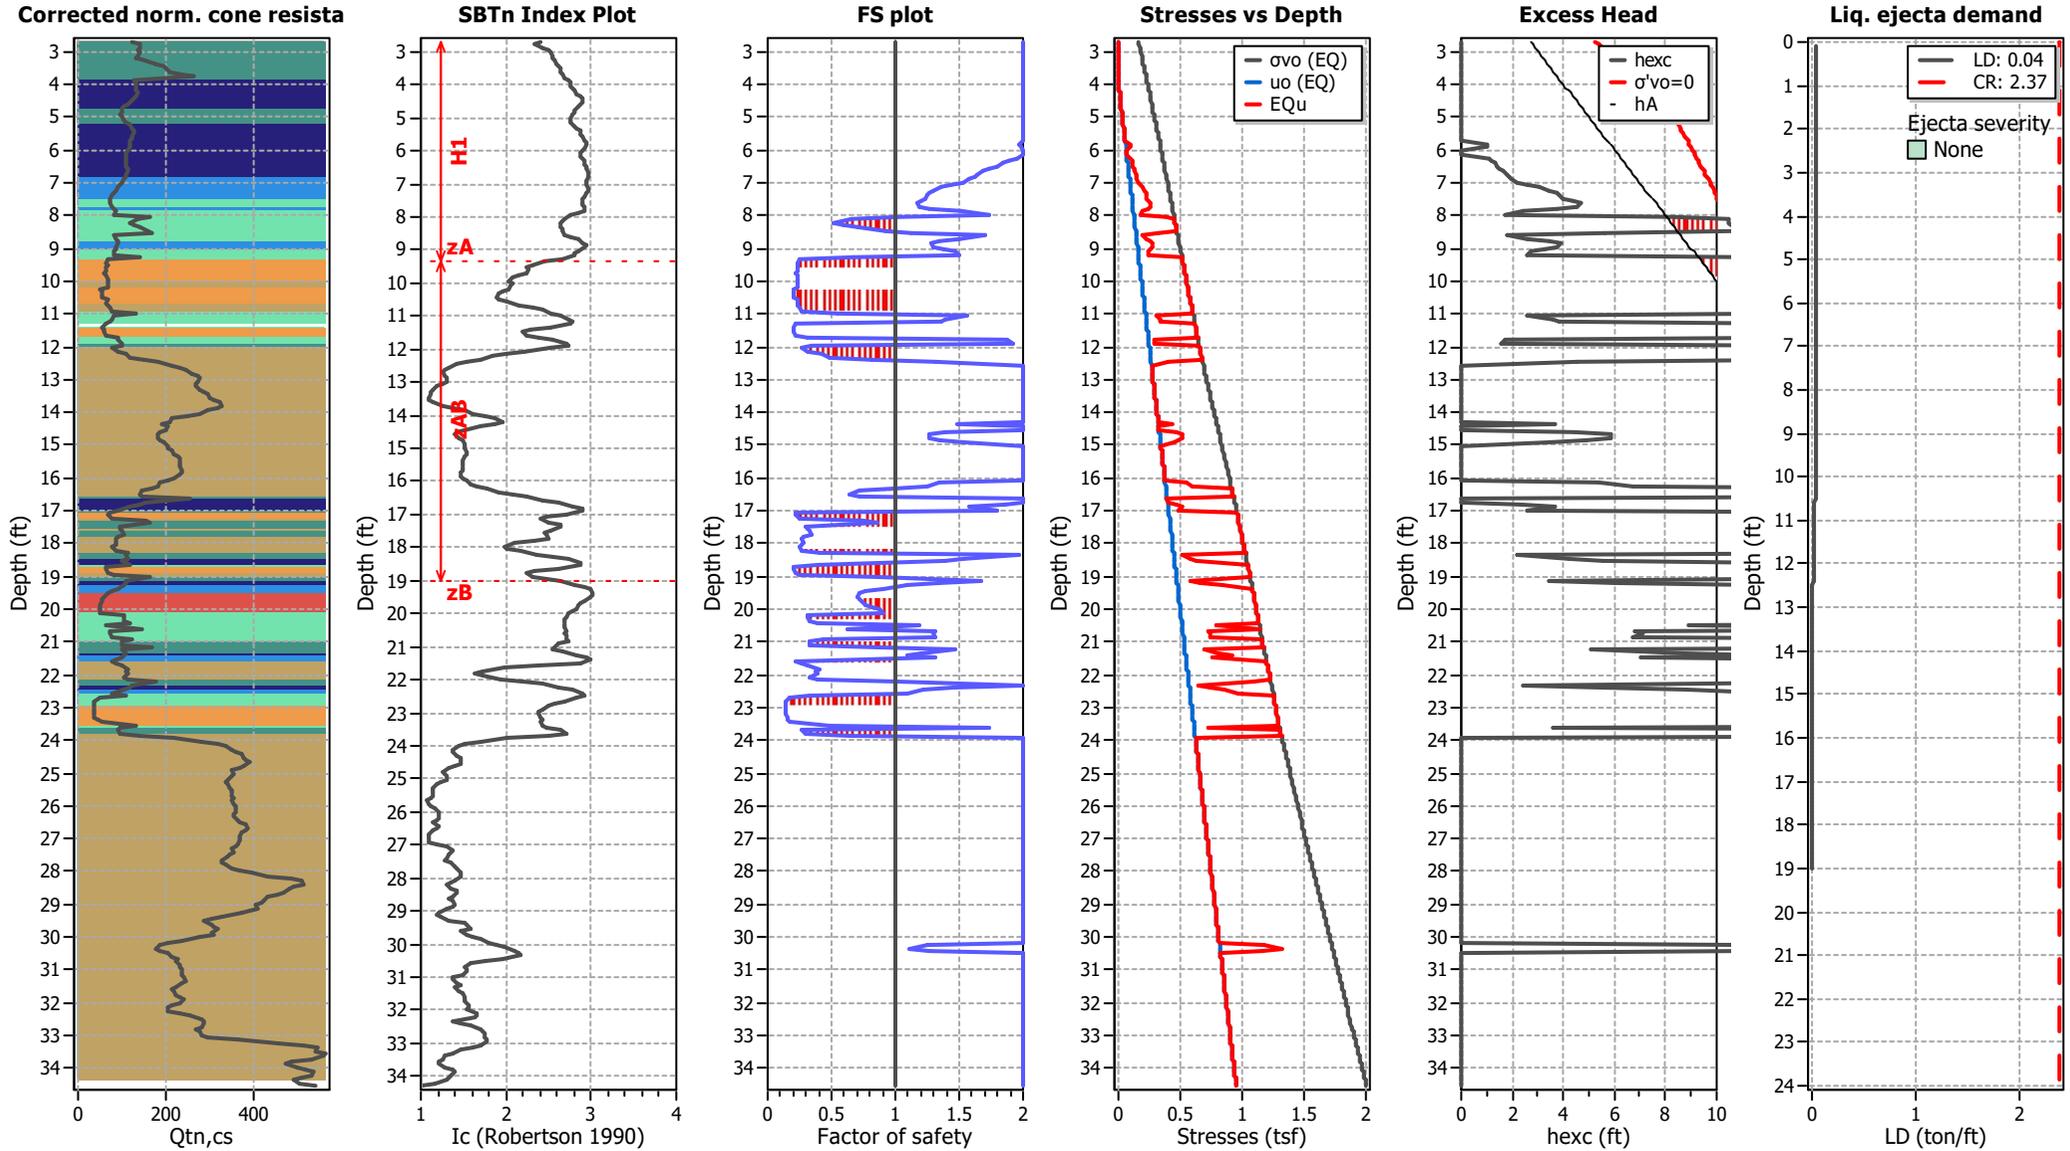

Procedure for the evaluation of soil liquefaction resistance, NCEER (1998)


Calculation of soil resistance against liquefaction is performed according to the Robertson & Wride (1998) procedure. The procedure used in the software, slightly differs from the one originally published in NCEER-97-0022 (Proceedings of the NCEER Workshop on Evaluation of Liquefaction Resistance of Soils). The revised procedure is presented below in the form of a flowchart¹:

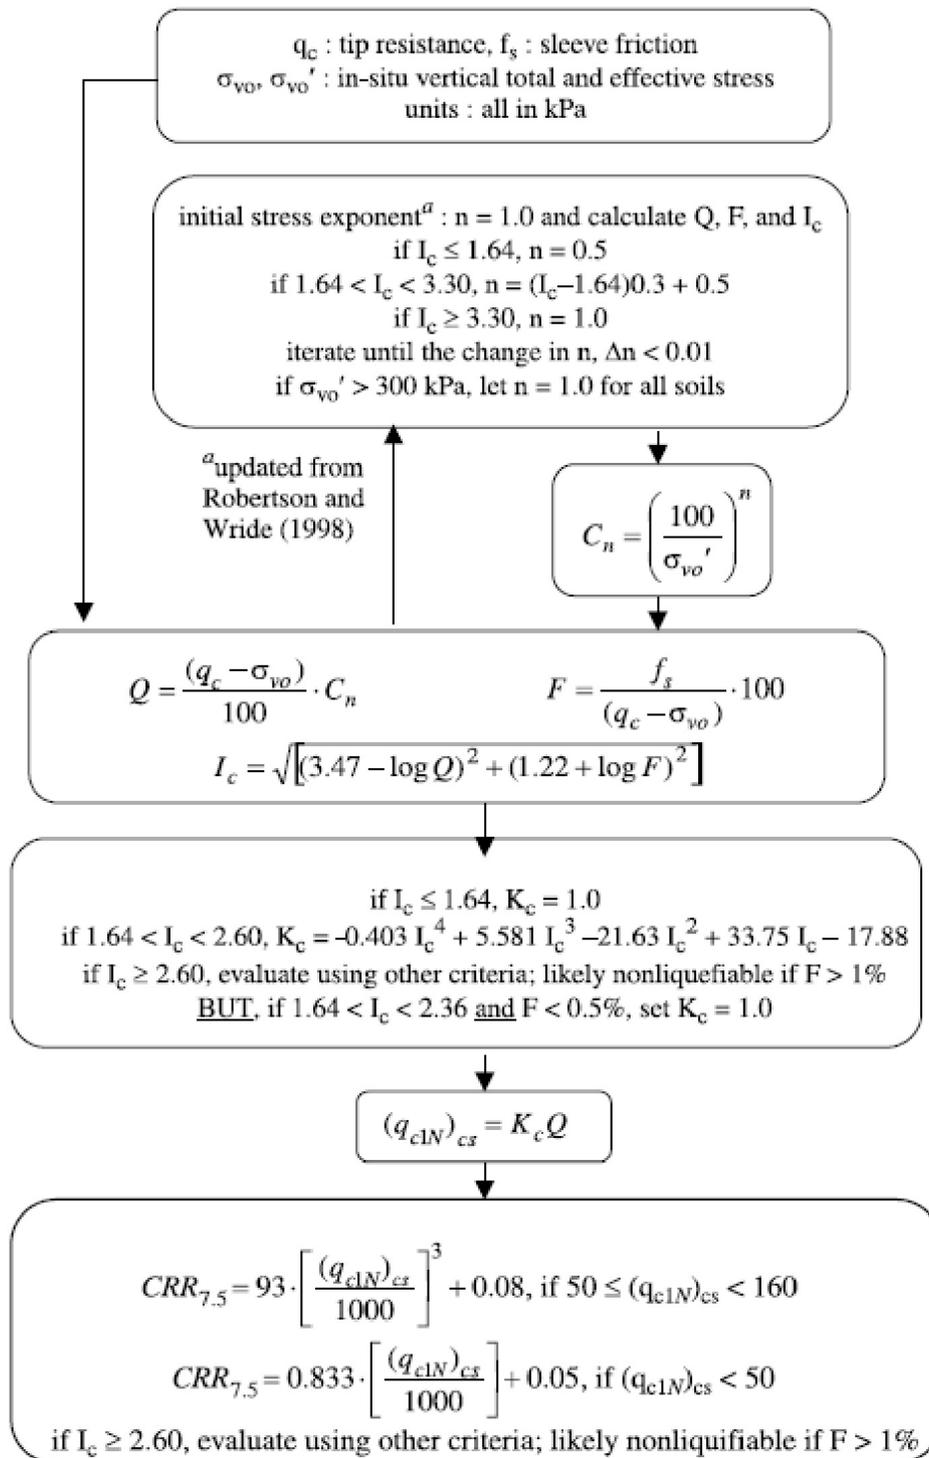

¹ "Estimating liquefaction-induced ground settlements from CPT for level ground", G. Zhang, P.K. Robertson, and R.W.I. Brachman


Procedure for the evaluation of soil liquefaction resistance (all soils), Robertson (2010)

Calculation of soil resistance against liquefaction is performed according to the Robertson & Wride (1998) procedure. This procedure used in the software, slightly differs from the one originally published in NCEER-97-0022 (Proceedings of the NCEER Workshop on Evaluation of Liquefaction Resistance of Soils). The revised procedure is presented below in the form of a flowchart¹:

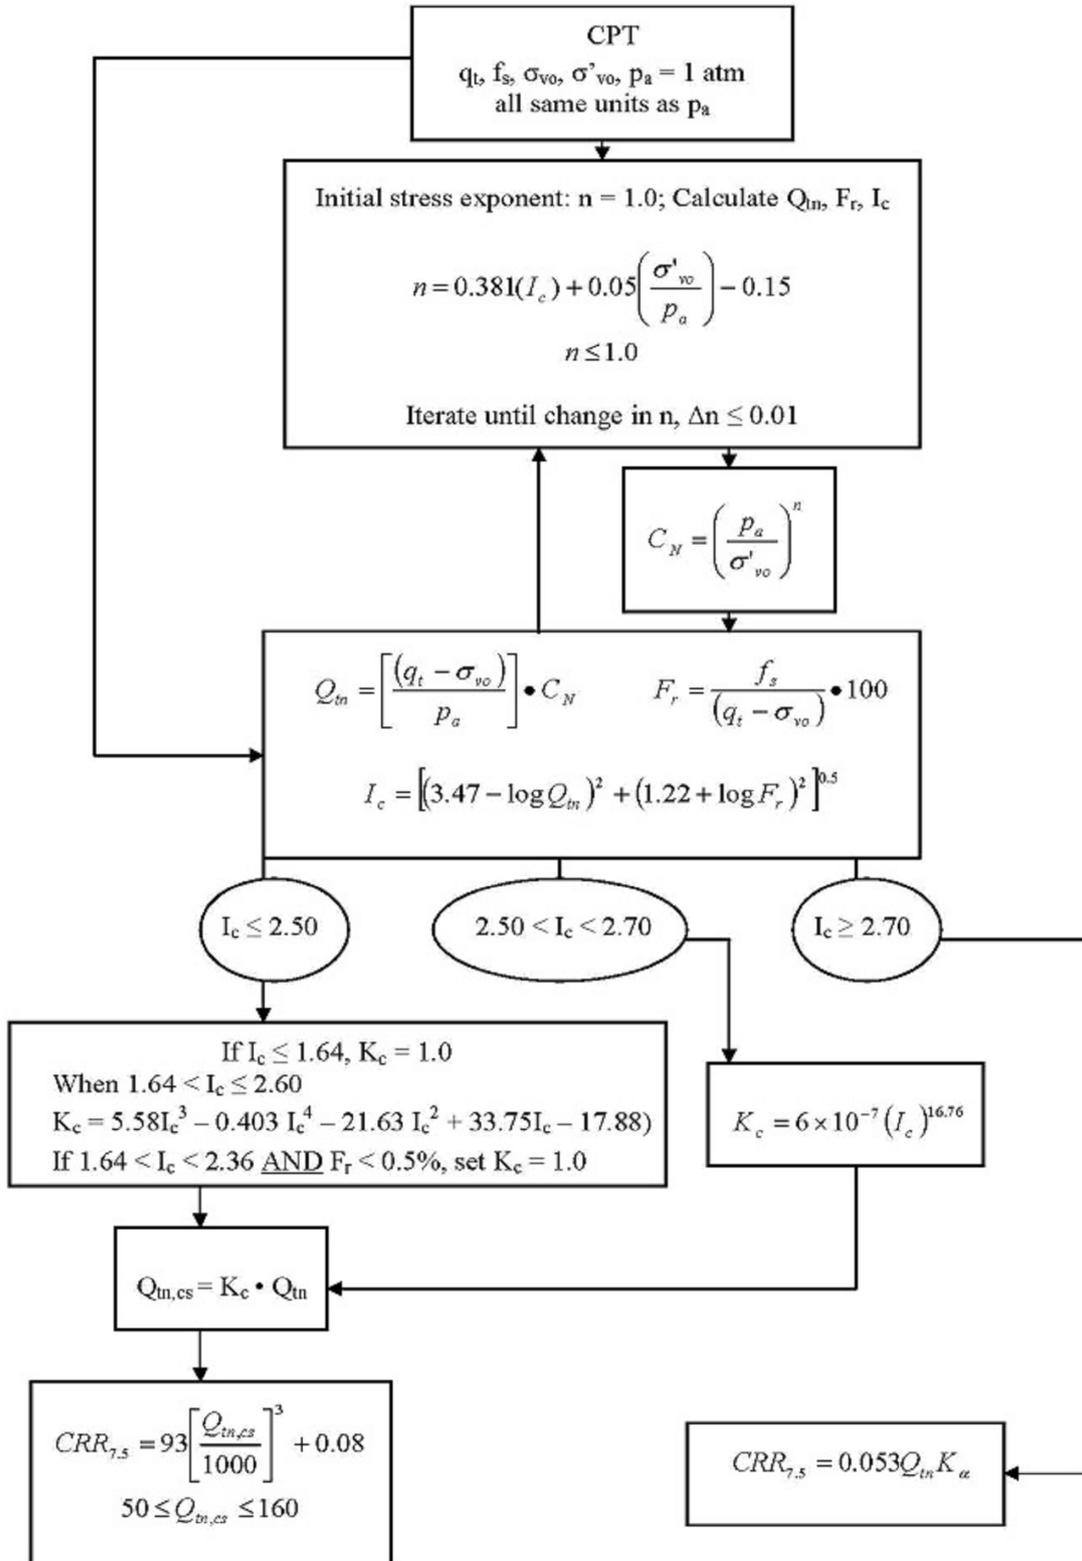


¹ P.K. Robertson, 2009. "Performance based earthquake design using the CPT", Keynote Lecture, International Conference on Performance-based Design in Earthquake Geotechnical Engineering – from case history to practice, IS-Tokyo, June 2009


Procedure for the evaluation of soil liquefaction resistance, Idriss & Boulanger (2008)

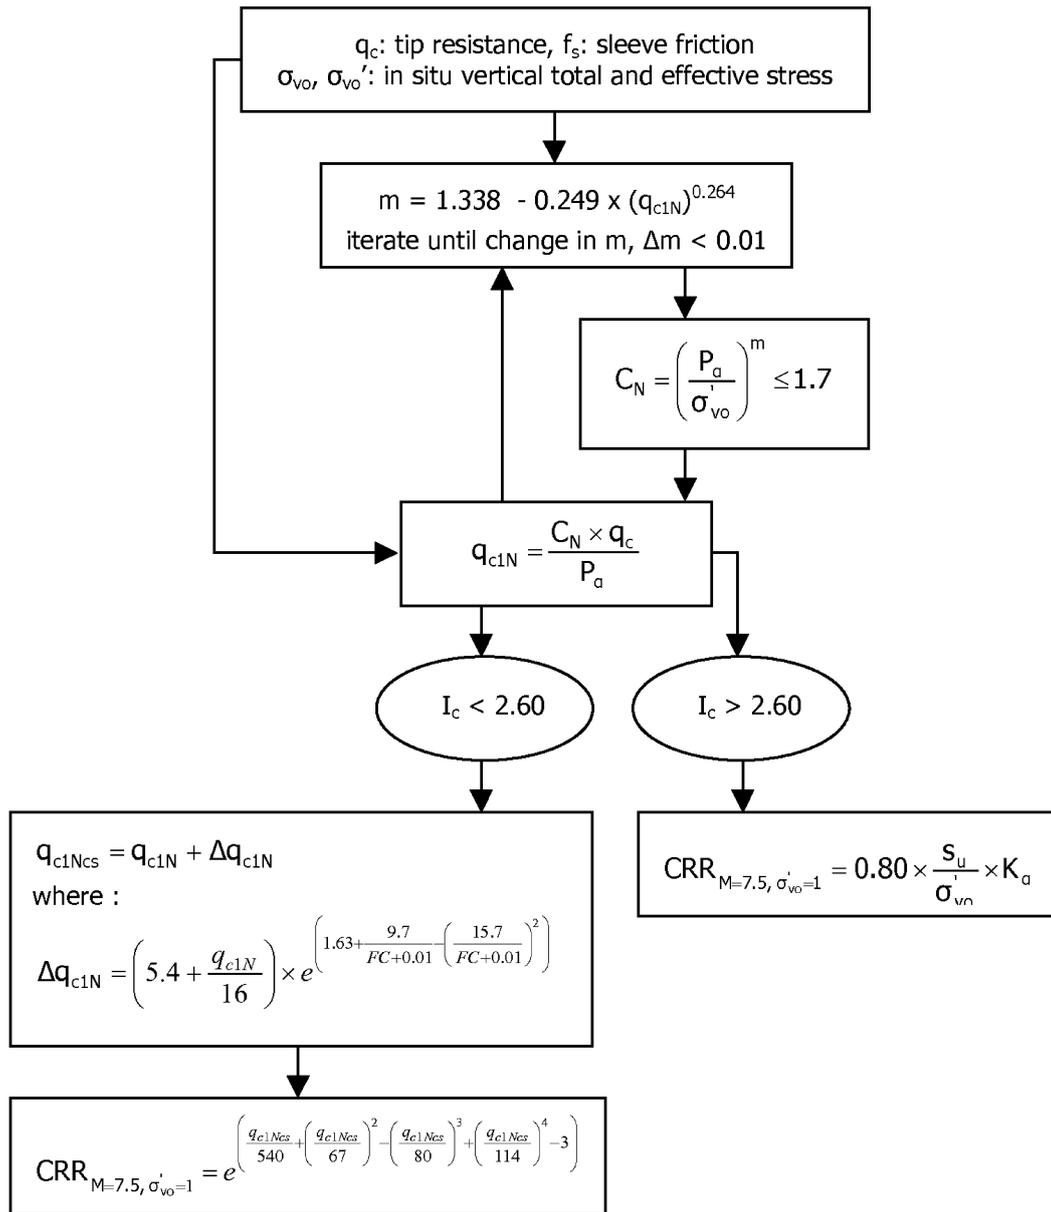


Procedure for the evaluation of soil liquefaction resistance (sandy soils), Moss et al. (2006)

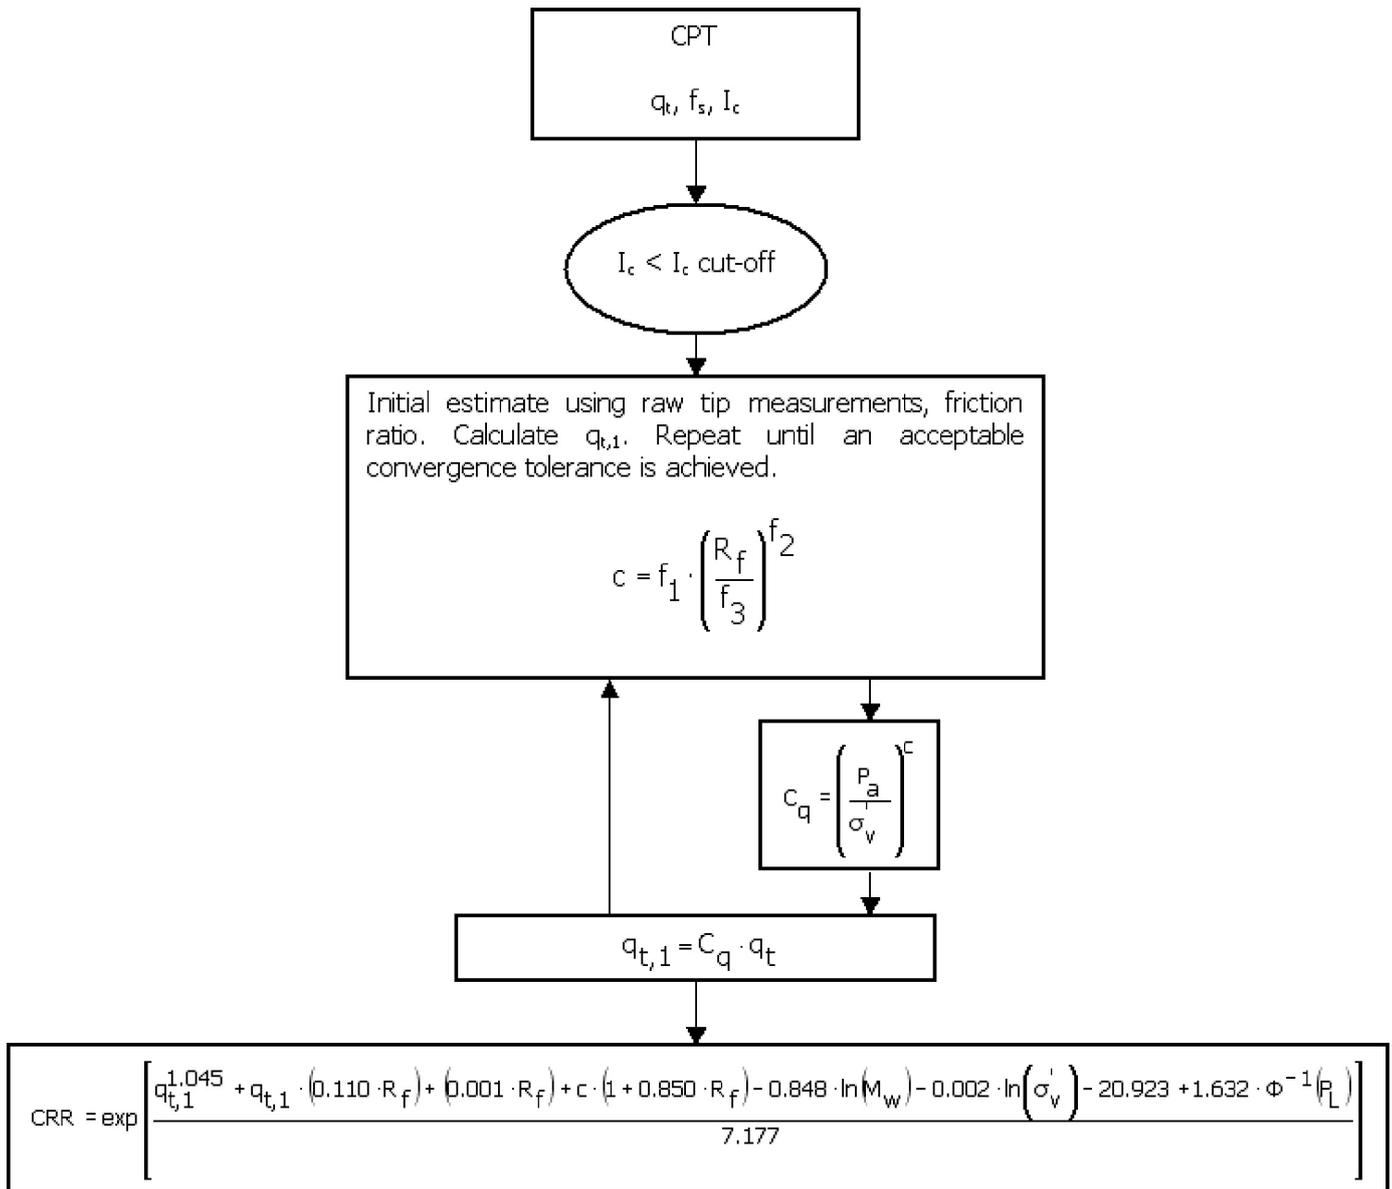


Procedure for the evaluation of soil liquefaction resistance, Boulanger & Idriss(2014)

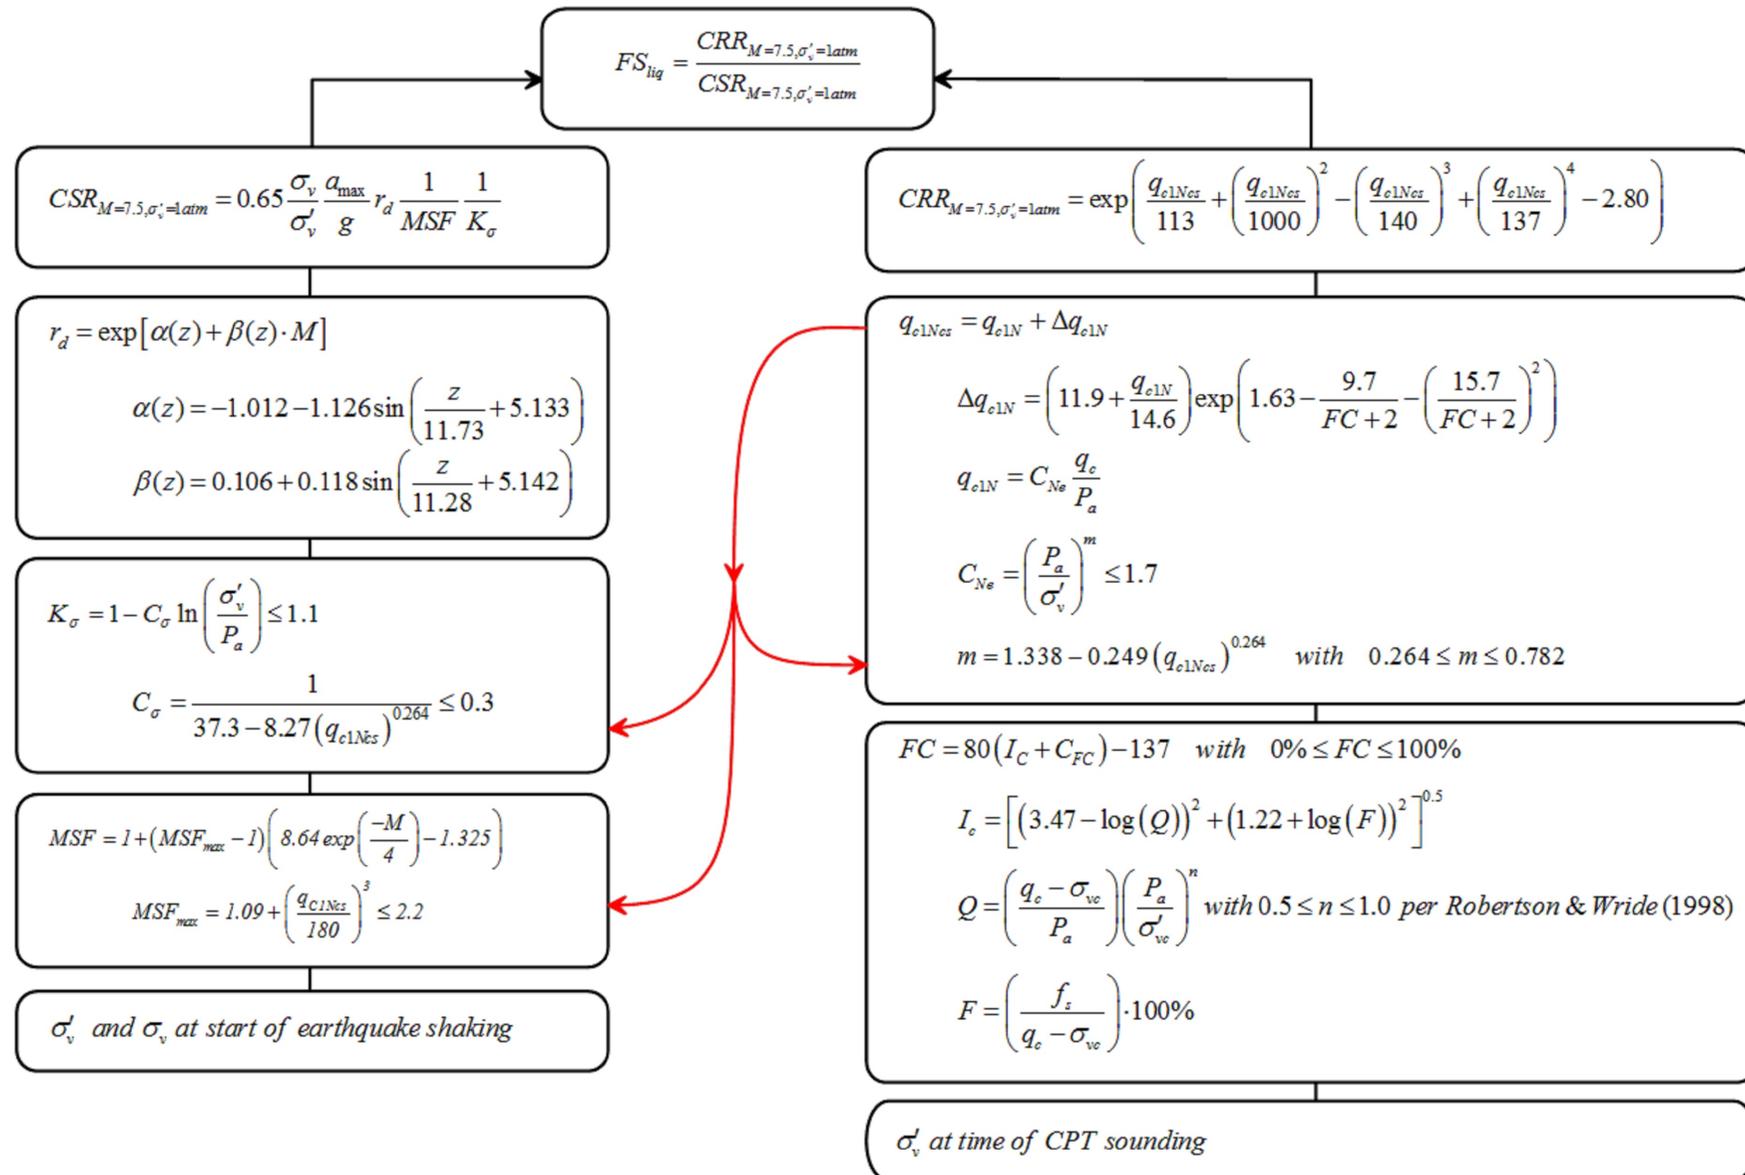

Procedure for the evaluation of liquefaction-induced lateral spreading displacements

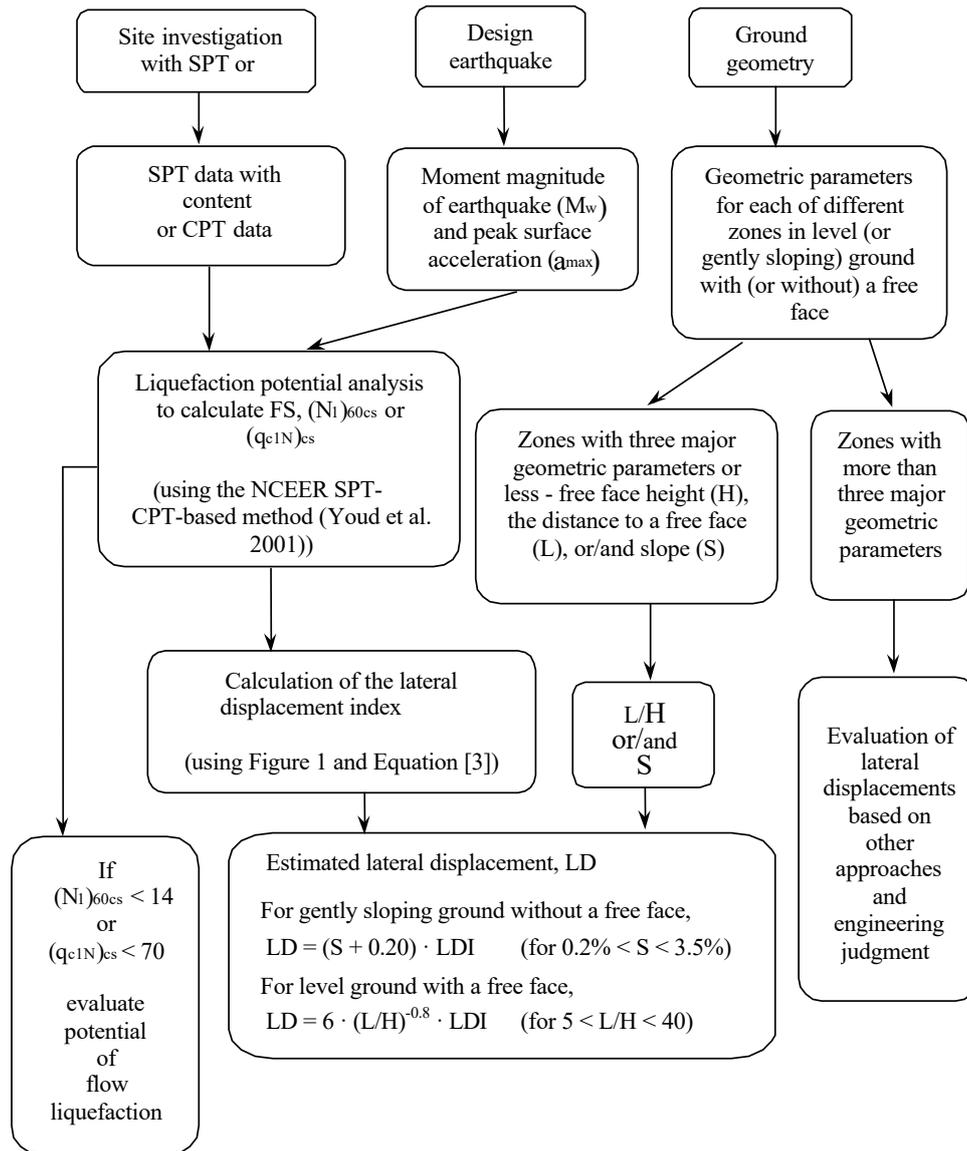

¹ Flow chart illustrating major steps in estimating liquefaction-induced lateral spreading displacements using the proposed approach

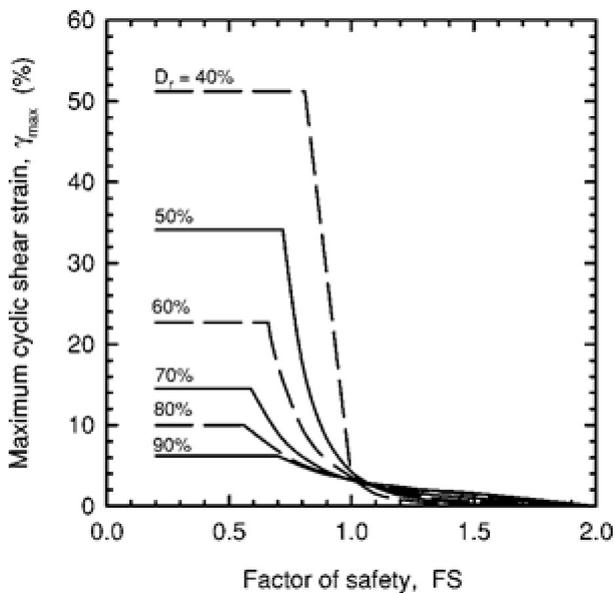


¹ Figure 1

$$LDI = \int_0^{Z_{max}} \gamma_{max} dz$$

¹ Equation [3]

¹ "Estimating liquefaction-induced ground settlements from CPT for level ground", G. Zhang, P.K. Robertson, and R.W.I. Brachman

Procedure for the estimation of seismic induced settlements in dry sands

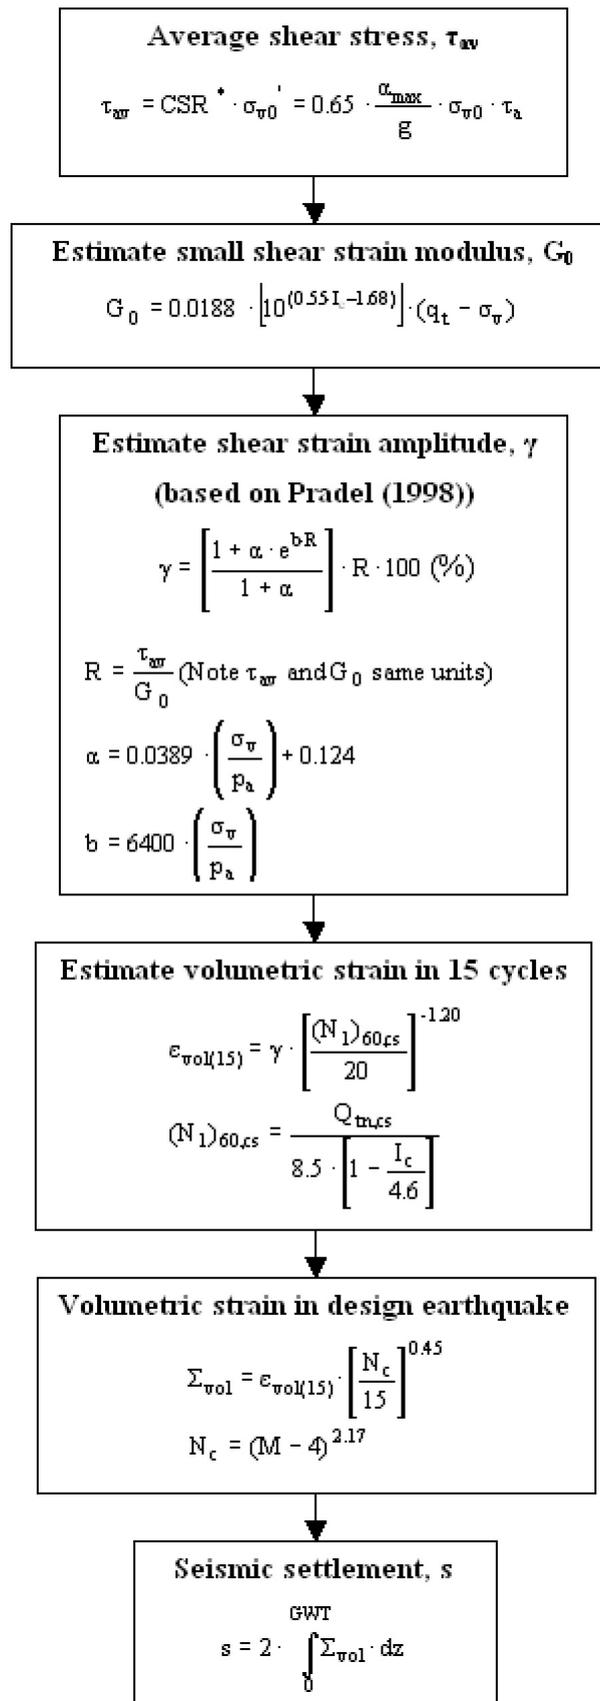

Robertson, P.K. and Lisheng, S., 2010, "Estimation of seismic compression in dry soils using the CPT" FIFTH INTERNATIONAL CONFERENCE ON RECENT ADVANCES IN GEOTECHNICAL EARTHQUAKE ENGINEERING AND SOIL DYNAMICS, Symposium in honor of professor I. M. Idriss, San Diego, CA

Liquefaction Potential Index (LPI) calculation procedure

Calculation of the Liquefaction Potential Index (LPI) is used to interpret the liquefaction assessment calculations in terms of severity over depth. The calculation procedure is based on the methodology developed by Iwasaki (1982) and is adopted by AFPS.

To estimate the severity of liquefaction extent at a given site, LPI is calculated based on the following equation:

$$\mathbf{LPI} = \int_0^{20} (10 - 0,5z) \times F_L \times dz$$

where:


$F_L = 1 - F.S.$ when F.S. less than 1

$F_L = 0$ when F.S. greater than 1

z depth of measurement in meters

Values of LPI range between zero (0) when no test point is characterized as liquefiable and 100 when all points are characterized as susceptible to liquefaction. Iwasaki proposed four (4) discrete categories based on the numeric value of LPI:

- LPI = 0 : Liquefaction risk is very low
- $0 < LPI \leq 5$: Liquefaction risk is low
- $5 < LPI \leq 15$: Liquefaction risk is high
- LPI > 15 : Liquefaction risk is very high

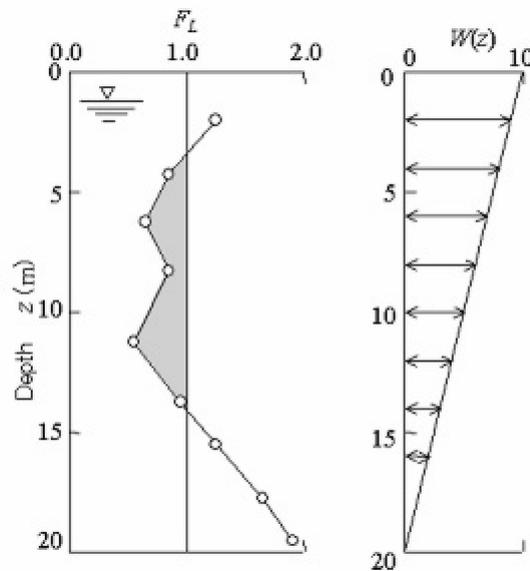

Graphical presentation of the LPI calculation procedure

Shear-Induced Building Settlement (Ds) calculation procedure

The shear-induced building settlement (Ds) due to liquefaction below the building can be estimated using the relationship developed by Bray and Macedo (2017):

$$\begin{aligned} \ln(Ds) = & c1 + c2 * LBS + 0.58 * \ln\left(\tanh\left(\frac{HL}{6}\right)\right) + \\ & 4.59 * \ln(Q) - 0.42 * \ln(Q)^2 - 0.02 * B + \\ & 0.84 * \ln(CAVdp) + 0.41 * \ln(Sa1) + \varepsilon \end{aligned}$$

where Ds is in the units of mm, c1= -8.35 and c2= 0.072 for $LBS \leq 16$, and c1= -7.48 and c2= 0.014 otherwise. Q is the building contact pressure in units of kPa, HL is the cumulative thickness of the liquefiable layers in the units of m, B is the building width in the units of m, CAVdp is a standardized version of the cumulative absolute velocity in the units of g-s, Sa1 is 5%-damped pseudo-acceleration response spectral value at a period of 1 s in the units of g, and ε is a normal random variable with zero mean and 0.50 standard deviation in Ln units. The liquefaction-induced building settlement index (LBS) is:

$$LBS = \sum W * \frac{\varepsilon_{shear}}{z} dz$$

where z (m) is the depth measured from the ground surface > 0 , w is a foundation-weighting factor wherein $W = 0.0$ for z less than Df, which is the embedment depth of the foundation, and $W = 1.0$ otherwise. The shear strain parameter (ε_{shear}) is the liquefaction-induced free-field shear strain (in %) estimated using Zhang et al. (2004). It is calculated based on the estimated Dr of the liquefied soil layer and the calculated safety factor against liquefaction triggering (FSL).

References

- Lunne, T., Robertson, P.K., and Powell, J.J.M 1997. Cone penetration testing in geotechnical practice, E & FN Spon Routledge, 352 p, ISBN 0-7514-0393-8.
- Boulanger, R.W. and Idriss, I. M., 2007. Evaluation of Cyclic Softening in Silts and Clays. ASCE Journal of Geotechnical and Geoenvironmental Engineering June, Vol. 133, No. 6 pp 641-652
- Boulanger, R.W. and Idriss, I. M., 2014. CPT AND SPT BASED LIQUEFACTION TRIGGERING PROCEDURES. DEPARTMENT OF CIVIL & ENVIRONMENTAL ENGINEERING COLLEGE OF ENGINEERING UNIVERSITY OF CALIFORNIA AT DAVIS
- Robertson, P.K. and Cabal, K.L., 2007, Guide to Cone Penetration Testing for Geotechnical Engineering. Available at no cost at <http://www.geologismiki.gr/>
- Robertson, P.K. 1990. Soil classification using the cone penetration test. Canadian Geotechnical Journal, 27 (1), 151-8.
- Robertson, P.K. and Wride, C.E., 1998. Cyclic Liquefaction and its Evaluation based on the CPT Canadian Geotechnical Journal, 1998, Vol. 35, August.
- Youd, T.L., Idriss, I.M., Andrus, R.D., Arango, I., Castro, G., Christian, J.T., Dobry, R., Finn, W.D.L., Harder, L.F., Hynes, M.E., Ishihara, K., Koester, J., Liao, S., Marcuson III, W.F., Martin, G.R., Mitchell, J.K., Moriwaki, Y., Power, M.S., Robertson, P.K., Seed, R., and Stokoe, K.H., Liquefaction Resistance of Soils: Summary Report from the 1996 NCEER and 1998 NCEER/NSF Workshop on Evaluation of Liquefaction Resistance of Soils, ASCE, Journal of Geotechnical & Geoenvironmental Engineering, Vol. 127, October, pp 817-833
- Zhang, G., Robertson. P.K., Brachman, R., 2002, Estimating Liquefaction Induced Ground Settlements from the CPT, Canadian Geotechnical Journal, 39: pp 1168-1180
- Zhang, G., Robertson. P.K., Brachman, R., 2004, Estimating Liquefaction Induced Lateral Displacements using the SPT and CPT, ASCE, Journal of Geotechnical & Geoenvironmental Engineering, Vol. 130, No. 8, 861-871
- Pradel, D., 1998, Procedure to Evaluate Earthquake-Induced Settlements in Dry Sandy Soils, ASCE, Journal of Geotechnical & Geoenvironmental Engineering, Vol. 124, No. 4, 364-368
- Iwasaki, T., 1986, Soil liquefaction studies in Japan: state-of-the-art, Soil Dynamics and Earthquake Engineering, Vol. 5, No. 1, 2-70
- Papathanassiou G., 2008, LPI-based approach for calibrating the severity of liquefaction-induced failures and for assessing the probability of liquefaction surface evidence, Eng. Geol. 96:94–104
- P.K. Robertson, 2009, Interpretation of Cone Penetration Tests - a unified approach., Canadian Geotechnical Journal, Vol. 46, No. 11, pp 1337-1355
- P.K. Robertson, 2009. "Performance based earthquake design using the CPT", Keynote Lecture, International Conference on Performance-based Design in Earthquake Geotechnical Engineering - from case history to practice, IS-Tokyo, June 2009
- Robertson, P.K. and Lisheng, S., 2010, "Estimation of seismic compression in dry soils using the CPT" FIFTH INTERNATIONAL CONFERENCE ON RECENT ADVANCES IN GEOTECHNICAL EARTHQUAKE ENGINEERING AND SOIL DYNAMICS, *Symposium in honor of professor I. M. Idriss, SAN diego, CA*
- R. E. S. Moss, R. B. Seed, R. E. Kayen, J. P. Stewart, A. Der Kiureghian, K. O. Cetin, CPT-Based Probabilistic and Deterministic Assessment of In Situ Seismic Soil Liquefaction Potential, Journal of Geotechnical and Geoenvironmental Engineering, Vol. 132, No. 8, August 1, 2006
- I. M. Idriss and R. W. Boulanger, 2008. Soil liquefaction during earthquakes, Earthquake Engineering Research Institute MNO-12
- Jonathan D. Bray & Jorge Macedo, Department of Civil & Environmental Engineering, Univ. of California, Berkeley, CA, USA, Simplified procedure for estimating liquefaction-induced building settlement, *Proceedings of the 19th International Conference on Soil Mechanics and Geotechnical Engineering, Seoul 201*

APPENDIX F
GROUNDWATER MONITORING DATA


Groundwater Monitoring Data for B-4 F-1

Groundwater Monitoring Data for B-5 F-2


Groundwater Monitoring Data for B-6 F-3

Groundwater Monitoring Data for B-7 F-4

FS 32 - Groundwater Pressure in Confined (Artesian) Aquifer, WWP tip at D = 30 ft, Boring B-4, (Surface Elevation = 76 ft NAVD88)

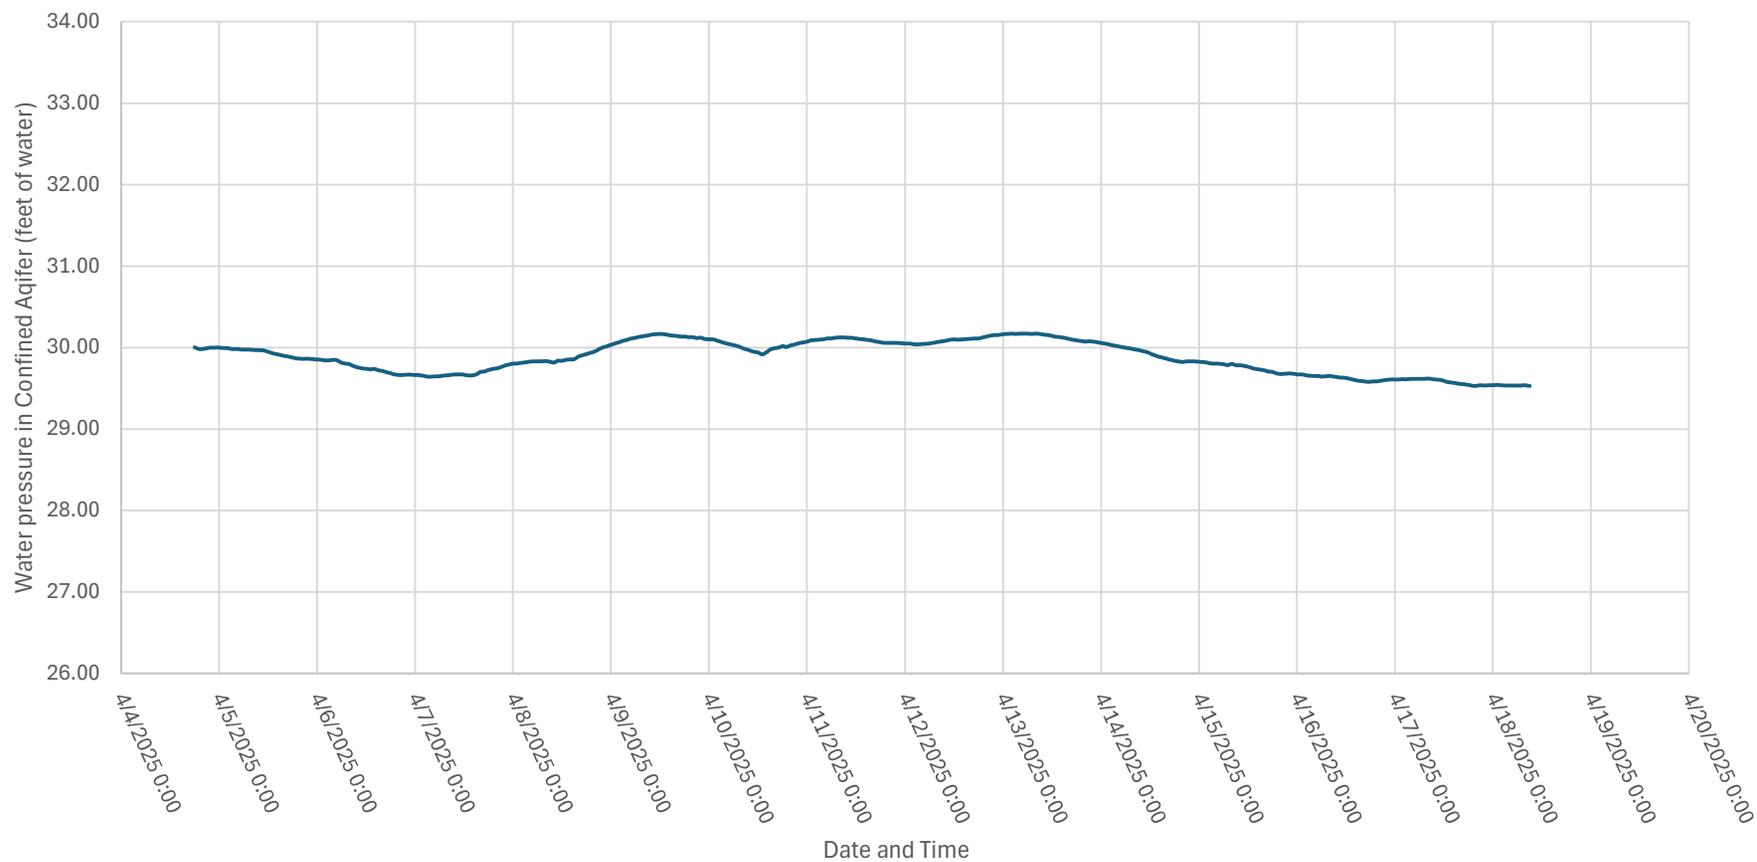


FS 32 - Depth to Groundwater at Boring B-5 (Surface Elevation = 75 ft NAVD88)

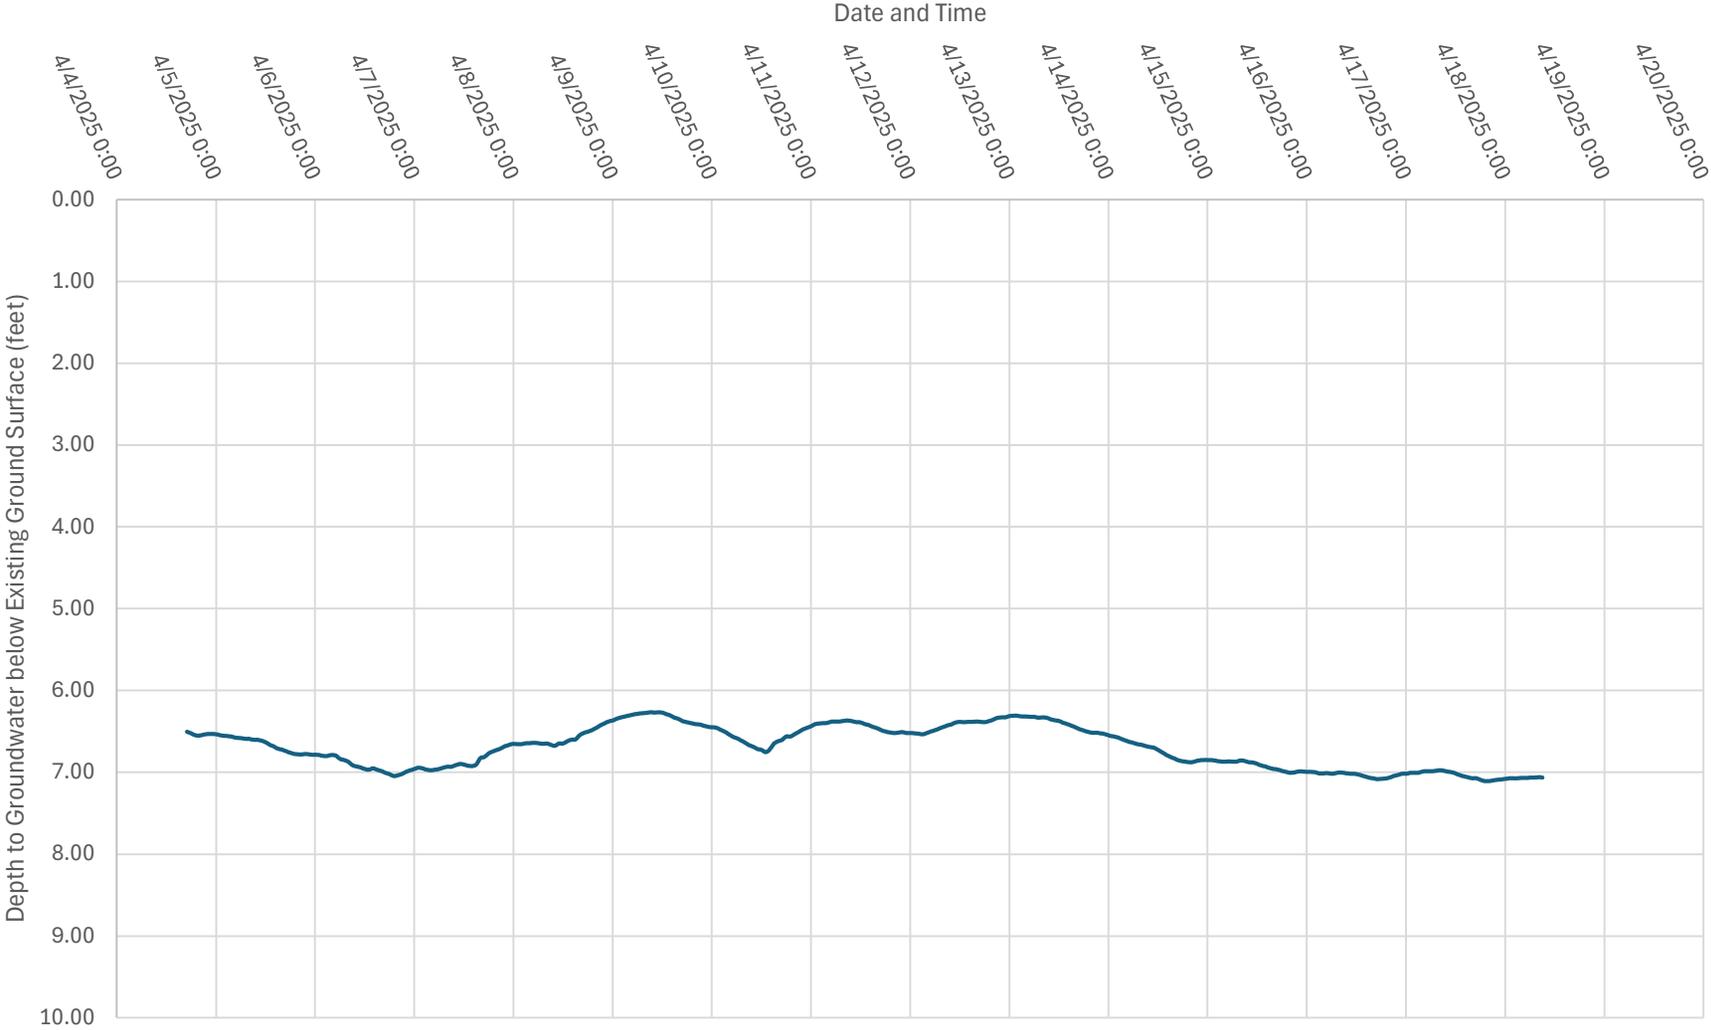

FS 32 - Depth to Groundwater at Boring B-6 (Surface Elevation = 76 ft NAVD88)

Date and Time

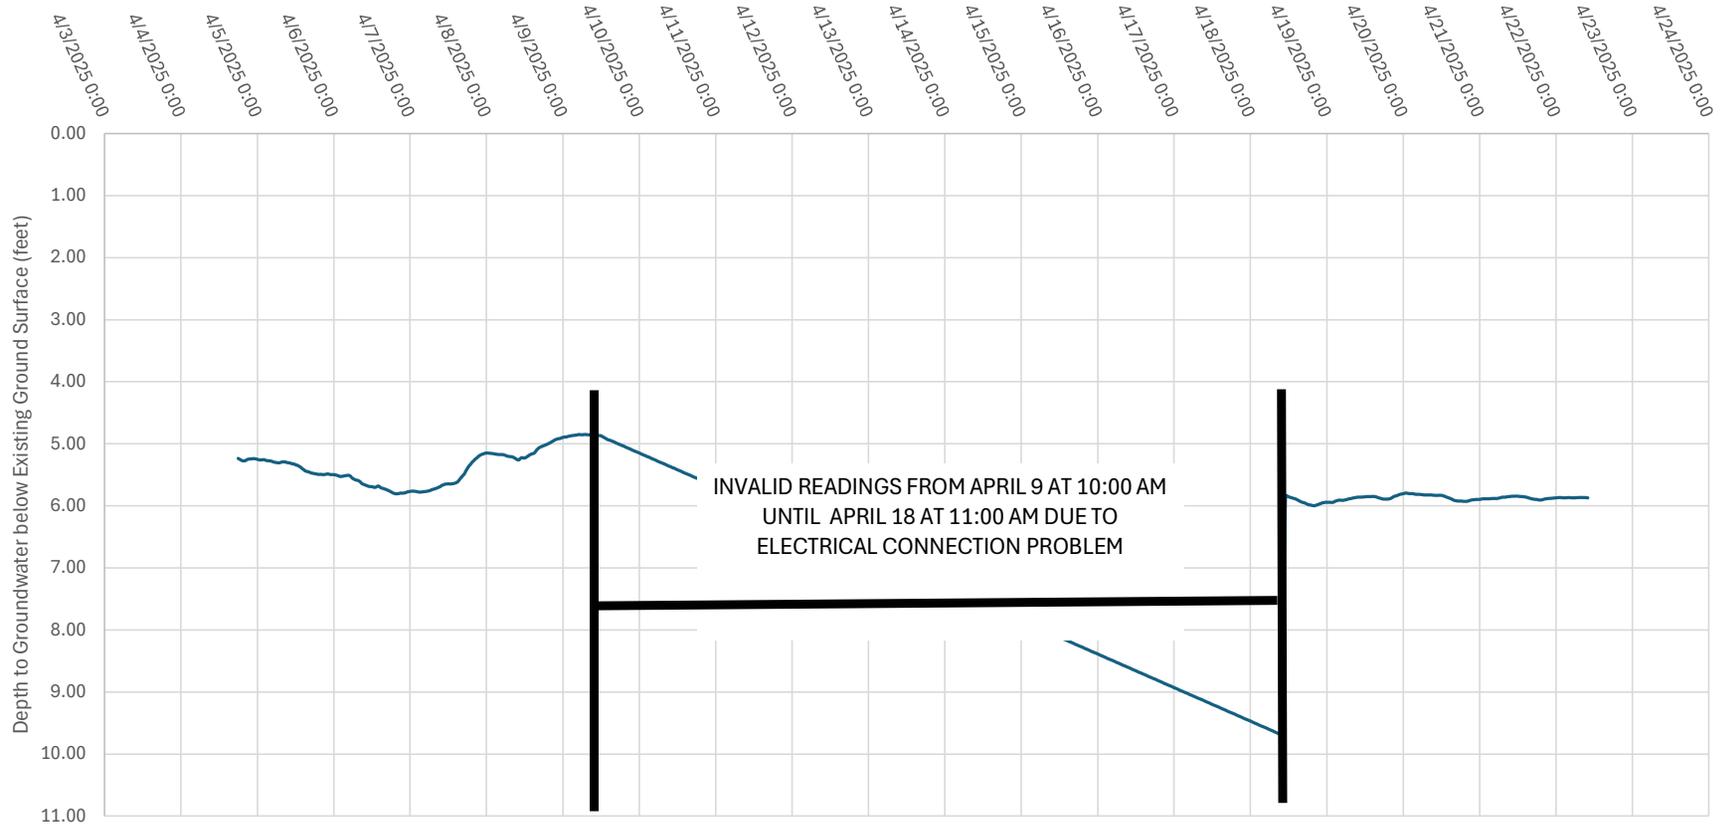

FS 32 - Depth to Groundwater at Boring B-7 (Surface Elevation = 75 ft NAVD88)

Date and Time

